




TYPICAL SECTION SHOWING DRY-STACK RETAINING WALL (>0m TO 1m EXPOSED HEIGHT)

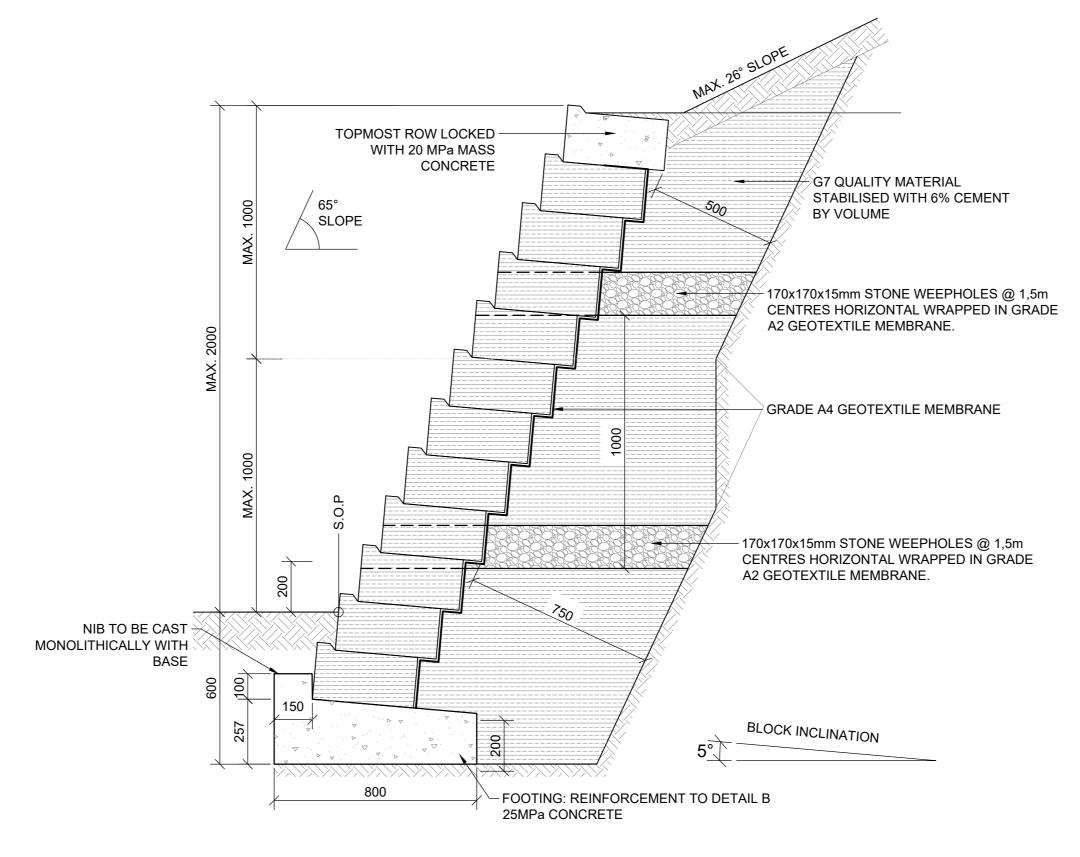


TYPICAL SECTION SHOWING DRY-STACK RETAINING WALL (>1m TO 2m EXPOSED HEIGHT)

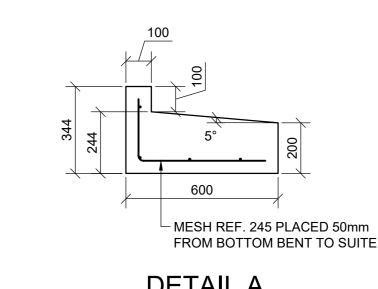


DETAIL A SCALE 1:15

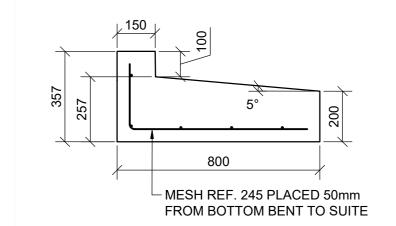


DETAIL B SCALE 1:15

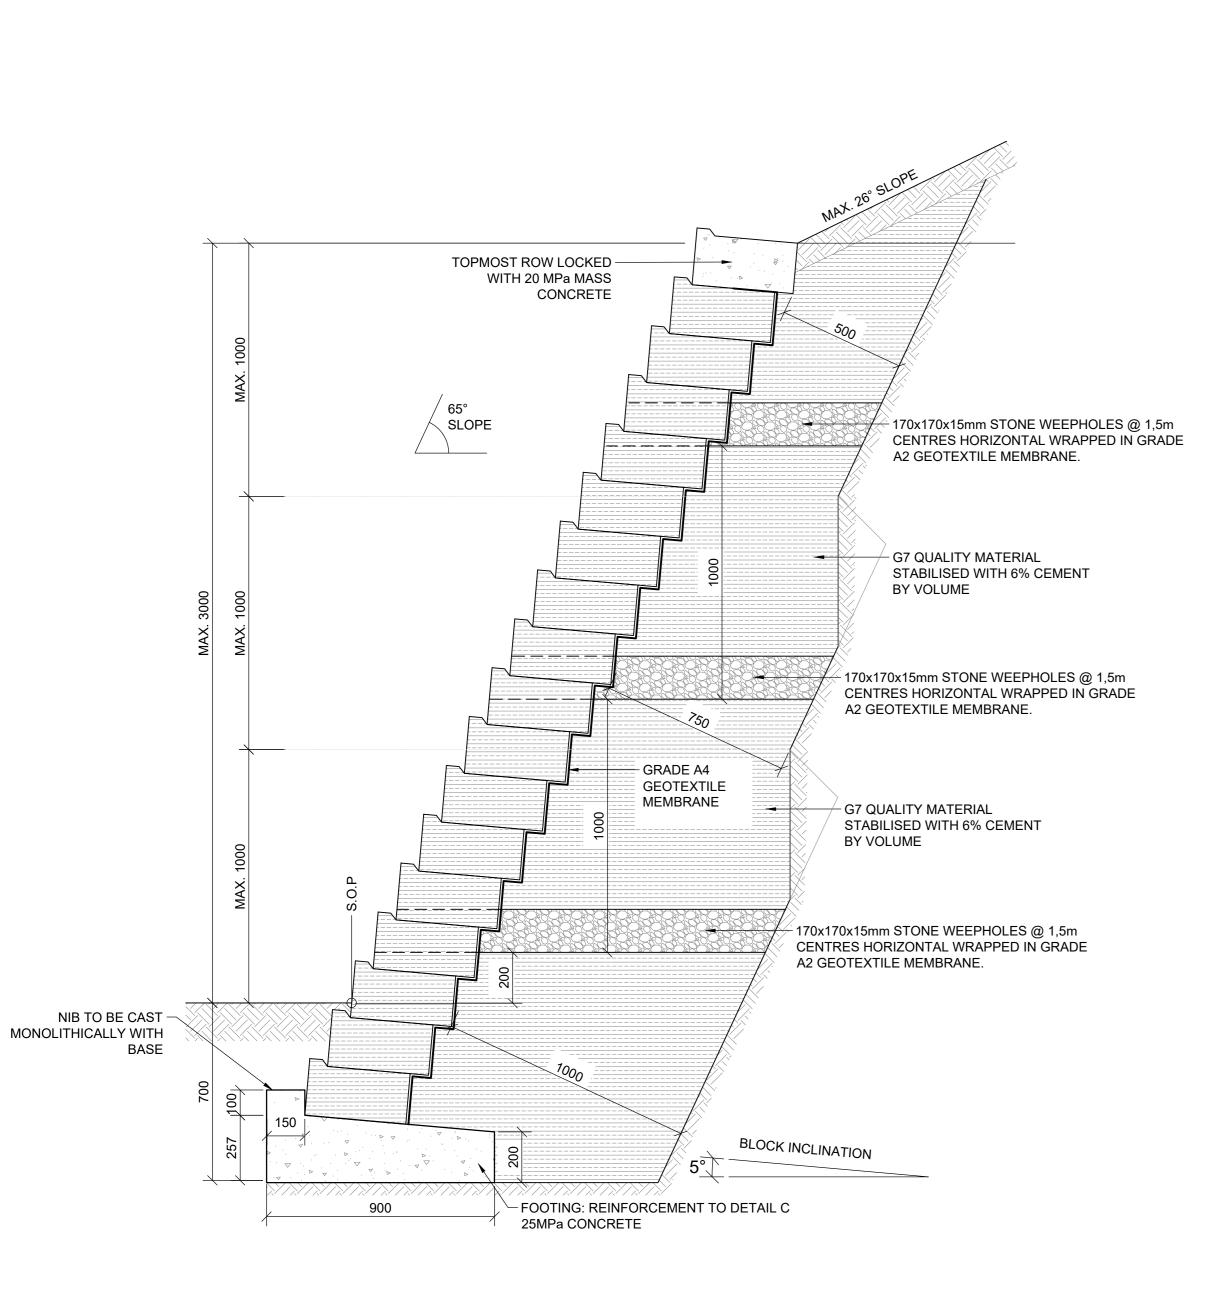


TYPICAL SECTION SHOWING DRY-STACK RETAINING WALL (>2m TO 3m EXPOSED HEIGHT)

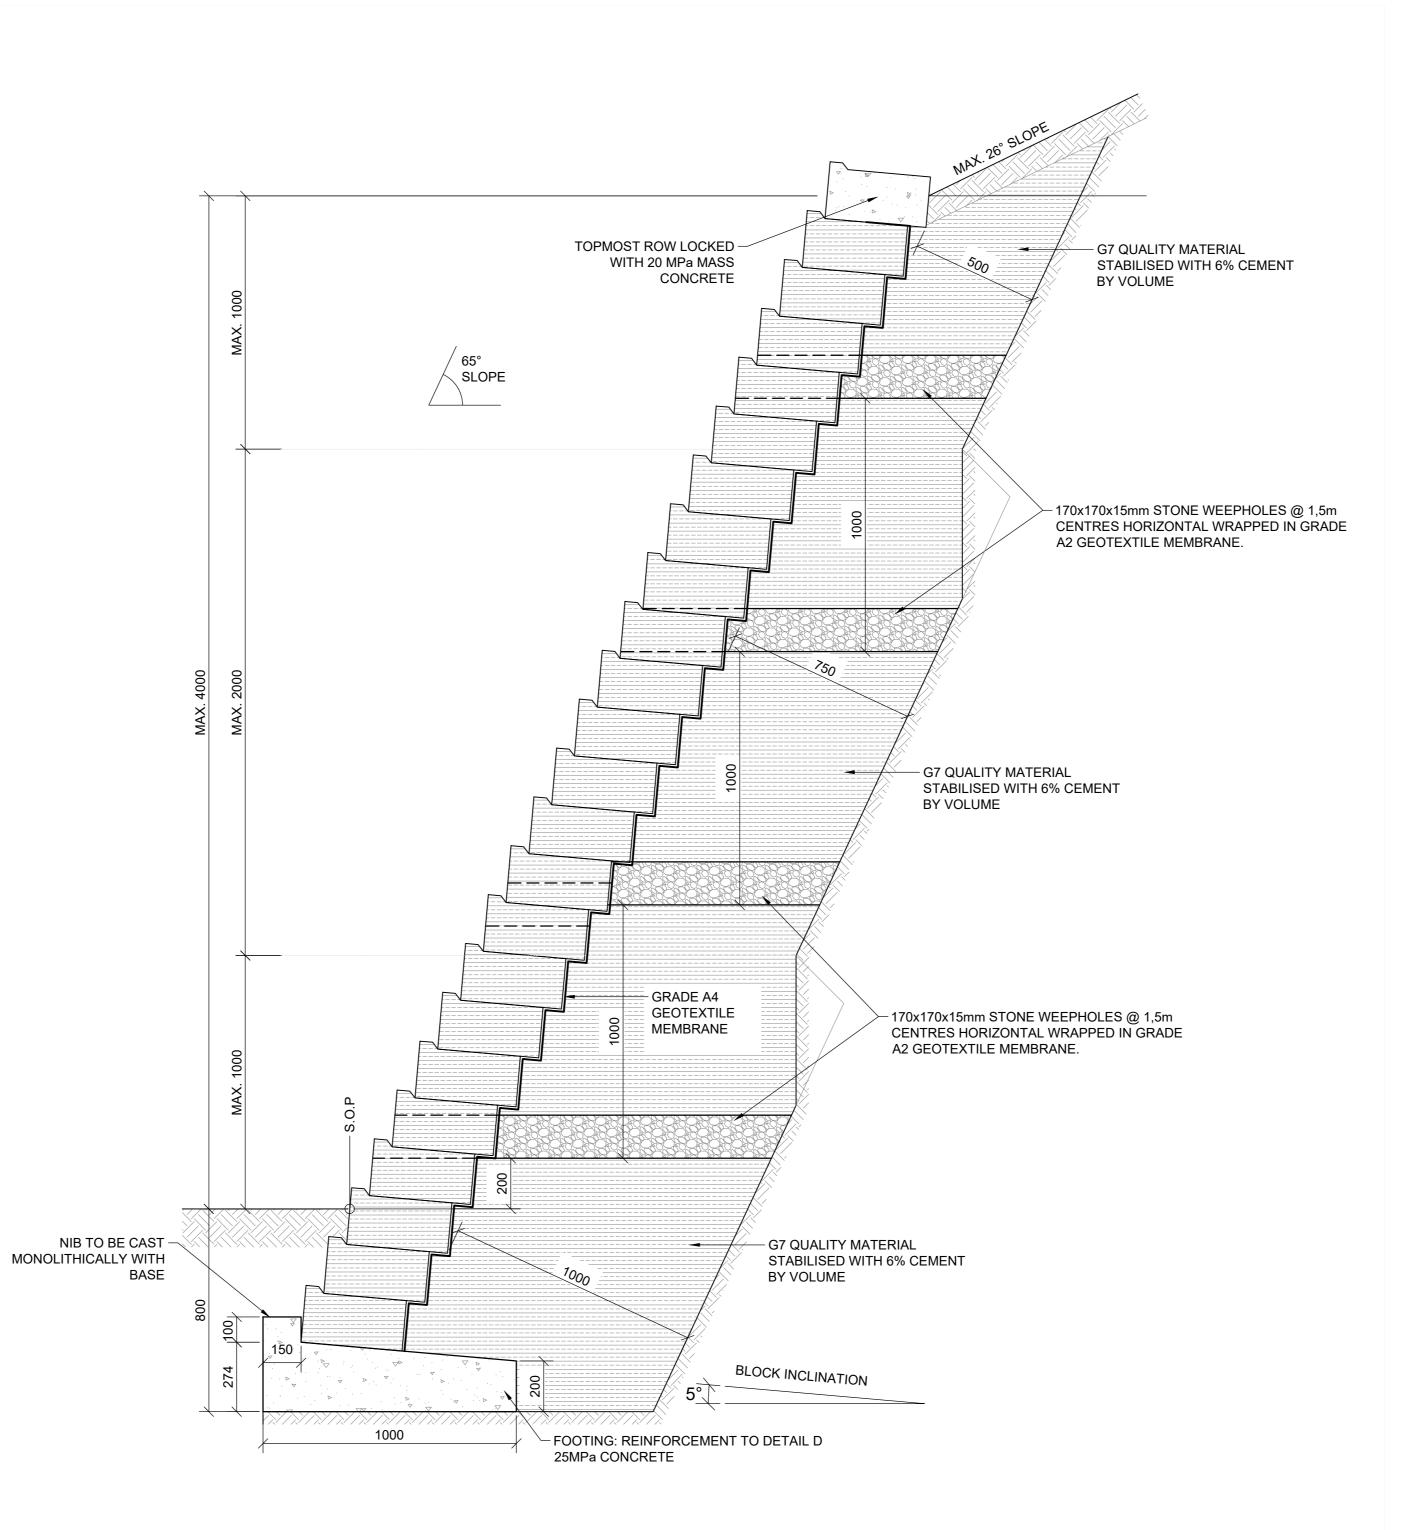

TYPICAL SECTION SHOWING DRY-STACK RETAINING WALL (>3m TO 4m EXPOSED HEIGHT)

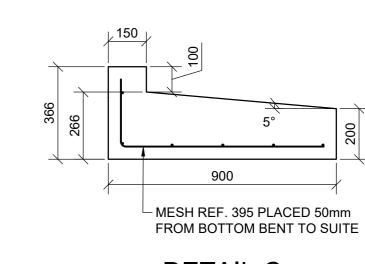

DETAIL C SCALE 1:15

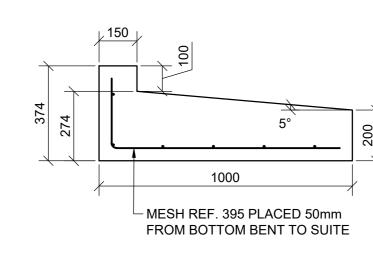

DETAIL D SCALE 1:15

GENERAL Notes: 1. SET BOTTOM ROW OF BLOCKS IN WET CONCRETE. 2. ALL BACKFILL TO BE COMPACTED TO 93% MOD AASHTO DENSITY
3. PROVE ALL SERVICES PRIOR TO CONSTRUCTION. 4. ALL WORK AREAS TO BE REINSTATED (PREMIX, CONCRETE, ETC.) . MUNICIPALITY TO EXECUTE ALL CONNECTIONS INTO MUNICIPAL UNLESS OTHERWISE AGREED WITH ENGINEER, CONTRACTOR TO SUPPLY ENGINEER WITH RESULTS OF COMPACTION TESTS, AND WHEN APPLICABLE, PERCENTAGE STABILIZATION TESTS ON

STORM WATER BEHIND THE TOP OF THE WALL TO BE MANAGED IN

SUCH A MANNER AS TO OBVIATE SCOUR BEHIND OR OVER -TOPPING OF THE WALL. . BACKFILL TO BE BENCHED IN COMPETENT GROUND.

9. ALL LEVELS AND DIMENSIONS TO BE VERIFIED ON SITE 10. SUBSOIL DRAINS TO BE USED WHEN INSTRUCTED BY ENGINEER. 1. ALL SETTING OUT TO BE UNDERTAKEN BY A REGISTERED PROFESSIONAL LAND SURVEYOR.

12. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE STRUCTURAL ENGINEERING DRAWINGS. 13. ALL WORKS IN ACCORDANCE WITH CITY OF DURBAN SPEC AND

MATERIAL COMPLIANCE TESTING . RESULTS OF COMPACTION AND CBR TESTS ON INSITU SUB-BASE MATERIAL AND FILLED SUB-BASE MATERIAL MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE THE UPPER

LAYER WORKS ARE IMPORTED TO THE SITE AND PLACED. FREQUENCY OF TESTS CBR TESTS 1 PER 500m² (AS REQUESTED BY ENGINEER ON SITE).

COMPACTION TESTS 1 PER 200m² / LOT NOTE : COMPACTION TESTS WILL BE REQUIRED FOR EACH OF THE VARYING LAYER WORKS THAT IS IMPORTED AND COMPACTED IN PLACE. RETAINING WALL

1. ALL LEVELS AND DIMENSIONS TO BE CHECKED ON SITE. . THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ARCHITECTURAL DRAWINGS.

3. ALL CONCRETE WORK IS TO COMPLY WITH SANS 1200G. 4. CONCRETE CLASS :-a) STRIP FOOTINGS & BASES.

5. COVER TO REINFORCEMENT :a) AS INDICATED ON DRAWINGS.

6. ALL FOUNDATION EXCAVATIONS ARE TO BE INSPECTED BY THE ENGINEER PRIOR TO CASTING OF CONCRETE.

ALL REINFORCING FIXING IS TO BE INSPECTED BY THE ENGINEER PRIOR 15 CASTING OF CONCRETE.

8. SIX CONCRETE CUBES TO BE TAKEN PER POUR. THREE CUBES TO BE THE TO BE EIGHT DAYS. THE RESULTS ARE TO BE APPROVAL. FORWARDED TO THE ENGINEER FOR REVIEW AND

9. ALL STRUCTURAL CONCRETE IS TO BE CURED FOR A MINIMUM OF FIVE DAYS. INSPECTIONS. 10. THE ENGINEER REQUIRES 24 HOURS NOTICE FOR ALL

ROADS:

1. ALL LEVELS, DIMENSIONS AND SETTING OUT DETAILS TO BE VERIFIED BY CONSULTANT AND CONTRACTORS ON SITE PRIOR . ALL EXISTING DRAINAGE CULVERTS ARE TO BE INSPECTED, AND ANY FOUND IN UNSERVICEABLE CONDITION ARE TO BE REPLACED UNLESS SHOWN OTHERWISE.

. CULVERT INVERTS ARE TO BE DECIDED BY ENGINEER ON SITE UNLESS SHOWN OTHERWISE. MIN. COVER = 600MM, MIN SLOPE = . FOR EROSION CONTROL GABION MATTRESSES ARE

RECOMMENDED AT CULVERT INLETS AND OUTLETS. . ROCK BOLSTERS ARE TO BE PLACED ACROSS THE INVERT OF DRAINS SUSCEPTIBLE TO EROSION FOR EVERY 2M VERTICAL

. SUBSOIL DRAINS ACCORDING TO CIVIL ENGINEERS DETAILS AND

SPECIFICATIONS ARE TO BE INSTALLED WITH V-DRAINS OR WHERE HIGH WATER TABLES ARE ENCOUNTERED. THE POSITIONS OF ACCESSES ARE TO BE DETERMINED IN CONSULTATION WITH THE LOCAL COMMUNITY. DAYLIGHT REQUIREMENTS ARE TO BE DECIDED BY THE ENGINEER ON SITE. CONCRETE WEDGES ACCORDING TO CIVIL ENGINEERS DETAILS

AND SPECIFICATIONS MAY BE USED IN PLACE OF SURFACED BELL-MOUTHS FOR ACCESSES SERVING SINGLE RESIDENTIAL EXISTING ROAD SIGNS, SERVICES AND FENCING AFFECTED BY CONSTRUCTION ARE TO BE REMOVED/RELOCATED WHERE

. UNDERGROUND SERVICE CROSSINGS AND MARKERS ARE TO BE ACCORDING TO CIVIL ENGINEERS DETAILS AND SPECIFICATIONS.). ALL NEW ROAD SIGNS AND ROAD MARKING REQUIREMENTS ARE TO CONFORM TO THE SOUTHERN AFRICAN DEVELOPMENT

COMMUNITY ROAD TRAFFIC SIGNS MANUAL (SADC - RTSM). I. ALL WORK IS TO BE CARRIED OUT IN ACCORDANCE WITH "COLTO SPECIFICATIONS FOR ROAD AND BRIDGE WORKS FOR STATE

ROAD AUTHORITIES". 2. ALL SURVEY AND SETTING OUT DATA PROVIDED IS BASED ON

3. NEW FILLS AND EXPOSED CUTTINGS ARE TO BE TOP-SOILED AND VEGETATED IMMEDIATELY AFTER CONSTRUCTION TO PREVENT

l	SCALE (mm)					
ı	0		10			
ı						
ı	No.		REFERENCE DRAWINGS			
I	49171-100		ROAD, FOOTPATHS AND STORMWATER LAYOUT AND D			
ı	REV		DESCRIPTION	BY	D	

Z.M 2022.09.1 P1 PRELIMINARY Registration rofessional person

ethekwini incremental SERVICES

> TYPICAL RETAINING WALL DETAILS

BHAMBAYI (WARD 57)

SUITE ESS106 STRATHMORE PARK, 305 MUSGRAVE ROAD, MUSGRAVE, DURBAN e-mail : admin@mapafrica.co.za website : www.mapafrica.co.za TEL. (031) 3095831

DESIGNED Z.M SCALES COPYRIGHT RESERVED AS SHOWN DATE 2022.09.12 APPROVED A.S PL TENDER No.

PRELIMINARY

DRAWING No. 49171/309

REV P1