


LEGEND

SYMBOL	DESCRIPTION
↓	2400MM LONG ELECTRODE IN CAST IRON INSPECTION CHAMBER
□	TEST JOINT, 300mm ABOVE NATURAL GROUND LEVEL
▽	AIR DISCHARGE COPPER ELECTRODE
⊙	COPPER DOWN CONDUCTOR TO EARTH ELECTRODE

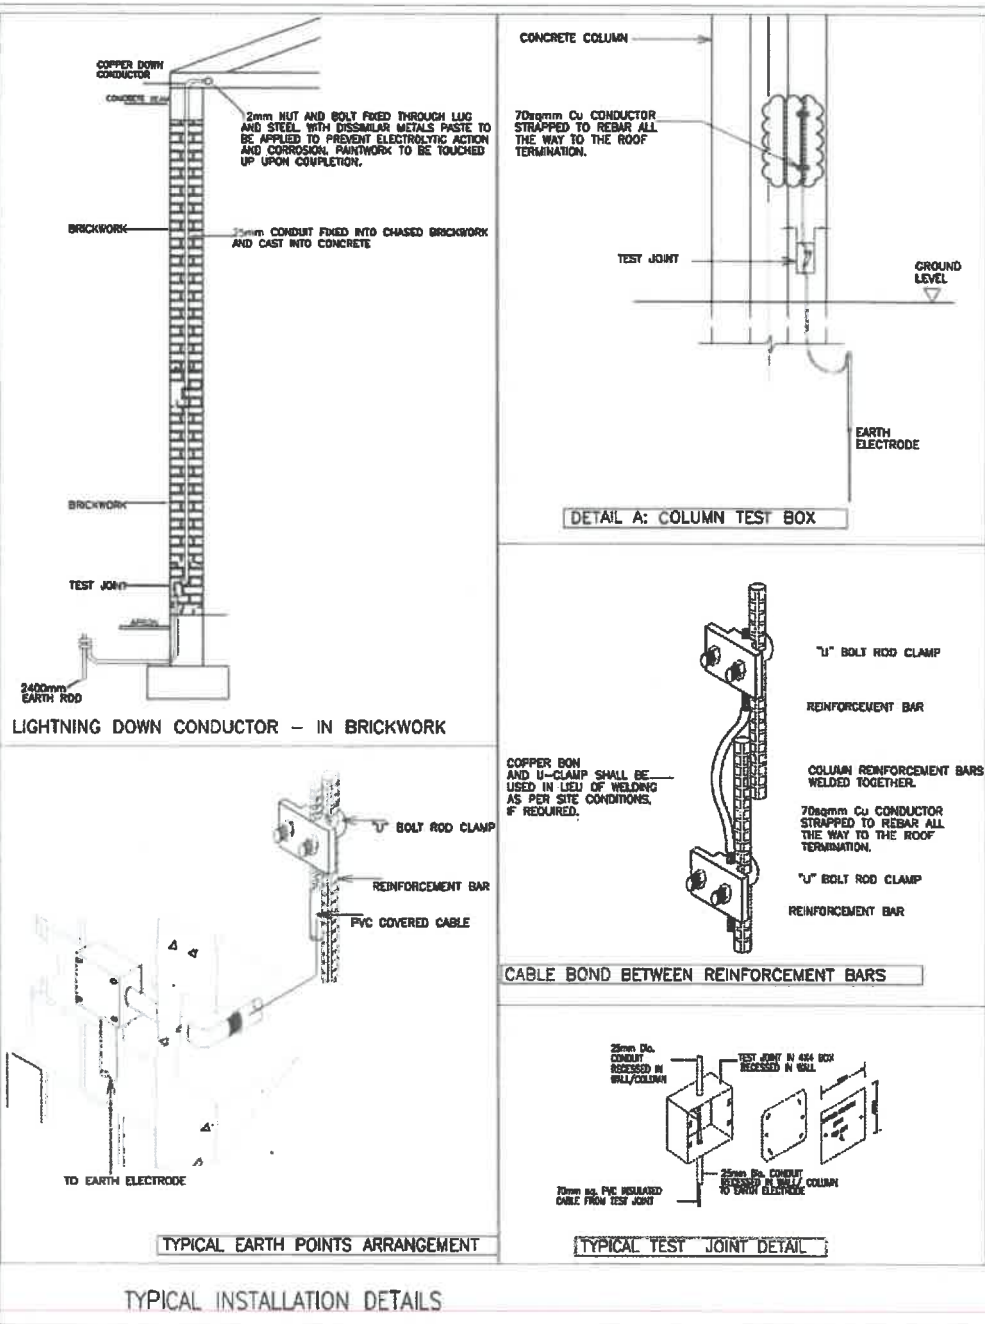

GENERAL NOTES:

1. THE EARTHING AND LIGHTNING PROTECTION INSTALLATION SHALL BE IN ACCORDANCE WITH SANS 10142-1 AND SANS 10313.
2. EARTHING AND LIGHTNING PROTECTION INSTALLATION TO BE DONE BY AN ACCREDITED SPECIALIST CONTRACTOR.

<p>FREE STATE PROVINCIAL GOVERNMENT DEPARTMENT OF HUMAN SETTLEMENT</p>		<p>LTE</p>		<p>APPROVED BY: F. MPOFU</p> <p>PROF. REGISTRATION: 0814083</p> <p>DATE: 04/08/2010</p>	<p>APPROVED: F. MPOFU</p> <p>ENGINEER: P. TSHABALA</p> <p>CHECKED: S. MOLOU</p> <p>DRAWN: S. MHLUMI</p> <p>DATE: 01-08-2010</p> <p>21-08-2017</p> <p>17-09-2017</p>
<p>Project Address: LEDINGO BEADING ST ANDREW STREET BUSHFORTH 9300</p>		<p>Project Address: LTE HOUSE Building 1 Office Park (Belvedere Place) 5 Egan Road, Sunning Hill 2157</p>		<p>Project Name: DARK & SILVER CITY HOUSING DEVELOPMENT (BOTTOM SITE)</p>	
<p>Project No: 4</p>		<p>Project No: 0814083</p>		<p>Client: E404-E-600 (SHEET 1 OF 1)</p>	