



public works
& infrastructure

Department:
Public Works and Infrastructure
REPUBLIC OF SOUTH AFRICA

Private Bag X54315, DURBAN 4000 Int Code: +27 31 Tel: 314 7000 website: www.publicworks.gov.za
Supply Chain Management: Mr. Saziso Ndlovu – 012 406 1847
Works Management – Mr. Mbongeni Putuzo

REQUEST FOR QUOTATION

You are hereby invited to submit a quotation for the supply and delivery of the following service to be rendered at : **HIBBERDENE** **DBNQ26/10/09**

Bid response documents to be deposited in the bid box situated at **National Department of Public Works and Infrastructure: BOX NUMBER 16 _ 05 Kensington Boulevard Kingsmead Office Park**

Item	Description	Quantity / Period
1	HIBBERDENE SAPS: SUPPLY, DELIVERY AND INSTALLATION OF A 12KVA SOLAR SYSTEM	

CLOSING DATE: 22/10/2026, CLOSING TIME 11h00 AM

NB: No late documents will be accepted.

Kindly submit your quotation by fully completing the attached bid document and bill of quantities or specifications attached in hereunder, and clearly indicate the delivery period and the validity period of your quotation, kindly also clearly indicates if you price includes or excludes VAT. ***"You may claim VAT only if you are a VAT Vendor"***

TERMS AND CONDITIONS

- If a supplier fails to deliver any or all goods or fails to deliver the required services within the specified period on the **order/ Contract or appointment letter** the Department of Public Works and Infrastructure may impose a penalty and further deduct from the order / contract a sum of the delayed goods or unperformed services or terminate the contract in part or in whole.
- The Department of Public Works and Infrastructure quotation documents must be fully completed, signed by the bidder and bear the signature of witnesses and be forwarded to the aforementioned physical address or email, failure to comply with these requirements will result in the quotation being disregarded.

Yours Faithfully

SIGNATURE:

DATE: 7/10/2026



public works
& infrastructure

Department:
Public Works and Infrastructure
REPUBLIC OF SOUTH AFRICA

DEPARTMENT OF PUBLIC WORKS AND INFRASTRUCTURE DURBAN REGIONAL OFFICE

FILE NO: 19/2/3/2/3/958

REFERENCE NUMBER – DBNQ26/10/09

SUBMITTED BY:

Company Name: _____

CSD registration: _____

CLOSING DATE: 22/10/2026 @11:00

Box Number 16 – 05 Kensington Boulevard @Kingsmead office park

TECHNICAL ENQUIRIES	OTHER ENQUIRIES
Name: Mbongeni Putuzo Contact number: 072 6124 7054 Email: Name: Mbongeni Putuzo@dpw.gov.za	Name: Saziso Ndlovu Tel No : 012 406 1847/ 072 738 1452 Email : Saziso.ndlovu@dpw.gov.za



PART A
PA 32: INVITATION TO BID

YOU ARE HEREBY INVITED TO BID FOR REQUIREMENTS OF THE DEPARTMENT OF PUBLIC WORKS AND INFRASTRUCTURE

BID NUMBER: DBNQ26/10/09 CLOSING DATE: 22/10/2026 CLOSING TIME: 11:00 AM

DESCRIPTION HIBBERDENE SAPS: SUPPLY, DELIVERY AND INSTALLATION OF A 12KVA SOLAR SYSTEM

BID RESPONSE DOCUMENTS MAY BE DEPOSITED IN THE BID BOX SITUATED AT (STREET ADDRESS)

NDPWI DURBAN REGIONAL OFFICE, SCM TENDER HALL, BOX 16

05 Kensington Boulevard, Kingsmead office park

BIDDING PROCEDURE ENQUIRIES MAY BE DIRECTED TO

CONTACT PERSON Saziso Ndlovu

TELEPHONE NUMBER 072 738 1452

FACSIMILE NUMBER

E-MAIL ADDRESS saziso.ndlovu@dpw.gov.za

TECHNICAL ENQUIRIES MAY BE DIRECTED TO:

CONTACT PERSON Mbongeni Putuzo

TELEPHONE NUMBER 031 314 7054

FACSIMILE NUMBER

E-MAIL ADDRESS Mbongeni Putuzo
@dpw.gov.za

SUPPLIER INFORMATION

NAME OF BIDDER

POSTAL ADDRESS

STREET ADDRESS

TELEPHONE NUMBER CODE NUMBER

CELLPHONE NUMBER

FACSIMILE NUMBER CODE NUMBER

E-MAIL ADDRESS

VAT REGISTRATION
NUMBER

SUPPLIER COMPLIANCE STATUS TAX COMPLIANCE SYSTEM PIN: OR CENTRAL SUPPLIER DATABASE No: MAAA

ARE YOU THE
ACCREDITED
REPRESENTATIVE IN
SOUTH AFRICA FOR
THE GOODS
/SERVICES
OFFERED?

☐ Yes ☐ No

[IF YES ENCLOSE PROOF]

ARE YOU A FOREIGN BASED
SUPPLIER FOR THE GOODS
/SERVICES OFFERED?

☐ Yes ☐ No

[IF YES, ANSWER THE
QUESTIONNAIRE BELOW]

QUESTIONNAIRE TO BIDDING FOREIGN SUPPLIERS

IS THE ENTITY A RESIDENT OF THE REPUBLIC OF SOUTH AFRICA (RSA)?

☐ YES ☐ NO

DOES THE ENTITY HAVE A BRANCH IN THE RSA?

☐ YES ☐ NO

DOES THE ENTITY HAVE A PERMANENT ESTABLISHMENT IN THE RSA?

☐ YES ☐ NO

DOES THE ENTITY HAVE ANY SOURCE OF INCOME IN THE RSA?

☐ YES ☐ NO

IS THE ENTITY LIABLE IN THE RSA FOR ANY FORM OF TAXATION?

☐ YES ☐ NO

IF THE ANSWER IS "NO" TO ALL OF THE ABOVE, THEN IT IS NOT A REQUIREMENT TO REGISTER FOR A TAX COMPLIANCE STATUS SYSTEM PIN CODE FROM THE SOUTH AFRICAN REVENUE SERVICE (SARS) AND IF NOT REGISTER AS PER 2.3 BELOW.

PART B TERMS AND CONDITIONS FOR BIDDING

1. BID SUBMISSION:

- 1.1. BIDS MUST BE DELIVERED BY THE STIPULATED TIME TO THE CORRECT ADDRESS. LATE BIDS WILL NOT BE ACCEPTED FOR CONSIDERATION.
- 1.2. ALL BIDS MUST BE SUBMITTED ON THE OFFICIAL FORMS PROVIDED (NOT TO BE RE-TYPED) OR IN THE MANNER PRESCRIBED IN THE BID DOCUMENT.
- 1.3. THIS BID IS SUBJECT TO THE PREFERENTIAL PROCUREMENT POLICY FRAMEWORK ACT, 2000 AND THE PREFERENTIAL PROCUREMENT REGULATIONS, THE GENERAL CONDITIONS OF CONTRACT (GCC) AND, IF APPLICABLE, ANY OTHER SPECIAL CONDITIONS OF CONTRACT.
- 1.4. THE SUCCESSFUL BIDDER WILL BE REQUIRED TO FILL IN AND SIGN A WRITTEN CONTRACT FORM (SBD7).

2. TAX COMPLIANCE REQUIREMENTS

- 2.1 BIDDERS MUST ENSURE COMPLIANCE WITH THEIR TAX OBLIGATIONS.
- 2.2 BIDDERS ARE REQUIRED TO SUBMIT THEIR UNIQUE PERSONAL IDENTIFICATION NUMBER (PIN) ISSUED BY SARS TO ENABLE THE ORGAN OF STATE TO VERIFY THE TAXPAYER'S PROFILE AND TAX STATUS.
- 2.3 APPLICATION FOR TAX COMPLIANCE STATUS (TCS) PIN MAY BE MADE VIA E-FILING THROUGH THE SARS WEBSITE WWW.SARS.GOV.ZA.
- 2.4 BIDDERS MAY ALSO SUBMIT A PRINTED TCS CERTIFICATE TOGETHER WITH THE BID.
- 2.5 IN BIDS WHERE CONSORTIA / JOINT VENTURES / SUB-CONTRACTORS ARE INVOLVED; EACH PARTY MUST SUBMIT A SEPARATE TCS CERTIFICATE / PIN / CSD NUMBER.
- 2.6 WHERE NO TCS PIN IS AVAILABLE BUT THE BIDDER IS REGISTERED ON THE CENTRAL SUPPLIER DATABASE (CSD), A CSD NUMBER MUST BE PROVIDED.
- 2.7 NO BIDS WILL BE CONSIDERED FROM PERSONS IN THE SERVICE OF THE STATE, COMPANIES WITH DIRECTORS WHO ARE PERSONS IN THE SERVICE OF THE STATE, OR CLOSE CORPORATIONS WITH MEMBERS PERSONS IN THE SERVICE OF THE STATE."

NB: FAILURE TO PROVIDE / OR COMPLY WITH ANY OF THE ABOVE PARTICULARS MAY RENDER THE BID INVALID.

SIGNATURE OF BIDDER:

.....

CAPACITY UNDER WHICH THIS BID IS SIGNED:

(Proof of authority must be submitted e.g. company resolution)

.....

DATE:

.....

DPW-07 (EC): FORM OF OFFER AND ACCEPTANCE

Project title:	HIBBERDENE SAPS : SUPPLY, DELIVERY AND INSTALLATION OF A 12kVA SOLAR SYSTEM		
Tender / Quotation no:		Reference no:	File No: 19/2/3/2/3/958

OFFER

The Employer, identified in the acceptance signature block, has solicited offers to enter into a contract for the procurement of:

Maintenance and repairs term contract for package plan, sewer and water pumps: 36 months

The Tenderer, identified in the offer signature block, has examined the documents listed in the tender data and addenda thereto as listed in the returnable schedules, and by submitting this offer has accepted the conditions of tender.

By the representative of the Tenderer, deemed to be duly authorized, signing this part of this form of offer and acceptance, the Tenderer offers to perform all of the obligations and liabilities of the Contractor under the contract including compliance with all its terms and conditions according to their true intent and meaning for an amount to be determined in accordance with the conditions of contract identified in the contract data.

THE TOTAL OFFER INCLUSIVE OF ALL APPLICABLE TAXES ("All applicable taxes" includes value-added tax, pay as you earn, income tax, unemployment insurance fund contributions and skills development levies) **IS:**

Rand (in figures) **R**

Rand (in words).....

.....

.....

The amount in words takes precedence over the amount in figures. The award of the tender may be subjected to further price negotiation with the preferred tenderer(s). The negotiated and agreed price will be considered for acceptance as ***a firm and final offer***.

This offer may be accepted by the Employer by signing the acceptance part of this form of offer and acceptance and returning one copy of this document to the Tenderer before the end of the period of validity stated in the tender data, whereupon the Tenderer becomes the party named as the Contractor in the conditions of contract identified in the contract data.

THIS OFFER IS MADE BY THE FOLLOWING LEGAL ENTITY: (cross out block which is not applicable)

Company or Close Corporation: And: Whose Registration Number is: And: Whose Income Tax Reference Number is: CSD supplier number:.....	OR	Natural Person or Partnership: Whose Identity Number(s) is/are: Whose Income Tax Reference Number is/are: CSD supplier number:.....
--	------------------	--

*Any reference to words "Bid" or "Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

**Any reference to the words "payment reduction" herein shall be construed to have the same meaning as the word "retention"

For Internal & External Use

Effective date 5 July 2022

Tender / Quotation no: Error! Reference source not found.

AND WHO IS (if applicable):	
Trading under the name and style of:	
AND WHO IS:	
Represented herein, and who is duly authorised to do so, by: Mr/Mrs/Ms: In his/her capacity as:	Note: A Resolution / Power of Attorney, signed by all the Directors / Members / Partners of the Legal Entity must accompany this Offer, authorising the Representative to make this offer.

SIGNED FOR THE TENDERER:

Name of representative	Signature	Date

WITNESSED BY:

Name of witness	Signature	Date

This Offer is in respect of: (Please indicate with an "X" in the appropriate block)

- The official documents ☐
 The official alternative ☐
 Own alternative (only if documentation makes provision therefore) ☐

(N.B.: Separate Offer and Acceptance forms are to be completed for the main and for each alternative offer)

SECURITY OFFERED:

- (a) the Tenderer accepts that in respect of contracts up to R1 million, a payment reduction** of 5% of the contact value (excluding VAT) will be applicable and will be deducted by the Employer in terms of the applicable conditions of contract
- (b) in respect of contracts above R1 million, the Tenderer offers to provide security as indicated below:
- (1) cash deposit of 10 % of the Contract Sum (excluding VAT) Yes ☐ No ☐
 - (2) variable construction guarantee of 10 % of the Contract Sum (excluding VAT) Yes ☐ No ☐
 - (3) payment reduction of 10% of the value certified in the payment certificate (excluding VAT) Yes ☐ No ☐
 - (4) cash deposit of 5% of the Contract Sum (excluding VAT) and a payment reduction of 5% of the value certified in the payment certificate (excluding VAT) Yes ☐ No ☐
 - (5) fixed construction guarantee of 5% of the Contract Sum (excluding VAT) and a payment reduction of 5% of the value certified in the payment certificate (excluding VAT) Yes ☐ No ☐

NB. Guarantees submitted must be issued by either an insurance company duly registered in terms of the Insurance Act [Long-Term Insurance Act, 1998 (Act 52 of 1998) or Short-Term Insurance Act, 1998 (Act 35 of 1998)] or by a bank duly registered in terms of the Banks Act, 1990 (Act 94 of 1990) on the pro-forma referred to above. No alterations or amendments of the wording of the pro-forma will be accepted.

*Any reference to words "Bid" or "Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

**Any reference to the words "payment reduction" herein shall be construed to have the same meaning as the word "retention"

Tender / Quotation no: Error! Reference source not found.

The Tenderer elects as its *domicilium citandi et executandi* in the Republic of South Africa, where any and all legal notices may be served, as (physical address):

Other Contact Details of the Tenderer are:

Telephone No..... Cellular Phone No.

Fax No

Postal address

Banker Branch.....

Registration No of Tenderer at Department of Labour

CIDB Registration Number:

ACCEPTANCE

By signing this part of this form of offer and acceptance, the Employer identified below accepts the Tenderer's offer. In consideration thereof, the Employer shall pay the Contractor the amount due in accordance with the conditions of contract identified in the contract data. Acceptance of the Tenderer's offer shall form an agreement between the Employer and the Tenderer upon the terms and conditions contained in this agreement and in the contract that is the subject of this agreement.

The terms of the contract are contained in:

Part C1 Agreement and contract data, (which includes this agreement)

Part C2 Pricing data

Part C3 Scope of work

Part C4 Site information and drawings and documents or parts thereof, which may be incorporated by reference into the above listed Parts.

Deviations from and amendments to the documents listed in the tender data and any addenda thereto as listed in the tender schedules as well as any changes to the terms of the offer agreed by the Tenderer and the Employer during this process of offer and acceptance, are contained in the schedule of deviations attached to and forming part of this agreement. No amendments to or deviations from said documents are valid unless contained in this schedule.

The Tenderer shall within two weeks after receiving a completed copy of this agreement, including the schedule of deviations (if any), contact the Employer's agent (whose details are given in the contract data) to arrange the delivery of any securities, bonds, guarantees, proof of insurance and any other documentation to be provided in terms of the conditions of contract identified in the contract data. Failure to fulfil any of these obligations in accordance with those terms shall constitute a repudiation of this agreement.

Notwithstanding anything contained herein, this agreement comes into effect on the date when the tenderer receives one fully completed original copy of this document, including the schedule of deviations (if any). Unless the tenderer (now contractor) within five (5) working days of the date of such receipt notifies the employer in writing of any reason why he/she cannot accept the contents of this agreement, this agreement shall constitute a binding contract between the parties.

For the Employer:

Name of signatory	Signature	Date

*Any reference to words "Bid" or "Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

**Any reference to the words "payment reduction" herein shall be construed to have the same meaning as the word "retention"

For Internal & External Use

Effective date 5 July 2022

Page 3 of 4
Version 2022/04

Tender / Quotation no: Error! Reference source not found.

Name of Organisation:	Department of Public Works and Infrastructure
Address of Organisation:	

WITNESSED BY:

Name of witness	Signature	Date

Schedule of Deviations

1.1.1. Subject:
Detail:
1.1.2. Subject:
Detail:
1.1.3. Subject:
Detail:
1.1.4. Subject:
Detail:
1.1.5. Subject:
Detail:
1.1.6. Subject:
Detail:

By the duly authorised representatives signing this agreement, the Employer and the Tenderer agree to and accept the foregoing schedule of deviations as the only deviations from and amendments to the documents listed in the tender data and addenda thereto as listed in the tender schedules, as well as any confirmation, clarification or changes to the terms of the offer agreed by the Tenderer and the Employer during this process of offer and acceptance.

It is expressly agreed that no other matter whether in writing, oral communication or implied during the period between the issue of the tender documents and the receipt by the Tenderer of a completed signed copy of this Agreement shall have any meaning or effect in the contract between the parties arising from this agreement.

*Any reference to words "Bid" or "Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

**Any reference to the words "payment reduction" herein shall be construed to have the same meaning as the word "retention"

For Internal & External Use

Effective date 5 July 2022

Page 4 of 4
Version 2022/04

PA-09 (EC): LIST OF RETURNABLE DOCUMENTS

Project title:	HIBBERDENE SAPS: SUPPLY, DELIVERY AND INSTALLATION OF A 12kVA SOLAR SYSTEM		
Tender / Quote no:		Reference no:	19/2/3/2/3/958
Receipt Number:			

1. RETURNABLE DOCUMENTS REQUIRED FOR TENDER EVALUATION PURPOSES

Note: Failure to submit the applicable documents will result in the tender offer being disqualified from further consideration.

Tender document name	Number of pages issued	Returnable document
Form of Offer and Acceptance (DPW-07 EC)	4 Pages	Yes
Declaration of Interest and Tenderer's Past Supply Chain Management Practices (PA-11)	4 Pages	Yes
Resolution of Board of Directors (PA-15.1) <i>(if applicable)</i>	1 Page	Yes
Resolution of Board of Directors to enter into Consortia or JV's (PA-15.2) <i>(if applicable)</i>	2 Pages	Yes
Special Resolution of Consortia or JV's (PA-15.3) <i>(if applicable)</i>	3 Pages	Yes
Preference points claim form in terms of the Preferential Procurement Regulations 2017 (PA – 16)	5 Pages	Yes
Certificate of independent Bid Determination (PA - 29)	4 Pages	Yes
Declaration Certificate for Local Production and Content for designated sectors (PA – 36 and Annexure/s C)		Yes
Fully completed Declaration of Designated Groups for Preferential Procurement (PA 40)	2 Pages	Yes
Registration on National Treasury's Central Supplier Database (CSD).	-	Yes
Particulars of Tenderer's Projects (DPW-09 EC)	2 Pages	Yes
Site Inspection Meeting Certificate (DPW-16 EC) <i>(if applicable)</i> .	1 Page	
Record of attending compulsory virtual bid clarification / site inspection meeting <i>(if applicable)</i> .	1 Page	
Record of Addenda to tender documents (DPW-21 EC)	1 Page	Yes
Site Inspection Meeting Certificate (DPW-16 EC) <i>(if applicable)</i>	1 Page	
Proof of 30% Subcontracting participation and related documents in terms of the Preferential Procurement Regulations 2017 <i>(if applicable)</i> .		

* In compliance with the requirements of the CIDB SFU Annexure G

Tender no:

2. ADDITIONAL RETURNABLE DOCUMENTS REQUIRED FOR TENDER EVALUATION PURPOSES

Note: Failure to submit the applicable documents will result in the Tenderer having to submit same upon request within a stipulated time and if not complied with, will result in the tender offer being disqualified from further consideration. [See also C.2.18 of the Standard Conditions of Tender]

Tender document name	Number of pages issued	Returnable document
Any <u>additional</u> information required to complete a risk assessment (<i>if applicable</i>)	-	Yes

3. RETURNABLE DOCUMENTS THAT WILL BE INCORPORATED INTO THE CONTRACT

Note: Failure to submit the applicable documents will result in the Tenderer having to submit same upon request within a stipulated time and if not complied with, will result in the tender offer being disqualified from further consideration. [See also C.2.18 of the Standard Conditions of Tender]

Tender document name	Number of pages issued	Returnable document
Schedule of proposed sub-contractors (DPW-15 EC) (<i>if applicable</i>)	1 Page	Yes
Particulars of Electrical Contractor (DPW-22 EC) (<i>if applicable</i>)	1 Page	Yes
Mechanical / Electrical / Security Work material and equipment schedules (<i>if applicable</i>)	Pages	Yes
Schedule for Imported Materials and Equipment (DPW-23 EC) (<i>if applicable</i>)	1 Page	Yes

4. OTHER DOCUMENTS THAT WILL BE INCORPORATED INTO THE CONTRACT

(Insert a tick in the "Returnable document" column to indicate which documents must be returned with the tender)

Note: Failure to submit the applicable documents will result in the tender offer being disqualified from further consideration.

Tender document name	Number of pages issued	Returnable document
Priced Bills of Quantities / Lump Sum Document (complete document inclusive of all parts)	Pages	☐ Yes ☐ No
Fully priced and completed sectional summary- and final summary pages with the tender.	Pages	☐ Yes ☐ No
<i>insert document name</i>	Pages	☐ Yes ☐ No
<i>insert document name</i>	Pages	☐ Yes ☐ No
<i>insert document name</i>	Pages	☐ Yes ☐ No



Tender no:

5. ADDITIONAL INFORMATION THAT MAY BE REQUIRED FOR TENDER EVALUATION PURPOSES

Legal Status of Tendering Entity: If the Tendering Entity is:	Documentation to be submitted with the tender, or which may be required during the tender evaluation:
a. A close corporation, incorporated prior to 1 May 2011 under the Close Corporations Act, 1984 (Act 69 of 1984, as amended)	Copies of the Founding Statement – CK1
b. A profit company duly registered as a private company. [including a profit company that meets the criteria for a private company, whose Memorandum of Incorporation states that the company is a personal liability company in terms of Section 8(2)(c) of the Companies Act, 2008 (Act 71 of 2008, as amended)].	Copies of: i. Certificate of Incorporation – CM1; ii. Shareholding Certificates of all Shareholders of the company, plus a signed statement of the company's Auditor, certifying each Shareholder's ownership / shareholding percentage relative to the total; and/or iii. Memorandum of Incorporation in the case of a personal liability company.
c. A profit company duly registered as a private company in which any, or all, shares are held by one or more other close corporation(s) or company(ies) duly registered as profit or non-profit company(ies).	Copies of documents referred to in a. and/or b. above in respect of all such close corporation(s) and/or company(ies).
d. A profit company duly registered as a public company.	Copy of Certificate of Incorporation – CM1, and a signed statement of the company's Secretary or Auditor confirming that the company is a public company.
e. A non-profit company, incorporated in terms of Section 10 and Schedule 1 of the Companies Act, 2008 (Act 71 of 2008, as amended).	Copies of: i the Founding Statement – CK1; and ii the Memorandum of Incorporation setting out the object of the company, indicating the public benefit, cultural or social activity, or communal or group interest.
f. A natural person, sole proprietor or a Partnership	Copy(ies) of the Identity Document(s) of: i. such natural person/ sole proprietor, or each of the Partners to the Partnership.
g. A Trust	Deed of Trust duly indicating names of the Trustee(s) and Beneficiary (ies) as well as the purpose of the Trust and the mandate of the Trustees.

Signed by the Tenderer:

Name of representative	Signature	Date



public works & infrastructure

Department:
Public Works and Infrastructure
REPUBLIC OF SOUTH AFRICA

ASSUMPTION OF DUTY & COMPLETION OF SERVICE CONTROL SHEET

Client	Town / Institution	Ref. No.	Normal/ Urgent or Term Contract	NDPWI Official Name
SAPS:	HIBBERDENE	19/2/3/2/3/958		M. Putuzo

Description: SUPPLY, DELIVERY AND INSTALLATION OF A 12KVA SOLAR SYSTEM

1. (a) Normal Services: -

When assuming duty ensure that the order and bill of quantities/scope of works is shown to the client's representative on site, otherwise you will not be allowed to commence work.

(b) Emergencies/Urgent or Term Contract services: -

Reference number & Control / Area Works Manager's (who called you out) name & cell phone number to be given to clients' representative.

2. On completion of the Works (in all respects) this certificate with all other required paperwork must be immediately emailed or sent to the Area Works Manager to conduct a final inspection. Any delays on your part will result in client dissatisfaction & late payments. A copy of this signed completed sheet, needs to be left with the Client for record purposes.

NOTIFICATION OF COMPLETION BY CONTRACTOR

The above works is complete in all respects and is ready for inspection.

Trading Entity's Name and stamp above

Contractors Signature

Date

Work Warranty / Guaranty for this services and equipment: () Years, () Months, () Days

THE CLIENTS CONFIRMATION: (COMPULSORY) Logistical Officer who complained or equal.

Name	Signature	Rank	Date Stamp

NDPW USE: CONFIRMATION OF SERVICE

I, the undersigned hereby confirm that the works has / has not been inspected and was found / confirmed to be satisfactory and complete in all respects (delete where n/a).

Chief WM

Name

Rank

CWM Signature

Date

Order No.		Date issued	/ /	Inv no.	
-----------	--	-------------	-----	---------	--

Please proceed with this payment

	Name	Rank	Date in	Date out	Signature
Chief Works Manager		CWM			
Control Works Manager		CWM			



public works
& infrastructure

Department:
Public Works and Infrastructure
REPUBLIC OF SOUTH AFRICA

**NATIONAL DEPARTMENT OF PUBLIC WORKS & INFRASTRUCTURE:
CONFIRMATION OF VISITING THE SITE FOR QUOTATIONS BY THE
SERVICE PROVIDER**

File No.	-	19/2/3/2/3/958		Call Out No.	-	
----------	---	----------------	--	--------------	---	--

**DESCRIPTION: HIBBERDENE SAPS
SUPPLY, DELIVERY AND INSTALLATION OF A 12kVA SOLAR SYSTEM**

The National Departmental Public Works and Infrastructure
Manager

Dear **Project Manager:**

I hereby confirm that I ----- have visited this site for
quotation purpose.

Attach six (6) A4 pictures for the roof structure CSC office where the system will be
installed.

Contractor Rep

Date & Stamp

I the Client for **HIBBERDENE SAPS** Department confirm that the service provider /
contractor: _____ visited this Site on _____ for
quoting.

Client Stamp

Date

PA-15.1: RESOLUTION OF BOARD OF DIRECTORS

RESOLUTION of a meeting of the Board of *Directors / Members / Partners of:

(Legally correct full name and registration number, if applicable, of the Enterprise)

Held at _____ (place)

on _____ (date)

RESOLVED that:

- The Enterprise submits a Bid / Tender to the Department of Public Works in respect of the following project:

(Project description as per Bid / Tender Document)

Bid / Tender Number: _____ (Bid / Tender Number as per Bid / Tender Document)

- *Mr/Mrs/Ms: _____

in *his/her Capacity as: _____ (Position in the Enterprise)

and who will sign as follows: _____

be, and is hereby, authorised to sign the Bid / Tender, and any and all other documents and/or correspondence in connection with and relating to the Bid / Tender, as well as to sign any Contract, and any and all documentation, resulting from the award of the Bid / Tender to the Enterprise mentioned above.

	Name	Capacity	Signature
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			

PA-15.1: Resolution of Board of Directors

17			
18			
19			
20			

The bidding enterprise hereby absolves the Department of Public Works from any liability whatsoever that may arise as a result of this document being signed.

Note:

1. * Delete which is not applicable.
2. **NB:** This resolution must, where possible, be signed by all the Directors / Members / Partners of the Bidding Enterprise.
3. In the event that paragraph 2 cannot be complied with, the resolution must be signed by Directors / Members / Partners holding a majority of the shares / ownership of the Bidding Enterprise (attach proof of shareholding / ownership hereto).
4. Directors / Members / Partners of the Bidding Enterprise may alternatively appoint a person to sign this document on behalf of the Bidding Enterprise, which person must be so authorized by way of a duly completed power of attorney, signed by the Directors / Members / Partners holding a majority of the shares / ownership of the Bidding Enterprise (proof of shareholding / ownership and power of attorney are to be attached hereto).
5. Should the number of Directors / Members / Partners exceed the space available above, additional names and signatures must be supplied on a separate page.

ENTERPRISE STAMP

PA-15.2: RESOLUTION OF BOARD OF DIRECTORS TO ENTER INTO CONSORTIA OR JOINT VENTURES

RESOLUTION of a meeting of the Board of *Directors / Members / Partners of:

(Legally correct full name and registration number, if applicable, of the Enterprise)

Held at _____ (place)

on _____ (date)

RESOLVED that:

1. The Enterprise submits a Bid /Tender, in consortium/Joint Venture with the following Enterprises:

(List all the legally correct full names and registration numbers, if applicable, of the Enterprises forming the Consortium/Joint Venture)

to the Department of Public Works in respect of the following project:

(Project description as per Bid /Tender Document)

Bid / Tender Number: _____ (Bid / Tender Number as per Bid / Tender Document)

2. *Mr/Mrs/Ms: _____
in *his/her Capacity as: _____ (Position in the Enterprise)
and who will sign as follows: _____

be, and is hereby, authorised to sign a consortium/joint venture agreement with the parties listed under item 1 above, and any and all other documents and/or correspondence in connection with and relating to the consortium/joint venture, in respect of the project described under item 1 above.

3. The Enterprise accepts joint and several liability with the parties listed under item 1 above for the due fulfilment of the obligations of the joint venture deriving from, and in any way connected with, the Contract to be entered into with the Department in respect of the project described under item 1 above.
4. The Enterprise chooses as its *domicilium citandi et executandi* for all purposes arising from this joint venture agreement and the Contract with the Department in respect of the project under item 1 above:

Physical address: _____

_____ (code)

Postal Address: _____

_____ (code)

Telephone number: _____

Fax number: _____

	Name	Capacity	Signature
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

The bidding enterprise hereby absolves the Department of Public Works from any liability whatsoever that may arise as a result of this document being signed

Note:

- * Delete which is not applicable.
- NB:** This resolution must, where possible, be signed by all the Directors / Members / Partners of the Bidding Enterprise.
- In the event that paragraph 2 cannot be complied with, the resolution must be signed by Directors / Members / Partners holding a majority of the shares / ownership of the Bidding Enterprise (attach proof of shareholding / ownership hereto).
- Directors / Members / Partners of the Bidding Enterprise may alternatively appoint a person to sign this document on behalf of the Bidding Enterprise, which person must be so authorized by way of a duly completed power of attorney, signed by the Directors / Members / Partners holding a majority of the shares / ownership of the Bidding Enterprise (proof of shareholding / ownership and power of attorney are to be attached hereto).
- Should the number of Directors / Members / Partners exceed the space available above, additional names and signatures must be supplied on a separate page.

ENTERPRISE STAMP

PA-15.3: SPECIAL RESOLUTION OF CONSORTIA OR JOINT VENTURES

RESOLUTION of a meeting of the duly authorised representatives of the following legal entities who have entered into a consortium/joint venture to jointly bid for the project mentioned below: *(legally correct full names and registration numbers, if applicable, of the Enterprises forming a Consortium/Joint Venture)*

1. _____

2. _____

3. _____

4. _____

5. _____

6. _____

7. _____

8. _____

Held at _____ (place)

on _____ (date)

RESOLVED that:

RESOLVED that:

- A. The above-mentioned Enterprises submit a Bid in Consortium/Joint Venture to the Department of Public Works in respect of the following project:

(Project description as per Bid /Tender Document)

Bid / Tender Number: _____ (Bid / Tender Number as per Bid /Tender Document)

PA-15.3: Special Resolution of Consortia or Joint Ventures

B. *Mr/Mrs/Ms: _____

in *his/her Capacity as: _____ (Position in the Enterprise)

and who will sign as follows: _____

be, and is hereby, authorised to sign the Bid, and any and all other documents and/or correspondence in connection with and relating to the Bid, as well as to sign any Contract, and any and all documentation, resulting from the award of the Bid to the Enterprises in Consortium/Joint Venture mentioned above.

C. The Enterprises constituting the Consortium/Joint Venture, notwithstanding its composition, shall conduct all business under the name and style of:

D. The Enterprises to the Consortium/Joint Venture accept joint and several liability for the due fulfilment of the obligations of the Consortium/Joint Venture deriving from, and in any way connected with, the Contract entered into with the Department in respect of the project described under item A above.

E. Any of the Enterprises to the Consortium/Joint Venture intending to terminate the consortium/joint venture agreement, for whatever reason, shall give the Department 30 days written notice of such intention. Notwithstanding such decision to terminate, the Enterprises shall remain jointly and severally liable to the Department for the due fulfilment of the obligations of the Consortium/Joint Venture as mentioned under item D above.

F. No Enterprise to the Consortium/Joint Venture shall, without the prior written consent of the other Enterprises to the Consortium/Joint Venture and of the Department, cede any of its rights or assign any of its obligations under the consortium/joint venture agreement in relation to the Contract with the Department referred to herein.

G. The Enterprises choose as the *domicilium citandi et executandi* of the Consortium/Joint Venture for all purposes arising from the consortium/joint venture agreement and the Contract with the Department in respect of the project under item A above:

Physical address: _____

 _____ (Postal code) _____

Postal Address: _____

 _____ (Postal code) _____

Telephone number: _____

Fax number: _____

PA-15.3: Special Resolution of Consortia or Joint Ventures

	Name	Capacity	Signature
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

The bidding enterprise hereby absolves the Department of Public Works & Infrastructure from any liability whatsoever that may arise as a result of this document being signed.

Note:

1. * Delete which is not applicable.
2. **NB:** This resolution must be signed by all the Duly Authorised Representatives of the Legal Entities to the consortium/joint venture submitting this tender, as named in item 2 of Resolution PA-15.2.
3. Should the number of the Duly Authorised Representatives of the Legal Entities joining forces in this tender exceed the space available above, additional names, capacity and signatures must be supplied on a separate page.
4. Resolution PA-15.2, duly completed and signed, from the separate Enterprises who participate in this consortium/joint venture, must be attached to this Special Resolution (PA-15.3).

PA-16: PREFERENCE POINTS CLAIM FORM IN TERMS OF THE PREFERENTIAL PROCUREMENT REGULATIONS 2022

This preference form must form part of all tenders invited. It contains general information and serves as a claim form for preference points for specific goals.

NB: BEFORE COMPLETING THIS FORM, TENDERERS MUST STUDY THE GENERAL CONDITIONS, DEFINITIONS AND DIRECTIVES APPLICABLE IN RESPECT OF THE TENDER AND PREFERENTIAL PROCUREMENT REGULATIONS, 2022

1. GENERAL CONDITIONS

1.1 The following preference point systems are applicable to invitations to tender:

- the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and
- the 90/10 system for requirements with a Rand value above R50 000 000 (all applicable taxes included).

1.2 Preference Points System to be applied

(tick whichever is applicable).

- ☒ The applicable preference point system for this tender is the **80/20** preference point system.
- ☐ The applicable preference point system for this tender is the **90/10** preference point system.
- ☐ Either the **90/10** or **80/20** preference point system will be applicable in this tender. The lowest/ highest acceptable tender will be used to determine the accurate system once tenders are received.

1.3 Points for this tender shall be awarded for:

1.3.1 Price; and

1.3.2 Specific Goals

1.4 The maximum points for this tender are allocated as follows:

	80/20
PRICE	
SPECIFIC GOALS	
Total points for Price and Specific Goals	100

1.5 Breakdown Allocation of Specific Goals Points



1.5.1. For procurement transaction with rand value greater than R2 000, 00 and up to R1 Million (Inclusive of all applicable taxes) the specific goals listed in table 1 below are applicable.

Table 1

Serial No	Specific Goals	Preference Points Allocated out of 20	Documentation to be submitted by bidders to validate their claim
1.	An EME or QSE which is at least 51% owned by black people (Mandatory)	10	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
2.	Located in a specific Local Municipality or District Municipality or Metro or Province area for work to be done or services to be rendered in that area(Mandatory)	2	- Official Municipal Rates Statement which is in the name of the bidder. Or - Any account or statement which is in the name of the bidder. Or - Permission to Occupy from local chief in case of rural areas (PTO) which is in the name of the bidder. Or - Lease Agreement which is in the name of the bidder.
3.	An EME or QSE which is at least 51% owned by black women (Mandatory)	4	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
4.	An EME or QSE which is at least 51% owned by black people with disability (Mandatory)	2	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.

			and • Medical Certificate indicating that the disability is permanent. Or • South African Social Security Agency (SASSA) Registration indicating that the disability is permanent. Or • National Council for Persons with Physical Disability in South Africa registration (NCPDPSA).
5.	An EME or QSE which is at least 51% owned by black youth (Mandatory)	2	• ID Copy and SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.

☐ **1.5.2. For procurement transaction with rand value greater than R1 Million and up to R50 Million (Inclusive of all applicable taxes) the specific goals listed in table 2 below are applicable.**

Table 2

Serial No	Specific Goals	Preference Points Allocated out of 20	Documentation to be submitted by bidders to validate their claim
1.	An EME or QSE or any entity which is at least 51% owned by black people (Mandatory)	10	• SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
2.	Located in a specific Local Municipality or District Municipality or Metro or Province area for work to be done or services to be rendered in that area (Mandatory)	2	• Official Municipal Rates Statement which is in the name of the bidder. Or

			- Any account or statement which is in the name of the bidder. Or - Permission to Occupy from local chief in case of rural areas (PTO) which is in the name of the bidder. Or - Lease Agreement which is in the name of the bidder.
3.	An EME or QSE or any entity which is at least 51% owned by black women (Mandatory)	4	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
4.	An EME or QSE or any entity which is at least 51% owned by black people with disability (Mandatory)	2	- SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable. and - Medical Certificate indicating that the disability is permanent. Or - South African Social Security Agency (SASSA) Registration indicating that the disability is permanent. Or National Council for Persons with Physical Disability in South Africa registration (NCPDPSA).

5.	An EME or QSE or any entity which is at least 51% owned by black youth (Mandatory)	2	ID Copy and SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
----	--	---	---

☐ **1.5.3. For procurement transaction with rand value greater than R50 Million (Inclusive of all applicable taxes) the specific goals listed in table 3 below are applicable.**

NB. The use of one of goal numbers' 4 or 5 is mandatory. The BSC must select either one of the two, but not both.

Table 3

Serial No	Specific Goals	Preference Points Allocated out of 10	Documentation to be submitted by bidders to validate their claim
1.	An EME or QSE or any entity which is at least 51% owned by black people (Mandatory)	4	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
2.	Located in a specific KZN Local Municipality or KZN District Municipality or KZN Metro or KZN Province area for work to be done or services to be rendered in that area (Mandatory)	2	- Official Municipal Rates Statement which is in the name of the bidder. Or - Any account or statement which is in the name of the bidder. Or - Permission to Occupy from local chief in case of rural areas (PTO) which is in the name of the bidder. Or - Lease Agreement which is in the name of the bidder.

	3.	An EME or QSE or any entity which is at least 51% owned by black women (mandatory)	2	• SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
	4. ☐	An EME or QSE or any entity which is at least 51% owned by black people with disability (Mandatory)	2	• SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable. and • Medical Certificate indicating that the disability is permanent. Or • South African Social Security Agency (SASSA) Registration indicating that the disability is permanent. Or National Council for Persons with Physical Disability in South Africa registration (NCPDPSA).
	5. ☐	An EME or QSE or any entity which is at least 51% owned by black youth (Mandatory)	2	• ID Copy and SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable

1.6 Failure on the part of the tenderer to submit proof or documentation required in terms of this tender to claim points for specific goals, if the service provider/ tenderer did not submit proof or documentation required to claim for specific goals will be interpreted to mean that preference points for specific goals are not claimed.

1.7 The organ of state reserves the right to require of a service provider/tenderer, either before a tender is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the organ of state.

2. DEFINITIONS

- (a) **“tender”** means a written offer in the form determined by an organ of state in response to an invitation to provide goods or services through price quotations,

competitive tendering process or any other method envisaged in legislation;

- (b) **“price”** means an amount of money tendered for goods or services, and includes all applicable taxes less all unconditional discounts;
- (c) **“rand value”** means the total estimated value of a contract in Rand, calculated at the time of bid invitation, and includes all applicable taxes;
- (d) **“tender for income-generating contracts”** means a written offer in the form determined by an organ of state in response to an invitation for the origination of income-generating contracts through any method envisaged in legislation that will result in a legal agreement between the organ of state and a third party that produces revenue for the organ of state, and includes, but is not limited to, leasing and disposal of assets and concession contracts, excluding direct sales and disposal of assets through public auctions; and
- (e) **“the Act”** means the Preferential Procurement Policy Framework Act, 2000 (Act No. 5 of 2000).

3. FORMULAE FOR PROCUREMENT OF GOODS AND SERVICES

3.1. POINTS AWARDED FOR PRICE

3.1.1. THE 80/20 OR 90/10 PREFERENCE POINT SYSTEMS

A maximum of 80 or 90 points is allocated for price on the following basis:

$$\begin{array}{ccc} \mathbf{80/20} & \mathbf{or} & \mathbf{90/10} \\ \\ \mathbf{Ps = 80 \left(1 - \frac{Pt - P_{min}}{P_{min}} \right)} & \mathbf{or} & \mathbf{Ps = 90 \left(1 - \frac{Pt - P_{min}}{P_{min}} \right)} \end{array}$$

Where

- Ps = Points scored for price of tender under consideration
- Pt = Price of tender under consideration
- Pmin = Price of lowest acceptable tender

3.2. FORMULAE FOR DISPOSAL OR LEASING OF STATE ASSETS AND INCOME GENERATING PROCUREMENT

3.2.1. POINTS AWARDED FOR PRICE

A maximum of 80 or 90 points is allocated for price on the following basis:

$$\begin{array}{ccc} \mathbf{80/20} & \mathbf{or} & \mathbf{90/10} \\ \\ \mathbf{Ps = 80 \left(1 + \frac{Pt - P_{max}}{P_{max}} \right)} & \mathbf{or} & \mathbf{Ps = 90 \left(1 + \frac{Pt - P_{max}}{P_{max}} \right)} \end{array}$$

Where

- Ps = Points scored for price of tender under consideration
- Pt = Price of tender under consideration

Pmax = Price of highest acceptable tender

4. POINTS AWARDED FOR SPECIFIC GOALS

- 4.1. In terms of Regulation 4(2); 5(2); 6(2) and 7(2) of the Preferential Procurement Regulations, preference points must be awarded for specific goals stated in the tender. For the purposes of this tender the tenderer will be allocated points based on the goals stated in table 1,2 and 3 above as may be supported by proof/ documentation stated in the conditions of this tender:
- 4.2. In cases where organs of state intend to use Regulation 3(2) of the Regulations, which states that, if it is unclear whether the 80/20 or 90/10 preference point system applies, an organ of state must, in the tender documents, stipulate in the case of—
- (a) an invitation for tender for income-generating contracts, that either the 80/20 or 90/10 preference point system will apply and that the highest acceptable tender will be used to determine the applicable preference point system; or
 - (b) any other invitation for tender, that either the 80/20 or 90/10 preference point system will apply and that the lowest acceptable tender will be used to determine the applicable preference point system,
- then the organ of state must indicate the points allocated for specific goals for both the 90/10 and 80/20 preference point system.

Table 4: Specific goals for the tender and points claimed are indicated per the table below.

(Note to organs of state: Where either the 90/10 or 80/20 preference point system is applicable, corresponding points must also be indicated as such.

Note to tenderers: The tenderer must indicate how they claim points for each preference point system.)

The specific goals allocated points in terms of this tender	Number of points allocated (90/10 system) (To be completed by the organ of state)	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (90/10 system) (To be completed by the tenderer)	Number of points claimed (80/20 system) (To be completed by the tenderer)
1. An EME or QSE (or any entity for procurement transaction with rand value greater than R1 Million) which is at least 51% owned by black people	4	10		

The specific goals allocated points in terms of this tender	Number of points allocated (90/10 system) (To be completed by the organ of state)	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (90/10 system) (To be completed by the tenderer)	Number of points claimed (80/20 system) (To be completed by the tenderer)
2. Located in a specific Local Municipality or District Municipality or Metro or Province area for work to be done or services to be rendered in that area	2	2		
3. An EME or QSE (or any entity for procurement transaction with rand value greater than R1 Million) which is at least 51% owned by black women	2	4		
4. An EME or QSE (or any entity for procurement transaction with rand value greater than R1 Million) which is at least 51% owned by black people with disability	2	2		
5. An EME or QSE (or any entity for procurement transaction with rand value greater than R1 Million) which is at least 51% owned by black youth.*	2	2		

DECLARATION WITH REGARD TO COMPANY/FIRM

- 4.3. Name of company/firm.....
- 4.4. Company registration number:
- 4.5. TYPE OF COMPANY/ FIRM
- ☐ Partnership/Joint Venture / Consortium
- ☐ One-person business/sole propriety
- ☐ Close corporation

- ☐ Public Company
 - ☐ Personal Liability Company
 - ☐ (Pty) Limited
 - ☐ Non-Profit Company
 - ☐ State Owned Company
- [TICK APPLICABLE BOX]

4.6. I, the undersigned, who is duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the specific goals as advised in the tender, qualifies the company/ firm for the preference(s) shown and I acknowledge that:

- i) The information furnished is true and correct;
- ii) The preference points claimed are in accordance with the General Conditions as indicated in paragraph 1 of this form;
- iii) In the event of a contract being awarded as a result of points claimed as shown in paragraphs 1.4 and 4.2, the contractor may be required to furnish documentary proof to the satisfaction of the organ of state that the claims are correct;
- iv) If the specific goals have been claimed or obtained on a fraudulent basis or any of the conditions of contract have not been fulfilled, the organ of state may, in addition to any other remedy it may have –
 - (a) disqualify the person from the tendering process;
 - (b) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
 - (c) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation;
 - (d) recommend that the tenderer or contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, be restricted from obtaining business from any organ of state for a period not exceeding 10 years, after the *audi alteram partem* (hear the other side) rule has been applied; and
 - (e) forward the matter for criminal prosecution, if deemed necessary.

..... SIGNATURE(S) OF TENDERER(S)	
SURNAME AND NAME:	
DATE:	
ADDRESS:	
	
	
	

PA- 40: DECLARATION OF DESIGNATED GROUPS FOR PREFERENTIAL PROCUREMENT

Tender no:

Name of Tenderer:

☐ EME¹
☐ QSE²
☐ Non EME/QSE (tick applicable box)

1. LIST ALL PROPRIETORS, MEMBERS OR SHAREHOLDERS BY NAME, IDENTITY NUMBER, CITIZENSHIP AND DESIGNATED GROUPS.

Name and Surname #	Identity/ Passport number and Citizenship##	Percentage owned	Black	Indicate if youth	Indicate if woman	Indicate if person with disability	Indicate if living in Rural (R) / Under Developed Area (UD) / Township (T) / Urban (U).	Indicate if military veteran
1.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
2.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
3.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
4.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
5.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
6.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
7.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
8.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
9.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
10.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
11.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No
12.		%	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ Yes ☐ No	☐ R ☐ UD ☐ T ☐ U	☐ Yes ☐ No

Where Owners are themselves a Company, Close Corporation, Partnership etc, identify the ownership of the Holding Company, together with Registration number
 ## State date of South African citizenship obtained (not applicable to persons born in South Africa)

¹ EME: Exempted Micro Enterprise

² QSE: Qualifying Small Business Enterprise

Any reference to words "Bid" or Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".
 For Internal & External Use
 Effective date 20 September 2021

PA- 40: DECLARATION OF DESIGNATED GROUPS FOR PREFERENTIAL PROCUREMENT

Tender no: _____

2. DECLARATION:

The undersigned, who warrants that he/she is duly authorized to do so on behalf of the Tenderer, hereby confirms that:

- 1 The information and particulars contained in this Affidavit are true and correct in all respects;
- 2 The Broad-based Black Economic Empowerment Act, 2003 (Act 53 of 2003), Preferential Procurement Policy Framework Act, 2000 (Act 5 of 2000), the Preferential Procurement Regulations, 2017, National Small Business Act 102 of 1996 as amended and all documents pertaining to this Tender were studied and understood and that the above form was completed according to the definitions and information contained in said documents;
- 3 The Tenderer understands that any intentional misrepresentation or fraudulent information provided herein shall disqualify the Tenderer's offer herein, as well as any other tender offer(s) of the Tenderer simultaneously being evaluated, or will entitle the Employer to cancel any Contract resulting from the Tenderer's offer herein;
- 4 The Tenderer accepts that the Employer may exercise any other remedy it may have in law and in the Contract, including a claim for damages for having to accept a less favourable tender as a result of any such disqualification due to misrepresentation or fraudulent information provided herein;
- 5 Any further documentary proof required by the Employer regarding the information provided herein, will be submitted to the Employer within the time period as may be set by the latter;

Signed by the Tenderer

Name of representative	Signature	Date



public works

Department:
Public Works
REPUBLIC OF SOUTH AFRICA

**SPECIFICATION FOR
HIBBERDENE SAPS**

**SUPPLY, DELIVERY AND INSTALLATION OF A 12kVA
SOLAR SYSTEM**

AUGUST 2026

TABLE OF CONTENTS

PART A - Specification for the supply and installation of Solar Power Installations

SECTION 1 – GENERAL	3
SECTION 2 – GENERAL TECHNICAL SPECIFICATION	7
SECTION 3 – PROJECT SPECIFICATION	166
SECTION 4 - SCHEDULES OF TECHNICAL INFORMATION.....	19

**SPECIFICATION FOR THE SUPPLY DELIVERY AND INSTALLATION OF SOLAR
ENERGY INSTALLATIONS**

**SECTION 1 – GENERAL
TABLE OF CONTENTS**

<u>Clause</u>		<u>Page</u>
1.	Intent of Specification.....	4
2.	Standards and Codes.....	4
3.	Regulations.....	4
4.	Scope of Work.....	4
5.	Co-ordination.....	4
6.	Test Certificates and Inspections.....	5
7.	Guarantee and Maintenance.....	5
8.	Materials and Workmanship.....	5
9.	Imported Content.....	6
10.	Brochures.....	6
11.	Submittals.....	6

1. Intent of Document

The specification is intended to cover the complete installation of the solar plant. The minimum equipment requirements are outlined, but do not cover all the details of design and construction. Such details are recognised as being the exclusive responsibility of the contractor.

In all cases where a device or part of the equipment is referred to in the singular, it is intended that such reference shall apply to as many devices as are required to complete the installation.

2. Standards and Codes

All work and equipment shall be in accordance with the requirements of NRS097-2, and current regulations of all other codes applicable to this work.

3. Acts and Regulations

The installation shall be erected and tested in accordance with the following Acts and regulations:

- a) The latest issue of SANS 10142-1 and -2: "Code of Practice for the Wiring of Premises",
- b) The Occupational Health and Safety Act, 1993 (Act 85 of 1993) as amended,
- c) The Local Government Ordinance 1939 (Ordinance 17 of 1939) as amended and the municipal by-laws and any special requirements of the local supply authority,
- d) The Fire Brigade services Act 1993 Act 99 of 1987 as amended,
- e) The National Building Regulations and Building Standards Act 1977 (Act 103 of 1977) as amended,
- f) The Post Office Act 1958 (Act 44 of 1958) as amended,
- g) The Electricity Act 1984 (Act 41 of 1984) as amended and
- h) The Regulations of the local Gas Board where applicable.

4. Scope of Work

Supply, delivery and installation of the complete SOLAR installation set specified in this document.

5. Co-ordination

The Contractor shall co-ordinate his program with all relevant parts. His installation rates shall include for such "first fixing of plant as may be required, and for returning at a later stage to complete the installation when the other Contractor's has completed their operations, were necessary.

Delays due to lack of co-ordination between the Contractors shall not form a basis for claims be the Contractor of this Contract.

6. Test Certificates and Inspections

The following tests are to be carried out:

- (b) After completion of the works and before first delivery is taken, a full test will be carried out on the installation for a period of sufficient duration to determine the satisfactory working thereof. During this period the installation will be inspected and the contractor shall make good, to the satisfaction of the Representative/Agent, any defects which may arise.
- (c) The Contractor shall provide all instruments and equipment required the commissioning and testing of the installation at completion.
- (d) Test reports of both tests as specified under (a) and (b) are to be submitted to the Departmental Engineer.

7. Guarantee and Maintenance

The Contractor shall guarantee the complete plant for a period of twelve months after the first delivery has taken place.

If during this period the plant is not in working order, or not working satisfactorily owing to faulty material, design or workmanship, the Contractor will be notified and immediate steps shall be taken by him to rectify the defects and/or replace the affected parts on-site at his own expense.

The Contractor shall maintain the plant in good working condition for the full twelve-month period to the final delivery of the installation. However, should the Contractor fail to hand over the plant in good working order on the expiry of the specified twelfth month, the Contractor shall be responsible for further monthly maintenance until final delivery is taken.

During this period the contractor will undertake to do 24/7-hour online monitoring of the performance of the plant and provide a monthly report to the client. Any on-site maintenance to be performed flowing from the 24/7-hour monitoring shall be taken at the cost of the contractor except for routine household cleaning operations to be attended to by the client and per the project manual.

8. Materials and Workmanship

- (a) The work throughout shall be executed to the highest standards and to the entire satisfaction of the Representative/Agent who shall interpret the meaning of the Contract Document and shall have the authority to reject any work and materials, which, in his judgement, are not in full accordance therewith. All condemned material and workmanship shall be replaced or rectified as directed and approved by the Engineer.
- (b) All work shall be executed in a first-class manner by qualified tradesman.
- (c) The Contractor shall warrant that the materials and workmanship shall be of the highest grade, that the equipment shall be installed in a practical and first-class manner in accordance with the best practices and ready and complete for full operation. It is specifically intended that all material or labour which is usually provided as part of such equipment as is called for and which is necessary for its proper completion and operation shall be provided without additional cost whether or not shown or described in the Contract Document.

PA-03 (EC): NOTICE AND INVITATION FOR QUOTATION

THE DEPARTMENT OF PUBLIC WORKS AND INFRASTRUCTURE INVITES QUOTATIONS FOR:

Project title:	HIBBERDENE SAPS:SUPPLY,DELIVERY AND INSTALLATION OF A 12KVA SOLAR SYSTEM
-----------------------	--

Quotation no:	DBNQ26/10/09	Reference no:	19/2/3/2/3/958
Advertising date:	07/10/2026	Closing date:	22/10/2026
Closing time:	11:00	Validity period:	84 Calendar days

1. REQUIRED CIDB GRADING

It is estimated that tenderers should have a CIDB contractor grading designation of **1 EB** or higher, or **1 EB** * or higher.

**Select tender value range and select class of construction works" or select "Not applicable" where only one class of construction works is applicable.*

It is estimated that potentially emerging enterprises should have a CIDB contractor grading designation of **Not applicable Not applicable PE** or higher, or **Not applicable Not applicable PE*** or higher.

**Select tender value range and select class of construction works" or select "Not applicable" where no or only one class of construction works is applicable.*

2. FUNCTIONALITY CRITERIA APPLICABLE YES ☐ NO ☒

Note 1: Failure to meet minimum functionality score will result in the tenderer being disqualified.

Functionality criteria ¹ :	Weighting factor:
1.	
2.	
3	
Total	100 Points

3. METHOD TO BE USED TO CALCULATE POINTS FOR SPECIFIC GOALS

¹The points allocated to each functionality criterion should not be generic but should be determined separately for each tender on a case by case basis.

Any reference to words "Bid" or Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

For Internal & External Use

Effective date: 21 July 2023

Version: 2023/08

3.1. For procurement transaction with rand value greater than R2 000, 00 and up to R1 Million (Inclusive of all applicable taxes) the specific goals listed in table 1 below are applicable.

Table 1

Serial No	Specific Goals	Preference Points Allocated out of 20	Documentation to be submitted by bidders to validate their claim
1.	An EME or QSE which is at least 51% owned by black people (Mandatory)	10	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
2.	Located in a specific Local Municipality or District Municipality or Metro or Province area for work to be done or services to be rendered in that area (Mandatory)	2	- Official Municipal Rates Statement which is in the name of the bidder. Or - Any account or statement which is in the name of the bidder. Or - Permission to Occupy from local chief in case of rural areas (PTO) which is in the name of the bidder. Or - Lease Agreement which is in the name of the bidder.
3.	An EME or QSE which is at least 51% owned by black women (Mandatory)	4	SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.
4.	An EME or QSE which is at least 51% owned by black people with disability (Mandatory)	2	- SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable. and - Medical Certificate indicating that the disability is permanent. Or - South African Social Security Agency (SASSA) Registration indicating that the disability is permanent. Or - National Council for Persons with Physical Disability in South Africa registration (NCPDSA).
5.	An EME or QSE which is at least 51% owned by black youth (Mandatory)	2	ID Copy and SANAS Accredited BBBEE Certificate or Sworn Affidavit where applicable.

Black people mean Africans, Coloureds and Indians, who - (a) are citizens of the Republic of South Africa by birth or descent; or (b) became citizens of the Republic of South Africa by naturalisation - (i) before 27 April 1994; or (ii) on or after 27 April 1994 and who would have been entitled to acquire citizenship by naturalisation prior to that date. (BROAD-BASED BLACK ECONOMIC EMPOWERMENT ACT No 25899, 2003 of

Any reference to words "Bid" or Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

For Internal & External Use


Effective date: 21 July 2023

Page 2 of 8
Version: 2023/08

5 JANUARY 2004).

4. RESPONSIVENESS CRITERIA

4.1. Indicate substantive responsiveness criteria applicable for this tender. Failure to comply with the criteria stated hereunder shall result in the tender offer being disqualified from further consideration:

1	☒	Only those tenderers who satisfy the eligibility criteria stated in the Tender Data may submit tenders.
2	☒	Tender offer must be properly received on the tender closing date and time specified on the invitation, completed either electronically (if issued in electronic format), or by writing legibly in non-erasable ink. (All as per Standard Conditions of Tender).
3	☒	Use of correction fluid is prohibited.
4	☒	Submission of a signed bid offer as per the DPW-07 (EC). 
5	☒	Submission of DPW-09 (EC): Particulars of Tenderer's Projects. 
6	☐	Bidders must comply with DPW-21 (EC): Record of Addenda to tender documents, if any.
7	☐	Submission of DPW-16 signed by the authorised official and completion of bid briefing attendance register. 
8	☐	The tenderer shall submit his fully priced Bills of Quantities / Lump Sum Document (complete document inclusive of all parts) together with his tender.
9	☐	The tenderer shall submit his fully priced and completed sectional summary- and final summary pages with the tender.
10	☒	Submission of SBD3.1 - Pricing schedule must be fully completed.
11	☒	Bidding companies must provide proof that their employed technicians or artisans are qualified and experienced in solar system maintenance/Repairs, installation, commissioning, Testing related services. The submission of valid trade test (Electrical artisan or Heavy current Electrical technician).
12	☒	The Department reserves the right not to appoint if a bidder has been awarded 2 or more contracts of similar nature within the NDPWI in the last six months, for equity & fair distribution of work amongst service providers.
13	☒	Bidders are required to submit references from previous clients, including contact details and a brief overview of the services provided. Proof of past experience and successful completion of similar projects must be included in the form of a letter of award and a completion certificate for evaluation. this experience must include Single phase and 3-phase solar system installation projects.
14	☒	Bidder to submit a Valid PV GREEN CARD (regulated by South African Photovoltaic Industry Association (SAPVIA)) for a technician /Artisan (installation of solar system related work) employed by the bidding company.
15	☒	Valid Wiremans License letter by the Dept of labour for the owner of the company or for the employee who will be performing the work and also verifiable proof that He/ She is employed by the company that has been awarded to do the work of Solar system.

4.2. Indicate administrative responsiveness requirements applicable for this tender.

The Employer reserves the right to request further information regarding the undermentioned criteria. Failing to submit further clarification and/or documentation within seven (7) calendar days from request will disqualify the tender offer from further consideration.

1	☒	Any correction to be initialled by the person authorised to sign the tender documentation as per PA 15.1 or PA 15.2 resolution of board/s of directors / or PA15.3 Special Resolution of Consortia or JV's.
2	☒	Submission of applicable (PA-15.1, PA-15.2, PA-15.3): Resolution by the legal entity, or consortium / joint venture, authorising a dedicated person(s) to sign documents on behalf of the firm / consortium / joint venture.
3	☒	All parts of tender documents submitted must be fully completed in ink and signed where required.
4	☒	Submission of (PA-11): Bidder's disclosure
5	☐	Submission of PA-16.1 (EC): Ownership Particulars
6	☐	Submission of documentation relating to risk assessment criteria as contained in C 2.1 of DPW-03 Tender Data.
7	☐	Submission of (PA 40): Declaration of Designated Groups.
8	☒	Submission of proof of Registration on National Treasury's Central Supplier Database (CSD). Insert the Supplier Registration Number on the form of offer, including proposed sub-contractors if any
9	☐	Data provided by the tenderer in Part 2 of DPW-04 Contract Data (JBCC 2018) or DPW-05 Contract Data (GCC 2015) whichever applicable to be fully completed.
10	☒	The tenderer shall submit his fully priced Bills of Quantities (complete document inclusive of all parts) within 14 calendar days from request.
11	☐	Upon request, submission of fingerprints obtainable from local SAPS including any other additional documentation and information required for vetting purposes.
12	☐	Upon request, submission of a fully completed security clearance application form with supporting documentation and information as required. The security clearance form will be provided by the Employer for projects requiring a security clearance.
13	☒	Submission of current / valid letter of good standing, Workman's Compensation certificate for electrical related work (COIDA).
14	☒	All documents submitted by Bidder are subject to Verification to confirm validity.
15	☒	Submission of (PA32): Invitation to Bid
16	☒	The awarded Bidder will be required to submit proof of current and valid Public Liability Insurance, issued by a registered and authorised insurer. The cover must be active on the tender closing date and maintained for the full contract period, covering third-party injury/death and damage to property arising from fire-related works, including accidental leakage, discharge or flooding. The policy must not exclude damage to the Employer's existing property caused by the Contractor's operations.
17	☒	Verifiable proof that the contractor has successfully completed the installation, testing and commissioning of solar system (award letter and completion letter or certificate of completion that will be verifiable)
18	☒	Contractor and the client to sign the site visit form for quotation purpose and submit with the tender document see the copy in the document attachment.

4.3. Indicate administrative requirements applicable for specific goals, Tenderers will not be required to submit the below documents if not provided in the original tender proposals, Failure to comply with the criteria stated hereunder shall result in the tenderer not allocated points for specific goals

1	☒	Submission of (PA-16): Preference Points Claim Form in terms of the Preferential Procurement Regulations 2022
2	☐	A trust, consortium or joint venture (including unincorporated consortia and joint ventures) must submit a consolidated B-BBEE Certificate issued by a SANAS accredited service provider

5. THE FOLLOWING EVALUATION METHOD FOR RESPONSIVE BIDS WILL BE APPLICABLE:

☐ Method 1 (Financial offer)	☒ Method 2 (Financial and Preference offer)
---	---

5.1. This bid will be evaluated according to the 80/20 Preference points scoring system:

6. ELIGIBILITY IN RESPECT OF RISK TO THE EMPLOYER:

Standard risk management assessment criteria in respect of tenders received for routine projects in the engineering and construction works environments:

Tender offers will be evaluated by an Evaluation Committee based on the technical and commercial risk criteria listed hereunder. Each criterion carries the same weight / importance and will be evaluated individually based on reports presented to the Bid Evaluation Committee by the Professional Team appointed on the project. A tender offer will be declared non-responsive and removed from any further evaluation if any one criterion is found to present an unacceptable risk to the Employer.

In order for the evaluation reports to be prepared by the Professional Team, the Tenderer is obliged to provide comprehensive information on form DPW-09 (EC). Failure to complete the said form will cause the tender to be declared non-responsive and removed from any further consideration. The Employer reserves the right to request additional information over and above that which is provided by the Tenderer on said form. The information must be provided by the Tenderer within the stipulated time as determined by the Bid Evaluation Committee, failing which the tender offer will *mutatis mutandis* be declared non-responsive.

6.1 Technical risks:

Criterion 1: Experience on comparable projects during the past 5 years.

The tendering Service Provider's experience on comparable projects during the past 5 years. The number of current and previous comparable projects performed by the Tenderer as per the evaluation report prepared by the Consultant Team, based on its research and inspection of a representative sample of the Tenderer's current and previous work as reflected on form DPW-09 (EC), as well as, if necessary, of any additional work executed by the Tenderer, not reflected on form DPW-09 (EC). Failing to provide contactable references will result in the tender offer will be *mutatis mutandis* declared non-responsive.

Aspects to be regarded as "comparable" includes (but may be extended according to circumstances): size of projects (measured against monetary value or other project quantifying parameters), nature of projects (building, engineering, high/low rise, etc.), locality/area of execution (site-specific influences, knowledge of local conditions, etc.), complexity of project, projects for similar client department irrespective of end purpose of buildings/facilities created or in progress of being created and time scales of projects (normal, fast track, etc.) and stage of its/their development.

Criterion 2: Contractual commitment and quality of performance on comparable projects during the past 5 years.

Adherence to contractual commitments and quality of performance of comparable current and previous projects performed by the Tenderer during the past 5 years as per the evaluation report prepared by the Consultant Team, based on its research and inspection of a representative sample of the Tenderer's current and previous work as reflected on form DPW-09 (EC), as well as, if necessary, of any additional work executed by the Tenderer.

Aspects to be considered include, but are not limited to the following:

1. The level of progress on current projects in relation to the project programme or, if such is not available/applicable, to the contractual construction period in general;

Any reference to words "Bid" or Bidder" herein and/or in any other documentation shall be construed to have the same meaning as the words "Tender" or "Tenderer".

2. The degree to which previous projects have been completed within the contractual completion periods and/or extensions thereto, and the extend of penalties imposed;
3. Project performance: time management & programming of works, timeous ordering of materials and appointment of subcontractors;
4. Financial management: payment to suppliers and cash flow problems;
5. Quality of workmanship: extent of reworks and timeous attention to remedial works;
6. Personnel resources: suitably qualified and experienced, turnover in site staff and labour force, specifically site manager and foreman;
7. Personnel management: extent of labour disputes and ability to resolving labour disputes amicably;
8. Sub-contractors: extent of turnover in subcontractors, general liaison and payment problems experienced;
9. Contract administration: contractual aspects such as complying to laws and regulations, insurances, security, submission of required documentation timeously, reaction to written contract instructions, appointments of subcontractors, etc. as can generally be expected in standard/normal conditions of contract.
10. Health & Safety: adherence to regulations and compliance, and number of transgressions & serious incidents.
11. Plant & equipment: sufficient resources on site and in time.
12. Delays: extent of causing delays, submission of claims timeously, and abuse of or exaggerated delay claims.
13. Final account: extent to which the contractor assisted in finalising the final account.

Criterion 3: Suitably qualified and appropriately experienced human resources

Allocation of suitably qualified and appropriately experienced human resources, both in respect of principals and/or other staff (contract manager, site agent, site foreman including other professional, technical and/or administrative) of the tendering Service Provider to the project, as proof that the tendering Service Provider will be able to react/respond appropriately to the Services required herein. The Company Organogram with CV's and certified ID's of all principals and employed workforce as well as proof of Professional Registration will be verified. Current and future workload of the tenderer in relation to capacity and capability will also be considered. The tenderer should demonstrate that he or she possesses the necessary professional and technical qualifications and -competence in relation to the scope of work and work to be undertaken.

Criterion 4: Attendance of compulsory bid clarification meeting, if applicable

If applicable, submission of confirmation of DPW-16.1 (PSB) attendance of compulsory bid clarification meeting or proof of attending the compulsory virtual meeting by a suitably qualified and experienced representative of the tenderer in terms of PA-04 (EC): Notice and Invitation to Tender.

6.2 Commercial risks:

The financial viability assessment evaluates the risk over the life of the construction period, as to whether the tenderer will be able to deliver the goods and services which are specified in the contract and / or be able to fulfil guarantees or warranties provided for in the contract in order to complete the project successfully for the amount tendered.

Aspects to be considered include but are not limited to, the respective rates tendered, bank rating, financial capability and capacity whether the tenderer has or has access to sufficient financial resources to deliver the goods or services described in the tender documentation (including fulfilling any guarantees or warranty claims), whether the tenderer is not subject to any current or impending legal action (either formal proceedings or notification of legal action) which could impact on the financial standing of the tenderer or the delivery of the goods or services, financial report from auditors as proof of current liquidity, and company or any parent company or investor guarantee/s and financial statements.

7. COLLECTION OF QUOTATION DOCUMENTS

☐ Quotation documents are available for collection during working hours

Compulsory briefing session will be held in respect of this quotation.

The particulars for compulsory briefing session or virtual briefing session are:

Venue:	N/A		
Virtual meeting Link:	N/A		
Date:	N/A	Starting time:	N/A

9. ENQUIRIES

9.1. Technical enquiries may be addressed to:

DPWI Project Manager	Mr. Mbongeni Putuzo	Telephone no:	031 314 7054
Cellular phone no	066 262 2818	Fax no:	
E-mail	Mbongeni Putuzo@dpw.gov.za		

9.2. SCM enquiries may be addressed to:

SCM Official	Mr. Saziso Ndlovu	Telephone no:	0124061847
Cellular phone no	072 738 1452	Fax no:	
E-mail	saziso.ndlovu@dpw.gov.za		

10. DEPOSIT / RETURN OF QUOTATION DOCUMENTS

Telegraphic, telephonic, telex, facsimile, electronic and / or late tenders will not be accepted.

Requirements for sealing, addressing, delivery, opening and assessment of tenders are stated in the Tender Data.

All tenders must be completed in non-erasable ink and submitted on the official forms – (forms not to be re-typed).

Tender documents may be posted to: The Director-General Department of Public Works and Infrastructure Private Bag X 05 Kensington Boulevard @Kingsmead Office Park Durban 4000 Attention: Procurement section: Room	OR	Deposited in the tender box at: BOX NUMBER 16 05 Kensington Boulevard @Kingsmead Office Park
--	------------------	---

- (d) The Contractor shall thoroughly acquaint himself with the work involved and shall verify on site all measurements necessary for proper installation work. The Contractor shall also be prepared to promptly furnish any information relating to his own work as may be necessary for the proper installation work and shall co-operate with and co-ordinate the work of others as may be applicable.
- (e) All components and their respective adjustment, which do not form part of the equipment installation work but effects the optimum and safe operation of the equipment shall be considered to form part of and shall be included in the Contractor's scope of works.
- (f) All control equipment and serviceable items shall be installed and positioned such that they will be accessible and maintainable.
- (g) The Contractor shall make sure that all safety regulations and measures are applied and enforced during the installation and guarantee periods to ensure the safety of the public and the User Client.
- (h) The Contractor is to include for all scaffolding and safety lines for working at heights required to complete the work required.

9. Imported Content

This equipment will not be subject to fluctuations in the rate of exchange. However, should the Contractor choose to be protected against fluctuations in the rate of exchange on imported equipment, the following conditions will apply:

- a) The Materials Offered Ex-Import which forms part of this tender document, must be completed by the Contractor.
- b) Any fluctuations in the rate of exchange will be for the account of the Government and shall be calculated from a date seven (7) days prior to the date of the Contractor's tender to a date seven (7) days after receipt by the Contractor's bank of the negotiable bill of lading or the exporter's invoice, provided this latter date is not later than 30 days after the date of payment. Thereafter, fluctuations in the rate of exchange shall not be for the account of the Government.

10. Brochures

Detailed brochures and specifications of all equipment offered shall be presented together with the tender documents.

11. Submittals

Full particulars, performance curves and illustrations of the equipment offered must be submitted with the Tender.

The successful Tenderer must, as soon as possible after receipt of the order, submit detailed drawings and wiring diagrams of the plant and the switchgear. One diagram shall be contained in a metal pouch on the wall adjacent to the logbook cabinet in a position to be agreed on.

**SPECIFICATION FOR THE SUPPLY DELIVERY AND INSTALLATION OF A SOLAR
POWER PLANT**

SECTION 2 – GENERAL TECHNICAL SPECIFICATION

TABLE OF CONTENTS

<u>Clause</u>	<u>Page</u>
1. General	8
2. Site Information and Conditions.....	8
3. Output and Voltage	8
4. Solar Control Panel Unit	8
5. Solar Plant General Technical Specification	9-15

1. General

Supply, deliver, install, commission, test and maintain a solar installation at Hiberdene SAPS.

This installation must comply fully with all the sections of this document. This technical specification is supplementary to the Equipment Requirements, Section 2, must be read together where they are at variance the Technical Specification shall apply.

2. Site Information and Conditions

2.1 Location

The site is at Hibberdene SAPS.

2.2 Site Conditions

The following site conditions will be applicable and equipment shall be suitably rated to develop their assigned rating and duty at these conditions.

- a) Height above sea level : 1050 meter
- b) Maximum ambient temperature : 37 °C
- c) Maximum ambient humidity at lowest temperature : 70 %

3. Output and Voltage

No load voltage	:	400/230 Volt
Rating	:	12 kVA
Power at 0,9 power factor	:	10,8 kW
Frequency	:	50Hz
Fault Level	:	6kA

The SOLAR plant is required to feed the following electrical load:

Type	Load (kW)	Power Factor
Discharge lighting		0.9
Fluorescent lighting		0.9
Heaters & plugs		1
Computers & radios		0.9
Kitchen Equipment		0.9

4. Solar Control Panel Unit

The switchboard shall comprise the complete change-over panel fed from the main DB. All cables to and from the SOLAR PLANT switchboard will be installed by the electrical contractor as well.

All switch- and control gear shall be rated for a fault current level of 6kA. The switchboard/control panel unit of the SOLAR PLANT shall be a wall-mounted type, which shall be installed in the building earmarked for this purpose.

Distribution Board: DB- CSC
Accommodation: CSC
Doors: Lockable Doors
Colour: PV Regulations & SANS 10142 for Solar Installation
Fault Rating: 6kA
Type: Wall mounted

5. **Cables**

The contractor will be responsible for all electrical cable connections associated with the complete SOLAR installation.

6. **SOLAR PLANT GENERAL TECHNICAL SPECIFICATION**

6.1 **TERMS AND DEFINITIONS**

Inverter

A power device that converts direct current to alternating current at a voltage and frequency which enables the generator to be connected to the utility grid.

Small-scale embedded generator (SSEG)

A small-scale embedded generator for the purposes of these Requirements is an embedded generator with a generation capacity of less than 1000kVA (1MVA).

Utility

The electricity distribution service provider is responsible for the electricity grid infrastructure to which the customer is connected.

Suitably interlocked change-over switch

Switch required for off-grid-tied hybrid SSEG.

Abbreviations

ADMD: After Diversity Maximum Demand
AC: Alternating Current
AMI: Advanced Metering Infrastructure
DC: Direct Current
DSD: Distribution System Development (a section within the EGD Department)
ECSA: Engineering Council of South Africa
EG: Embedded Generation
EGD: Electricity Generation and Distribution Department of the City of Cape Town
kVA: kilovolt-ampere (unit of electrical power, often similar in magnitude to kW)
kW: kilowatt (unit of electrical power)
kWp: kilowatt peak (the rated peak output of solar PV panels)
LV: Low voltage
MV: Medium voltage
MVA: Megavolt-ampere (1000kVA)
NERSA: National Energy Regulator of South Africa
PV: Photovoltaic
RPP: Renewable Power Plant
SSEG: Small-scale Embedded Generation/Generator

6.2. APPLICABLE TECHNICAL STANDARDS

- 6.2.1 Earthing must be in accordance to SANS 10142-1 and NRS 097-2-1.
- 6.2.2 Lightning protection earthing shall be done on the Faraday Cage protection principle and aligned with the National Department of Public Works (NDPWI) "general electrical specifications" document's earthing-related requirements. This document is found on the NDPWI website.

SOLAR PHOTOVOLTAIC (PV) MODULES:-

The PV panels will be 620W Enersol, JA Solar/Jinko or similar, installed on a tiled roof on the main building of CSC as shown on the image attached:

- The PV modules used must qualify to the latest edition of IEC PV module qualification test or equivalent BIS standards Crystalline Silicon Solar Cell Modules IEC 61215/IS14286.
- The modules must conform to IEC 61730 Part-1 - requirements for construction & Part2 – requirements for testing, for safety qualification or equivalent IS.
- They must qualify to IEC 61701
- The total solar PV array capacity should not be less than the allocated capacity (kWp) and should comprise of solar crystalline modules of minimum 620Wp or above wattage.
- Adequate protective devices against surges at the PV module shall be provided. Low voltage drop bypass diodes shall be provided.
- PV modules must be tested and a credited IEC authorized test centres
- The module frame shall be made of corrosion-resistant materials, preferably having anodised aluminium.
- The rated output power of any supplied module shall have a tolerance within +/-3%.
- An identification plate shall be mounted on the rear of each panel listing:
 - Name of the manufacturer of the PV module
 - Name of the manufacture of Solar Cells
 - Month & year of the manufacture (separate for solar cells and modules)
 - Country of origin (separately for solar cells and modules)
 - I-V curve for the module Wattage, Im, Vm and FF for the module
 - Unique Serial No and Model No of the module
 - Date and year of obtaining IEC PV module qualification certificate.
 - Name of the test lab issuing IEC certificate.
 - Other relevant information on traceability of solar cells and module

WARRANTIES:-

Material Warranty shall include:

- The project developer should warrant the Solar Module(s) to be free from the defects and/or failures specified below for a period not less than ten (10) years from the date of sale
- Defects and/or failures due to manufacturing
- Defects and/or failures due to quality of materials
- Non conformity to specifications due to faulty

Performance Warranty shall include:

- The predicted electrical degradation of power generated not exceeding 20% of the minimum rated power over the 20 year period and not more than 10% after ten years period of the full rated original output.

ARRAY STRUCTURE :-

- Hot dip galvanized MS mounting structures may be used for mounting the modules / panels / arrays.
- Minimum thickness of galvanization should be at least 120 microns.
- The Mounting structure shall be so designed to withstand the speed for the wind zone of the location where a PV system is proposed to be installed.
- Suitable fastening arrangement shall be provided allowing environmental and vandal-proofing requirements
- Aluminium structures also can be used provided corrosion be provided either by coating or anodization.
- Aluminium frames should be avoided for installations in coastal areas.
- The fasteners used should be made up of stainless steel.
- The structures shall be designed to allow replacement of any module while still have approved vandal-proofing characteristics.
- The array structure shall be so designed that it will occupy minimum space without sacrificing the output from the SPV panels.
- The total load of the structure (when installed with PV modules) on the roof structure shall be less than 60 kg/m².
- The minimum clearance of the structure from the roof level should be 100mm.

JUNCTION BOXES (JBs):-

- Junction boxes (JB's) shall be made of GRP / FRP / Powder Coated Aluminium /cast aluminium alloy with full dust, water & vermin proof arrangement.
- All wires/cables must be terminated through cable lugs.
- The JB's shall be equipped with UV-resistant GPRS glands for cables
- Copper bus bars / terminal blocks must be fitted in the junction boxes to terminate each cable individually (no bunching allowed)
- Hinged doors shall have EPDM rubber gaskets to prevent water entry.
- Each Junction Box shall have High quality Suitable capacity Metal Oxide Varistors (MOVs) / SPDs, suitable Reverse Blocking Diodes.
- The Junction Boxes shall have suitable arrangement monitoring and disconnection for each of the groups.
- Suitable markings shall be provided on the bus bars for easy identification
- All fuses shall have DIN rail mountable fuse holders and shall be housed in thermoplastic IP 65 enclosures with transparent covers.



INVERTERS

The Inverter will be 12kW, Single Phase, Sigenergy or similiar

The minimum technical specification of inverters shall comply with the following:

Nominal AC output voltage and frequency	230V, 1 Phase, 50 Hz
Grid Frequency Synchronization range	± 3Hz
Temperature	25~60°C, >45°C Derating
Humidity	95%
Enclosure	IP65
Grid frequency tolerance	+/- 3Hz
Grid voltage range	±10%
No-load losses	1% of rated power
Inverter efficiency	>90%
THD	<3%
PF	>0.9
Niose	<45dB
Cooling	Smart Cooling

- A single-phase inverter shall be used unless otherwise specified by the departmental engineer. The inverter must have multiple string input ports as required by the design.
- The inverter shall be capable of complete automatic operation including wake-up, synchronization & shutdown.
- The output of power factor of the inverter shall be able to operate on a minimum load power factor of 0.8 lagging or leading
- Inverters shall have internal protection arrangement against any sustainable fault or surges in the feeder lines.
- Inverters shall have a built-in meter and data logger to monitor plant performance.
- Certifications and Standards
Safety EMC / Standard: IEC62109-1/-2, EN61000-6-1, EN61000-6-2, EN61000-6-3, EN61000-6-4.

BATTERY STORAGE

The battery storage 10kWh (Sigenergy or similar, shall comply with the following:

The latest battery technology shall be applied,

- Unless otherwise specified in the Project Specification, Lithium Titanate Oxide (LTO) batteries shall be used, with the following minimum requirements:
 - Batteries shall be equipped with battery management systems (BMS) and preferably monitor each cell individually.
 - Design life cycle of 20 000 charge cycles at 90% load discharge per cycle.
 - Cells shall be serviceable by replacement on site with minimum interruption of usability.
 - Batteries shall be serviceable over a 0-year period from date of commissioning.
- The BMS shall have the following functionality.
 - Automatic balancing of load per cell and collectively
 - Monitor load distribution per cell collectively and individually
 - Have the facility to pre-set alarms to pre-warn against fault conditions which may arise.
 - Monitor battery temperature, preferably per cell and collectively

- Monitor battery charging and load rates, preferably per cell and collectively
- The battery pack shall have a built-in monitor screen on the front panel with basic functionality for on-site monitoring.
- The battery minimum operation voltage shall be set lower than the inverter minimum voltage.
- Battery packs shall be serviceable in the field.
- Batteries shall preferably be untradeable on site as new LTO battery technology takes place.
- The Solar contractor shall ensure the availability of field service staff for a period of 10 years from first day of commissioning.

DATA ACQUISITION SYSTEM / PLANT MONITORING

A gateway control or system controller with a screen shall be provided i.e. Sigenergy or equally approved.

- A 24/7-hour data Acquisition System and logger shall be provided and managed by the solar service provider for the first twelve months after commissioning as part of the tender price.
- The software shall be of open-source design to allow other service providers access should the original service provider be replaced for any reason.
- This service shall be offered on a retainer basis to the client after the twelve-month period.
- Data Logging Provision must be included for plant control and monitoring, time and date stamped system data logs for analysis with the high quality, suitable PC.
- Metering and Instrumentation for display of systems parameters and status indication shall be provided.
- A battery management system (BMS) shall be an integral part of the mentoring system.
- Temperature probes for recording the Solar panel temperature and/or ambient temperature shall be provided complete with readouts integrated with the data logging system.
- The following parameters are accessible via the operating interface display in real time separately for solar power plant:
 - AC Voltage.
 - AC Output current.
 - Output Power
 - Power factor.
 - DC Input Voltage.
 - DC Input Current.
 - Time Active.
 - Time disabled.
 - Time Idle.
 - Power generated.
 - Protective function limits (Viz-AC over voltage, AC under voltage, over frequency, under frequency, ground fault, PV starting voltage, PV stopping voltage).

The system must have a communication module with a simcard as there is no wifi or router on site. All communication systems, subscriptions, sim card registration and fees must be paid for by the service provider five (5) to ten (10) years, which forms part of the Bill of Quantities.

PV ARRAY

- Computerized DC String/Array monitoring and AC output monitoring shall be provided as part of the inverter and/or string/array combiner box or separately.
- The data shall be recorded in a common work sheet chronologically date wise. The data file shall be MS Excel compatible. The data shall be represented in both tabular and graphical form.
- All instantaneous data shall be shown on the computer screen.
- Software shall be provided for USB download and analysis of DC and AC parametric data for individual plant.
- Provision for instantaneous Internet monitoring and download of historical data shall be also incorporated.
- Remote Server and Software for centralized Internet monitoring system shall be also provided for download and analysis of cumulative data of all the plants and the data of the solar radiation and temperature monitoring system.
- Ambient / Solar PV module back surface temperature shall be also monitored on continuous basis.
- Simultaneous monitoring of DC and AC electrical voltage, current, power, energy and other data of the plant for correlation with solar and environment data shall be provided.
- Remote Monitoring and data acquisition through Remote Monitoring System software at the owner / MEDA location with latest software/hardware configuration and service connectivity for online / real time data monitoring / control complete to be supplied and operation and maintenance / control to be ensured.


CABLES

Cables of appropriate size used in the system shall comply with the following specifications:

- Shall meet IEC 60227/IS 694, IEC 60502/IS1554 standards
- Voltage rating 660/1000V
- Excellent resistance to heat, cold, water, oil, abrasion, UV radiation
- Flexible
- Sizes of cables between array interconnections, array to junction boxes, junction boxes to Inverter etc. shall be so selected to keep the voltage drop (power loss) of the entire solar system to the minimum (2%)
- For the DC cabling, XLPE or, XLPO insulated and sheathed, UVstabilized single core multi-stranded flexible copper cables shall be used; Multi-core cables shall not be used.
- For the AC cabling, PVC or, XLPE insulated and PVC sheathed single or, multi-core multi-stranded flexible copper cables shall be used; Outdoor AC cables shall have a UV-stabilized outer sheath.
- The cables (as per IS) should be insulated with a special grade PVC compound formulated for outdoor use. Outer sheath of cables shall be electron beam cross-linked XLPO type and black in colour.
- The DC cables from the SPV module array shall run through a galvanised steel of adequate diameter to SANS specifications.
- Cables and wires used for the interconnection of solar PV modules shall be provided with solar PV connectors (MC4) and couplers.
- All cables and conduit pipes shall be saddled at intervals not exceeding 500mm
- The minimum DC cable size shall be 4.0 mm² copper. (Aluminum cables are not allowed).

Cable Routing / Marking:

- All cable/wires are to be routed in conduit or sleeve channels and suitably tagged and marked with proper manner by good quality ferule or by other means so that the cable easily identified.
- Cable drum numbers / batch numbers shall be embossed/ printed at every one meter and indicated on the as built drawings on installation completion.
- Cable Jackets shall also be electron beam cross-linked XLPO, flame retardant, UV resistant and black in colour.
- All cables and connectors for use for installation of solar field must be of solar grade which can withstand harsh environment conditions including high temperatures, UV radiation, rain, humidity, dirt, salt, burial and attack by moss and microbes for 25 years and voltages as per latest IEC standards.
- DC cables used from solar modules to array junction box shall be solar grade copper (Cu) with XLPO insulation and rated for 1.1kV as per relevant standards only.
- The ratings given are approximate.
- All the cables required for the plant shall be provided by the solar contractor.

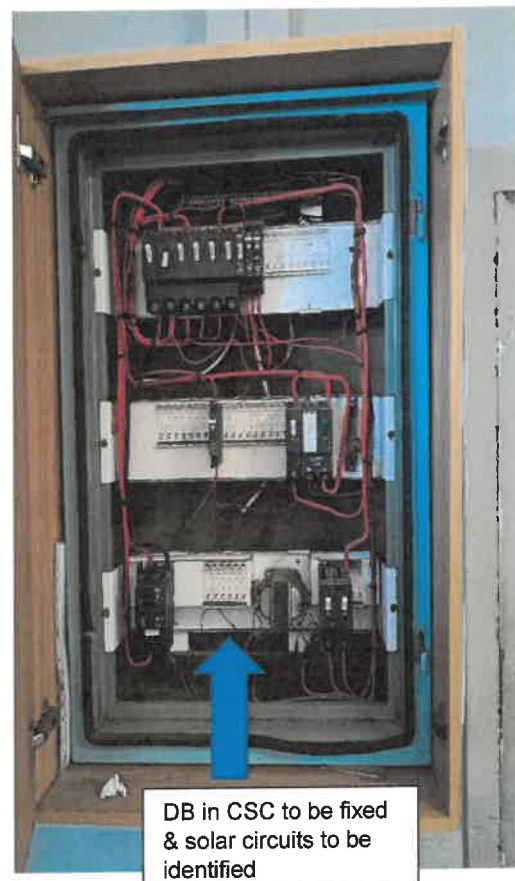

SECTION 3.0 PROJECT SPECIFICATION

1. SCOPE

This contract involves the manufacture, supply, delivery, installation and commissioning of the following:

- 1.1. Building electrical installation as detailed in this specification and the drawings.
- 1.2. Coordination with other contractors, to ensure that service sleeves and power will be available for testing and commissioning of equipment. The programs for the various contractors must be coordinated with the main contractor.

The contractors include but is not necessarily limited to the following:

- 1.2.1. Communication and related systems
- 1.2.2. Solar Installation
- 1.2.3. Air conditioning

In case of discrepancies, the following order of precedence shall apply:

- Statutory requirements.
- Bills of quantities
- Project Specification

2. CABLE SLEEVE PIPES

Where cables cross under roadways, other services and where cables enter buildings, the cables shall be installed in earthenware or high-density polyethylene pipes. The ends of all sleeves shall be sealed with a non-hardening watertight compound after the installation of cables. All sleeves intended for future use shall likewise be sealed.

The cable sleeves shall comply with the general electrical specification part A&B by the National Department of Public Works and Infrastructure.

3. ELECTRICAL EQUIPMENT

Equipment must comply with the general technical specification, schedules of BOQ forming part of this specification

4. DRAWINGS

Contractor will also provide design and as build drawings for this installation.

5. BALANCING OF LOAD

The Contractor is required to balance the load as indicated on the line diagrams and in the schedules of distribution boards for each building.

6. EARTHING AND BONDING

The Contractor will be responsible for all earthing and bonding of the building and installation. The earthing and bonding is to be carried out strictly as described in the General Technical Specification and to the satisfaction of the Client's representative.

7. EXTENT OF WORK

For this installation, the Specialist Service Provider will design installation, sign of designs by an Engineer and register this installation with the Municipality/ESKOM as per the SSEG regulation. The work covered under this contract comprises the complete design, supply and installation of a PV System including the inverter, batteries, gateway, combiner box and all cabling/accessories. The contractor to trace and move the lighting/socket outlet loads from DB in CSC to a separate solar DB, only lights and socket outlet circuits in CSC. The Electrical installation will be handed over in working order, as per this specification, including installations, testing, commission and certification of this solar system. COC for the installation as well as lightning/earthing certificate.

8. MAIN ELECTRICAL SUPPLY AND CONNECTION

The main electrical supply is from the Municipal/ESKOM miniature substation.

9. CONDUIT AND WIRING

Conduit and conduit accessories shall be PVC and black enamelled / galvanised screwed conduit, or black enamelled / galvanized plain end conduit in accordance with SABS 162, 763 and 1007 respectively for all exposed conduit.

9.1. Power Trunking

The Contractor shall be responsible for the supply and installation of all power trunking complete with corner pieces, end pieces, junction pieces, supply conduits, cover plates and power outlets as specified and indicated on the drawings. The rate per meter for the power trunking shall include for the accessories mentioned above.

The power trunking must comply with SABS 1197. The Contractor must ensure that the power trunking is installed to satisfaction of the Engineer before commencing with the wiring of the power trunking. Power trunking shall be of the three-tier steel type, secured to the walls at floor level with "Fisher" or similar approved plugs. Sleeves supplying power, Telkom or other services to the trunking shall end direct into the channel intended to provide the specific service and may not be routed through other channels.

10. CABLES

The Contractor shall supply and completely install all distribution cables as indicated on the drawings.

The storage, transportation, handling and laying of the cables shall be according to first class practice, and the contractor shall have adequate and suitable equipment and labour to ensure that no damage is done to cables during such operations.

11. LABELING OF ELECTRICAL OUTLETS

All electrical power outlets and light switches and cables shall be labelled on each outlet in accordance with the distribution board name and circuit number as indicated on the drawings.

The tender rates in the bill of quantities shall include the cost of the labelling.

Labelling may be done with "Dymo" tape or similar approved system prior to the hand-over of the installation to the client.

The labelling must be coordinated with the labelling system of the distribution boards.

SECTION 4 – SCHEDULES OF TECHNICAL INFORMATION

The following schedules must be completed for tender submission, failure of which the tender may be disqualified:

4.2 Equipment Detail

NO	ITEM	REMARKS
1.	Manufacturer's Name	
2.	Country of Origin	
3.	Inverter manufacturer's model No. and year of manufacture	
4.	Battery manufacturer's model No. and year of manufacture	
5.	Solar panel manufacturer's model No. and year of manufacture	
6.	Inverter kW rating ay 0,8 power factor (Full data sheet and specifications to be attached to the tender).	
7.	Battery pack kWh capacity for the full operating capacity (Full data sheet and specifications to be attached to the tender).	
8.	Solar panel kW rating per panel (Full data sheet and specifications to be attached to the tender)	
9.		
10.		
11.		
12.		

4.3 Recommended Spare Parts and Maintenance Facilities

NO	ITEM	REMARKS
1	Approximate value of spares carried in stock?	
2	Where are these spares held in stock?	
3	What facilities exist for the servicing of the equipment offered?	
4	Where are these facilities located?	

4.4 Deviation from the Specification as Alternative (State Briefly)

Full design details to be provided in case of a major deviation from the specification and quantities with new bills of quantities to be provided with the tender offer.

The main offer as specified will form the basis of evaluation of tenders and must be provided to avoid disqualification of the tender.

NO	DESCRIPTION

and details of any risk associated with any hazard at the construction site, in order to identify the steps needed to be taken to remove, reduce or control such hazard. *This Risk Assessment and the steps identified will be the basis or point of departure for the Health and Safety Plan.* The Health and Safety Plan shall include documented 'Methods of Statement' (see definitions under Construction Regulations) detailing the key activities to be performed in order to reduce as far as practicable, the hazards identified in the Risk Assessment.

The Department of Public Works is tasked to provide accommodation and operational facilities to a very large proportion of the approximate 35 National Departments responsible for the governance of the Department of Public Works. A very large number of State employees and public users of the facilities and the services provided there-in directly interacts with the facilities provided by the well-being, health and safety of a great number of people. This Department thus has directly or indirectly, an impact on the Republic of South Africa as well as the National Parliament.

In this a high premium is to be placed on the health and safety of the most valuable assets of the Department of Public Works. These are its personnel, the personnel of its Clients and the physical assets of which it is the custodian and may also include the public as well. The responsibilities the Department and relevant stakeholders have toward its employees and other people present in the facilities or on the sites are captured further in this specification document. These responsibilities stem from both moral, civil and a variety of legal obligations. The Principal Contractor is to take due cognisance of the above statement.

Every effort has been made to ensure that this specification document is accurate and adequate in all respects. Should it however, contain any errors or omissions they may not be considered as grounds for claims under the contract for additional reimbursement or extension of time, or relieve the Principal Contractor from his responsibilities and accountability in respect of the project to which this specification document pertains. Any such inaccuracies, inconsistencies and/or inadequacies must immediately be brought to the attention of the Agent and/or Client.

2. SCOPE OF HEALTH AND SAFETY SPECIFICATION DOCUMENT

These Specifications should be read in conjunction with the Act, the Construction Regulations and all other Regulations and Safety Standards which were or will be promulgated under the Act or incorporated into the Act and be in force or come into force during the effective duration of the project. The stipulations in this specification, as well as those contained in all other documentation pertaining to the project, including contract documentation and technical specifications shall not be interpreted, in any way whatsoever, to countermand or nullify any stipulation of the Act, Regulations and Safety Standards which are promulgated under, or incorporated into the Act.

3. PURPOSE

The Department is obligated to implement measures to ensure the health and safety of all people and properties affected under its custodianship or contractual commitments, and is further obligated to monitor that these measures are structured and applied according to the requirements of these Health and Safety Specifications.

The purpose of this specification document is to provide the relevant Principal Contractor (and his /her contractor) with any information other than the standard conditions pertaining to construction sites which might affect the health and safety of persons at work and the health and safety of persons in connection with the use of plant and machinery; and to protect persons other than persons at work against hazards to health and safety arising out of or in connection with the activities of persons at work during the carrying out of construction work for the Department of Public Works. The Principal Contractor (and his /her contractor) is to be briefed on the significant health and safety aspects of the project and to be provided with information and requirements on inter alia:

- a) Safety considerations affecting the site of the project and its environment;
- b) Health and safety aspects of the associated structures and equipment;
- c) submissions on health and safety matters required from the Principal Contractor (and his /her contractor); and
- d) the Principal Contractor's (and his /her contractor) health & safety plan.

To serve to ensure that the Principal Contractor (and his /her contractor) is fully aware of what is expected from him/her with regard to the Occupational Health and Safety Act, 1993 (Act No. 85 of 1993) and the Regulations made there-under including the applicable safety standards, and in particular in terms of Section 6,7 and 8 of the construction regulation (2014).

To inform the Principal Contractor that the Occupational Health and Safety Act, 1993 (Act 85 of 1993) in its entirety shall apply to the contract to which this specification document applies. The Construction Regulations promulgated on 07 February 2014.

4. DEFINITIONS - The most important definitions in the Act and Regulations pertaining to this specification document are hereby extracted.

“Purpose of the Act” – To provide for the health and safety of persons at work and the health and safety of persons in connection with the use of plant and machinery; the protection of persons other than persons at work against hazards to health and safety arising out of or in connection with the activities of persons at work; to establish an advisory council for occupational health and safety; and to provide for matters connected therewith.

“Health & Safety Specification” – means a document that includes information required under the construction regulation and obtained from the clients & designers during the early planning & design stage for a specific project on a specific site for use by the contractors when preparing their tenders or bids to clients.

“Health & Safety Plan” – means a document which is site specific and includes all identified hazards, safe work procedures to mitigate, reduce & control the hazards identified in a project.;

“Agent” – means any person who acts as a representative for a client;

“Client” – means any person for whom construction work is performed;

“Construction Health & Safety Agent (SACPCMP)” – The person or entity appointed by the client through the Agent and who has a full authority and obligation to act on the clients behalf in terms of the construction regulations;

“Construction Work” is defined as any work in connection with –

- (a) the erection, maintenance, alteration, renovation, repair, demolition or dismantling of or addition to a building or any similar structure;
- (b) the installation, erection, dismantling or maintenance of a fixed plant where such work includes the risk of a person falling;
- (c) the construction, maintenance, demolition or dismantling of any bridge, dam, canal, road, railway, runway, sewer or water reticulation system or any similar civil engineering structure; or
- (d) the moving of earth, clearing of land, the making of an excavation, piling, or any similar type of work;

“Contractor” – means an employer, as defined in Section 1 of the Act, who performs construction work and includes Principal Contractors;

“Contract Amount” Financial value of the contract at the time of the award of the contract, exclusive of all allowance and any value added tax or sales tax which the law requires the employer to pay to the contractor.

“Practical Completion Certificates” A certificates issued in terms of a contract by the employer, signifying that the whole of the construction works have reached a state of readiness for occupation or use for the purposes intended, although some minor work may be outstanding.

“Accident” – means unplanned occurrence that happens due to the unsafe condition and may cause injury to a person, damage to the property, material, plant, equipment and the environment;

“Hazard” – means anything including work activities and practices with the potential to cause harm;

“Risk” – means the likelihood that harm will occur and the subsequent consequences.

“Risk assessment” – means a process to determine any risk associated with any hazard at a construction site in order to identify the steps needed to be taken to mitigate, reduce or control such hazards.

Health and Safety File” – means a file, or other record in permanent form, containing the information required a contemplated in the regulations;

5. OCCUPATIONAL HEALTH & SAFETY MANAGEMENT

5.1 Structure and Organization of OH&S Responsibilities

5.1.1. *Overall Supervision and Responsibility for OH&S*

- a) The Client and/or its Agent on its behalf to ensure that the Principal Contractor, appointed in terms of Construction Regulation 4(1)(c), implements and maintains the agreed and approved H&S Plan. Failure on the part of the Client or Agent to comply with this requirement will not relieve the Principal Contractor from any one or more of his/her duties under the Act and Regulations.
- b) The Chief Executive Officer of the Principal Contractor in terms of Section 16 (1) of the Act to ensure that the Employer (as defined in the Act) complies with the Act. The pro forma Legal Compliance Audit may be used for this purpose by the Principal Contractor or his/her appointed contractor.
- c) All OH&S Act (85 /1993), Section 16 (2) appointee/s as detailed in his/her/their respective appointment forms to regularly, in writing, report to their principals on matters of health and safety per routine and ad hoc inspections and on any deviations as soon as observed, regardless of whether the observation was made during any routine or ad hoc inspection and to ensure that the reports are made

available to the principal Contractor to become part of site records (Health & Safety File).

- d) The Construction Supervisor and Assistant Construction Supervisor/s appointed in terms of Construction Regulation 6 to regularly, in writing, report to their principals on matters of health and safety per routine and ad hoc inspections and on any deviations as soon as observed, regardless of whether the observation was made during any routine or ad hoc inspection and to ensure that the reports are made available to the principal Contractor to become part of site records (Health & Safety File).
- e) All Health and Safety Representatives (SHE-Reps) shall act and report as per Section 18 of the Act.

5.12 Required appointments as per the Construction Regulations:-

Item	Regulation	Appointment	Responsible Person
1.	3.	Application Construction work permit	Client
2.	5(1)(k)	Principal contractor for each phase or project	Client
3.	5(6)	Construction Health & Safety Agent	Client
4.	7.(1)(c)	Contractor	Principal Contractor
5.	7(3)	Contractor	Contractor
6.	8(1)	Construction manager	Contractor
7.	8(2)	Assistance Construction manager	Contractor
8.	6(1)	Construction supervisor	Contractor
9.	6(2)	Construction supervisor sub-ordinates	Contractor
10.	8(5)	Construction Safety Officer	Contractor
11.	8(8)	Responsible employee	
12.	9(1)	Person to carry out risk assessment	Contractor
13.	10(1)	Fall protection planner	Contractor
14.	12(1)	Temporal work designer	
15.	12(2)	Supervisor of temporal work operation	
16.	13(1)	Excavation supervisor	Contractor
17.	13(2)(k)	Competent person in the use of explosive for excavations	Contractor
18.	14(11)	Explosives expert	Contractor
19.	14(1)	Supervisor demolition work	Contractor
20.	14(2)	Scaffold supervisor	Contractor
21.	16(1)	Suspended platform supervisor	Contractor
22.	18(1)a	Rope access	Contractor
23.	19(8)(a)	Material hoist inspector	Contractor
24.	20(1)	Bulk mixing plant supervisor	Contractor
25.	21(2)	Explosive actuated fastening device inspector	Contractor
26.	21(2)(g)	Explosive actuated fastening device cartridge, nails and studs: issuer & collector	Contractor
27.	23 (1)	Operator : construction vehicle and mobile plant	Contractor
28.	28 (a)	Stacking and storage supervisor	Contractor
29.	29 (h)	Fire equipment inspector	Contractor

5.2 *Communication, Participation & Consultation*

- 5.2.1 Occupational Health & Safety matters/issues shall be communicated between the Employer, the Principal Contractor, the other Contractors, the Designer and other concerned parties shall be through the H&S Committee or other means determined by the client.
- 5.2.2 In addition to the above, communication may be directly to the Client or his appointed Agent, verbally or in writing, as and when the need arises.
- 5.2.3 Consultation with the workforce on OH&S matters will be through their Supervisors and H&S Representatives ('SHE – Reps')
- 5.2.4 The Principal Contractor will be responsible for the dissemination of all relevant OH&S information to the other Contractors e.g. design changes agreed with the Client and/or its Agent on its behalf and the Designer, instructions by the Client and/or his/her agent, exchange of information between Contractors, the reporting of hazardous/dangerous conditions/situations etc.

6. INTERPRETATION

- a) The Occupational Health and Safety Act and all its Regulations, with the exception of the Construction Regulations, distinguish between the roles, responsibilities and functions of employers and employees respectively. It views consultants and contractors as employees of the "owner" of a construction or operational project, the "owner" being regarded as the employer.
- b) (The position taken by the Construction Regulations is that the "owner", in terms of its instructions, operates (has to operate) in the role of client as per relevant definition. The contractors working for the "client" are seen to be in two categories, i.e. the Principal Contractor and Contractors.

- c) The Principal Contractor has to take full responsibility for the health and safety on the site of the relevant project / contract. This includes monitoring health and safety conditions and overseeing administrative measures required by the Construction Regulations from all contractors on the project site.

7. RESPONSIBILITIES

7.1 Client

- a) The Client or his appointed Agent on his behalf will appoint each Principal Contractor for this project or phase/section of the project in writing for assuming the role of Principal Contractor as intended by the Construction Regulations.
- b) The Client or his appointed Agent on his behalf shall discuss and negotiate with the Principal Contractor the contents of the health and safety plan of the both Principal Contractor and Contractor for approval.
- c) The Client or his appointed Agent on his behalf will take reasonable steps to ensure that the health and safety plan of both the Principal Contractor and Contractor is implemented and maintained. The steps taken will include periodic audits at intervals of at least once every month.
- d) The Client or his appointed Agent on his behalf, will prevent the Principal Contractor and/or the Contractor from commencing or continuing with construction work should the Principal Contractor and/or the Contractor at any stage in the execution of the works be found to:
- have failed to have complied with any of the administrative measures required by the Construction Regulations in preparation for the construction project or any physical preparations necessary in terms of the Act;
 - have failed to implement or maintain their health and safety plan;
 - have executed construction work which is not in accordance with their health and safety plan; or

- act in any way which may pose a threat to the health and safety of any person(s) present on the site of the works or in its vicinity, irrespective of him/them being employed or legitimately on the site of the works or in its vicinity.

7.2 Principal Contractor

- a) The Principal Contractor shall accept the appointment under the terms and Conditions of Contract. The Principal Contractor shall sign and agree to those terms and conditions and shall, before commencing work, notify the Department of Labour of the intended construction. Annexure 2 of this construction regulation contains a "Notification of Construction Work" form. The Principal Contractor shall submit the notification in writing prior to commencement of work and inform the Client or his Agent accordingly.
- b) The Principal Contractor shall ensure that he is fully conversant with the requirements of this Specification and all relevant health and safety legislation.
- c) The Principal Contractor will in no manner or means be absolved from the responsibility to comply with all applicable sections of the Act, the Construction Regulations or any Regulations proclaimed under the Act or which may perceivable be applicable to this contract.
- d) The Principal Contractor shall provide and demonstrate to the Client a suitable and sufficiently documented health and safety plan based on this Specification, the Act and the Construction Regulations, which shall be applied from the date of commencement of and for the duration of execution of the works. This plan shall, as appendices, include the health and safety plans of all Sub-contractors for which he has to take responsibility in terms of this contract.
- e) The Principal Contractor shall provide proof of his registration and good standing with the Compensation Fund or with a licensed compensation insurer prior to commencement with the works.
- f) The Potential Principal Contractor shall, in submitting his tender, demonstrate that he has made provision for the cost of compliance with the specified health and safety

requirements, the Act and Construction Regulations. (Note: This shall have to be contained in the conditions of tender upon which a tenderer's offer is based.)

- g) The Principal Contractor shall consistently demonstrate his competence and the adequacy of his resources to perform the duties imposed on the Principal Contractor in terms of this Specification, the Act and the Construction Regulations.
- h) The Principal Contractor shall ensure that a copy of his health and safety plan is available on site and is presented upon request to the Client, an Inspector, Employee or Sub-contractor.
- i) The Principal Contractor shall ensure that a health and safety file, which shall include all documentation required in terms of the provisions of this Specification, the Act and the Construction Regulations, is opened and kept on site and made available to the Client or Inspector upon request. Upon completion of the works, the Principal Contractor shall hand over a consolidated health and safety file to the Client.
- j) The Principal Contractor shall, throughout execution of the contract, ensure that all conditions imposed on his Sub-contractors in terms of the Act and the Construction Regulations are complied with as if they were the Principal Contractor.
- k) The Principal Contractor shall from time to time evaluate the relevance of the Health and Safety Plan and revise the same as required, following which revised plan shall be submitted to the Client and/or his/her Agent for approval.

7.3 Contractor

The contractor must demonstrate to the Principal Contractor that he has the Necessary competencies and resources to perform the construction work safely.

7.4 Responsibilities of Construction Health & Safety Agent (SACPCMP)

The construction Health & Safety Agent act as a link between the client, Principal Contractor and the project team members with respect to health & Safety, They are Required to ensure that the client carry out its H&S responsibilities in terms of Legislation as well as to co-ordinate and ensure good H&S practices are maintained Throughout the duration of the project. In many cases this role starts from project Initiation to project close-out.

- a) H&S competence: In the event that the client is unable to satisfy the requirements of the Construction Regulations for whatever reasons, the construction H&S agent may be appointed to perform these functions on behalf of the client. Given the need to appoint a registered construction H&S agent that is competent and adequately resourced with respect to H&S matters.
- b) H&S goals: It is important that the construction H&S agents demonstrate clearly to clients how they are going to contribute to the achievement of any client H&S goals and objectives. They should also set their own H&S goals.
- c) H&S responsibilities: Prior to accepting the H&S agent appointment from clients, H&S agents need to ensure that they brief clients fully on the client's particular responsibilities in terms of the OH&SA of 1993 and Construction Regulations as amended from time to time. In the absence of acceptance by clients of these responsibilities, H&S agents will not be able to adequately meet their own H&S responsibilities and duties.
- d) H&S information: H&S agents must provide the designer or design team with all H&S information to enable them to conduct a design HIRA to identify the significant hazards that need to be included in the H&S specification. This information may be gathered from multiple sources such as, for example, discussion with the client, previous historical use of the site or facility, previous surveys and investigations and past H&S files.

8. SCOPE OF WORK

These specifications are applicable to the specific scope of work pertaining to the above-mentioned project as detailed in the tender documents, this amongst all includes for example:

- a) Construction, erecting, alteration, renovations, refurbishment, repairs, demolishing or dismantling of building and structures.
 - Site clearance
 - Site hoarding, demarcation and demolition works
 - excavations, filling, compaction, evening surface
 - Piling (by drilling, excavating,)
 - Temporal works
- b) Construction, erecting, alteration, renovations, refurbishment, repairs, demolishing or dismantling of any bridge, dam, canal, road, railway, runaway, sewer, or water reticulation system or any civil engineering structure or type of work
- c) Construction of a new two storied Administration building.
 - Preparation of site by leveling, compaction etc.
 - Excavations for parking areas/services

9. PREPARING A HEALTH & SAFETY PLAN

- (a) The level of detail required for a H&S plan will depend on how complex the workplace is (in particular, the number of contractors at the workplace at any one time) and the risks involved in the work. The plan must be easily accessible in a construction site and it must be clearly understood by management, supervisors & workers on construction site.
- (b) The plan must be implemented, maintained and kept up to date during the construction of the project.
- (c) The principal contractor should prepare a H&S plan that includes
 - project information;
 - client requirements for H&S management on the project;
 - Environmental restrictions and existing on-site risks arrangements, imposed

by others or developed by the principal contractor, to control significant site H&S risks; H&S file & project H&S review.

(d) The H&S plan should include the following information:

- details of the client, that is the person commissioning the construction work, for example their name, representative and contact details;
- details of the principal contractor;
- details of the construction project, for example address of the workplace, anticipated start and end date and a brief description of the type of construction work that the H&S plan will cover;
- details on how subcontractors will be managed and monitored, including how the principal contractor intends to implement and ensure compliance with the H&S plan such as checking on the performance of subcontractors and how non-compliance will be handled; and
- details on how the risks associated with falls, falling objects, moving plant, electrical work and all high risk construction work that will take place on a construction project will be managed.

(e) The H&S plan should also include information on:

- the provision and maintenance of a hazardous chemicals register, safety data sheets and hazardous chemicals storage;
- the safe use and storage of plant;
- the development of a construction project traffic management plan;
- obtaining and providing essential services information – electrical, gas, telecom, water and similar services;
- workplace security and public safety; and
- ensuring workers have appropriate licences and training to undertake the construction work.

(f) The H&S plan must contain:

- a general description of the type of work activities involved in the project and not just a description of the facility to be constructed;
- the project program or schedule details, including start and finish dates, showing principal activities;
- details of client, design team, principal contractor, subcontractors, and major suppliers; and
- extent and location of relevant existing records, surveys, site investigation and geotechnical reports, 'as-built' plans, H&S files.

10. HEALTH AND SAFETY FILE

- a) The H&S file is a document prepared by the principal contractor containing important project H&S information for use by the owner of the completed structure after construction has been completed.
- b) The principal contractor is responsible for producing an H&S file. It contains important project H&S information for use by the owner of the completed structure after construction has been completed. It is essential that the process of compiling the file commences as early as possible to ensure sufficient time to gather the required information.
- c) The Principal Contractor must, in terms of Construction Regulation 7(7), keep a Health & Safety File on site at all times that must include all documentation required in terms of the Act and Regulations and must also include a list of all Contractors on site that are accountable to the Principal Contractor and the agreements between the parties and details of work being done. A more detailed list of documents and other legal requirements that must be kept in the Health & Safety File.
- d) The contractor must ensure that the client's format and layout of the H&S file is adhered to. The contractor must identify the responsible person that will prepare the H&S file and who will be responsible for the drafting of as-built drawings. The contractor must establish procedures:
- e) The Health and Safety File will remain the property of the Client and/or its Agent on its behalf throughout the period of the project and shall be consolidated and handed over to the Client and/or its Agent on its behalf at the time of completion of the project.

11. OH&S GOALS AND OBJECTIVES AND ARRANGEMENTS FOR MONITORING AND REVIEWING OH&S PERFORMANCE

The Principal Contractor is required to maintain an acceptable disabling incident frequency rate (DIFR) and report on this to the Client and/or its Agent on its behalf on a monthly basis.

11.1 IDENTIFICATION OF HAZARDS AND DEVELOPMENT OF RISK ASSESSMENTS, STANDARD WORKING PROCEDURES (SWP) AND METHOD STATEMENTS

The Principal Contractor is required to develop Risk Assessments, Standard Working Procedures (SWP) and Method Statements for each activity executed in the contract or project.

The identification of hazards is over and above the hazards identification programme and those hazards identified during the drafting of the Health and Safety Plan.

11.1.1 Monthly Audit by Client and/or its Agent.

The Client and/or its Agent on its behalf will be conducting Periodic Audits at times agreed with the Principal Contractor Audit to comply with Construction Regulation 4(1)(d) to ensure that the principal Contractor has implemented, is adhering to and is maintaining the agreed and approved OH&S Plan.

- a) A representative of the Principal Contractor and the relevant Health and Safety Representative(s) (SHE-Reps) must accompany the Client and/or its Agent on its behalf on all Audits and Inspections and may conduct their own audit/inspection at the same time. Each party will, however, take responsibility for the results of his/her own audit/inspection results. The Client and/or its Agent on its behalf may require to be handed a copy of the minutes of the previous Health and Safety Committee meeting reflecting possible recommendations made by that committee to the Employer for reference purposes.

11.1.2 Health & Safety incident/accident reporting & investigations

- a) The Principal Contractor shall report all incidents where an employee is injured on duty to the extent that he/she:
 - i. dies
 - ii. becomes unconscious
 - iii. loses a limb or part of a limb
 - iv. is injured or becomes ill to such a degree that he/she is likely either to die or to suffer a permanent physical defect or likely to be unable for a period of at

least 14 days either to work or continue with the activity for which he/she was usually employed

OR where:

- i. a major incident occurred
 - ii. the health or safety of any person was endangered
 - iii. where a dangerous substance was spilled
 - iv. the uncontrolled release of any substance under pressure took place
 - v. machinery or any part of machinery fractured or failed resulting in flying, falling or uncontrolled moving objects
 - vi. Machinery ran out of control, to the Provincial Director of the Department of Labour within seven days and at the same time to the Client and/or its Agent on its behalf.
- b) The Principal Contractor is required to provide the Client and/or its Agent on its behalf with copies of all statutory reports required in terms of the Act and the Regulations.
- c) The Principal Contractor is required to provide the Client and/or its Agent on its behalf with a monthly "SHE Risk Management Report".
- d) The Principal Contractor is required to provide a.s.a.p. the Client and/or its Agent on its behalf with copies of all internal and external accident/incident investigation reports.
- The Principal Contractor is responsible to oversee the investigation of all accidents/incidents where employees and non-employees were injured to the extent that he/she/they had to receive first aid or be referred for medical treatment by a doctor, hospital or clinic. (General Administrative Regulation 9)
- (e) The results of the investigation to be entered into the Accident/Incident Register listed above. (General Administrative Regulation 9)

- (f) The Principal Contractor is responsible for the investigation of all non-injury incidents as described in Section 24 (1) (b) & (c) of the Act and keeping a record of the results of such investigations including the steps taken to prevent similar incidents in future.
- (g) The Principal Contractor is responsible for the investigation of all accidents relating to the construction site and keeping a record of the results of such investigations including the steps taken to prevent similar accidents in future.
- (h) Notwithstanding the requirements of Section 24 of the Act, ALL incidents shall be investigated and reported on in writing, irrespective of whether such incident gave rise to injury or damage.
- Determine the underlying H&S deficiencies and other contributory factors
 - Identification of corrective/preventative actions and continual improvement
 - Communicating the outcome/results and documenting the events of the investigation.
- (i) **Reporting Of Near-Misses**
- Department of Public Works views the reporting of near misses as a critical component in creating a positive health and safety awareness culture on site.
 - Department of Public Works retains the right to enforce the reporting of near misses within 24 hours of occurrence.

12. Review

The Principal Contractor is to review the Hazard Identification, Risk Assessments and Standard Work Processes at each Production Planning and Progress Report meeting as the construction work develops and progresses and each time changes are made to the designs, plans and construction methods and processes.

The Principal Contractor must provide the Client and/or its Agent on its behalf, other Contractors and all other concerned parties with copies of any changes, alterations or amendments as contemplated in the above paragraph.

12.1 Site Rules and other Restrictions

a) *Site OH&S Rules*

The Principal Contractor must develop a set of site-specific OH&S rules that will be applied to regulate the Health and Safety Plan and associated aspects of the construction. When required for a site by law, visitors and non-employees upon entering the site shall be issued with the proper Personal Protective Equipment (PPE) as and when necessary.

b) *Security Arrangements*

The Principal Contractor must establish site access rules and implement and maintain these throughout the construction period. Access control must include the rule that non-employees shall at all times be provided with fulltime supervision while on site. The Principal Contractor must develop a set of Security rules and procedures and maintain these throughout the construction period.

If not already tasked to the H&S Officer appointed in terms of Construction Regulation, the Principal Contractor must appoint a competent person who must develop contingency plans for any emergency that may arise on site as indicated by the risk assessments.

12.1.1 Appointment of Health & Safety Representatives

a) *H&S Representatives('SHE – Reps')*

Where the Principal Contractor employs more than 20 persons (including the employees of other Contractors (sub-contractors) he has to appoint one H&S Representatives for every 50 employees or part thereof. (Section 17 of the Act and General Administrative Regulation 6. & 7.)

H&S Representatives must be appointed in writing and the designation shall be in accordance with the Collective Agreement as concluded between the parties as is required in terms of General Administration Regulation 6.

12.1.2 Duties and Functions of the H&S Representatives

- The Principal Contractor must ensure that the designated H&S Representatives conduct at least a weekly inspection of their respective areas of responsibility using a checklist developed by a Principal Contractor.
- The report must be consolidated and submitted to the Health & Safety Committee.
- H&S Representatives must form part of the incident/accident investigating team.

12.1.3 Establishment of H&S Committee(s)

- The Principal Contractor must establish H&S Committees consisting of designated H&S Representatives together with a number of Employers Representatives appointed as per Section 19(3) that are not allowed to exceed the number of H&S Representatives on the committee.
- The persons nominated by the employer on a H&S Committee must be designated in writing for such period as may be determined by him. The H&S Committee shall co-opt advisory (temporary) members and determine the procedures of the meetings including the chairmanship.
- The H&S Committee must meet minimum monthly and consider, at least, an agreed Agenda for the first meeting. Thereafter the H&S Committee shall determine its own procedures.

12.1.4 Training & Awareness

The contents and syllabi of all training required by the Act and Regulations including any other related or relevant training as required must be included in the Principal Contractor's Health and Safety Plan and Health and Safety File.

a) *Training & Induction*

All employees performing work or task on site that potentially impact on H&S must be competent & have the necessary appropriate education, training & experience.

All the training must be closely aligned with the risk profile of the project; procedures must be put in place to ensure that all workers are aware of the consequences of their work activities & benefits of improved H&S performance.

All employees of the Principal and other Contractors must be in possession of proof of General Induction training

b) *Site Specific Induction Training*

All employees of the Principal and other Contractors must be in possession of Site Specific Occupational Health and Safety Induction or other qualifying training.

c) *Other Training*

All operators, drivers and users of construction vehicles, mobile plant and other equipment must be in possession of valid proof of training.

13. PROJECT/SITE SPECIFIC REQUIREMENTS

The following is a list of specific activities and considerations that have been identified for the project and site and for which Risk Assessments, Standard Working Procedures (SWP), management and control measures and Method Statements (where necessary) have to be developed by the Principal Contractor:

- a) Clearing & grubbing the area/site
- b) Site establishment
- c) Dealing with existing structures
- d) Location of existing services
- e) Boundary & Access control/Public liability exposures
- f) Protection against heat exhaustion, dehydration, wet & cold conditions
- g) Dealing with HIV & aids other related diseases
- h) Use of portable electrical & explosive tools
- i) Any Excavation work
- j) Any welding work
- k) Loading & offloading of trucks
- l) Driving & operations of Construction vehicles & mobile plant
- m) Temporal works and
- n) Construction work as defined in the construction regulation 2014

14. OUTLINED DATA, REFERENCES AND INFORMATION ON CERTAIN AND/OR SPECIFIC OBLIGATORY REQUIREMENTS TO ENSURE COMPLIANCE

Administrative & Legal Requirements

OHS Act Section/ Regulation	Subject	Requirements
Construction. Regulation	Notice of carrying out Construction work	- Department of Labour notified - Copy of Notice available on Site
General Admin. Regulation 4	Copy of OH&S Act (Act 85 of 1993)	- Updated copy of Act & Regulations on site. - Readily available for perusal by employees.
COVID Act Section 80	Registration with Compensation Insurer.	Written proof of registration/Letter of good standing available on Site
Construction. Regulation 4 & 5(1)	H&S Specification & Programme	- H&S Spec received from Client and/or its Agent on its behalf - OH&S programme developed & Updated regularly
Section 8(2)(d) Construction. Regulation 7	Hazard Identification & Risk Assessment	- Hazard Identification carried out/Recorded - Risk Assessment and – Plan drawn up/Updated - RA Plan available on Site - Employees/Sub-Contractors informed/trained
Section 16(2)	Assigned duties (Managers)	Responsibility of complying with the OH&S Act assigned to other person/s by CEO.
Construction. Regulation 6(1)	Designation of Person Responsible on Site	Competent person appointed in writing as Construction Supervisor with job description
Construction. Regulation 6(2)	Designation of Assistant for above	Competent person appointed in writing as Assistant Construction Supervisor with job description
Section 17 & 18 General Administrative Regulations 6 & 7	Designation of Health & Safety Representatives	- More than 20 employees - one H&S Representative, one additional H&S Rep. for each 50 employees or part thereof. - Designation in writing, period and area of responsibility specified in terms of GAR 6 & 7 - Meaningful H&S Rep. reports. - Reports actioned by Management.

Section 19 & 20 General Administrative Regulations 5	Health & Safety Committee/s	- H&S Committee/s established. - All H&S Reps shall be members of H&S Committees - Additional members are appointed in writing. - Meetings held monthly, Minutes kept. - Actioned by Management.
Section 37(1) & (2)	Agreement with Mandatories/ (Sub-)Contractors	- Written agreement with (Sub-)Contractors - List of SubContractors displayed. - Proof of Registration with Compensation Insurer/Letter of Good Standing - Construction Supervisor designated - Written arrangements re. - H&S Reps & H&S Committee - Written arrangements re. First Aid
Section 24 & General Admin. Regulation 8 C/OID Act Sect.38, 39 & 41	Reporting of Incidents (Dept. of Labour)	- Incident Reporting Procedure displayed. - All incidents in terms of Sect. 24 reported to the Provincial Director, Department of Labour, within 3 days. (Annexure 1)(WCL 1 or 2) and to the Client and/or its Agent on its behalf - Cases of Occupational Disease Reported - Copies of Reports available on Site - Record of First Aid injuries kept
General Admin. Regulation 9	Investigation and Recording of Incidents	- All injuries which resulted in the person receiving medical treatment other than first aid, recorded and investigated by investigator designated in writing. - Copies of Reports (Annexure 1) available on Site - Tabled at H&S Committee meeting - Action taken by Site Management.
Construction. Regulation 8	Fall Prevention & Protection	- Competent person appointed to draw up the Fall Protection Plan - Proof of appointees competence available on Site - Risk Assessment carried out for work at heights - Fall Protection Plan drawn up/updated - Available on Site
Construction. Regulation Driven Machinery Regulations 18 & 19	Cranes & Lifting Machines Equipment	- Competent person appointed in writing to inspect Cranes, Lifting Machines & Equipment - Written Proof of Competence of above appointee available on Site. - Cranes & Lifting tackle identified/numbered

		• Register kept for Lifting Tackle • Log Book kept for each individual Crane • Inspection: - All cranes - daily by operator - Tower Crane/s - after erection/6monthly - Other cranes - annually by comp. person • - Lifting tackle(slings/ropes/chain slings etc.) - daily or before every new application
General Safety Regulation 8(1)(a)	Designation of Stacking & Storage Supervisor.	• Competent Person/s with specific knowledge and experience designated to supervise all Stacking & Storage • Written Proof of Competence of above appointee available on Site
Construction. Regulation Environmental Regulation 9	Designation of a Person to Co-ordinate Emergency Planning And Fire Protection	• Person/s with specific knowledge and experience designated to co-ordinate emergency contingency planning and execution and fire prevention measures • Emergency Evacuation Plan developed: • Drilled/Practiced • Plan & Records of Drills/Practices available on Site • Fire Risk Assessment carried out • All Fire Extinguishing Equipment identified and on register. • Inspected weekly. Inspection Register kept • Serviced annually
General Safety Regulation 3	First Aid	• Every workplace provided with sufficient number of First Aid boxes. (Required where 5 persons or more are employed) • First Aid freely available • Equipment as per the list in the OH&S Act. • One qualified First Aider appointed for every 50 employees. (Required where more than 10 persons are employed) • List of First Aid Officials and Certificates • Name of person/s in charge of First Aid box/es displayed. • Location of First Aid box/es clearly indicated. • Signs instructing employees to report all • Injuries/illness including first aid injuries
General Safety Regulation 2	Personal Safety Equipment (PSE)	• PSE Risk Assessment carried out • Items of PSE prescribed/use enforced

		- Records of Issue kept - Undertaking by Employee to use/wear PSE - PSE remain property of Employer, not to be removed from premises GSR 2(4)
General Safety Regulation 9	Inspection & Use of Welding/Flame Cutting Equipment	- Competent Person/s with specific knowledge and experience designated to Inspect Electric Arc, Gas Welding and Flame Cutting Equipment - Written Proof of Competence of above appointee available on Site - All new vessels checked for leaks, leaking vessels NOT taken into stock but returned to supplier immediately - Equipment identified/numbered and entered into a register - Equipment inspected weekly. Inspection Register kept - Separate, purpose made storage available for full and empty vessels
General Safety Regulation 13A	Inspection of Ladders	- Competent person appointed in writing to inspect Ladders - Ladders inspected at arrival on site and weekly thereafter. Inspections register kept - Application of the types of ladders (wooden, aluminium etc.) regulated by training and inspections and noted in register
General Safety regulation 13B	Ramps	- Competent person appointed in writing to supervise the erection & inspection of Ramps. Inspection register kept. - Daily inspected and noted in register

15. THE PRINCIPAL CONTRACTOR'S GENERAL DUTIES

- The Principal Contractor shall at all times ensure his status of an “employer” as referred to in the Act, and will abide by his/her responsibilities, duties and functions as per the requirements of the Act and Regulations with specific reference to Section 8 of the Act.
- The Principal Contractor shall keep, and on demand make available, a copy of the Act on site at all times and in addition to that he/she will introduce and maintain a file titled “Health and Safety File”, or other record in permanent form, which shall contain all relevant aspects and information as contemplated in the Construction Regulations. He/she will make this file available to the client or his representative whenever necessary or on request to an interested party.
- The project under control of the Principal Contractor shall be subject to periodic health and safety audits that will be conducted by the client at intervals agreed upon between the Principal Contractor and the client, provided such intervals will not exceed periods of one month.
- The Principal Contractor is to ensure that he/she and all persons under his control on the construction site shall adhere to the above specifications.
- The Principal Contractor should note that he/she shall be held liable for any anomalies including costs and resulting deficiencies due to delays caused by non-conformance and/or non-compliance to the above Health and Safety Specifications and the Health and Safety Plan based on these specifications.

16. THE PRINCIPAL CONTRACTOR'S SPECIFIC DUTIES

Rev H&S Spec Guideline Oct 2015

The Principal Contractor's specific duties in terms of these specifications are detailed in the Construction Regulations as published under government notice 07 August 2014, stipulated in Section 7.

17. THE PRINCIPAL CONTRACTOR'S SPECIFIC RESPONSIBILITIES WITH REGARD TO HAZARDOUS ACTIVITIES

The following examples of activities are identifiable as hazardous in terms of the Construction Regulations. The contractor shall execute the activities in accordance with the following Construction Regulations and other applicable regulations of the Act:

- Fall protection
- Structures
- Excavation work
- Demolition work
- Scaffolding
- Construction vehicles & mobile plant.
- Water environments
- Housekeeping on construction sites
- Fire precautions on construction sites.

This list must not be taken to be exclusive or exhaustive! All of the above requirements will be read in conjunction with the relevant regulations and health and safety standards as required by the Act. All documents and records required by the Construction Regulations will be kept in the Health and Safety File and will be made available at any time when required by the client or his representative, or on request to an interested party.

18. GENERAL NOTES TO THE PRINCIPAL CONTRACTOR

Legal Framework

Part of legal obligations

The more important Acts and relevant subordinate/secondary legislation as well as other (inter alia Local Government) legislation that also apply to the State as well as to State owned buildings and premises: -

- a. The latest issue of SABS 0142: "Code of Practice for the Wiring of Premises"
- b. The Local Government Ordinance 1939 (Ordinance 17 of 1939) as amended and the municipal by-laws and any special requirements of the local supply authority
- c. The Fire Brigade Services Act 1987, Act 99 of 1987 as amended
- d. The National Building Regulations and Building Standards Act 1977 (Act 103 of 1977) as amended and relevant proclaimed Regulations (SABS 0400)
- e. The Post Office Act 1958 (Act 44 of 1958) as amended
- f. The Electricity Act 1984, Act 41 of 1984
- g. The Regulations of Local Gas Board(s), including Publications of the SABS Standards and Codes of Practice, with specific reference to GNR 17468 dated 4th October 1997
- h. Legislation pertaining to water usage and the environment
- i. Legislation governing the use of equipment, which may emit radiation (e.g. X-Rays etc.)
- j. Common Law

19. HOUSE KEEPING

Good housekeeping will be maintained at all times as per Construction Regulation No. 25. Poor housekeeping contributes to three major problems, namely, costly or

increased accidents, fire or fire hazards and reduction in production. Good housekeeping will enhance production time.

In promotion of environmental control all waste, rubble, scrap etc, will be disposed of at a registered dump site and records will be maintained. Where it is found to be impractical to use a registered dump site or it is not available, the Principal Contractor will ensure that the matter is brought to record with the client or his representative, after which suitable, acceptable alternatives will be sought and applied.

Dross and refuse from metals, and waste matters or by-products whose nature is such that they are poisonous or capable of fermentation, putrefaction or constituting a nuisance shall be treated or disposed of by methods approved of by an inspector.

NOTE: No employer (Principal Contractor) shall require or permit any person to work at night or after hours unless there is adequate, suitable artificial lighting including support services in respect of Health and Safety.

a) Facilities

The site establishment plan shall make provision for:

b) Dining room facilities

The contractor shall make provision for adequate dining room facilities for his employees on site.

c) Change rooms

The contractor shall make provision for adequate change rooms for his employees on site.

d) Ablution facilities

The contractor shall make provision for adequate ablution facilities for his employees on site.

These facilities shall be maintained by the contractor.

e) Smoking Areas

Designated smoking areas shall be established by Department of Public Works.

f) Drinking Water Facilities

The provision of drinking water facilities shall be negotiated between the Contractor and Department of Public Works.

g) Equipment Compliance Certificates

Before equipment is brought on site valid certificates of compliance issued by a competent person shall be presented. The equipment includes but shall not be limited to:

- i. lifting equipment and lifting tackle
- ii. power driven machinery
- iii. electrical equipment
- iv. testing and monitoring equipment

h) Barricading

All barricading shall be of the rigid type unless the use of non-rigid barricading has been approved in writing by the Department of Public Works Project Manager. The contractors' barricading standard shall be included in the Health and Safety Plan.

Where more than one contractor is working on a site, the fixed barricading shall be clearly marked with the company's name, site contact person as well as the contact number/s.

i) Erection of Structures for Logistic Support

Prior to site establishment Department of Public Works shall approve the contractor's site plan.

Department of Public Works shall approve all structures erected for logistical support by the contractor. These structures include fences, workshops, tool sheds, offices, ablution facilities, etc.

j) Salvage Yard Management

Depending on the site specific arrangements and procedures, Department of Public Works may provide the salvage yard and the resources to manage it.

The salvage yard management shall conform to safety, health and environmental requirements. The contractors are required to move the equipment from the place of work to the salvage yard.

k) Fall Arrest and Prevention Equipment

Approved fall prevention equipment shall be used at heights of less than 2.0 metres. Above heights of 2.0 metres fall prevention equipment shall include fall arrest Equipment. Users of fall arrest equipment shall, amongst other things be trained in what an appropriate load bearing point is for connecting fall prevention equipment. Any deviation from this requirement shall be negotiated and agreed with Department of Public Works in writing.

l) Hazardous Chemical Substances Waste Removal

Department of Public Works shall provide a facility to collect all hazardous chemical waste material.

The contractor shall provide adequately marked and sealable containers to transport The hazardous chemical waste from the source to the approved Department of Public Works disposal point.

m) Personal Protective Equipment (PPE)

Personal protective equipment issued shall be specific to the risks associated with the work to be performed and specific to conditions on site and shall comply with South African National Standards (SANS) or similar.

20. LOCKOUT SYSTEMS

A system of control shall be established in order that no unauthorized person can energize a circuit, open a valve, or activate a machine on which people are working or doing maintenance, even if equipment, plant or machinery is out of commission for any period, thus eliminating injuries and damage to people and equipment as far as is reasonably practicable.

Physical/mechanical lock-out systems shall be part of the safety system and included in training. Lockouts shall be tagged and the system tested before commencing with any work or repairs.

21. IMPORTANT LISTS AND RECORDS TO BE KEPT

The following are lists of several records that are to be kept in terms of the Construction Regulations. The lists are:

- i. List of appointments
- ii. List of record keeping responsibilities
- iii. Inspection checklist

a) Contractor Risk Assessment Process

The risk assessment process shall include:

- 1) an evaluation of the method of the work to be conducted
- 2) the method statement on the procedure to be followed in performing the task shall be developed
- 3) the risk assessment will also include activities like:
 - i. Transportation of passengers and goods to and from site
 - ii. Site establishment
 - iii. Physical and mental capabilities of employees
 - iv. Others as may be specified.
- 4) the hazards as listed in the paragraph – Site Specific Health and Safety Hazards

5) a review plan for risk assessments shall provide for:

- i. the quarterly review of all applicable risk assessments
- ii. the review of an assessment if there is reason to believe that the previous assessment is no longer valid, or there has been a change in a process, work methods, equipment or procedures and working conditions
- iii. Risk assessment/s to be reviewed if the outcome of incident investigations and audits etc. requires such action.

A pre - task risk assessment shall be conducted in writing on every task and be facilitated by the team leader. All risk assessments and pre-task risk assessments shall be filed and be available on site.

b) Risk Profile

All contractors shall submit a risk profile of the work to be conducted with their Health and Safety Plan.

c) Risk Based Inspection Program

The inspection programme shall be risk based. The inspection plan shall form part of the Health and Safety Plan.

IMPORTANT CONTACT DETIALS

(FOR HEALTH & SAFETY ASPECTS ONLY)

The contractor is to add all the important contact information about essentials services, support and assistance.



SERVICE	NUMBER	CONTACT PERSON
Hospital		



Ambulance		



Water		
Electricity		



Police		



Fire Brigade		



Engineer		

**ADD OTHER IMPORTANT HEALTH & SAFETY CONTACT DETAILS AS MAY BE FOUND
NECESSARY.**

SECTION 37(2) AGREEMENTS
CONCLUDED BETWEEN
DEPARTMENT OF PUBLIC WORKS
(Hereinafter referred to as Department of Public Works)

AND

.....
(Name of contractor/supplier/Agent/)

I,[
(name)representing *[Insert name of contractor/supplier]*, do hereby acknowledge that
[insert name of contractor/supplier] is an employer in his/her own right, with duties as prescribed in the Occupational Health and Safety Act No. 85 of 1993 ("the Act"), as amended, and agree to ensure that all work will be performed and/or machinery or plant used in accordance with the provisions of the Act.

I undertake that *[insert name of contractor/supplier]*
shall strictly adhere to, and ensure that his/her employees adhere to, the provisions of the Occupational Health and Safety Act, 1993 (Act 85 of 1993).

I have been provided with SHE specifications for project/service*[insert brief details of project/service, for example, name, contract/project number]*
.....and will comply with the requirements set out in these.

I accept and agree that the SHE specifications constitute arrangements and procedures between *[Insert name of contractor/supplier/Agent Safety Manager/Safety Officer]* and Department of Public Works, which will ensure compliance by *[Insert name of contractor/supplier]* with the provisions of the Act, as contemplated in section 37(2) of the Act.

This agreement constitutes the sole agreement between the parties, and no variation, modification, or waiver of any of the provisions of this agreement or consent to any departure from these shall, in any manner, be of any force or effect, unless confirmed in writing and signed by both parties, and such variation, modification, waiver, or consent shall be effective only in the specific instance and for the specific purpose and to the extent for which it was made or given.

This agreement is signed on behalf of the parties, each signatory to this warranting that he/she has the requisite authority to do so.

Signed this day of 20 at

..... (Place)

(Full name)..... (Signature)on

behalf of (Supplier/contractor/Agent)

Contractor Responsible Manager (*responsible for signing the Department of Public Works' contract on behalf of the contractor*)

Witnesses

1.

2.

Signed this day of20.....

at (Place)

(Full name)..... (Signature).....on

Behalf of **Department of Public Works.**

(Contracts and/or Project Manager or Department of Public Works representative)

Witnesses

1.

2.



Additions to health and safety specifications for all construction sites to include COVID 19

1. Introduction
2. References
3. Special appointments
4. Workers transport
5. Security/access control/control of visitors onsite
6. Pre-construction evaluation of medical requirements, screening and training
7. Facilities, resources and action required by principal contractor where applicable contractor onsite
8. Required procedures, documentation development and updates
9. Procedures at start during and at end of shift
10. Managing and controlling flammable hazardous chemicals
11. Contractor management
12. Compliance monitoring and discipline
13. Additional resources and recourse management

1. Introduction

COVID 19 Novel Corona virus has changed the world we live in and how we will conduct business activities and life in the future. Due to this it has become necessary to take special precautions, to plan and implement control measures, to prevent further spread of this disease.

These specifications are based on the prevention of persons, objects/tools being contaminated with the virus, infection transmission and specific occupational hygiene practices that focus on the need for employers to implement measures to mitigate or eliminate the transmission of the virus in the workplace.

This document is an addendum to the original project health and safety specification to assist the principal contractor and contractors to protect their workers, and to comply with the interim Regulations that has been gazetted

2. References

The Department of Employment and Labour has appealed to employers to use the prescriptions of the Occupational Health and Safety (OHS) Act of 1993 in governing workplaces in relation to Coronavirus Disease 2019 COVID19 under the National Disaster Act



public works

Department:
Public Works
REPUBLIC OF SOUTH AFRICA

OCCUPATIONAL HEALTH AND SAFETY

GENERIC GUIDELINES FOR SAFETY, HEALTH AND ENVIRONMENTAL SPECIFICATIONS

IN

CONSTRUCTION PROJECTS, REPAIRS, RENOVATIONS & MAINTENANCE

MANAGED BY

**THE DEPARTMENT OF
PUBLIC WORKS**

TABLE OF CONTENT

1. Preamble	3
2. Scope of health & safety specification document.....	5
3. Purpose	5
4. Definitions.....	6
5. Occupational health & safety management.....	8
5.1 Structure and organization of OHS responsibilities.....	8
5.1.1 Overall supervision and responsibilities OHS.....	8
5.1.2 Required appointment as per the construction regulation.....	10
5.2 Communication, participation & consultation.....	11
6. Interpretation.....	11
7. Responsibilities.....	12
7.1 Client.....	12
7.2 Principal contractor.....	13
7.3 Contractor.....	14
7.4 Responsibilities of Construction Health & Safety Agent (SACPCMP)	15
8. Scope of work.....	16
9. Preparing Health & Safety Plan.....	16
10. Health & Safety File.....	19
11. OH&S Goals & Objective & Arrangements for Monitoring & Reviewing OH&S Performance..	19
11.1 Identification of Hazards & development of Risk Assessment, Standard working Procedures (SWP) & Method Statement.....	19
11.1.1. Monthly audit by client and/or its agent.....	19
11.1.2 Health & Safety incident/accident reporting and investigation.....	19
12. Review.....	21
12.1 Site Rules & other Restrictions.....	22
12.1.1 Appointment of Health & Safety Reps.....	23
12.1.2 Duties and functions of the Health & Safety Reps.....	23
12.1.3 Establishment of Health & Safety Committee.....	23
12.1.4 Training & Awareness.....	24
13. Project Site Specific Requirements.....	25
14. Outlined Data References & information on Certain & Specific Obligatory Requirements to ensure compliance.....	26
15. Principal Contractor General duties.....	30
16. The Principal Contractor Specific Duties.....	31
17. The Principal Contractor Specific Responsibilities with regard to hazardous activities.....	31
18. General Notes to the Principal Contractor.....	32
19. House Keeping.....	33
20. Lockout System.....	36
21. Important Lists & Records to be kept.....	36

1. PREAMBLE

In terms of Construction Regulation 4(1)(a) of the Occupational Health and Safety Act, 1993 (Act 85 of 1993), and 5(1) construction regulation of 2014, the Department of Public Works, as the Client and/or its Agent on its behalf, shall be responsible to prepare Health & Safety Specifications for any intended construction project and provide any Principal Contractor who is making a bid or appointed to perform construction work for the Client and/or its Agent on its behalf with the same.

The Client's further duties are as described in The Act and the Regulations made thereunder. The Principal Contractor shall be responsible for the Health & Safety Policy for the site in terms of Section 7 of the Act and in line with Construction Regulation 5 as well as the Health and Safety Plan for the project.

This 'Health and Safety Specifications' document is governed by the "Occupational Health and Safety Act, 1993 (Act No. 85 of 1993), hereinafter referred to as 'The Act'. Notwithstanding this, cognizance should be taken of the fact that no single Act or its set of Regulations can be read in isolation. Furthermore, although the definition of Health and Safety Specifications stipulates 'a documented specification of all health and safety requirements pertaining to associated works on a construction site, so as to ensure the health and safety of persons', it is required that the entire scope of the Labour legislation, including the Basic Conditions of Employment Act be considered as part of the legal compliance system. With reference to this specification document this requirement is limited to all health, safety and environmental issues pertaining to the site of the project as referred to here-in. Despite the foregoing it is reiterated that environmental management shall receive due attention.

Due to the wide scope and definition of construction work, every construction activity and site will be different, and circumstances and conditions may change even on a daily basis. Therefore, due caution is to be taken by the Principal Contractor when drafting the Health and Safety Plan based on these Health and Safety Specifications. Prior to drafting the Health and Safety Plan, and in consideration of the information contained here-in, the contractor shall set up a Risk Assessment Program to identify and determine the scope



Department of labour, notice no. 479, 29 April 2020, covid-19, Occupational health and safety measures in workplaces Covid-19 (c19 ohs), directive by the minister of employment and labour in terms of regulation 10 (8) of the regulations issued by the minister of cooperative governance and traditional affairs in terms of section 27 (2) of the disaster management act, 2002 (act no. 57 of 2002)

The OHS Act read with the Hazardous Biological Agents Regulations requires the employer to provide and maintain as far as is reasonably practicable a working environment that is safe and without risks to the health of employees

Section 8(2)(b) of OHS act *requires steps such as may be reasonably practicable to eliminate or mitigate any hazard or potential hazard before resorting to personal protective equipment (PPE).* However, in the case of COVID19, a combination of controls is required, although the main principle is to follow the hierarchy of controls

However, before the implementation of control measures, current risk assessments need to be reviewed and updated, considering the new hazards posed by exposure to COVID-19 in the workplace. The risk assessment should take the Risk Assessment Guides published online by the National Department of Health into account

3. Special appointments

- a. *The employer must appoint a manager (from within the existing structure) to address the concerns of employees and workplace representatives concerning COVID 19*
- b. Appointment and training of security personnel and adequate personnel to conduct procedures of screening, isolating, conducting questionnaire and further actions required if person presents positive COVID 19 symptoms

4. Workers transport

- a. Where possible the contractors must arrange transport of their employees in line with the travel rules of not more than 70% occupancy and social distancing
- b. Where not possible to avoid the use of public transport provide employees with information on the virus and precautions to take during public transport travel:
 - i. Frequent sanitising
 - ii. Maintain social distancing (at least 2 m)
 - iii. Always wear a mask
 - iv. Coughing, sneezing safe practice and spitting
 - v. When being coughed or sneezed on, turn face away and do not touch face before hands have been sanitised
 - vi. Do not travel if experiencing symptoms of infection
 - vii. Provide employees with CIPC travel certificate



5. Security/access control/control of visitors onsite

- a. **Only 1 access point allowed on site during the Phase lockdown period.**
- b. A policy of lockdown inside site for the whole shift must be maintained which will mean that employees will not be allowed to exit and re-enter the site during working hours. This will prevent employees from bringing contaminated food or articles onto site and **will have to bring food from home**
- c. The principal contractor must enforce strict access control and no person may enter the site except those who have undergone induction training and who is listed on the employee list
- d. The only exceptions are persons who have pre-arranged official appointment which has been approved by the project construction manager. This person may not enter the site before they have passed the screening procedure (fever and questionnaire) and thereafter must be escorted by a person designated by the construction manager
- e. Biometric or any form of touch access entry is prohibited
- f. Delivery vehicle drivers must undergo and pass the full COVID 19 screening procedure or may not leave the cab of the vehicle and wear a face mask
- g. Where more than one Principal Contractor operates on site. A meeting must be held with all the Principal Contractors where an access plan must be formulated and **agreed to in writing**, which incorporates the sharing of expenses and other resources.

6. Pre-construction evaluation, screening and training

Principal contractor and contractor's pre-construction requirements:

It is critical that the principal contractor conduct the following preparatory actions before going to site. These actions must be documented and each employee must sign that he/she has undergone this screening and training and understands and procedures

a. **Evaluation:**

- i. Employees medical evaluation, ensuring annual medical is valid
- ii. Screening:
 1. Fever screening
 2. **Health questionnaire** (signs and symptoms)
 3. Questionnaire of travel during shut down level 4 and exposure
 4. Employee practical understanding of:



- a. the risks of the virus
- b. how do you get contaminated?
- c. how do you get infected?
- d. signs and symptoms
- e. prevention

b. Training program

It is important to understand that workers have been of site for an extended period and which requires that the principal contractor and contractors develop a full risk based induction training and awareness program, policies and procedure for COVID 19 and communicate it with management, employees and contractors which include the following:

- i. Employees responsibility to look after their own health and safety and preventing from being infected or infecting other persons
- ii. What is COVID 19
- iii. How are you infected
- iv. Explanation of symptoms and signs (ever, cough, sore throat, redness of eyes or shortness of breath or difficulty in breathing, body aches, loss of smell or loss of taste, nausea, vomiting, diarrhoea, fatigue, weakness or tiredness
- v. Incubation period
- vi. Explain the risk of underlying conditions, i.e.:
 - 1. People 60 years and older
 - 2. People with chronic lung disease or moderate to severe asthma
 - 3. People who have serious heart conditions
 - 4. People who are immunocompromised
 - 5. People with diabetes
 - 6. People with chronic kidney disease undergoing dialysis
 - 7. People with liver disease
- vi. Self-monitoring and reporting of symptoms, possible exposure or infection to company
- vii. The importance of being aware of who you have been in contact with during work and after hours to assist with tracking in case of being infected
- viii. How to self-isolate
- ix. Company COVID sick leave and Temporary Employer Relief Scheme under regulation 10(8) of the Regulations promulgated in terms of section 27(2) of the Disaster Management Act
- x. How to prevent infection:
 - 1. Correct methods of sanitising
- f. Hands
- g. Personal hygiene



h. Site facilities

2. Social distancing
3. Not touching face
4. The correct way to cough or sneeze
5. Correct use, limitations of and disposal of PPE
6. How to protect yourself and family after hours

xi. What to do if employee is not feeling well and are presenting with the symptoms when already at the work-place or before arrival onsite include:

1. Employees

a. If already onsite

- i. Immediate reporting to employer
- ii. Social distancing and other preventative actions

b. When not onsite yet

- i. Do not go to work
- ii. Who to contact at your company?
- iii. Relevant company contact numbers

2. Principal contractor and contractors

- a. Procedures and PPE required when employee presents with symptoms at the site screening and needs to be isolated and tracking of persons in contact with that employee
- b. Procedures and care of persons who are in self isolation or being treated at hospital or COVID 19 facility
- c. Company and employee return to work after recovery procedures

xii. Updated company COVID 19:

1. SHE plan and risk assessment
2. Policies
3. PPE requirements
4. Method statements & risk assessment
5. Stay at home policy and sick leave
6. Employee assistance/care program

xiii. Include COVID awareness in every day DSTI/permit to work system

7. Facilities, resources and action required by principal contractor where applicable contractor onsite



- a. Provide these employees with appropriate PPE for their tasks
- b. Prevention of employees having to come into close-proximity (Queuing or bundling together)
- c. Method/procedure of providing drinking water that cannot be contaminated with the virus
- d. Adequate and appropriate risk-based:
 - i. PPE
 - ii. Sanitising/hand washing facilities at entrance, eating areas, offices, kitchens, toilets (Foot pedal hand sanitisers is the preferable option)
 - iii. Awareness signage and posters
- e. Procedures for sanitising site, offices, toilets, eating areas, meeting rooms communal kitchen appliances, printers and telephones
- f. Procedures and rules to minimise exposure during:
 - i. Meetings (Alternates to close contact meetings)
 - ii. Duration and maximum number of delegates at close contact meetings
 - iii. Induction, Toolbox talk, DSTI
 - iv. Sanitising of areas, offices, boardrooms and furniture
 - v. Communal drinking facility use
 - vi. Housekeeping and garbage removal
- g. Provide an isolation area/tent/room where person can be interviewed and remain until instructions have been received from the COVID 19 control centre on next step to be taken

CORONA 24 Hour HOTLINE 0800029999

8. Required procedures, documentation development and updates

The contractor must develop new and update existing plans, policies, documentation and procedures to include COVID 19

- a. She plan and policy
- b. Company COVID 19 plans, policies, procedures and programs to include:
 - i. Prevention, exposure, infection
 - ii. Social distancing during entering and exiting site, meetings, training
 - iii. Creating different areas for and staggering start of work and lunch-times, training sessions and effective planning of required staff compliments
 - iv. Cooperation with local police, clinic, emergency services and notifying them of the project and developing beneficial relationships
 - v. Engaging with CLO and communities and establish a trust relationship by providing relevant information and possible assistance where possible
 - vi. Emergencies (mass infections)
 - vii. Post-infection return to work guideline, which include:
 - 1. minimum medical and practical criteria for return to work



2. medical evaluation by occupational health practitioner

- viii. Employee emotional care and assistance during and post infection
- ix. Management and disposal of contaminated PPE and equipment
- x. Planning to maximise social distancing
- xi. Planning of production and progress to optimise the work-force to minimise the amount of persons onsite at one-time
- xii. Managing and disposal of biological (Virus) contaminated PPE and other personal waste
- xiii. Daily reporting to management of screening results and of persons who were isolated, taken for testing and follow-up
- xiv. Reporting of persons who have been confirmed to be infected to company management, department of labour and Health
- xv. Contact-tracing of persons who were in contact with a person who have been isolated or who has been confirmed as being infected
- xvi. Updated risk assessment to include COVID 19 hazards and risks
- xvii. Evaluation of daily screening, reporting to management and if required update procedure and training
- xviii. Company policy related to paid sick leave in terms of section 22 of the BCEA illness benefit in terms of clause 4 of the Directive issued on 25 March 2020 on the COVID-19 Temporary Employer Relief Scheme under regulation 10(8) of the Regulations promulgated in terms of section 27(2) of the Disaster Management Act;
- xix. Also revise the permit to work where required.

9. Procedures at start during and at end of shift

a. Include conducting and recording information of:

i. Sanitisation

- 1. At start of shift all persons must sanitise with sanitiser that contains at least 70% alcohol with foot pedal or automatic detection and spray device, no hand contact
- 2. Site facilities, offices, boardrooms, toilets, eating areas, surfaces
- 3. Hand and power tools, and other communal equipment to be wiped down

ii. Fever screening and procedure when person has fever

1. Re-do fever screen and if high fever

- a. Isolate and questionnaire
- b. Procedure if evidence points at infection
- c. Contact call centre and follow instructions
- d. Also follow company procedure for reporting to management, client and authorities

10. Managing and controlling flammable hazardous chemicals

- a. The type of sanitiser used for COVID 19 must have a minimum of 70% alcohol and it is important that adequate stock is held onsite



- b. Due to its high alcohol content it poses a fire risk as well as a possible risk of being used by workers for intoxicating purposes which can lead to poisoning
- c. It is therefore particularly important to include these risks into account when the risk assessments is updated
- d. The principal contractor and contractors must ensure that they provide a flammable liquid storage facility, considering the quantities they will be storing onsite which conforms with local government fire regulations and GSR 4
- e. The storage area must be lockable and issuing and stock levels must be controlled by an appointed competent hazardous chemical substance controller
- f. Records of stock levels, issuing and usage must be updated daily and any discrepancies must be reported to management and investigated
- g. Decanting procedures must be developed which includes spillage control. Bottles into which it has been decanted into must be marked to clearly show the contents
- h. Appropriate and adequate signage must be posted
- i. Adequate Alcohol resistant foam or Carbon dioxide (CO₂) fire extinguishers must be appropriately positioned
- j. Inspections of the flammable hazardous chemicals store must be conducted at least monthly
- k. First aiders should be trained on the first aid measures as set out in the MSDS

11. Contractor management

It is the responsibility of the principal contractors to ensure that all contractor comply with the requirements of the addition to the original project health and safety specifications

12. Compliance monitoring and discipline

- a. Monitoring of compliance is critical to the prevention program and there may be no tolerance of non-compliance
- b. Strict appropriate disciplinary action must be instituted against employees, contractors, consultants or any person
- c. found in breach of the requirements
- d. The client will be responsible for compliance through audits and inspections and evaluation of principal contractors' reports
- e. The principal contractor must monitor compliance through inspections and COVID 19 specific audit of:
 - i. Available equipment
 - ii. Sanitiser/washing facilities
 - iii. Sanitising of site facilities
 - iv. Employee screening
 - v. Access control
 - vi. Availability of isolation facilities
 - vii. Separation and procedures followed when employees present with symptoms
 - viii. Continuous awareness training
 - ix. Recordkeeping



- x. Sub-contractor training and screening records, risk assessments and monitoring
- f. Any suspected or confirmed infection or noncompliance with the COVID 19 requirements must be reported to the client health and safety agent with immediate effect
- g. A written incident report must be supplied within 24 hours after the incident. If the risk assessment or procedures are required to be reviewed, same will be done within 36 hours.

13. Additional resources and recourse management

- a. It is a fact that finance and budgets of active projects that were shut down due to COVID 19 have approved budgets and available capital projects that are currently running have already been allocated and approved and Therefore funds should be available from the client to pay Principal Contractors/Contractors
- b. It is therefore critical that the principal contractor ensure that their payment certificates and related documents are correct and is submitted before deadline dates with their invoices. Many delays in payment from clients are due to incorrect or insufficient documentation that has been submitted late.
- c. It is important to understand that the COVID 19 virus has affected all parties and cooperation will increase the probability of completing the project successful
- d. It is critical that the client and principal contractor re-negotiate and discuss the project deadlines and budget and agree on solutions to the benefit of all. The impact of screening, site access, delayed delivery of long lead items due to manufacturing constraints and restrictions due to COVID19 legislation must be considered when negotiating the program and deadlines specifically.
- e. Clients must not delay payment to principal contractors and principal contractors must do the same with their contractors. Delaying payments will have a snowball effect all the way down to the workers who have in some case already not received salaries or has only received partial payment
- f. Businesses must do their utmost to protect the workers who are the most crucial asset of construction
- g. Although SMME are businesses in their own right, many of these companies were already struggling financially before lockdown started and the principal contractor could use the assistance of the project CLO to ensure that workers are being paid and if not report it to the principal contractor.
- h. **Contractor must assist employees with UIF claims.**
- i. **All the above requirement and information must be filtered down to the contractors onsite**

“Health and safety is not negotiable”

- 2.2 Do you, or any person connected with the bidder, have a relationship with any person who is employed by the procuring institution?

YES / NO

- 2.2.1 If so, furnish particulars:

.....
.....

- 2.3 Does the bidder or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest in the enterprise have any interest in any other related enterprise whether or not they are bidding for this contract?

YES / NO

- 2.3.1 If so, furnish particulars:

.....
.....

3 DECLARATION

I, the undersigned, (name).....
in submitting the accompanying bid, do hereby make the following statements that I certify to be true and complete in every respect:

- 3.1 I have read and I understand the contents of this disclosure;
- 3.2 I understand that the accompanying bid will be disqualified if this disclosure is found not to be true and complete in every respect;
- 3.3 The bidder has arrived at the accompanying bid independently from, and without consultation, communication, agreement or arrangement with any competitor. However, communication between partners in a joint venture or consortium² will not be construed as collusive bidding.
- 3.4 In addition, there have been no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications, prices, including methods, factors or formulas used to calculate prices, market allocation, the intention or decision to submit or not to submit the bid, bidding with the intention not to win the bid and conditions or delivery particulars of the products or services to which this bid invitation relates.
- 3.5 The terms of the accompanying bid have not been, and will not be, disclosed by the bidder, directly or indirectly, to any competitor, prior to the date and time of the official bid opening or of the awarding of the contract.
- 3.6 There have been no consultations, communications, agreements or arrangements made by the bidder with any official of the procuring institution in relation to this procurement process prior to and during the bidding process except to provide clarification on the bid submitted where so required by the institution; and the bidder was not involved in the drafting of the specifications or terms of reference for this bid.

² Joint venture or Consortium means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract.

- 3.7 I am aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to bids and contracts, bids that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and or may be reported to the National Prosecuting Authority (NPA) for criminal investigation and or may be restricted from conducting business with the public sector for a period not exceeding ten (10) years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

I CERTIFY THAT THE INFORMATION FURNISHED IN PARAGRAPHS 1, 2 and 3 ABOVE IS CORRECT.

I ACCEPT THAT THE STATE MAY REJECT THE BID OR ACT AGAINST ME IN TERMS OF PARAGRAPH 6 OF PFMA SCM INSTRUCTION 03 OF 2021/22 ON PREVENTING AND COMBATING ABUSE IN THE SUPPLY CHAIN MANAGEMENT SYSTEM SHOULD THIS DECLARATION PROVE TO BE FALSE.

.....
Signature

.....
Date

.....
Position

.....
Name of bidder

This form has been aligned with SBD4