


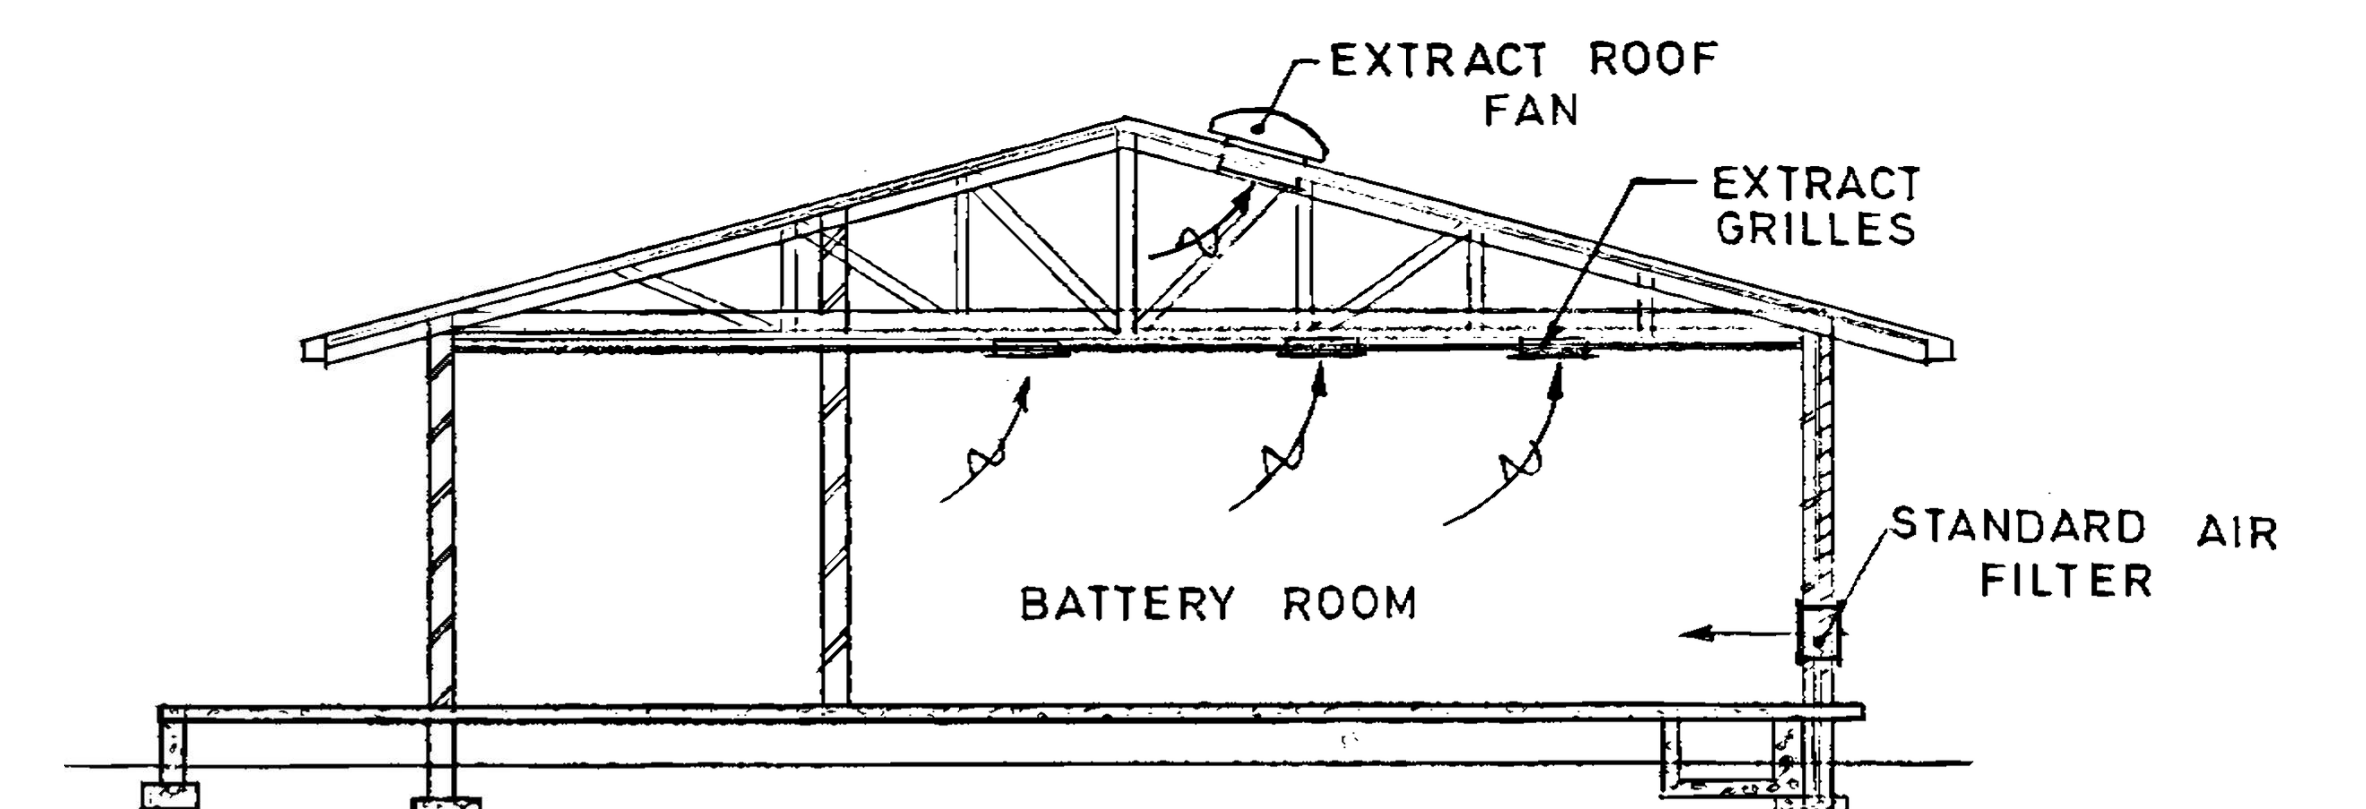

SECTION D-D

NOTES:

1. DUCT DIMENSIONS TO BE INCREASED BY 25mm ALL ROUND TO INCLUDE INTERNAL INSULATION
2. DOOR GRILLE TO BE SUPPLIED BY AIR-CONDITIONING CONTRACTOR AND HANDED TO BUILDER TO INSTALL.

CANNED

AUTH NAG	DISCIPLINE AFDELING	DATE DATUM	FIRST ISSUE / EERSTE UITREIKING						
	STRUCTURAL	REV	AUTH TAG	DATE DATUM	REVISIONS/REVISIES	BY DEUR	CHKD NAGES	REFERENCE DRAWINGS VERWYSINGS TEKENINGE	
	MECHANICAL	DWG. TECH REGISTER			INDEX/INDEXES		0.18/		
	FIRE/PROT.	SOUTH AFRICA			ESCOM • EVKOM RAND AND O.F.S. REGION MIDAS SUBSTATION CONTROL AND CARRIER ROOMS AIR CONDITIONING				
	ELECTRICAL	SUID AFRIKA							
	CNCRANGE								
	CIVIL	CHKD NAGES							
	AIR/COND.	DRAWING GETEKEN	M.K.			APPROVED GOEDGEKEUR	0.18/15540		
	SCALE SKAAL	1:100	22/15/22			22/15/22		0	