

COLD WATER LINE TYPE LEGEND	
LINE TYPE	SERVICE
————	MUNICIPAL DOMESTIC WATER SUPPLY
-----	EXISTING MUNICIPAL LINE

LOCAL AUTHORITY STAMPS

NOTES:

WATER INSTALLATION

1. THE INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF SANS 0400 AND 0252-1 : 1994.
2. THE INSTALLATION BELOW GROUND SHALL COMPRISE HIGH DENSITY POLYETHYLENE TO SANS ISO4427:1996, PE80 PN12.5
3. THE INSTALLATION ABOVE GROUND SHALL COMPRISE GEBERT MEPLA.
4. THE INSTALLATION OF PIPES AND FITTINGS SHALL BE STRICTLY IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS AND INSTRUCTIONS. THIS APPLIES ESPECIALLY TO SUPPORT BRACKETRY, WHERE PIPES ARE BUILT INTO OR SUPPORTED FROM STRUCTURE. SUCH PIPES SHALL BE FIXED BUT NOT ALLOWED TO SWING. HOWEVER, ALLOWANCE SHALL BE MADE FOR THERMAL MOVEMENT.
5. ISOLATING VALVES SHALL BE INSTALLED ON ALL BRANCH PIPES LONGER THAN 3m.
6. LOOPS SHALL BE PROVIDED IN PIPES CROSSING BUILDING EXPANSION JOINTS.
7. ON COMPLETION, THE INSTALLATION SHALL BE STERILISED AND TESTED TO THE ENGINEERS SPECIFICATION.
8. THE CONTRACTOR SHALL SUBMIT A FULL SET OF AS-BUILT DRAWINGS UPON COMPLETION OF THE INSTALLATION.
9. ALL TOILETS TO BE FITTED WITH 020mm OVER FLOWS.
10. ALL HOT WATER PIPES TO BE LAGGED WITH ARMOUR FLEX.

MUNICIPAL NOTES

1. WORK TO COMPLY WITH LOCAL BYELAWS AND NATIONAL REGULATIONS.

NOTES & LEGENDS

REVISION	DESCRIPTION	P.L.	DATE
A	ISSUED FOR INFORMATION		28.03.24

CONSULTANT

REDLINE CONSULTING ENGINEERS

CONTRACT DETAILS:


161 Luther Road
 Midde 427 01 414 3078
 Tel: 427 91 573 2336
 Fax: 427 91 573 2335
 Durban West
 Email: info@redlineconsulting.co.za
 031 555 1453

COPYRIGHT:

The drawings and the copyright herein is the property of Redline Consulting Engineers. It may not be used or reproduced, nor passed on to any third party without written permission of Redline Consulting Engineers.

DRAWING INFORMATION

PROJECT:	PLAYHOUSE		
DRAWING TITLE:	PROPOSED 7 000L BACK UP WATER TANK		
PROJECT NUMBER	DISCIPLINE	DRAWING NUMBER	REVISION NUMBER
JR2819	800	00	A
DESIGNER:	MR SWAN ANO	ISSUED FOR:	FOR INFORMATION
	20.07.14		

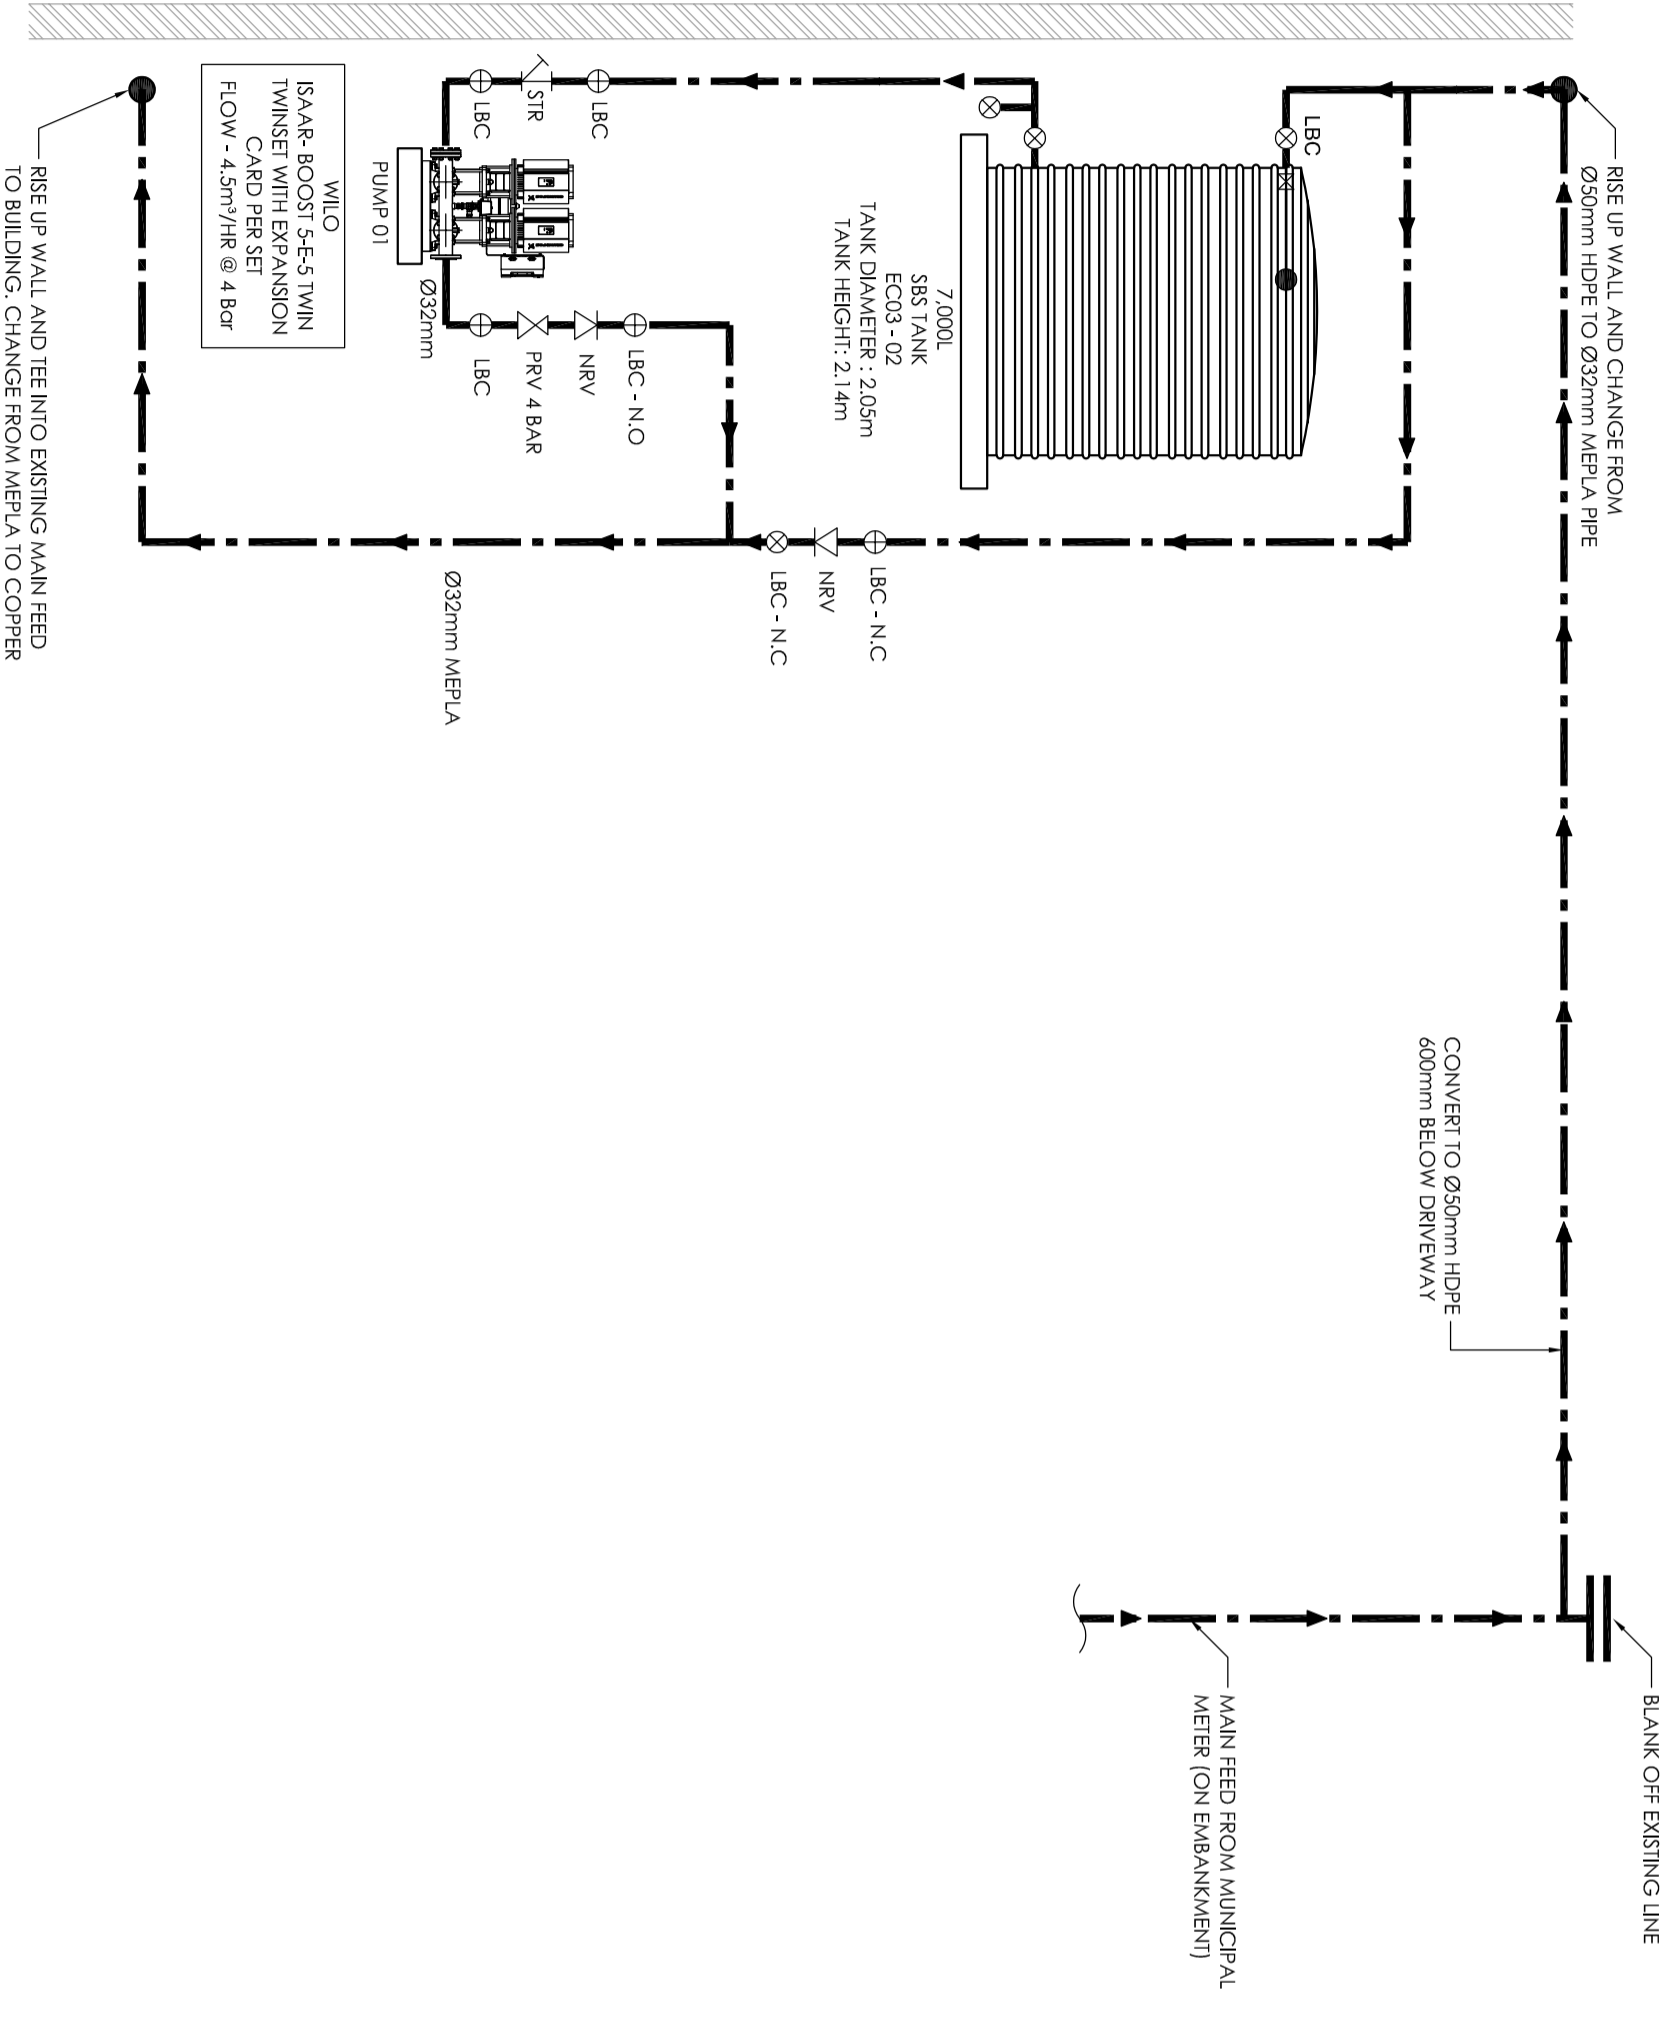

7000L PLAY HOUSE ADMIN MAYVILLE BACK UP WATER SCHEMATIC

SCALE N.T.S.