
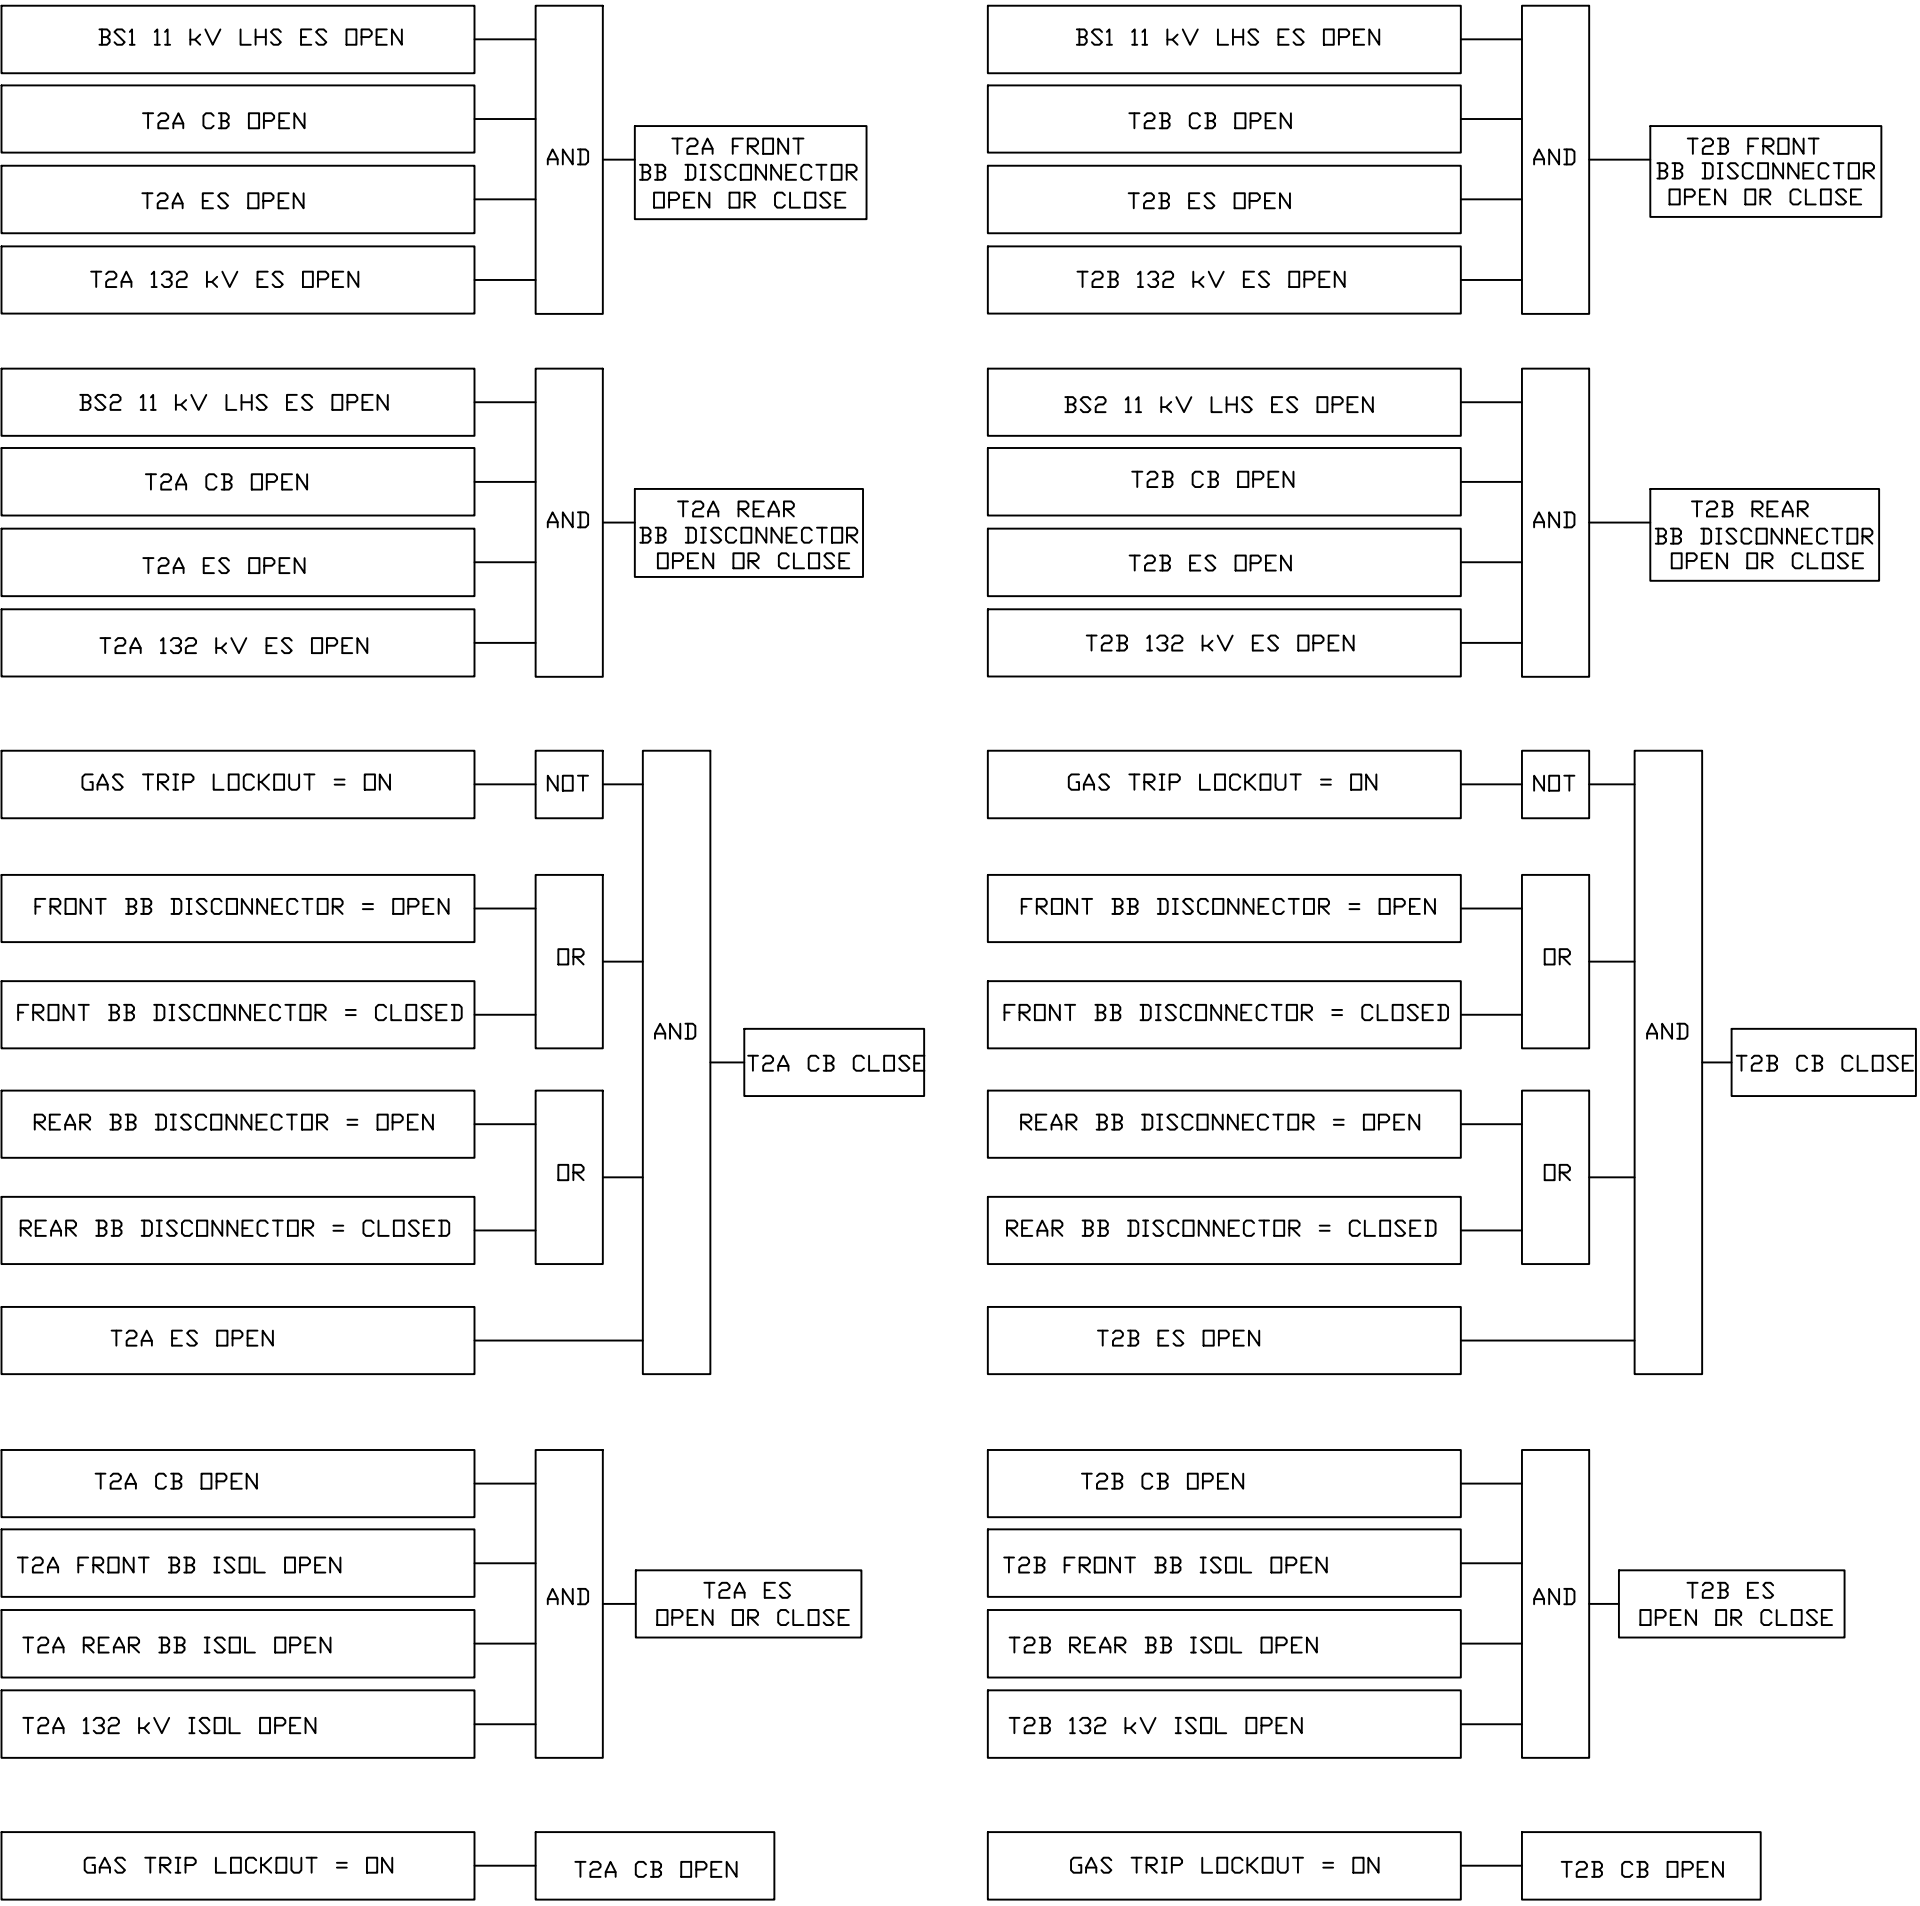
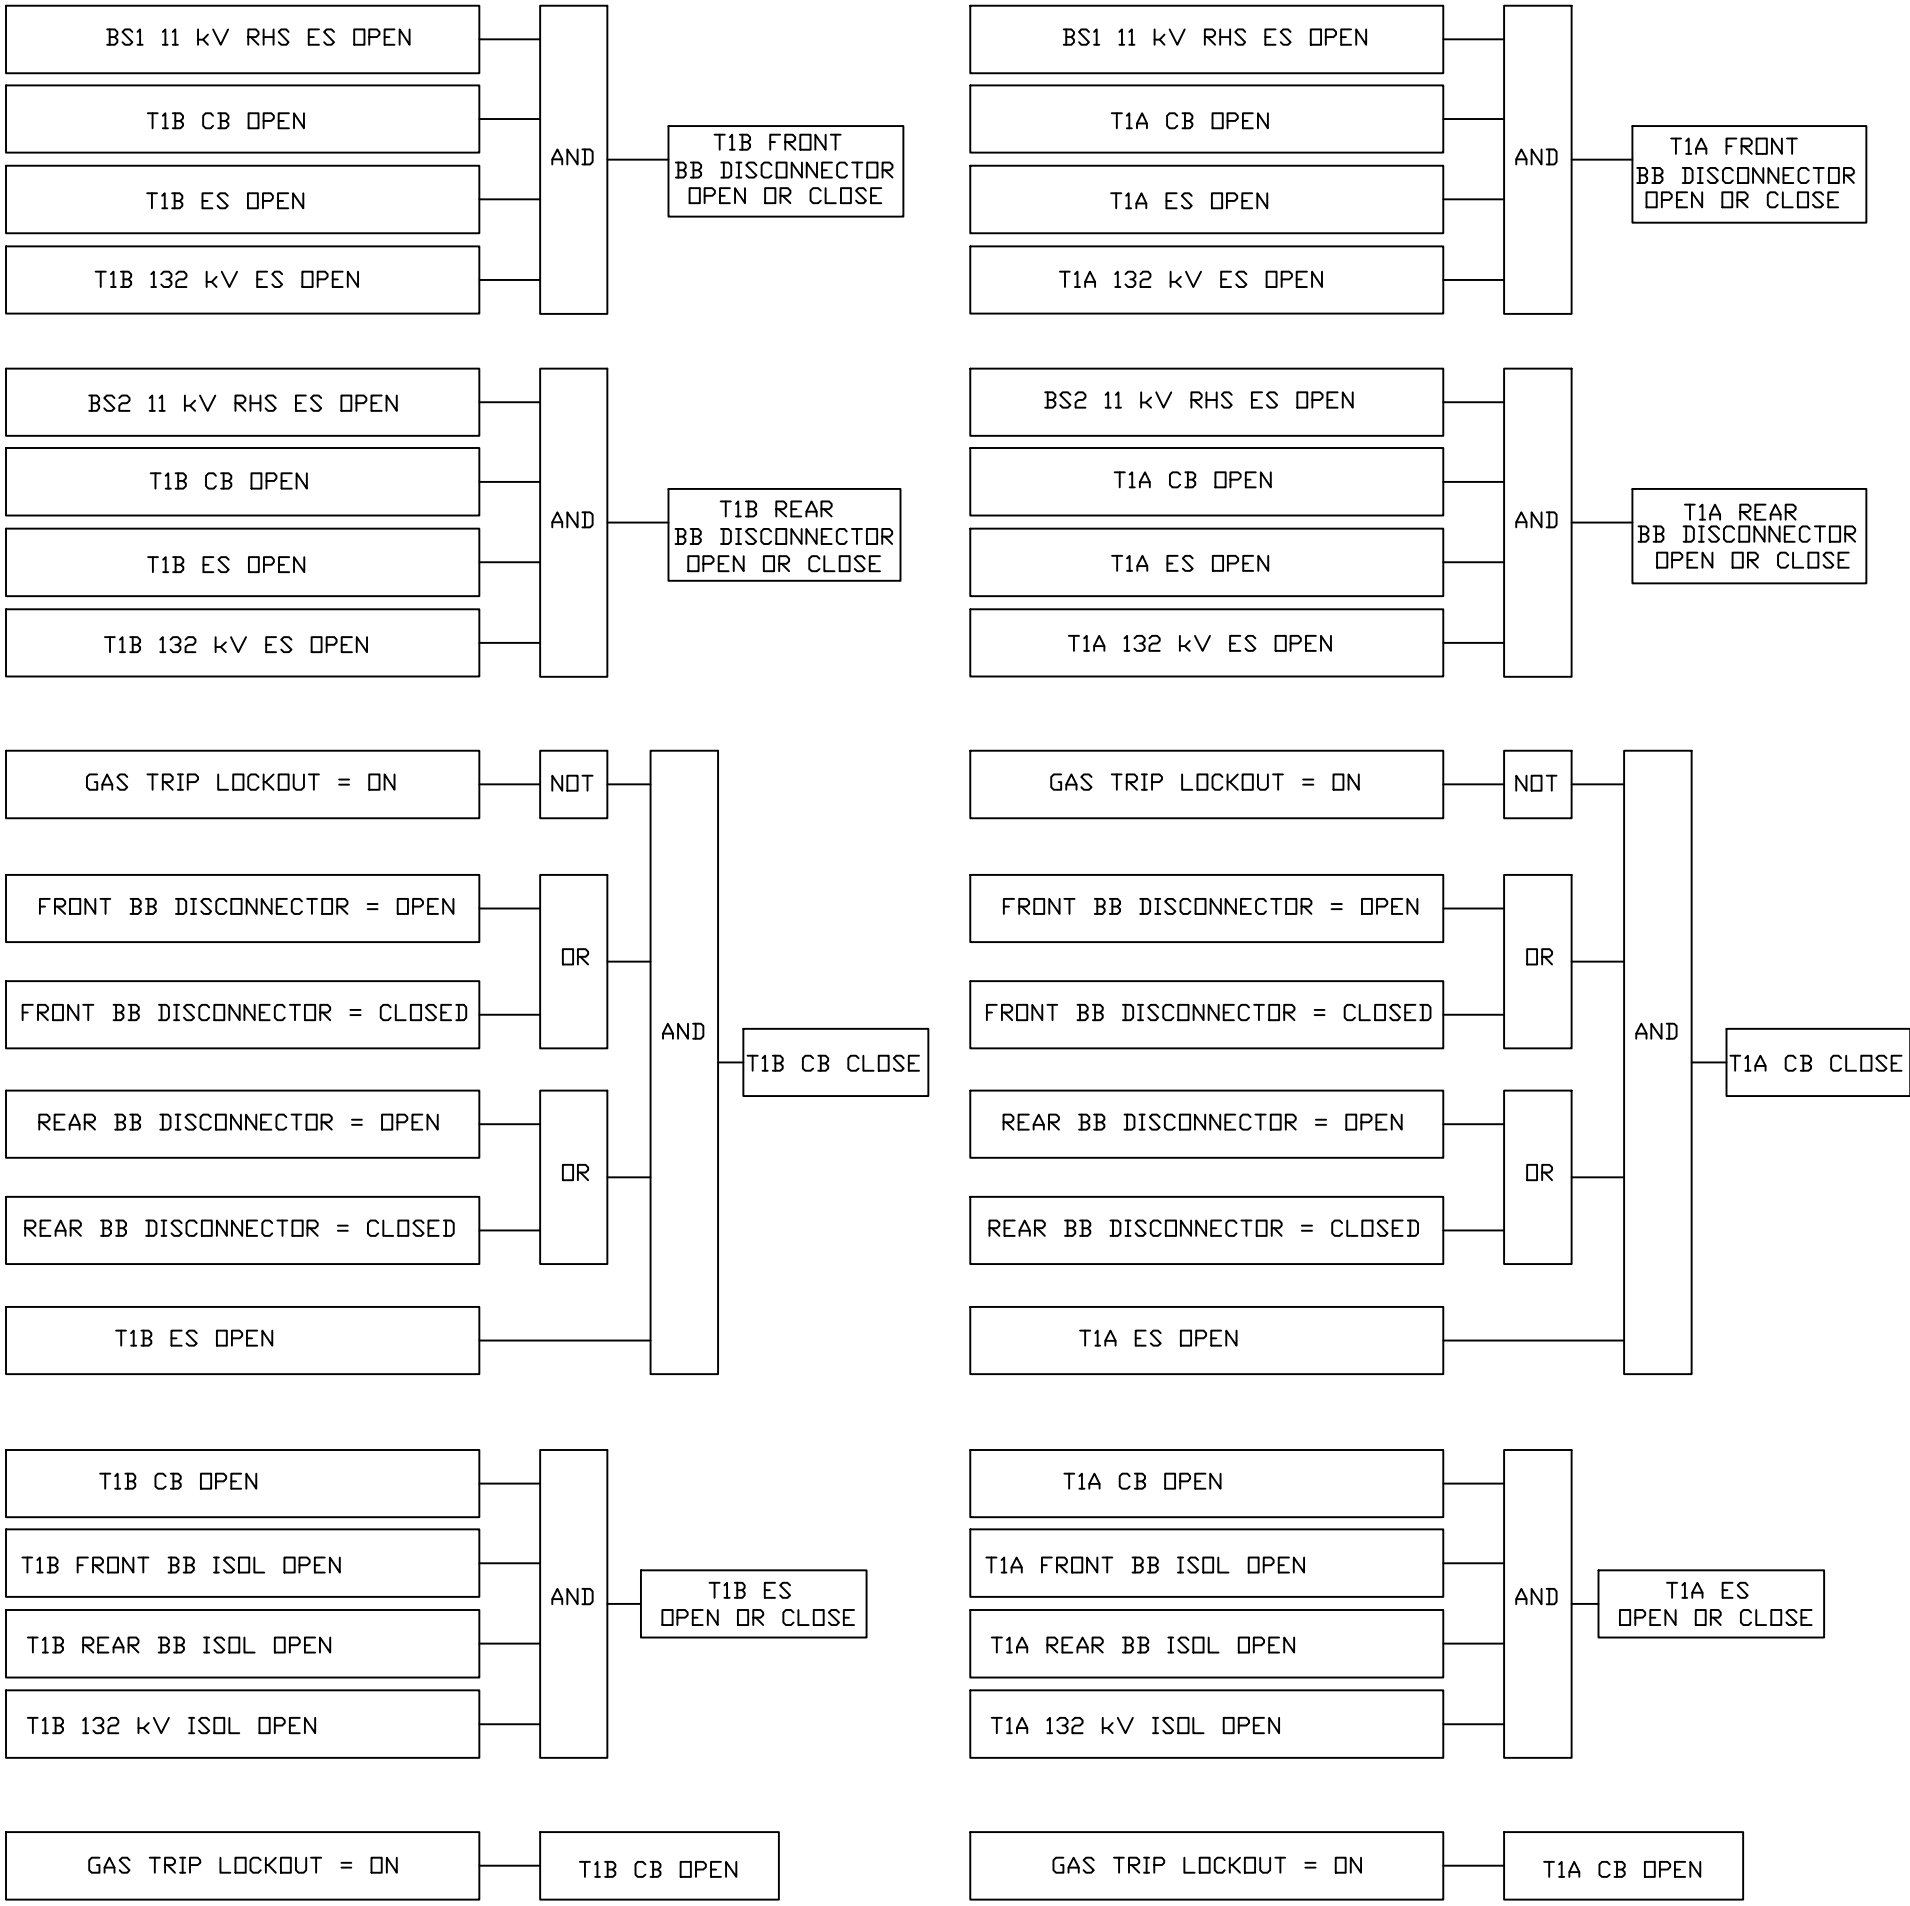


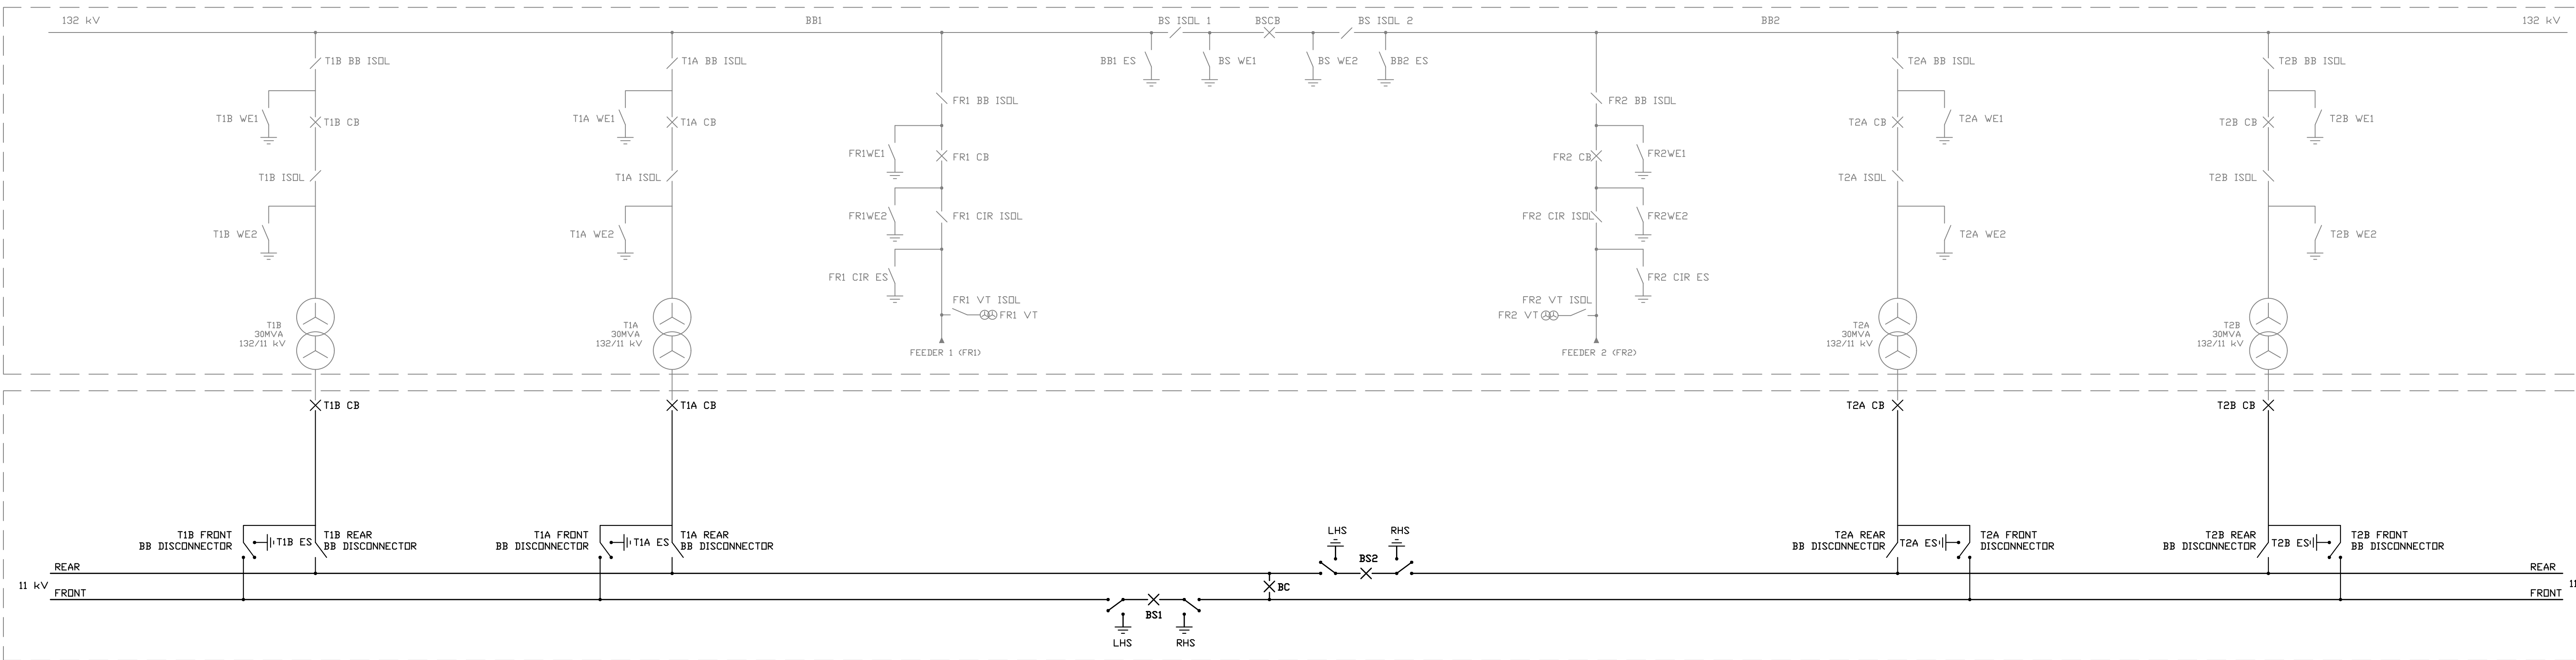

NOTES :
REFER TO TD81 REV 1 FOR A DETAILED
LOGIC FOR THE 132 kV SIDE

	SIGNATURE	DATE					
DRAWN	N. DLAMINI	12-09-2025					
CHIEF DRAUGHTSPERSON			REFERENCE DRAWINGS	REVISIONS	BY	DATE	
PROTECTION ENGINEER			ETHEKWINI ELECTRICITY PROPOSED 132/11 kV SUBSTATION WITH 132 kV GIS PROPOSED INTERLOCKING LOGIC BETWEEN 11 kV AND 132 kV WITHOUT JERICHO SCHEME				
PLANNING ENGINEER							
PROJECTS ENGINEER							
PLAN APPROU. MANAGER							
APPROVED V. RAMPUSAN DEPUTY DIRECTOR: HV OPERATIONS			SCALE N.T.S.	DRAWING NUMBER TD 85	REV		