


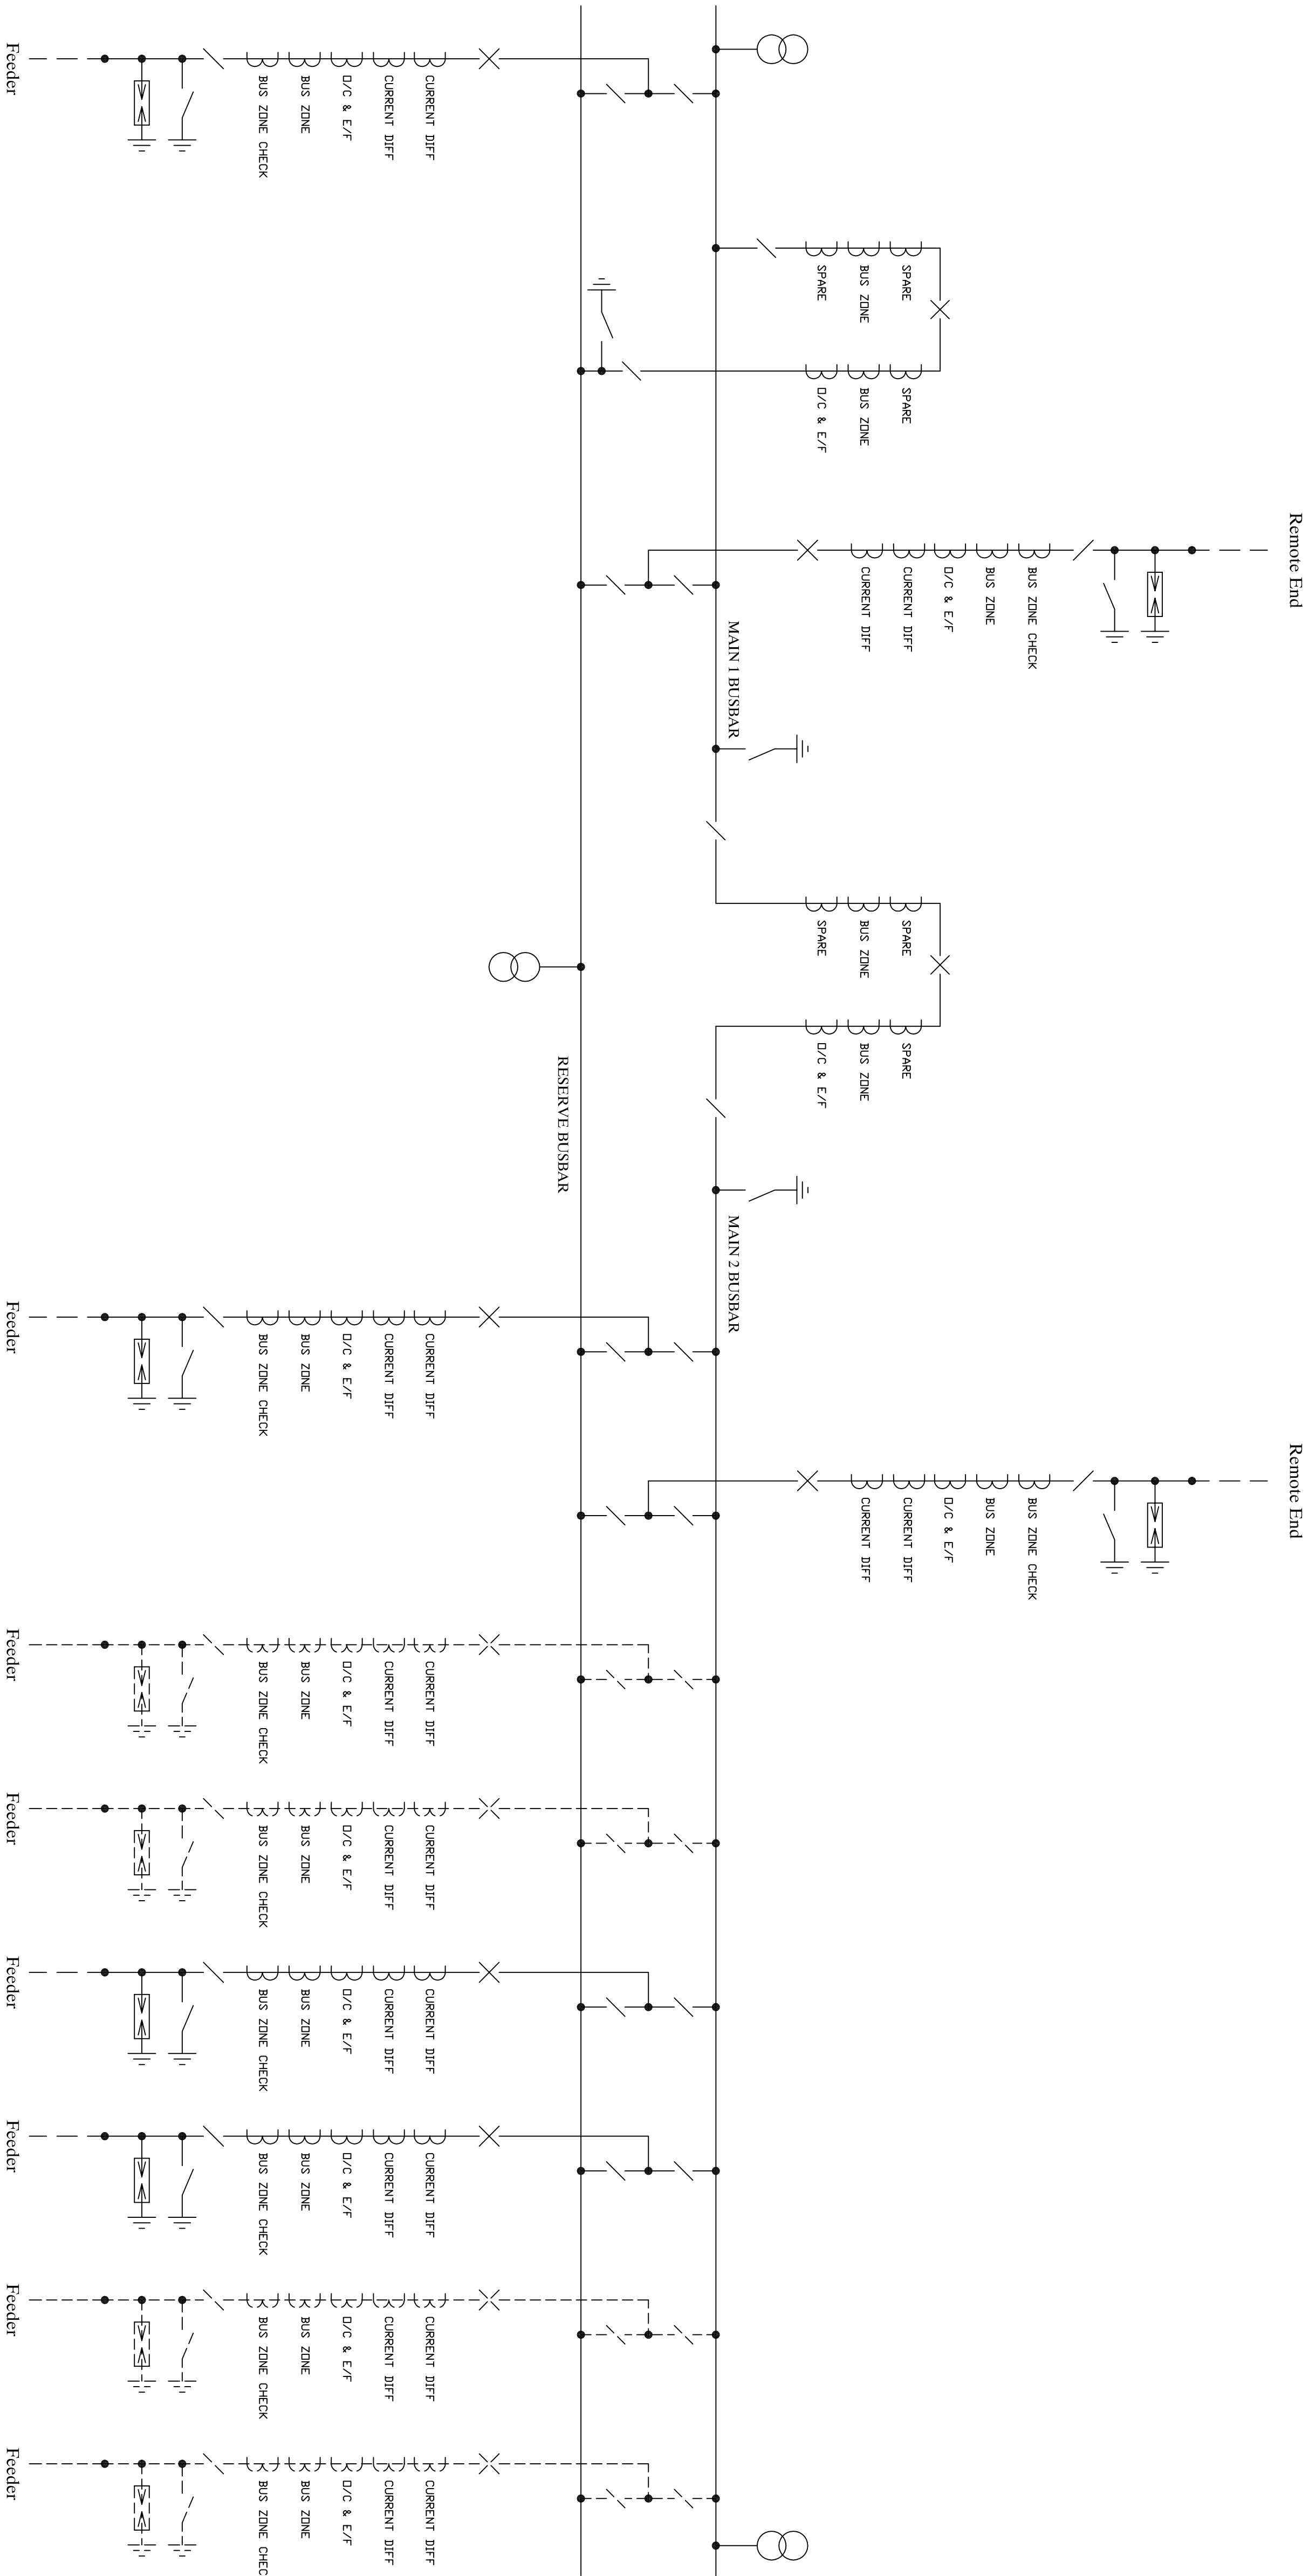

- BUS SECTION / BUS COUPLER
- CPRE 1 2400/2400/2000/1600/1200/1000/800/2 CLASS X BUS ZONE
 - CPRE 2 3200/2400/2000/1600/1200/1000/800/2 CLASS X BUS ZONE
 - CPRE 3 1500/1200/1000/800/600/500/400/300/150/1 CLASS X BUS ZONE CHECK

- FEDERS
- CPRE 1 1600/1200/1000/800/600/500/400/300/150/1 CLASS X CURRENT DIFF
 - CPRE 2 1600/1200/1000/800/600/500/400/300/150/1 CLASS X CURRENT DIFF
 - CPRE 3 1600/1200/1000/800/600/500/400/300/150/1 CLASS X D/C & E/F
 - CPRE 4 1600/1200/1000/800/600/500/400/300/150/1 CLASS X BUS ZONE
 - CPRE 5 1600/1200/1000/800/600/500/400/300/150/1 CLASS X BUS ZONE CHECK

DRAWN		A.J.R.V.			
DATE		25.03.2009			
DRAWN/PERSON		1	PRINTED CT DATA		
REVISIONS				REV.	DATE
PLANNING					
PROTECTION					
ENGINEERS					
CHECKERS					
PRODUCTS					
PLAN/PROJ.					
MANAGER					
APPROVED					
DEPUTY HEAD H.V. OPERATIONS					
SCALE		NTS	DRAWING NUMBER		REV
			TD 41		1

ETHEKWINI ELECTRICITY

PROPOSED 132KV DOUBLE BUSBAR SWITCHYARD

132KV SCHEMATIC DIAGRAM