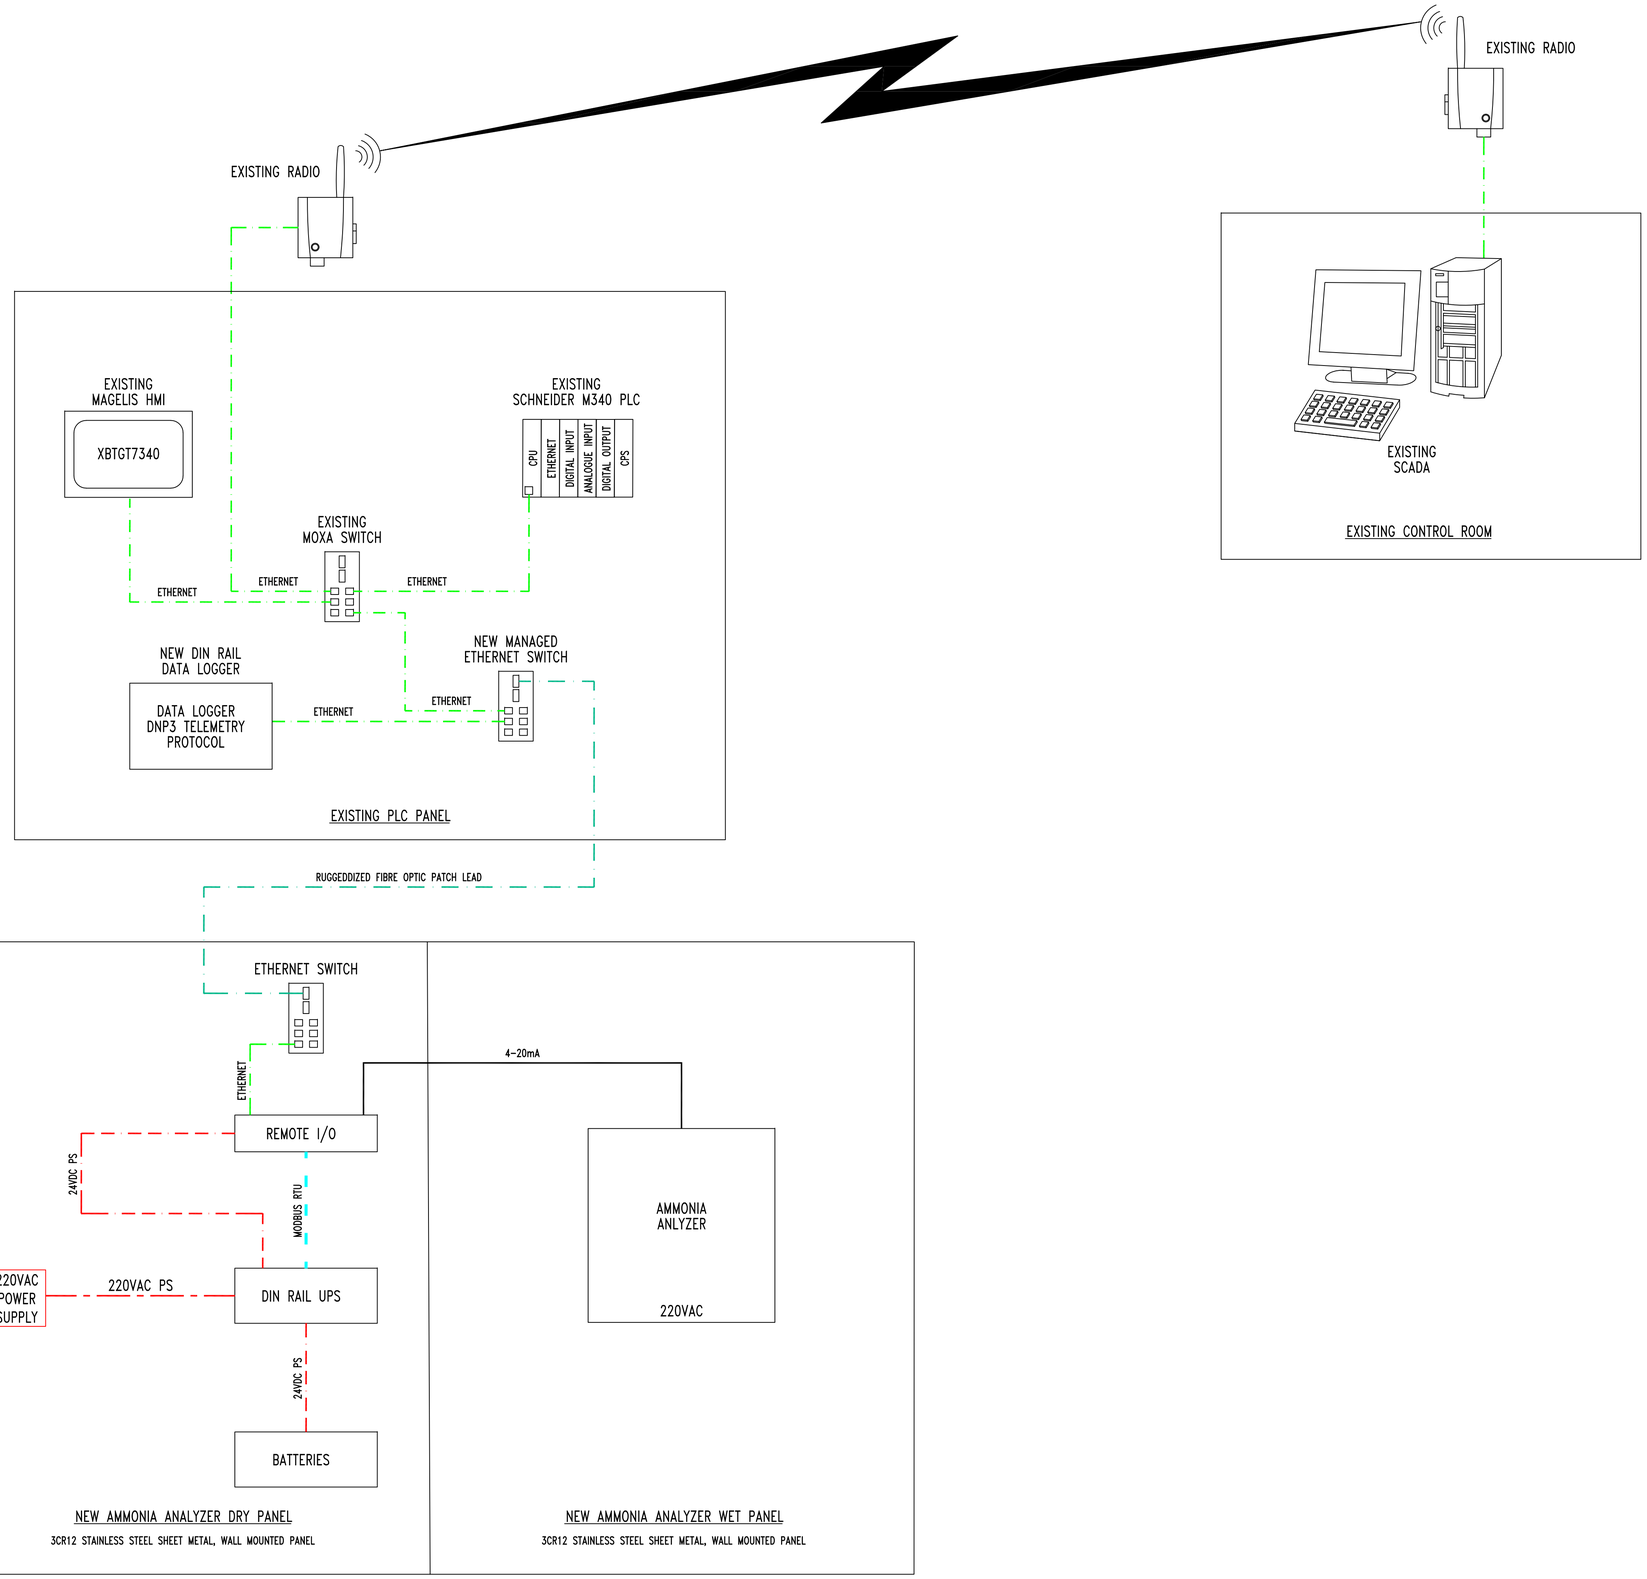

RA | 72224

LEGEND:

- 220V AC SUPPLY
- 24V DC SUPPLY
- 4-20mA CABLE
- CAT 5 ETHERNET CABLE
- MODBUS CABLE
- RUGGEDIZED FIBRE PATCH LEADS

REVISIONS

No	DATE	CHECKED	APPROVED	DESCRIPTION
A	2025-04-09	P.M.	T.N.	PRELIMINARY DESIGN DRAWING

RA_XXXXX	XXXXXXX
NUMBER	TITLE

REFERENCE DRAWINGS

RAND WATER
BOX 1127
JOHANNESBURG
2000
TEL: +27 11 682-0911

SAP PROJECT No.:	P.0XXXX	CHECKED:	
NETWORK ID No.:	400XXXX	SECTION HEAD:	
CONTRACT:	RWXXXXX/XX	APPROVED	
FILE:	RWXXXXX/XX		
DRAWN BY:	P. MANANA	SIGNATURE	
TRACED BY:	S. MAJAM	Pr Eng. No.	
DATE:	2025-04-09	DATE	

BARRAGE WATER TREATMENT PLANT
ZEOLITE WATER TREATMENT PLANT
AUTOMATION NETWORK LAYOUT

STATION	WKS	DOC. TYPE	S
BAR	XXXXXX	DLG	A

© RAND WATER 2004 All Rights Reserved

SCALE: N.T.S.

RA | 72224 | REVISION A