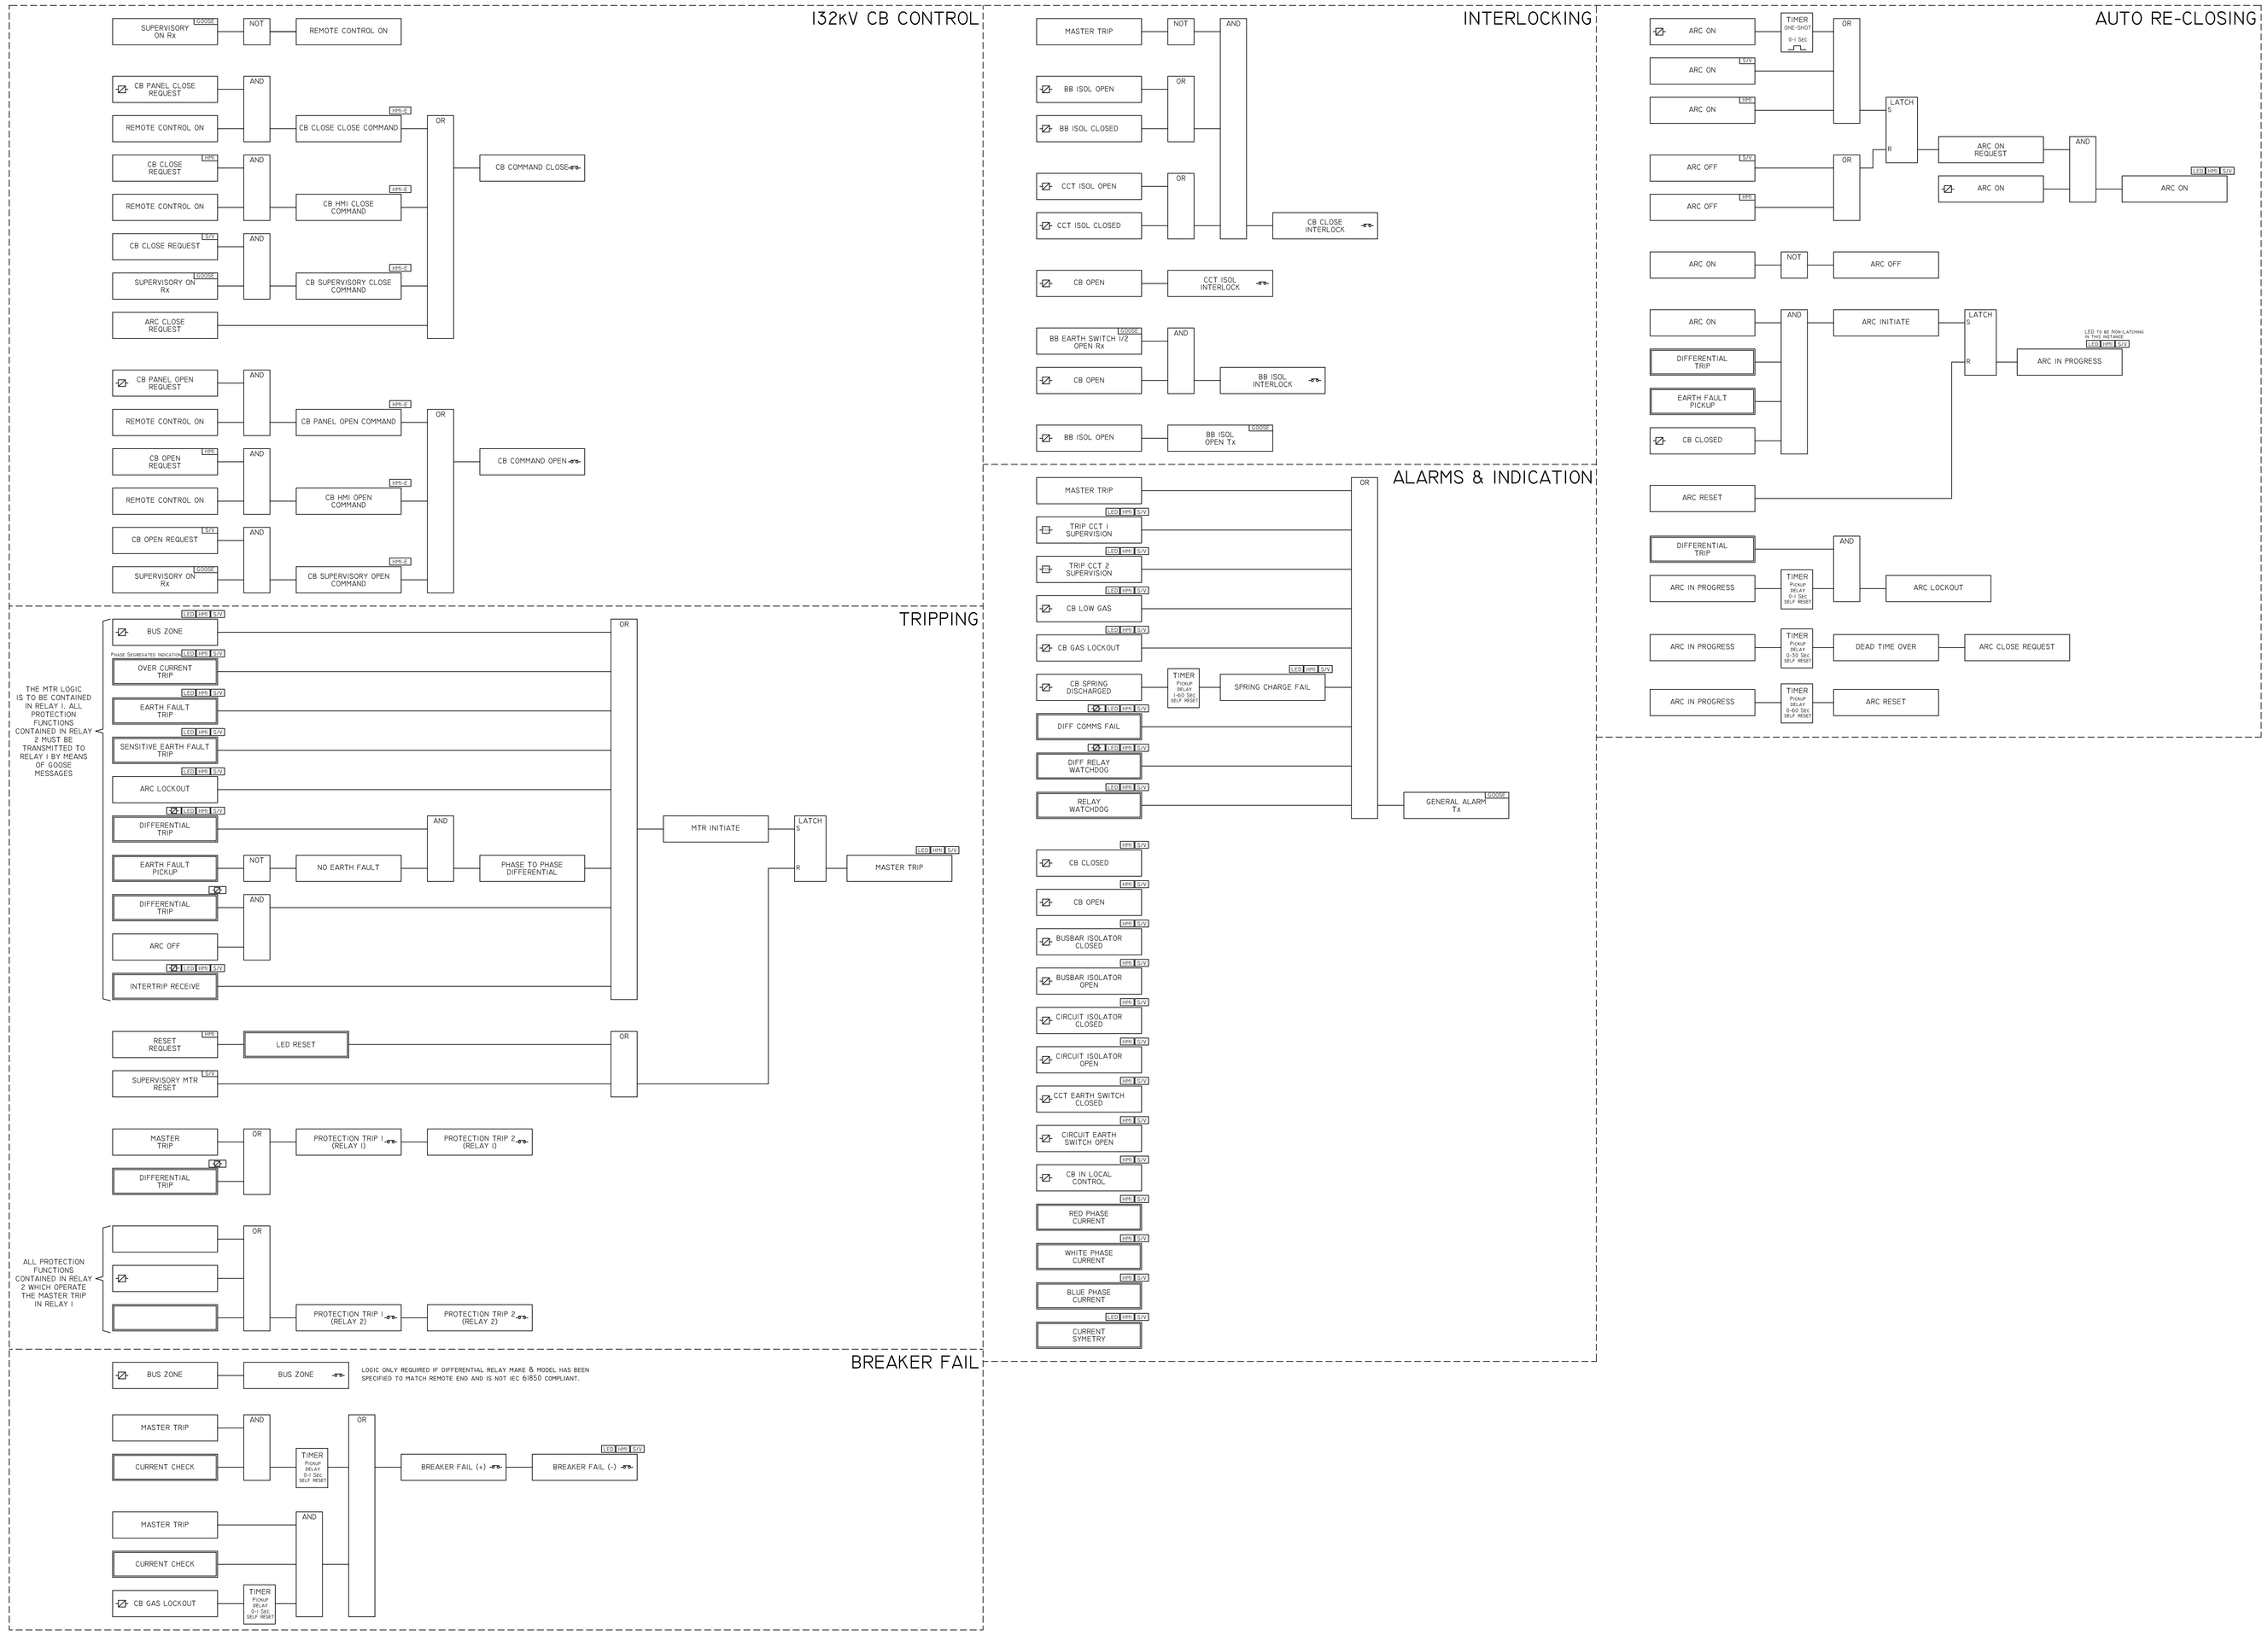

NOTE:
THE PURPOSE OF THIS DRAWING IS TO CLARIFY THE REQUIREMENTS OF THE ASSOCIATED CONTRACT ENQUIRY SPECIFICATION AND THE ISSUE OF THIS WITH THE SPECIFICATION DOES NOT ABSOLVE THE SUCCESSFUL CONTRACTOR FROM HIS NORMAL RESPONSIBILITY TO PROVIDE A SATISFACTORY SCHEME OR SUBMIT DRAWINGS OF SYSTEMS PROPOSED FOR APPROVAL BY THE ENGINEER.

DRAWN	A.J.R.W.				
DATE	25.03.2009				
CHIEF TRANSMITTER/SCN		REFERENCE DRAWINGS:	REVISIONS:	BY:	DATE:
PLANNING ENGINEER					
PROTECTION ENGINEER					
PLANNING ENGINEER					
PROJECTS ENGINEER					
PLAN /PROJ MANAGER					
APPROVED A.J. DOLD DEPUTY HEAD H.V. OPERATIONS		SCALE NTS	DRAWING NUMBER TD 54	REV:	

ETHERWINI ELECTRICITY

PROPOSED 132kV SINGLE BUSBAR SWITCHYARD

PROTECTION & CONTROL LOGIC FOR 132kV FEEDER WITH AUTO-RECLOSING