DRAWING NOTES:

1. TRENCH TO BE BACKFILLED IN 150MM LAYERS AND COMPACTED WITH MECHANICAL VIBRATORS TO 90% MOD AASHTO DENSITY.
2. ALL MV CABLES IN PROXIMITY OR IN COMMON TRENCH WITH LV CABLES TO HAVE MINIMUM 150 MM HORIZONTAL DISTANCE BETWEEN CABLES(LV-MV).
3. ALL CABLES TO BE ENCASED IN CONCRETE.

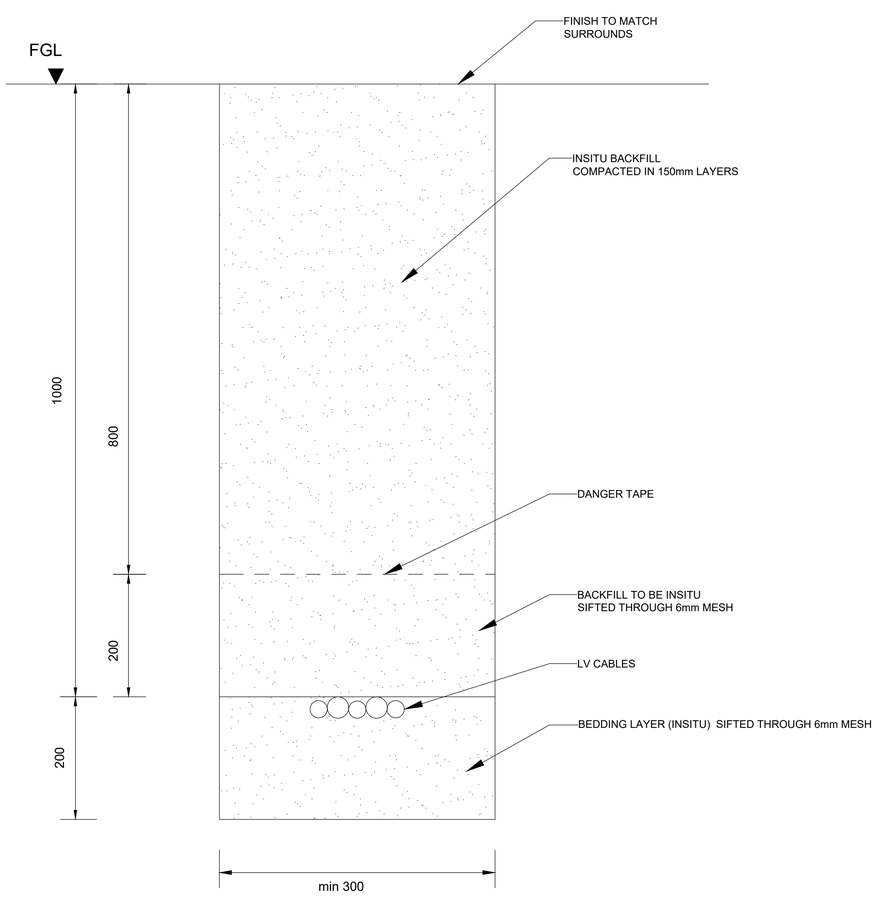

DETAIL 1
LV CABLE TRENCH
NTS

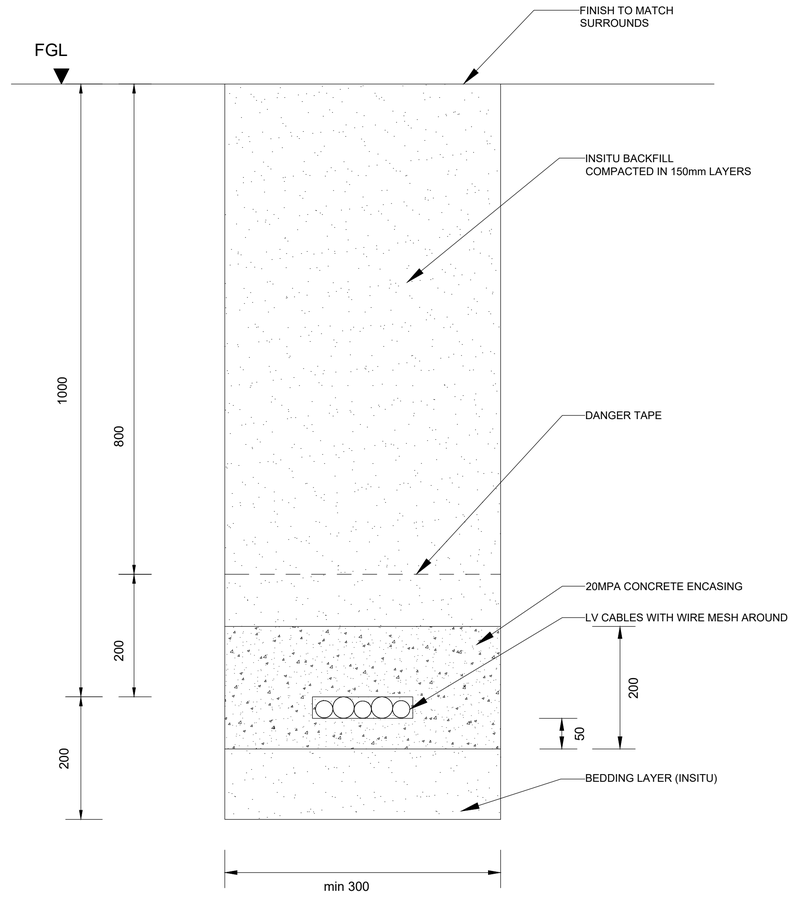

DETAIL 2
LV CABLE TRENCH WITH CABLES ENCASED
NTS

No.	DATE	REVISION	APPROVED
V1	10-07-2020	ORIGINAL VERSION	D.N.

SANRAL TYPICAL DRAWINGS

COPYRIGHT: THIS DRAWING IS PROTECTED IN TERMS OF THE COPYRIGHT ACT No. 98 OF 1978 AND MAY NOT BE REPRODUCED WITHOUT THE PERMISSION IN WRITING FROM SANRAL.
CONDITIONS FOR USE: CONSULTANTS APPOINTED BY SANRAL SHALL INCORPORATE THE TYPICAL DETAILS HEREON INTO THEIR SPECIFIC DESIGN FOR WHICH THEY WILL ASSUME FULL PROFESSIONAL RESPONSIBILITY. THIS TYPICAL DRWING MAY NOT BE USED FOR TENDER PURPOSES.

SANRAL
BUILDING SOUTH AFRICA THROUGH BETTER ROADS

HEAD OFFICE
48 Tambotie Avenue
Val de Grace
Pretoria
0184

PO Box 415
Pretoria 0001
South Africa
Tel: (012) 844 8000

EASTERN REGION
58 van Eck Place
Pietermaritzburg
3201

PO Box 100410
Scottsville
3209
Tel: (033) 392 8100

APPROVED

Date:

TYPICAL DRAWINGS - ELECTRICAL

LV CABLE TRENCH STANDARD DETAILS

SANRAL DOC No. (PDF): -

SANRAL DOC No. (DWG): -

SANRAL DRAWING No.: TD-E-P-3000-1-V1

TD-E-P-3000-1-V1