



NOTES

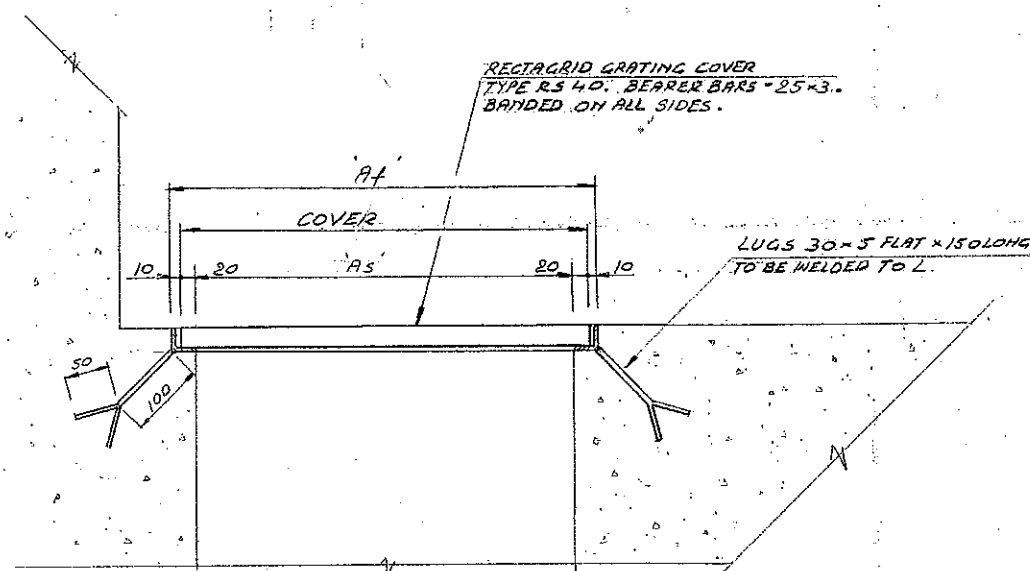

SECTION A-A

NOTES.

1. FRAME TO BE MADE OF 30 x 30 x 3 L
2. CORNERS TO BE MITRED AT 45°
3. DIMENSIONS: A1 & B1 - (FRAME) TO BE — 560 x 560 U.O.S.
 A's & B's - (SPAN) TO BE — 500 x 500 U.O.S.
 RECTAGRID GRATING COVER TO BE — 540 x 540 U.O.S.
4. COVER AND FRAME TO BE HOT DIPPED GALVANIZED.

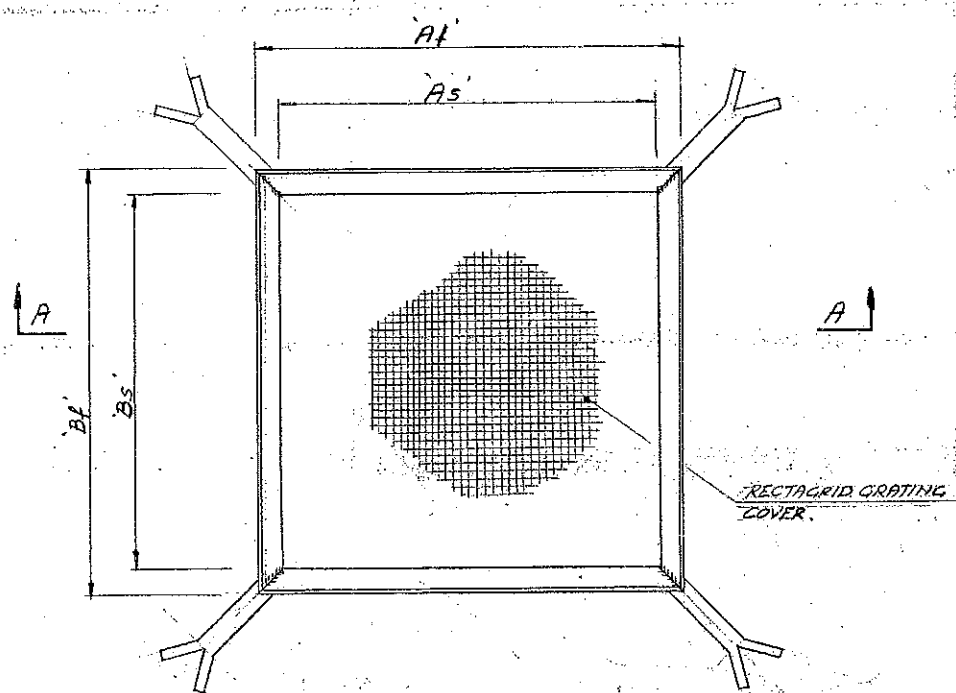

PLAN

[illegible]

RAND WATER BOARD

BOX 1127
JOHANNESBURG
TEL: 933 6650

A. B. HARDWICK
PR. ENG.
MANAGER ENGINEERING

JOB No		CHECKED	<i>[Signature]</i>
CONTRACT No		SECTION HEAD	<i>[Signature]</i>
SCHEME		APPROVED	<i>[Signature]</i> (P. Eng.)
DRAWN BY	P. R.		
DATE	3.5.1988		
			CAPACITY 450 000 L.
			DATE 15.07.15

STANDARDS

PIPELINES AND BOOSTERS

DETAILS OF CAST IN FRAME FOR
VALVE CHAMBER SUMPS

SCALE 1:5

DRG No A 8879

REVISION