



**THE DECOMMISSIONING, REMOVAL,
INSTALLATION AND COMMISSIONING OF
AUTOMOTIVE FUEL DISPENSING UNITS AND
STORAGE TANKS FOR NAVAL BASE SIMON'S
TOWN, EAST DOCKYARD**

SPSC/ B / 014 / 2024

FOR DEPARTMENT OF DEFENCE

SIMON'S TOWN PROCURMENT SERVICE CENTRE

**CLOSING DATE: 19 SEPTEMBER 2024
CLOSING TIME: 11H00**

VALIDITY: 120 CALENDAR DAYS

INDEX

Bid: General Information

Contact Information
Bid Details
Address for Bid Submissions
Map / Directions to Simon's Town Procurement Service Centre

SECTION A:

MANDATORY EVALUATION CRITERIA PHASE 1 (STAGE 1)

Appendix A: Pricing Schedule
Appendix B: SBD 4: Bidders Disclosure
Appendix C: SBD 6.1: Preference Points Claim Form
Appendix D: Compulsory Briefing Session
Appendix E: Compulsory Site Viewing

ADMINISTRATION EVALUATION CRITERIA PHASE 1 (STAGE 1)

Appendix F: SBD 1: Invitation to Bid
Appendix G: Central Suppliers Database (CSD) Registration / Summary Report
Appendix H: Certificate of Compliance by Sub-Contractor/s
Appendix I: SPSC Indemnity Agreement form
Appendix J: Written Agreement wrt Occupational Health and Safety Agreement (OHASA)
Appendix K: SPSC Group Questionnaire
Appendix L: Defence Intelligence questionnaire (D.I.)

SECTION B:

MANDATORY TECHNICAL EVALUTION PHASE 1 (STAGE 2)

Appendix M: Specification/ Statement of Work
Appendix N: Construction Industry Development Board (CIDB)
Appendix O: Electrical Conformance Board of South Africa (ECB (SA) and/or Electrical Contractors Association of South Africa (ECA (SA)
Appendix P: Type Approval Certificate SANS 1650 or SANS 1020 and/or ISO 9001
Appendix Q: Type Approval Certificate ISO 9001
Appendix R: Waste disposal undertaking / agreement
Appendix S: Letter of accreditation from offered Fuel Dispensers OEM
Appendix T: Letter of accreditation from offered Underground Storage Tanks OEM

CONTACT INFORMATION

Technical Information:

Contact: Staff Sergeant N.N. Jantjies
Email Address: spsctechsection@gmail.com
Office Tel No: (021) 787 5144

Administrative Information:

Contact: Flight Sergeant Crous
Email Address: spscbidinvitation@gmail.com
Office Tel No: (021) 787 5034

Address for depositing of bid documents

Street: Simon's Town Procurement Service Centre
No. 2 Arsenal Road
Simon's Town
7995


BID SUBMISSIONS

Closing period of bid: Minimum 21 Calendar days

Validity of Bid: 120 Calendar days

GPS CO-ORDINATES TO SPSC BID BOX:

S 34° 11. 530'
E 18° 25. 591'

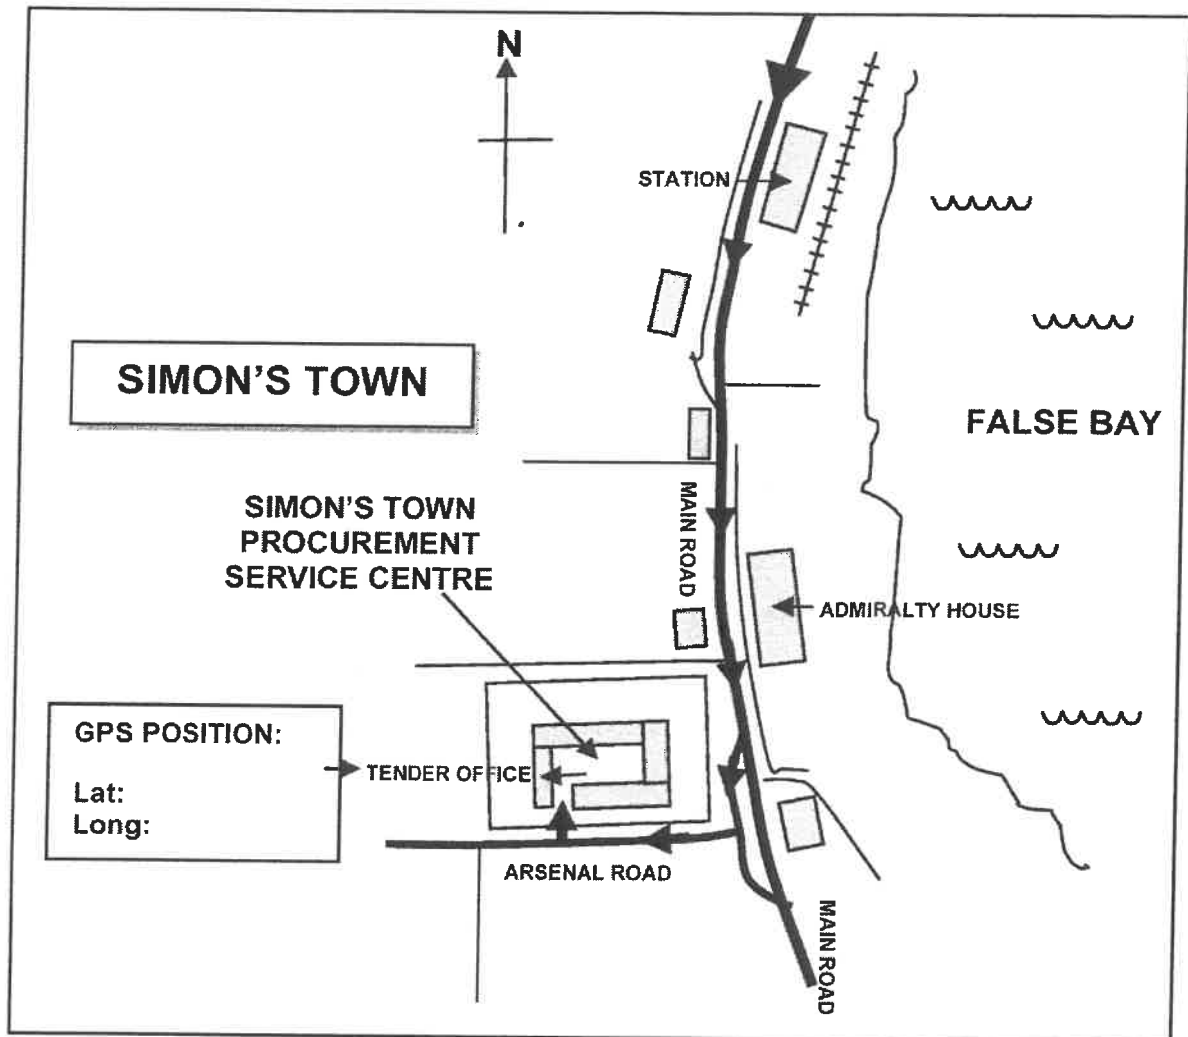



logistics division

Department:
Defence
REPUBLIC OF SOUTH AFRICA

BID EVALUATION INSTRUCTIONS

1. All entries are to be completed in any **non-erasable ink** of your choice preferably **Blue** or **Black** ink. Amendments, scratching out, use of Tippex and omission to any documents will Invalidate the bid.
 2. Except where otherwise indicated, all questions must be completed.
 3. **No** bids received by **email, facsimile** or similar medium will be considered. The original bid must be deposited at the entrance (green box) or handed in at the Bid receipt section at SPSC, 2 Arsenal Road, Simon's Town.
 4. The bidder is responsible for all the costs that they shall incur related to the preparation and submission of the bid document
 5. All information regarding the evaluation process must be treated as confidential.
 6. The **2 ENVELOPE** system will be utilized. Bidders are required to submit two separate, properly sealed envelopes, both clearly marked with the Company Name, Bid Number and Closing Date.
 - a. **Envelope 1:** Pricing Schedule (**Only Pricing Schedule**)
 - b. **Envelope 2:** SBD documents, Description and all other required documents.
- NOTE THAT IF THE DOCUMENTS ARE SUBMITTED IN ONE ENVELOPE AND NOT IN TWO ENVELOPES AS INDICATED ABOVE, THIS OFFER WILL BE INVALIDATED**
7. The bids will be evaluated according to the following criteria:
 - a. Mandatory Criteria and Administration Criteria (Phase 1, Stage 1)
 - b. Mandatory Technical evaluation (Phase 1, Stage 2)
 - c. Price and Specific Goals (Phase 3 & 4)
 8. This requirement will be awarded using the 80/20 principal
 9. No late bids will be accepted after the closing date and time.
 10. The Simon's Town Procurement Service Centre reserves the right to award this Requirement as a case or per individual line.

MANDATORY AND ADMINISTRATION EVALUATION CRITERIA

Phase 1: Bidders will be evaluated as follows:

Phase 1 Stage 1: Compliance to Mandatory Evaluation Criteria, bidders that do not fully comply with the Mandatory Evaluation Criteria will be eliminated/ excluded and **will not proceed to Phase 1 Stage 2.**

S/NO	Criteria
	A
	Phase 1, Stage 1
	Phase 1, Stage 1, Mandatory Evaluation Criteria
1.	<u>Pricing Schedule:</u> All fields on this document must be fully completed. Attention must be given to page 1, Bidders to complete the address block or make use of a Company Stamp, Total Unit Cost and Total Cost must be completed. The bid must be submitted in the Two (2) Envelope system as follows: Envelope 1: Pricing Schedule (Only Pricing Schedule) Envelope 2: SBD documents, Specification/ Statement of work and all other required documents. Failure to submit this document as indicated by the closing date and time will invalidate this offer. Appendix A
2.	<u>SBD 4 - Bidders Disclosure:</u> This document must be fully completed. Failure to submit this document as indicated by the closing date and time will invalidate this offer. Appendix B
3.	<u>SBD 6.1 Preference Points Claim Form:</u> This document must be fully completed. Failure to submit this document as indicated by the closing date and time will forfeit your Specific Goals points. Appendix C
4.	<u>Compulsory Briefing Session Certificate:</u> Suppliers/Contractors are advised to send a technically knowledgeable representative to the Briefing Session. Failure to attend the compulsory Briefing Session and submit the completed and signed Briefing Session certificate by the closing date and time will invalidate your offer. Appendix D
5.	<u>Compulsory Site Viewing Certificate:</u> Suppliers/Contractors are advised to send a technically knowledgeable representative to the Site Viewing to do measurements. Failure to attend the compulsory Site Viewing Session and submit the completed and signed Site Viewing certificate by the closing date and time will invalidate your offer. Appendix E

Phase 1: Bidders will be evaluated as follows:

Phase 1 Stage 1 Administration: Compliance to Administration Evaluation Criteria, bidders that do not fully comply with the Administration Evaluation Criteria may be required to submit omitted information. The Department of Defence reserves the right to request any info that will not interfere with the bid competitiveness.

S/NO	Criteria
	A
	Phase 1, Stage 1
	Phase 1, Stage 1, Administration Evaluation Criteria
6.	SBD 1 / Invitation to Bid: This document to be fully completed. Failure to submit this document as indicated by the closing date and time may invalidate this offer. Appendix F
7.	Central Suppliers Database (CSD) Full Registration/Summary Report: The CSD Full Registration/Summary Report should be submitted. The supplier should be: i. Tax Compliant on day of award. If not compliant, a grace period of 7 days will be given to update this status. ii. Successfully verified bank details iii. Physical Address Type iv. Suppliers should be registered for the commodity/service required for this bid. Failure to submit the CSD full Registration/Summary Report by the closing date and time may invalidate this offer. Appendix G
8.	Certificate of Compliance by Sub-Contractor/s: A certificate of compliance signed by the bidder and all sub - contractor/s (in the event of sub-contracting) to be fully completed. Failure to submit this document as indicated by the closing date and time may invalidate this offer. Appendix H
9.	SPSC Indemnity Agreement Form: This document to be fully completed. Failure to submit this document as indicated by the closing date and time may invalidate this offer. Appendix I
10.	Written Agreement wrt Occupational Health and Safety Agreement (OHASA): The OHASA agreement, signed amongst the DOD and bidder to be fully completed. Failure to submit this document as indicated by the closing date and time may invalidate this offer. Appendix J
11.	SPSC Group Questionnaire: This document to be fully completed. Failure to submit this document as indicated by the closing date and time may invalidate this offer. Appendix K
12.	Defence Intelligence Questionnaire (D.I.) The DI Vetting form to be completed in full. Failure to submit the DI Vetting form and required documentation as indicated, by the closing date and time may invalidate this offer. N.B. The short listed companies will be requested to submit Police Clearance for members entering SANDF property. Appendix L

MANDATORY TECHNICAL EVALUATION

Phase 1 Stage 2: Bidders must comply with Statement of Work. Bidders who do not will be invalidated/ excluded and will not proceed to Phase 2.

S/No	Criteria
	Phase 1 Stage 2
1.	<u>SPECIFICATION / STATEMENT OF WORK:</u> The bidder's compliance must be indicated with the word <u>comply/do not comply, agree/do not agree, yes or no,</u> or any other form of acceptance or non-acceptance on the statement of work, <u>each paragraph and sub-paragraph must be acknowledged. No abbreviations will be accepted, for example, "c/nc for comply/not comply or y/n for yes/no etc".</u> The most suitable supplier will be awarded in accordance with compliance to Specification/ Statement of Work and fit for purpose A separate attached signed letterhead shall be used if space provided is inadequate for listing the deviations. It shall clearly list the relevant paragraphs and, in detail, the deviations from that stated/specified. This Specification/ Statement of Work shall not be used for any purpose other than tendering or manufacturing. No alterations shall be allowed without the consent of the Simon's Town Procurement Service Centre Failure to comply will invalidate this offer. Appendix M
2.	<u>Construction Industry Development Board (CIDB):</u> The bidder's must be registered for Grade 4 ME or higher / Grade 4 CE or higher. Proof to be attached. Failure to comply will invalidate this offer. Appendix N
3.	<u>Electrical Conformance Board of South Africa (ECB(SA) and/or Electrical Contractors Association of South Africa (ECA(SA):</u> The bidder's must be registered with ECB (SA) and/or ECA (SA) with a proven track record in executing electrical installation work in hazardous areas (specifically public forecourt automotive fuel storage and dispensing facilities.) Proof to be attached. Failure to comply will invalidate this offer. Appendix O
4.	<u>Type Approval Certificate SANS 1650 or SANS 1020 and/or ISO 9001:</u> The bidder to provide a Certificate clearly indicate the manufacturer of the offered automotive fuel dispensing unit being a SANS accredited company or ISO 9001 to be offered for Aboveground Fuel Dispensers. Failure to comply will invalidate this offer. Appendix P
5.	<u>Type Approval Certificate ISO 9001:</u> The bidder to provide Certificate of Registration that shall clearly indicate the manufacturer of the offered Underground Storage Tanks OEM being ISO 9001 accredited company. Signed letter of accreditation to be attached. Failure to comply will invalidate this offer. Appendix Q

S/No	Criteria
Phase 1 Stage 2	
6.	<u>Waste disposal undertaking / agreement:</u> The bidder's shall provide agreement of a legal and recognised waste disposal facility. Proof to be submitted. Failure to comply will invalidate this offer. Appendix R
7.	<u>Letter of accreditation from offered Fuel Dispensers OEM:</u> Bidder to submit a letter of accreditation from offered fuel dispensers OEM confirming tenderer and accredited/approved agent/installer thereof. Failure to comply will invalidate this offer. Appendix S
8.	<u>Letter of accreditation from offered Underground Storage Tanks OEM:</u> Bidder to submit a letter of accreditation from offered underground storage tanks OEM confirming tenderer and accredited/approved installer thereof. Failure to comply will invalidate this offer. Appendix T

Phase 3 & 4: Only bidders who qualified on Phase 1 stage 1 & 2 will be evaluated on Phase 3 and 4 Price and Specific Goal Points

Phase 3	Price (Will be according to specific requirements)	80/
----------------	---	------------

Phase 4: Preferential points. (As per Preferential Procurement Regulations 2022)
In terms of Regulation 4(2); 5(2); and 7(2) of the Preferential Procurement Regulations, preference points must be awarded for specific goals stated in the tender. For the purpose of this tender the tenderer will be allocated points based on the goals stated in table 1 below as may be supported by proof/documentation stated in the conditions of this tender

Table 1: Specific goals for the tender and points claimed are indicated per the table below. (Note to organs of state: Where either the 90/10 or 80/20 preference point system is applicable, corresponding points must also be indicated as such.

Note to tenderers: the tenderer must indicate how they claim points for each preference point system).

TABLE 1: THE TENDERER IS TO PICK ONLY ONE SPECIFIC GOAL


	The specific goals allocated points in terms of this tender	Number of points allocated (90/10 system) (To be completed by the organ of state)	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (90/10 system) (To be completed by the tenderer)	Number of points claimed (80/20 system) (To be completed by the tenderer)
LEVEL 1	51% owned by Black Women Military veterans or 51% owned by Black Youth or 51% owned by Black people with disability	10	20		
LEVEL 2	51% owned by Black Male Military veterans or 51% owed by people with disability or 51% owned by Black Women EME's	8	18		
LEVEL 3	51% owned by Women Military veterans or 51% owned by Black Male EME's or 51% owned by Black Women EME's or 51% owned by Black Women QSE's	6	16		

	The specific goals allocated points in terms of this tender	Number of points allocated (90/10 system) (To be completed by the organ of state)	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (90/10 system) (To be completed by the tenderer)	Number of points claimed (80/20 system) (To be completed by the tenderer)
LEVEL 4	51% owned by Male Military veterans or 51% owned by Youth or 51% owned by any other EME's or 51 owned by Black Male QSE's or 51% owned by Women QSE's	4	14		
LEVEL 5	51% owned by any other QSE's	2	12		
LEVEL 6	NOT APPLICABLE				
LEVEL 7	NOT APPLICABLE				
LEVEL 8	Non-compliant	0	0		

NOTE: BIDDERS ARE TO SUBMIT Sworn affidavit to substantiate the preference points claimed. Sworn Affidavit must be signed by legally recognized Commissioner of Oaths

Failure on the part of a tenderer to submit proof or documentation required in terms of this tender to claim points for specific goals with the tender, will be interpreted to mean that preference points for specific goals are not claimed

The organ of state reserves the right to require of a tenderer, either before a tender is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the organ of state



PRICING SCHEDULE

Pricing Schedule: All fields on this document must be fully completed.

Attention must be given to page 1, Bidders to complete the address block or make use of a Company Stamp, Total Unit Cost and Total Cost must be completed. The bid must be submitted in the Two (2) Envelope system as follows:

Envelope 1: Pricing Schedule (Only Pricing Schedule)

Envelope 2: SBD documents, Statement of work and all other required documents.

NOTE: DOCUMENTS SUBMITTED IN ONE (1) ENVELOPE AND NOT IN TWO (2) ENVELOPES AS INDICATED ABOVE, WILL BE INVALIDATED

Failure to submit these document as indicated by the closing date and time will invalidate this offer.

Appendix A



the sandf

Department:
Defence
REPUBLIC OF SOUTH AFRICA

Request for Bid : SPSC-B-014-2024

Author: E.A Martinus
Date: 08/23/2024 10:55:10

PRICING SCHEDULE

Bid No. SPSC-B-014-2024
Document No: 0000539162
Description: THE DECOMMISSIONING, REMOVAL, INSTALLATION AND COMMISSIONING OF AUTOMOTIVE FUEL DISPENSING UNITS AND STORAGE TANKS FOR NAVAL BASE EAST DOCKYARD, SIMON'S TOWN
Currency: ZAR
Closing Date: 2024-09-19 11:00:00
Status: Created
Validity Days: 120 Calendar Days

Document Type
*Company Name:
* Attention:
* Tel No:
* Fax No:
* Cell No:
*Email:

Request for Bid Open * Please Complete

No.

Item Code	Item Description	Consumer	Delivery Point	Purchase Unit of Measure	Date Required
60035430	THE DECOMMISSIONING, REMOVAL, INSTALLATION AND COMMISSIONING OF AUTOMOTIVE FUEL DISPENSING UNITS AND STORAGE TANKS FOR NAVAL BASE EAST DOCKYARD, SIMON'S TOWN. AS PER ATTACHED STATEMENT OF WORK	NAVAL BASE SIMONSTOWN	Simon's Town	Service	N/A
Line Comment					
Total Unit Cost in ZAR Currency, including VAT and ALL Delivery Costs *		Lead Time	Quantity Required	Quantity Available	
Total Cost in ZAR Currency, including VAT and ALL Delivery Costs *		N/A	1	N/A	

Item Code	Item Description	Consumer	Delivery Point	Purchase Unit of Measure	Date Required
60035430	MAINTENANCE PLAN: YEAR 1	NAVAL BASE SIMONSTOWN	Simon's Town	per month	N/A
Line Comment					
UNIT PRICE IS PER MONTH X 12 = TOTAL PRICE FOR YEAR 1					
Total Unit Cost in ZAR Currency, Including VAT and ALL Delivery Costs			Quantity Required	Quantity Available	
			12	N/A	
Total Cost in ZAR Currency, Including VAT and ALL Delivery Costs					
★					
★					

2

Item Code	Item Description	Consumer	Delivery Point	Purchase Unit of Measure	Date Required
60035430	MAINTENANCE PLAN: YEAR 2	NAVAL BASE SIMONSTOWN	Simon's Town	per month	N/A
Line Comment					
UNIT PRICE IS PER MONTH X 12 MONTHS = TOTAL PRICE FOR YEAR 2					
Total Unit Cost in ZAR Currency, Including VAT and ALL Delivery Costs			Quantity Required	Quantity Available	
			12	N/A	
Total Cost in ZAR Currency, Including VAT and ALL Delivery Costs					
★					
★					

3

Indicate Lead Time for all Items (Days)

The following conditions are hereby accepted:
"Standard Terms and Conditions" or "General Conditions of Contract" Available on Websites () or attached.
The awarding of the price quotation as determined by (Department of Defence).
The following is hereby certified:
This offer is correct and any mistakes will be at my risk.
I accept responsibility for the execution of all obligations entrusted upon me.
I did not participate in any collusive practices with any other supplier or any other person regarding
this price quotation or any other price quotation.
I am duly authorized to sign the price quotation.
The offer is inclusive of value Added Tax

*Name: *Capacity:

*Signature: *Date:

Price Firm Y/N		* Grand Total Including Vat:
Do You Accept Government Orders Y/N		
Comply with Specification Y/N		
Brand & Model		
Delivery Period Firm Y/N		
If Not, Deviations		

Questionnaires

Questionnaires / Evaluation Criteria

THE 80/20 QUESTIONNAIRE EVALUATION TEMPLATE V2

Questions	Options
Level 1: 51% owned by Black Women Military veterans / 51% owned by Black youth / 51% owned by Black people with disability	LEVEL 1
Level 2: 51% owned by Black Male Military veterans / 51% owned by people with disability / 51% owned by Black Women EMES	LEVEL 2
Level 3: 51% owned by Women Military veterans / 51% owned by Black Male EMES / 51% owned by Black Women QSEs/51% owned by Women EMES	LEVEL 3
	LEVEL 4
	LEVEL 5
	LEVEL 6

Refer to SBD b.1.

~~Level 4: 51% owned by Male Military veterans / 51% owned by youth / 51% owned by any other EMEs / 51% owned by Black Male QSEs / 51% owned by Women QSEs~~

Level 5: 51% owned by any other QSEs

LEVEL 7

LEVEL 8

NON-COMPLIANT

Attachment Description

Attachment File Name



SBD 4: BIDDERS DISCLOSURE

SBD 4 - Bidders Disclosure: This document must be fully completed. Failure to submit this document as indicated by the closing date and time **will invalidate this offer. Appendix B**

Failure to submit the document as indicated by the closing date and time will invalidate this offer.

Appendix B

BIDDER'S DISCLOSURE

1. PURPOSE OF THE FORM

Any person (natural or juristic) may make an offer or offers in terms of this invitation to bid. In line with the principles of transparency, accountability, impartiality, and ethics as enshrined in the Constitution of the Republic of South Africa and further expressed in various pieces of legislation, it is required for the bidder to make this declaration in respect of the details required hereunder.

Where a person/s are listed in the Register for Tender Defaulters and / or the List of Restricted Suppliers, that person will automatically be disqualified from the bid process.

2. Bidder's declaration

2.1 Is the bidder, or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest¹ in the enterprise, employed by the state? **YES/NO**

2.1.1 If so, furnish particulars of the names, individual identity numbers, and, if applicable, state employee numbers of sole proprietor/ directors / trustees / shareholders / members/ partners or any person having a controlling interest in the enterprise, in table below.

Full Name	Identity Number	Name of State Institution

2.2 Do you, or any person connected with the bidder, have a relationship

¹ the power, by one person or a group of persons holding the majority of the equity of an enterprise, alternatively, the person/s having the deciding vote or power to influence or to direct the course and decisions of the enterprise.

with any person who is employed by the procuring institution? YES/NO

2.2.1 If so, furnish particulars:

.....

2.3 Does the bidder or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest in the enterprise have any interest in any other related enterprise whether or not they are bidding for this contract? YES/NO

2.3.1 If so, furnish particulars:

.....

3 DECLARATION

I, _____ the _____ undersigned,
 (name)..... in
 submitting the accompanying bid, do hereby make the following
 statements that I certify to be true and complete in every respect:

- 3.1 I have read and I understand the contents of this disclosure;
- 3.2 I understand that the accompanying bid will be disqualified if this disclosure is found not to be true and complete in every respect;
- 3.3 The bidder has arrived at the accompanying bid independently from, and without consultation, communication, agreement or arrangement with any competitor. However, communication between partners in a joint venture or consortium² will not be construed as collusive bidding.
- 3.4 In addition, there have been no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications, prices, including methods, factors or formulas used to calculate prices, market allocation, the intention or decision to submit or not to submit the bid, bidding with the intention not to win the bid and conditions or delivery particulars of the products or services to which this bid invitation relates.
- 3.4 The terms of the accompanying bid have not been, and will not be, disclosed by the bidder, directly or indirectly, to any competitor, prior to the date and time of the official bid opening or of the awarding of the contract.
- 3.5 There have been no consultations, communications, agreements or arrangements made by the bidder with any official of the procuring

² Joint venture or Consortium means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract.

institution in relation to this procurement process prior to and during the bidding process except to provide clarification on the bid submitted where so required by the institution; and the bidder was not involved in the drafting of the specifications or terms of reference for this bid.

- 3.6 I am aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to bids and contracts, bids that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and or may be reported to the National Prosecuting Authority (NPA) for criminal investigation and or may be restricted from conducting business with the public sector for a period not exceeding ten (10) years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

I CERTIFY THAT THE INFORMATION FURNISHED IN PARAGRAPHS 1, 2 and 3 ABOVE IS CORRECT.

I ACCEPT THAT THE STATE MAY REJECT THE BID OR ACT AGAINST ME IN TERMS OF PARAGRAPH 6 OF PFMA SCM INSTRUCTION 03 OF 2021/22 ON PREVENTING AND COMBATING ABUSE IN THE SUPPLY CHAIN MANAGEMENT SYSTEM SHOULD THIS DECLARATION PROVE TO BE FALSE.

.....	
Signature	Date
.....	
Position	Name of bidder



SBD 6.1: PREFERENCE POINTS CLAIM FORM

SBD 6.1 -Preference Points Claim Form: This document must be fully completed. Failure to submit this document as indicated by the closing date and time **will forfeit your Specific Goals points. Appendix C**

**Failure to complete the document as indicated by the closing date and time will forfeit your Specific Goals points.
Appendix C**

**PREFERENCE POINTS CLAIM FORM IN TERMS OF THE PREFERENTIAL
PROCUREMENT REGULATIONS 2022**

This preference form must form part of all tenders invited. It contains general information and serves as a claim form for preference points for specific goals.

NB: BEFORE COMPLETING THIS FORM, TENDERERS MUST STUDY THE GENERAL CONDITIONS, DEFINITIONS AND DIRECTIVES APPLICABLE IN RESPECT OF THE TENDER AND PREFERENTIAL PROCUREMENT REGULATIONS, 2022

1. GENERAL CONDITIONS

- 1.1 The following preference point systems are applicable to invitations to tender:
- the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and
 - the 90/10 system for requirements with a Rand value above R50 000 000 (all applicable taxes included).

1.2 **To be completed by the organ of state**

(delete whichever is not applicable for this tender).

- a) The applicable preference point system for this tender is the 90/10 preference point system.
- b) The applicable preference point system for this tender is the 80/20 preference point system.
- c) Either the 90/10 or 80/20 preference point system will be applicable in this tender. The lowest/ highest acceptable tender will be used to determine the accurate system once tenders are received.

- 1.3 Points for this tender (even in the case of a tender for income-generating contracts) shall be awarded for:

- (a) Price; and
- (b) Specific Goals.

1.4 **To be completed by the organ of state:**

The maximum points for this tender are allocated as follows:

POINTS	
PRICE	80
SPECIFIC GOALS	20
Total points for Price and SPECIFIC GOALS	100

- 1.5 Failure on the part of a tenderer to submit proof or documentation required in terms of this tender to claim points for specific goals with the tender, will be interpreted to mean that preference points for specific goals are not claimed.
- 1.6 The organ of state reserves the right to require of a tenderer, either before a tender is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the organ of state.

2. DEFINITIONS

- (a) **"tender"** means a written offer in the form determined by an organ of state in response to an invitation to provide goods or services through price quotations, competitive tendering process or any other method envisaged in legislation;
- (b) **"price"** means an amount of money tendered for goods or services, and includes all applicable taxes less all unconditional discounts;
- (c) **"rand value"** means the total estimated value of a contract in Rand, calculated at the time of bid invitation, and includes all applicable taxes;
- (d) **"tender for income-generating contracts"** means a written offer in the form determined by an organ of state in response to an invitation for the origination of income-generating contracts through any method envisaged in legislation that will result in a legal agreement between the organ of state and a third party that produces revenue for the organ of state, and includes, but is not limited to, leasing and disposal of assets and concession contracts, excluding direct sales and disposal of assets through public auctions; and
- (e) **"the Act"** means the Preferential Procurement Policy Framework Act, 2000 (Act No. 5 of 2000).

3. FORMULAE FOR PROCUREMENT OF GOODS AND SERVICES

3.1. POINTS AWARDED FOR PRICE

3.1.1 THE 80/20 OR 90/10 PREFERENCE POINT SYSTEMS

A maximum of 80 or 90 points is allocated for price on the following basis:

$$P_s = 80 \left(1 - \frac{P_t - P_{min}}{P_{min}} \right) \quad \text{or} \quad P_s = 90 \left(1 - \frac{P_t - P_{min}}{P_{min}} \right)$$

Where

- P_s = Points scored for price of tender under consideration
- P_t = Price of tender under consideration
- P_{min} = Price of lowest acceptable tender

3.2. FORMULAE FOR DISPOSAL OR LEASING OF STATE ASSETS AND INCOME GENERATING PROCUREMENT

3.2.1. POINTS AWARDED FOR PRICE

A maximum of 80 or 90 points is allocated for price on the following basis:

$$\begin{array}{ccc} 80/20 & \text{or} & 90/10 \\ P_s = 80 \left(1 + \frac{P_t - P_{max}}{P_{max}} \right) & \text{or} & P_s = 90 \left(1 + \frac{P_t - P_{max}}{P_{max}} \right) \end{array}$$

Where

P_s = Points scored for price of tender under consideration
 P_t = Price of tender under consideration
 P_{max} = Price of highest acceptable tender

4. POINTS AWARDED FOR SPECIFIC GOALS

- 4.1. In terms of Regulation 4(2); 5(2); 6(2) and 7(2) of the Preferential Procurement Regulations, preference points must be awarded for specific goals stated in the tender. For the purposes of this tender the tenderer will be allocated points based on the goals stated in table 1 below as may be supported by proof/ documentation stated in the conditions of this tender:
- 4.2. In cases where organs of state intend to use Regulation 3(2) of the Regulations, which states that, if it is unclear whether the 80/20 or 90/10 preference point system applies, an organ of state must, in the tender documents, stipulate in the case of—
- (a) an invitation for tender for income-generating contracts, that either the 80/20 or 90/10 preference point system will apply and that the highest acceptable tender will be used to determine the applicable preference point system; or
 - (b) any other invitation for tender, that either the 80/20 or 90/10 preference point system will apply and that the lowest acceptable tender will be used to determine the applicable preference point system,
- then the organ of state must indicate the points allocated for specific goals for both the 90/10 and 80/20 preference point system.

Table 1: Specific goals for the tender and points claimed are indicated per the table below.

(Note to organs of state: Where either the 90/10 or 80/20 preference point system is applicable, corresponding points must also be indicated as such.

Note to tenderers: The tenderer must indicate how they claim points for each preference point system.)

THE TENDERER IS TO PICK ONLY ONE SPECIFIC GOAL

Status Level	The specific goals allocated points in terms of this tender	Number of points allocated (90/10 system) (To be completed by the organ of state)	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (90/10 system) (To be completed by the tenderer)	Number of points claimed (80/20 system) (To be completed by the tenderer)
Level 1	51% owned by Black Women Military veterans or 51% owned by Black Youth or 51% owned by Black people with disability	10	20		
Level 2	51% owned by Black Male Military veterans or 51% owned by people with disability or 51% owned by Black Women EME's	8	18		

Level 3	51% owned by Women Military veterans or 51% owned by Black Male EMEs or 51% owned by Women EMEs or 51% owned by Black Women QSEs	6	16		
Level 4	51% owned by Male Military veterans or 51% owned by Youth or 51% owned by any other EMEs or 51% owned by Black Male QSEs or 51% owned by Women QSEs	4	14		
Level 5	51% owned by any other QSEs	2	12		
Level 6	Not Applicable				
Level 7	Not Applicable				
Level 8	Non-compliant	0	0		

NOTE: Bidders are to submit Sworn Affidavit to substantiate the preference points claimed. Sworn Affidavit must be signed by legally recognized Commissioner of Oath.

DECLARATION WITH REGARD TO COMPANY/FIRM

4.3. Name of company/firm.....

4.4. Company registration number:

4.5. TYPE OF COMPANY/ FIRM

- ☐ Partnership/Joint Venture / Consortium
- ☐ One-person business/sole propriety
- ☐ Close corporation
- ☐ Public Company
- ☐ Personal Liability Company
- ☐ (Pty) Limited
- ☐ Non-Profit Company
- ☐ State Owned Company

[TICK APPLICABLE BOX]

4.6. I, the undersigned, who is duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the specific goals as advised in the tender, qualifies the company/ firm for the preference(s) shown and I acknowledge that:

- i) The information furnished is true and correct;
- ii) The preference points claimed are in accordance with the General Conditions as indicated in paragraph 1 of this form;
- iii) In the event of a contract being awarded as a result of points claimed as shown in paragraphs 1.4 and 4.2, the contractor may be required to furnish documentary proof to the satisfaction of the organ of state that the claims are correct;
- iv) If the specific goals have been claimed or obtained on a fraudulent basis or any of the conditions of contract have not been fulfilled, the organ of state may, in addition to any other remedy it may have –
 - (a) disqualify the person from the tendering process;
 - (b) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
 - (c) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation;
 - (d) recommend that the tenderer or contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, be restricted from obtaining business from any organ of state for a period not exceeding 10 years, after the *audi alteram partem* (hear the other side) rule has been applied; and
 - (e) forward the matter for criminal prosecution, if deemed necessary.

NOTE: The Department of Defence reserves the right to verify the truthfulness of the claims (par 4.6 iii).

.....
SIGNATURE(S) OF TENDERER(S)

SURNAME AND NAME:


DATE:

ADDRESS:

.....

.....

.....



COMPULSORY BRIEFING SESSION

Compulsory Briefing Session certificates: Suppliers/Contractors are advised to send a technically knowledgeable representative to the briefing session. Failure to attend the Compulsory Briefing Session and submit the completed and signed Briefing Session Certificates by the closing date and time **will invalidate this offer. Appendix D**

Failure to attend the Compulsory Briefing Session and submit the completed and signed Briefing Session Certificate by the closing date and time will invalidate this offer.

Appendix D

BIDDERS INFORMATION BRIEFING SESSION CERTIFICATE

Briefing session date: 12 September 2024

Briefing session time: 11:00 AM

Venue: Simon's Town Procurement Service Centre, Arsenal Road, Simon's Town, Community Hall

Bid No: SPSC-B-014-2024

Closing date: 19 September 2024

Closing time: 11H00

Validity period: 120 Calendar Days

The Information briefing session is **compulsory** and the original signed and stamped certificate must be submitted as appendix D as part of the Bid document.

It is hereby confirmed that:

_____ (Representative)

Of _____ (Legal Name of company)

Attended the official briefing session and cognisance has been taken of the information as per the presentation, bid document, the brochure/hand-out and all relevant documentation.

(_____)
SIGNATURE OF REPRESENTATIVE

(_____)
CHIEF LOGISTICS: LIEUTENANT GENERAL OFFICIAL DATE STAMP

The time as stipulated in the Bid document for the briefing session and latecomers will under no circumstances be permitted to attend.

Failure to attend the briefing session and provide this completed certificate with the Bid document by the closing date and time will invalidate your Bid





COMPULSORY SITE SESSION

Compulsory Briefing Session certificates: Suppliers/Contractors are advised to send a technically knowledgeable representative to the briefing session. Failure to attend the Compulsory Briefing Session and submit the completed and signed Briefing Session Certificates by the closing date and time **will invalidate this offer. Appendix E**

Failure to attend the Compulsory Briefing Session and submit the completed and signed Briefing Session Certificate by the closing date and time will invalidate this offer.

Appendix E

BIDDERS INFORMATION SITE VIEWING CERTIFICATE

Site Viewing Date: 12 September 2024

Site Viewing Time: 11:00 AM

Venue: Simon's Town Procurement Service Centre, Arsenal Road, Simon's Town, Community Hall

Bid No: SPSC-B-014-2024

Closing date: 19 September 2024

Closing time: 11H00

Validity period: 120 Calendar Days

It is hereby confirmed that:

_____ (Representative)

Of _____ (Legal Name of company)

Attended the official Site Viewing, cognisance has been taken of the information as per the presentation, bid document and Scope of Work, the brochure/hand-out and all relevant documentation.

(_____) **SIGNATURE OF REPRESENTATIVE**

(_____) **CHIEF LOGISTICS: LIEUTENANT GENERAL**

OFFICIAL DATE STAMP

Latecomers will under no circumstances be permitted to attend the Site Viewing

Failure to attend the Site Viewing and provide this completed certificate with the Bid document by the closing date and time will invalidate your Bid





SBD 1: INVITATION TO BID

SBD 1 / Invitation to Bid: This document to be fully completed. Failure to submit this document as indicated by the closing date and time **may invalidate this offer.**

Failure to submit this document as indicated by the closing date and time may invalidate this offer.

Appendix F

PART A INVITATION TO BID

YOU ARE HEREBY INVITED TO BID FOR REQUIREMENTS OF THE (NAME OF DEPARTMENT/ PUBLIC ENTITY)					
BID NUMBER:	SPSC-B-014-2024	CLOSING DATE: 19 SEPTEMBER 2024	CLOSING TIME:	11H00	
DESCRIPTION	THE DECOMMISSIONING, REMOVAL, INSTALLATION AND COMMISSIONING OF AUTOMOTIVE FUEL DISPENSING UNITS AND STORAGE TANKS FOR NAVAL BASE SIMON'S TOWN, EAST DOCKYARD				
BID RESPONSE DOCUMENTS MAY BE DEPOSITED IN THE BID BOX SITUATED AT (STREET ADDRESS)					
DOCUMENTS TO BE DEPOSITED AT THE ENTRANCE (GREEN BOX) SIMON'S TOWN PROCUREMENT SERVICE CENTRE, NO: 2 ARSENAL ROAD, SIMON'S TOWN OR HANDED IN AT THE BID RECEPTION SECTION, NO: 2 ARSENAL ROAD, SIMON'S TOWN (DIRECTIONS TO THE ABOVE ADDRESS AVAILABLE WITH THE BID DOCUMENTS)					
BIDDING PROCEDURE ENQUIRIES MAY BE DIRECTED TO			TECHNICAL ENQUIRIES MAY BE DIRECTED TO:		
CONTACT PERSON	FLIGHT SERGEANT CROUS		CONTACT PERSON	SSGT N.N. JANTJIES	
TELEPHONE NUMBER	021 787 5034		TELEPHONE NUMBER	021 787 5144	
FACSIMILE NUMBER			FACSIMILE NUMBER		
E-MAIL ADDRESS	spscbidinvitation@gmail.com		E-MAIL ADDRESS	spsctechsection@gmail.com	
SUPPLIER INFORMATION					
NAME OF BIDDER					
POSTAL ADDRESS					
STREET ADDRESS					
TELEPHONE NUMBER	CODE		NUMBER		
CELLPHONE NUMBER					
FACSIMILE NUMBER	CODE		NUMBER		
E-MAIL ADDRESS					
VAT REGISTRATION NUMBER					
SUPPLIER COMPLIANCE STATUS	TAX COMPLIANCE SYSTEM PIN:		OR	CENTRAL SUPPLIER DATABASE No:	MAAA
ARE YOU THE ACCREDITED REPRESENTATIVE IN SOUTH AFRICA FOR THE GOODS /SERVICES OFFERED?	☐ Yes ☐ No [IF YES ENCLOSE PROOF]		ARE YOU A FOREIGN BASED SUPPLIER FOR THE GOODS /SERVICES OFFERED?		☐ Yes ☐ No [IF YES, ANSWER THE QUESTIONNAIRE BELOW]
QUESTIONNAIRE TO BIDDING FOREIGN SUPPLIERS					
IS THE ENTITY A RESIDENT OF THE REPUBLIC OF SOUTH AFRICA (RSA)?				☐ YES ☐ NO	
DOES THE ENTITY HAVE A BRANCH IN THE RSA?				☐ YES ☐ NO	
DOES THE ENTITY HAVE A PERMANENT ESTABLISHMENT IN THE RSA?				☐ YES ☐ NO	
DOES THE ENTITY HAVE ANY SOURCE OF INCOME IN THE RSA?				☐ YES ☐ NO	
IS THE ENTITY LIABLE IN THE RSA FOR ANY FORM OF TAXATION?				☐ YES ☐ NO	
IF THE ANSWER IS "NO" TO ALL OF THE ABOVE, THEN IT IS NOT A REQUIREMENT TO REGISTER FOR A TAX COMPLIANCE STATUS SYSTEM PIN CODE FROM THE SOUTH AFRICAN REVENUE SERVICE (SARS) AND IF NOT REGISTER AS PER 2.3 BELOW.					

PART B

TERMS AND CONDITIONS FOR BIDDING

1. BID SUBMISSION:
1.1. BIDS MUST BE DELIVERED BY THE STIPULATED TIME TO THE CORRECT ADDRESS. LATE BIDS WILL NOT BE ACCEPTED FOR CONSIDERATION.
1.2. ALL BIDS MUST BE SUBMITTED ON THE OFFICIAL FORMS PROVIDED (NOT TO BE RE-TYPED) OR IN THE MANNER PRESCRIBED IN THE BID DOCUMENT.
1.3. THIS BID IS SUBJECT TO THE PREFERENTIAL PROCUREMENT POLICY FRAMEWORK ACT, 2000 AND THE PREFERENTIAL PROCUREMENT REGULATIONS, THE GENERAL CONDITIONS OF CONTRACT (GCC) AND, IF APPLICABLE, ANY OTHER SPECIAL CONDITIONS OF CONTRACT.
1.4. THE SUCCESSFUL BIDDER WILL BE REQUIRED TO FILL IN AND SIGN A WRITTEN CONTRACT FORM (SBD7).
2. TAX COMPLIANCE REQUIREMENTS
2.1 BIDDERS MUST ENSURE COMPLIANCE WITH THEIR TAX OBLIGATIONS.
2.2 BIDDERS ARE REQUIRED TO SUBMIT THEIR UNIQUE PERSONAL IDENTIFICATION NUMBER (PIN) ISSUED BY SARS TO ENABLE THE ORGAN OF STATE TO VERIFY THE TAXPAYER'S PROFILE AND TAX STATUS.
2.3 APPLICATION FOR TAX COMPLIANCE STATUS (TCS) PIN MAY BE MADE VIA E-FILING THROUGH THE SARS WEBSITE WWW.SARS.GOV.ZA.
2.4 BIDDERS MAY ALSO SUBMIT A PRINTED TCS CERTIFICATE TOGETHER WITH THE BID.
2.5 IN BIDS WHERE CONSORTIA / JOINT VENTURES / SUB-CONTRACTORS ARE INVOLVED; EACH PARTY MUST SUBMIT A SEPARATE TCS CERTIFICATE / PIN / CSD NUMBER.
2.6 WHERE NO TCS PIN IS AVAILABLE BUT THE BIDDER IS REGISTERED ON THE CENTRAL SUPPLIER DATABASE (CSD), A CSD NUMBER MUST BE PROVIDED.
2.7 NO BIDS WILL BE CONSIDERED FROM PERSONS IN THE SERVICE OF THE STATE, COMPANIES WITH DIRECTORS WHO ARE PERSONS IN THE SERVICE OF THE STATE, OR CLOSE CORPORATIONS WITH MEMBERS PERSONS IN THE SERVICE OF THE STATE."

NB: FAILURE TO PROVIDE / OR COMPLY WITH ANY OF THE ABOVE PARTICULARS MAY RENDER THE BID INVALID.

SIGNATURE OF BIDDER:

.....

CAPACITY UNDER WHICH THIS BID IS SIGNED:

.....

(Proof of authority must be submitted e.g. company resolution)

DATE:

.....



CENTRAL SUPPLIER DATA BASE (CSD) FULL REGISTRATION / SUMMARY REPORT

Central Suppliers Database (CSD) Registration/Summary Report: The CSD Full Registration / Summary Report should be submitted. The supplier should be:

- i. Tax Compliant on day of award. If not compliant, a grace period of 7 days will be given to update this status.
- ii. Successfully verified bank details
- iii. Physical Address Type
- iv. Suppliers should be registered for the commodity/service required for this bid

Failure to submit the CSD Full Registration / Summary Report by the closing date and time **may invalidate this offer. Appendix G**

Failure to submit the CSD Full Registration / Summary Report by the closing date and time may invalidate this offer.

Appendix G



CERTIFICATE OF COMPLIANCE BY SUB-CONTRACTOR/S

Certificate of Compliance by Sub-Contractor/s: A certificate of compliance signed by the bidder and all sub - contractor/s (in the event of sub-contracting) to be fully completed. Failure to submit this document as indicated by the closing date and time **may invalidate this offer.** **Appendix H**

Failure to submit this document as indicated by the closing date and time may invalidate this offer.
Appendix H

CERTIFICATE OF COMPLIANCE BY SUB-CONTRACTOR / SUPPLIER

THIS CERTIFICATE MUST BE SUBMITTED WITH THE COMPLETED BID (IN THE ORIGINAL FORMAT) BY THE BIDDER

CONTRACTORS NAME: _____

SUB-CONTRACTORS NAME: _____

(Delete whichever is not applicable)

I/we am/are fully aware of the Bid Requirements and am/are capable of supplying the required item(s)/service(s) strictly according to the Bid Conditions, Special Conditions and Specifications supplied by the Department of Defence. I/we hereby certify that _____ will submit quotations/bids to

Supply the item(s)/service(s) listed in Bid no: _____

Section(s) _____

I/we further certify that I/we have the necessary infrastructure at my/our disposal to execute the Bid.

I/we, the Sub-contractor(s) am/are willing to allow the Department of Defence's Officials access to my/our premises for inspection purposes.

Sub-Contractor's Contact Person: _____

Address of Sub-Contractor: _____

Telephone No: _____

Fax No: _____

_____ SIGNATURE OF SUB-CONTRACTOR

WITNESSES:

1. _____ Date: _____

2. _____ Date: _____



SPSC INDEMNITY AGREEMENT FORM

SPSC Indemnity Agreement Form: This document to be fully completed. Failure to submit this document as indicated by the closing date and time **may invalidate this offer.**
Appendix I

Failure to submit this document as indicated by the closing date and time may invalidate this offer.

Appendix I



logistics division

Department:
Defence
REPUBLIC OF SOUTH AFRICA

RELEASE OF INDEMNITY AGREEMENT FROM BIDDER: _____

_____ IN RESPECT OF SPSC / B / / 2024

INDEMNITY

1. I agree that the Department of Defence, its agents, Officers, employees, volunteers and representatives (hereafter referred to as "DOD") are indemnified from any claim that may arise from a third party and all costs or legal expenses in this regard, to such a claim for loss or damage resulting from the death, illness, injuries or disability of any such person(s), or the damage to the property of mine or any other person(s) that may result from or be related to the execution of this contract.

2. The DOD and its employees will not be held responsible for any claim or injury to my personnel or the personnel of my sub-contractors, if and when applicable, whilst on DOD property or in the execution of their tasks on DOD property.

DAMAGE COMPENSATION

3. I will be held liable for any damage or theft that may be caused, to the premises or content by me or my employees or be due to our neglect whether in the normal execution of our duties or otherwise and a claim for indemnification can accordingly be imposed by the DOD against me.

4. In the case of damages to premises or content resulting from the work done, I undertake to rectify the damage immediately to the satisfaction of the DOD. If I fail to act immediately after notification, the DOD will rectify the damage at will and the cost thereof will be recovered from any monies outstanding to me.

WAIVER

5. No waiver of any of the terms and conditions of the contract will be binding or effectual for any purpose unless expressed in writing and signed by the parties thereto, and any waiver will be effective only in specific instances and for the purpose given. No failure or delay on the part of either party in exercising any right, power or privilege hereunder will operate as a waiver thereof, nor will any single or partial exercise of any right, power or privilege preclude any other or further exercise thereof or the exercise of right, power or privilege.

ACKNOWLEDGEMENT

I acknowledge that I have read and understood this agreement, that I have executed this agreement voluntarily and that this agreement is binding to myself. I accept that the DOD may reject the offer and/or act against me if I contravene this agreement.

Full Name and Signature of Bidder's Duly Authorised Representative

Date

Witness 1: _____ Witness 2: _____

Date: _____



Isithakathaka seBhunga: Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika. Isithakathaka seBhunga seMzantsi Afrika.





WRITTEN AGREEMENT WRT OCCUPATIONAL HEALTH AND SAFETY AGREEMENT (OHASA)

Written Agreement wrt Occupational Health and Safety Agreement (OHASA): The signed OHASA agreement amongst the DOD, bidder and sub – contractor/s (in the event of sub-contracting) to be fully completed. Failure to submit this document as indicated by the closing date and time **may invalidate this offer. Appendix J**

Failure to submit this document as indicated by the closing date and time may invalidate this offer.

Appendix J



WRITTEN AGREEMENT TO COMPLETE AN OCCUPATIONAL HEALTH AND SAFETY AGREEMENT FOR THE COMPLETION OF A CONTRACT ENTERED INTO BETWEEN

THE DEPARTMENT OF DEFENCE AND _____

_____(Herein after referred to as the contractor)

AS ENVISAGED BY SECTION 37(2) OF THE OCCUPATIONAL HEALTH AND SAFETY ACT NO 85 OF 1993 AS AMENDED

WORKMAN COMPENSATION NUMBER: _____

1, I, (full names) _____

(Identity Number _____) being fully authorised to represent the Contractor, do hereby confirm that the supplier is an employer on its own right with duties as prescribed in the Occupational Health and Safety Act 85 of 1993 as amended and agree to ensure that all work will be performed or plant and machinery will be used in accordance with the provision of the said Act.

2. I hereby confirm that I will ensure that all our employees or Subcontractors workmen are covered in terms of the Compensation for Occupational Injuries and Diseases Act 1993, which cover shall remain in force whilst any such workmen are working with or on Department of Defence (DOD) property for the duration of the contract period.

3. I furthermore confirm that we and / or our Subcontractor(s) are in possession of a valid "Certificate of good standing" issued by the Workman Compensation Commissioner.

4. I furthermore confirm and agree that I and / or our Subcontractor(s) will sign a written agreement on occupational health and safety responsibilities for completion of a contract entered into between the Department of Defence **within 10 days** of the award of the contract should we be successful bidder. I acknowledge that should I fail to sign the OHAS agreement within this period; the contract will be terminated with immediate effect with no recourse on my behalf.


Signed By Contractors Authorised Representative

Full Name of Contractors Authorised Representative

Witnesses 1. _____

2. _____

Signed and entered into at _____ On _____ 2024



SPSC GROUP QUESTIONNAIRE

SPSC Group Questionnaire: This document to be fully completed. Failure to submit this document as indicated by the closing date and time **may invalidate this offer.**
Appendix K

Failure to submit this document as indicated by the closing date and time may invalidate this offer.

Appendix K

SIMON'S TOWN PROCUREMENT SERVICE CENTRE

CLOSING DATE OF BID: 19 SEPTEMBER 2024
CLOSING TIME OF BID: 11H00

BID NUMBER: SPSC-B-014-2024
VALIDITY: 120 CALENDAR DAYS

GROUP QUESTIONNAIRE

Circle applicable response and delete not applicable response.

Service required for: **THE DECOMMISSIONING, REMOVAL, INSTALLATION AND COMMISSIONING OF AUTOMOTIVE FUEL DISPENSING UNITS AND STORAGE TANKS FOR NAVAL BASE SIMON'S TOWN, EAST DOCKYARD**

Do you confirm compliance to 120 calendar day's validity period? YES / NO

If not, state reason/s: _____

Is your price firm for the validity period of 120 calendar days? YES / NO

If not, state reason/s: _____

Do you accept Government Orders? YES / NO

Lead Time/Delivery period required by supplier after receipt of order: days, weeks or months _____

Copies of General Bid Conditions and General Conditions of Contract are available from the National Treasury Website (www.treasury.gov.za)

Do you confirm compliance to the Special Conditions of Contract, General Bid Conditions and General Conditions of Contract YES / NO

Do you confirm that you may sign a SBD 7.1 or SBD 7.2 on award, YES / NO

General Information

Bid Documents: have you made/kept a copy of completed Bid documents for reference purposes: YES / NO

Clarification of Information: It has been noted and confirmed that the DOD may request clarification on any information regarding any aspect included in the bid document. The bidder is to supply the requested information within the requested time span. Failing may result in the bid being disqualified.

ADMINISTRATION

Bidders are requested to number each page of the Bid Document submitted. Pages are to be numbered from the bottom page to the top page (top right hand corner)

NB: SPSC RESERVES THE RIGHT TO RECALL THE BIDDER/S TO COMPLY WITH THE ABOVE ADMINISTRATION INSTRUCTION

I/WE HEREBY CONFIRM THAT I/WE HAVE COMPLIED WITH ALL OF THE ABOVE REQUIREMENTS

WITNESS 1: _____ DATE: _____

WITNESS 2: _____ DATE: _____

BIDDER NAME: _____

SIGNATURE: _____ DATE: _____

Capacity under which this bid is signed _____



DEFENCE INTELLIGENCE QUESTIONNAIRE (D.I.)

Defence Intelligence Questionnaire (D.I.) The DI Vetting form must be completed in full. Failure to submit the DI Vetting form and required documentation as indicated by the closing date and time may invalidate this offer

N.B. The short listed companies will be requested to submit Police Clearance for all personnel entering SANDF Property.

Failure to submit the DI Vetting form and required documentation as indicated by the closing date and time may invalidate this offer.

Appendix L

DEPARTMENT OF DEFENCE INTELLIGENCE (DI) VETTING

TO DI SEC INSTR/01/2014

QUESTIONNAIRE:

MAIN CONTRACTOR

Company Name:

Company Registration Number:

DOD Supplier Code (if already registered with the DOD):

Personal particulars of Company Director(s) (Include copy of RSA Identification and passport document):

.....
.....
.....
.....
.....

Personal particulars of Foreign Nationals employed by the company (incl copy of ID / passport and working visa/ documentation)

.....
.....
.....
.....
.....

Company Physical Address:

.....
.....
.....
.....

Company Postal Address:

.....
.....
.....
.....

Company Core Business:

.....
.....
.....
.....

SECTION B

SUB CONTRACTORS DETAILS

Personal particulars of sub-contractors if any (Include copy of RSA Identification and passport documents):

.....
.....
.....
.....
.....

Personal particulars of Foreign Nationals employed by the company (incl copy of ID / passport and working visa/ documentation)

.....
.....
.....

Sub Contractors Company Physical Address:

.....

.....

.....

.....

.....

.....

Sub Contractors Company Postal Address:

.....

.....

.....

.....

.....

Sub Contractors Company Core Business:

.....

.....

.....

.....

.....

.....

SECTION C

MAIN CONTRACTOR

1. When did the company begin with its operations?

Answer:

2. Does the company have a valid SARS tax clearance certificate? If yes, provide the tax clearance certificate number and the certified copy of the certificate.

Answer:

3. Is the company registered with the Company and Intellectual Property Commission (CIPC)? If yes, provide the registration number and attach a certified copy of the registration certificate.

Answer:

4. Who are the shareholders of the company and what percentage of shares do they each possess?

Answer:

.....

.....

5. List the services that will be rendered by the company to the SANDF?

Answer:

.....

.....

6. Which DOD installations/unit and specific area/section does the company require access to?

Answer:

.....

.....

7. Name list and copies of RSA ID's / passports of all employees entering the DOD installation.

Answer:

.....

.....

8. Does the company provide services to other RSA state departments? If yes, provide the names of the departments and the period/s during which service was provided.

Answer:

.....

.....

9. Does the company provide services to foreign governments and/or companies? If so, provide details.

Answer:

.....

.....

10. Has the company been implicated in any fraudulent activities? If yes, provide details.

Answer:

.....

.....

11. Has the company been implicated in any corrupt practices? If yes, provide details.

Answer:

.....

.....

12. Has the company been implicated in any other criminal activity? If yes, provide details.

Answer:

.....

.....

13. Does the company have the Employment Equity Plan? If yes, provide the Employment Equity Plan as well as the number and composition of the employees. (Only if the company is South African or employs South Africans)

Answer:

.....

.....

.....

.....

14. What is the track record and achievements of the company? Provide details.

Answer:

.....

.....

.....

15. Is the company under investigation by any government security agency? If yes, provide details.

Answer:

.....

.....

.....

.....

.....

16. What known factor could possibly prevent this company from entering into contract with the Department of Defence and Military Veterans or any component thereof and why?

Answer:
.....
.....

Compiled by:

Name:

Identification Number:

Position in Company:

Signature:

Date:

NB: Important; The following documentation is Mandatory and is to be included in the DI vetting declaration

- *The profiles of the Director(s) of the Main Contractor and Sub- Contractors as well as their RSA Identification and passport documents.*
- *The current Financial Statement(s) of the company.*
- *The current and valid SARS Tax Clearance Certificate.*
- *The current and valid SARS Personal Tax Clearance Certificate and or IRP6 of all Directors, Shareholders and Members (Sub-Contractor/s included).*
- *The registration number and attach a certified copy of the registration certificate with the Company and Intellectual Property Commission (CIPC).*
- *Central Data Base registration report with MAAA and Unique number.*
- *Name list and RSA IDs of all personnel entering DOD premises.*
- *Foreign Nationals employed by the company (incl copy of ID / passport and working visa/ documentation).*
- *Employment Equity Plan as well as the number and composition of the employees. (Only if the company is South African or employs South Africans).*



STATEMENT OF WORK

STATEMENT OF WORK: The bidder's compliance must be indicated with the word **comply/do not comply, agree/do not agree, yes or no**, or any other form of acceptance or non-acceptance on the statement of work, **each paragraph and sub-paragraph must be acknowledged**. No abbreviations will be accepted, for example, "c/nc for comply/not comply or y/n for yes/no etc". The most suitable suppliers will be awarded in accordance with compliance to Statement of Work and fit for purpose


A separate attached signed letterhead shall be used if space provided is inadequate for listing the deviations. It shall clearly list the relevant paragraphs and, in detail, the deviations from that stated/specified.

This Statement of Work shall not be used for any purpose other than tendering or manufacturing. No alterations shall be allowed without the consent of the Simon's Town Procurement Service Centre

Failure to submit this document as indicated by the closing date and time will invalidate this offer

Appendix M

RESTRICTED

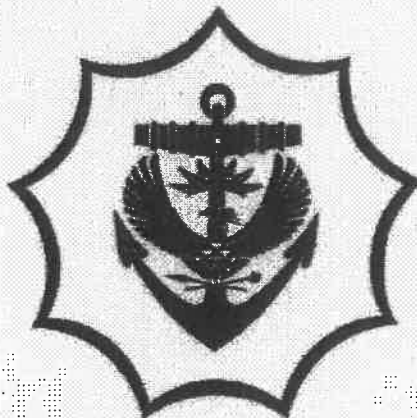

SOUTH AFRICAN NAVY

This document is the property of the SOUTH AFRICAN NAVY. Any person who finds this document should hand it to the nearest Service Unit of the SANDF or Police Station for its safe return.

This document contains information relating to the defence of the Republic of South Africa. The provisions of Sections 118 of the Defence Act, Act No. 44 of 1957, as well as the provisions of the Protection of Information Act, Act No. 84 of 1982, are applicable to this document.

TITLE: SPECIFICATION FOR THE DECOMMISSIONING, REMOVAL, INSTALLATION AND COMMISSIONING OF AUTOMOTIVE FUEL DISPENSING UNITS AND STORAGE TANKS, COMPLETE WITH ANCILLARY EQUIPMENT, REHABILITATION AND ASSOCIATED WORKS, FOR THE S.A. NAVY IN THE EAST DOCKYARD, SIMON'S TOWN, CAPE TOWN, WESTERN CAPE.

NPN NUMBER: NBS 403-1-184 NBST 37/22


DOCUMENT NUMBER: 94930-540005001-226001

COMPUTER FILE NAME: 949302306001a.doc

ISSUE DATE: 17 JULY 2023

DATE OF ORIGINAL ISSUE: 18 OCTOBER 2022

COPY NUMBER:

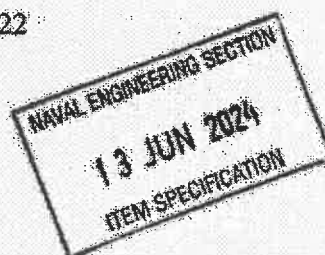

Compiled By

J. J. BESTER

Signature

Date

17/07/2023

Checked By

J. J. BESTER

Signature

Date

17/07/2023

Approved By

B. W. MVOVO (Pr. Eng.) : R. Adm. (JG)

Signature

Date

19/07/2023

Responsibility Authority: Item Specification Section, Naval Engineering Section

DOC NO: 94930-540005001-226001 | DOC ISSUE: 2 | PAGE REV: 0 | PAGE: 1 OF 33

RESTRICTED

RESTRICTED

AMENDMENT HISTORY

[illegible]

RESTRICTED

RESTRICTED

TABLE OF CONTENTS

PARAGRAPH	TITLE	PAGE
	TITLE PAGE	1
	AMENDMENT PAGE	2
	CONTENTS PAGE	3
	CONTENTS PAGE (CONT.)	4
1.	SCOPE	5
1.1	General	5
1.2	Mandatory requirement	5
1.3	Item name	5
2.	APPLICABLE DOCUMENTS	5
2.1	SA Government documents	5
2.2	Standards/specifications, as applicable	6
3.	QUALIFICATION	7
3.1	General	7
3.2	Responsibility for Inspection	8
3.3	Inspection control	8
3.4	Acceptance	8
3.5	Deviations	8
4.	PREPARATION AND DELIVERY	8
4.1	Packaging	8
4.2	Documentation	8
4.3	Delivery	9
5.	NOTES	9
5.1	Definitions	9
5.2	Offers and comments	9
5.3	Validation	10
5.4	Purpose	10
5.5	Documentation	10
5.6	Authorization	10
6.	REQUIREMENTS	11
6.1	General	11
6.2	Technical qualification for tender	11
6.3	Site inspection	13
6.4	Additional site inspection date	13
6.5	Installation site	13
6.6	Utility scan	14
6.7	Corrosion protection	14
6.8	Designed lifespan	14
6.9	Site decommissioning	15
6.10	Site rehabilitation	15
6.11	Interface definitions	15
6.12	Site work requirements	16
6.13	Ad hoc requirements	26
6.14	System testing	27
6.15	Certificates of Conformance	27
6.16	Familiarization	28

RESTRICTED

CONTENTS PAGE CONT.

PARAGRAPH	TITLE	PAGE
6.17	Maintenance plan	28
6.18	Spare parts	29
6.19	Technical documentation	30
6.20	Warranty	30
6.21	Acceptance authority	31
6.22	Liaison authority	32
	List of Abbreviations	33

RESTRICTED

1. SCOPE

1.1 General

1.1.1 This specification relates to the decommission, removal, installation and commissioning of automotive fuel dispensing units and storage tanks for the SA Navy in the East Dockyard, NAVAL BASE SIMON'S TOWN, including providing associated works and setting to work all related ancillary equipment.

1.2 Mandatory requirement

1.2.1 For guidance on completion of this tender specification, all tenderers to adhere to instructions given in paragraph 5.2 of this specification.

1.2.2 Tenderers are to submit the completed tender specification by the promulgated closing date and time. **FAILURE** to comply herewith shall lead to the disqualification of the tenderer.

1.3 Item name

1.3.1 The approved item name assigned to this item shall be:

DISPENSING PUMP SYSTEM, AUTOMOTIVE FUEL

2. APPLICABLE DOCUMENTS

2.1 SA Government documents

2.1.1 Department of Defence : General Bid Conditions (G.B.C's), as amended.

This document is available from the Secretary for Defence (Attention : Chief of Acquisition and Procurement), Private Bag X910, Pretoria, 0001, or from any of the Department's Procurement entities.

2.1.2 Special Conditions of Contract (SCC's), issued as part of this bid specification / documentation.

2.1.3 Construction Industry Development Board Act, Act 38 of 2000, as amended.

2.1.4 Occupational Health and Safety (OHS) Act, Act 85 of 1993, as amended.

2.1.5 Compensation for Occupational Injuries and Diseases (COID) Act, Act 130 of 1993, as amended.

2.1.6 National Water Act, Act 36 of 1998, as amended.

2.1.7 National Environmental Management Act (NEMA), Act 107 of 1998, as amended.

2.1.8 Atmospheric Pollution Prevention Act, Act 45 of 1965, as amended.

2.1.9 Environment Conservation Act (ECA), Act 73 of 1989, as amended.

2.1.10 Environment Conservation Amendment Act, Act 50 of 2003, as amended.

2.1.11 Hazardous Substances Act, Act 15 of 1973, as amended.

2.1.12 Heritage Resources Act, Act 25 of 1999, as amended.

2.1.13 Biodiversity Act, Act 10 of 2004, as amended.

DOC NO: 94930-540005001-226001	DOC ISSUE: 2	PAGE REV: 0	PAGE: 5 OF 33
--------------------------------	--------------	-------------	---------------

RESTRICTED

RESTRICTED

- 2.1.14 National Building Regulations and Standards Act, Act 103 of 1997, as amended.
- 2.1.15 Promotion of Access to Information Act, Act 2 of 2000, as amended.
- 2.1.16 Department of Environmental Affairs and Tourism (DEAT) Guideline 3 : General Guideline to Environmental Impact Assessment Regulations of 2006, as amended.
- 2.1.17 Department of Environmental Affairs and Tourism (DEAT) Guideline 5 : Assessment of Alternatives and Impacts of 2006, as amended.
- 2.1.18 Government Notice Number Regulation (GNR) 387 of 2006, activity 3, as amended.
- 2.1.19 Applicable Provincial and local Municipal by-laws and regulations as well as local supply authority regulations, where applicable.
- 2.1.20 The local Municipal fire regulations.
- 2.1.21 The standard regulations of any Government Department (DPW) or public service company, where applicable.
- 2.1.22 All National as well as Local Building Regulations, pertaining to this type of installation.
- 2.1.23 All regulations and requirements pertaining to national standards for the specification and quality of construction material.
- 2.2 Standards/Specifications.
 - 2.2.1 AISI 316 L : American Iron and Steel Institute specification for Stainless Steel grade 316 L.
 - 2.2.2 AISI 304 L : American Iron and Steel Institute specification for Stainless Steel grade 304 L.
 - 2.2.3 API RP 1604 : Closure of underground petroleum storage tanks.
 - 2.2.4 EN 12954 : General principles of cathodic protection of buried or immersed onshore metallic structures.
 - 2.2.5 ISO 9001 : Quality management systems. Requirements.
 - 2.2.6 SANS 342 : Automotive diesel fuel.
 - 2.2.7 SANS 1020 : Power-operated dispensing devices for flammable liquid fuels.
 - 2.2.8 SANS 1200 A : Standardized specification for civil engineering construction Section A : General.
 - 2.2.9 SANS 1200 DB : Standardized specification for civil engineering construction Section DB : Earthworks (pipe trenches).
 - 2.2.10 SANS 1200 GA : Standardized specification for civil engineering construction Section GA : Concrete (small works).
 - 2.2.11 SANS 1200 LB : Standardized specification for civil engineering construction Section LB : Bedding (pipes).
 - 2.2.12 SANS 1535 : Steel tanks for the underground storage of hydrocarbons and oxygenated solvents.

RESTRICTED

2.2.13 SANS 1598 : Unleaded petrol.

2.2.14 SANS 1830 : Flexible piping for underground use at service stations and consumer installations.

2.2.15 SANS 10086-1 : The installation, inspection and maintenance of equipment used in explosive atmospheres Part 1 : Installations, including surface installations on mines.

2.2.16 SANS 10089-2 : The petroleum industry Part 2 : Electrical and other installations in the distribution and marketing sector.

2.2.17 SANS 10089-3 : The petroleum industry Part 3 : The installation, modification, and decommissioning of underground storage tanks, pumps / dispensers and pipework at service stations and consumer installations.

2.2.18 SANS 10119 : Reduction of explosion hazards presented by electrical equipment – Segregation, ventilation and pressurization.

2.2.19 SANS 10313 : The protection of structures against lightning.

2.2.20 SANS 10400 : The application of the National Building Regulations.

2.2.21 SANS 10140-1 : Identification colour marking – Part 1: General.

2.2.22 SANS 10140-2 : Identification colour marking – Part 2: Identification of hazards and equipment in work situations.

2.2.23 SANS 10140-3 : Identification colour marking – Part 3: Contents of pipelines.

2.2.24 SANS 10142-1 : The wiring of premises Part 1 : Low-voltage installations.

2.2.25 SANS 60079-11 : Explosive atmospheres Part 11: Equipment protection by intrinsic safety "i".

2.2.26 SANS 60529 : Degrees of protection provided by enclosures (IP code).

2.2.27 SANS 61084-1 : Cable trunking and ducting systems for electrical installations Part 1 : General requirements.

2.2.28 SANS 61084-2-1 : Cable trunking and ducting systems for electrical installations Part 2 : Particular requirements Section 1 : Cable trunking and ducting systems intended for mounting on walls and or ceilings.

3. QUALIFICATION

3.1 General.

3.1.1 The supply of this item(s) and/or service(s) shall be in accordance with the documentation and information contained and referred herein. Unless otherwise stated, all dimensions are indicated in millimetres.

RESTRICTED

3.2 Responsibility for Inspection.

3.2.1 Unless otherwise specified in the order or contract, the Contractor shall be responsible for the performance of all inspections required to ensure compliance with this specification.

3.2.2 Except as otherwise specified, the Contractor may utilise his own facilities or any SANAS accredited commercial laboratory and / or inspecting authority acceptable to the SA Navy authorities.

3.2.3. The SA Navy, however, reserves the right to perform any inspection, where these are deemed necessary, to assure that supplies and services conform to prescribed requirements.

3.3 Inspection control

3.3.1 The item(s) and/or service(s) may be subject to inspection during the course of manufacture / installation. The duly authorized delegate(s) of the SA Navy shall, during normal working hours, be granted access to all facilities to perform his / her duties.

3.3.2 The SA Navy's delegate(s) shall have the right of entry into the Contractor's factory or works of any sub-contractor where work supplied to this specification may be in progress.

3.3.3 The Contractor may inspect the finished item(s) and/or service(s) for compliance with this specification before submitting it to the SA Navy for final inspection.

3.3.4 Before acceptance, the item(s) and/or service(s) shall have been inspected and tested by the SA Navy and be found to comply with the requirements of this specification.

3.4 Acceptance.

4.4.1 Although the Contractor shall primarily be responsible to see that the item(s) and/or service(s) conform to this specification, the SA Navy shall subject it to acceptance.

3.4.2 Furthermore, the SA Navy reserves the right to carry out inspection of the item(s) and/or service(s) on the manufacturer's premises at any stage during or after manufacture thereof.

3.5 Deviations.

3.5.1 No deviations from this specification or any laid down process, treatment or procedures as set out in this specification shall be allowed except with the prior approval of the SA Navy.

3.5.2 Applications should be made to the Item Specification Section, Naval Engineering Section, Fleet Command, Simon's Town - Telephone no.: 021 787 4387/3274.

4. **PREPARATION AND DELIVERY**

4.1 Packaging.

4.1.1 Where applicable, item(s) shall be delivered in the manufacturer's original packaging and shall be in a clean, dry and commercially acceptable condition. It shall be so packaged that the item(s) shall not be damaged in transit, storage or during installation procedure(s).

4.2 Documentation.

4.2.1 The packing slip or delivery note as well as the inspection/compliance certificate(s), where applicable, together with a copy of the invoice showing the order number, shall be delivered with the consignment.

RESTRICTED

4.3 Delivery

4.3.1 The Contractor shall deliver the item(s) in an undamaged condition to the SA Naval Stores Depot or Unit stipulated in the relevant printed Government Order.

4.3.2 The SA Navy reserves the right to inspect item(s) upon delivery for damage(s) and where found, reject such items and demand corrective action from the Contractor.

5. NOTES

5.1 Definitions

5.1.1 For the purpose of this specification, the following definitions shall apply:

a. Acceptable

i. Acceptable to the SA Navy's inspecting authorities.

b. Nominal

i. Subject to the tolerances normal to good manufacturing practice.

5.2 Offers and comments

5.2.1 Where item(s) and/or service(s) are specified in detail, the specifications shall form an integral part of the tender document and tenderers shall indicate in the space provided whether the item(s) and/or service(s) offered are to specification or not.

5.2.2 It shall be a **MANDATORY** requirement for all tenderers to **provide a response** on **EACH** and **EVERY dotted line** under the **"TENDERERS' OFFERS AND COMMENTS"** column(s).

5.2.3 Tenderers shall acknowledge under the **"TENDERERS' OFFERS AND COMMENTS"** column(s) their compliance or non-compliance against requirements specified in the applicable paragraph(s) and sub-paragraph(s) by indicating with the words **"COMPLY / DO NOT COMPLY"**, **"AGREE / DO NOT AGREE"**, **"YES"** or **"NO"** or any other comprehensible form of acceptance or non-acceptance with that specified Responses such as **"N/A"** for **"NOT APPLICABLE"** and / or **"NOTED"** as well as any abbreviations (e.g. **"C / NC"** for **"COMPLY / NON-COMPLY"** or **"Y / N"** for **"YES / NO"**) against any paragraph(s) and / or sub-paragraph(s) shall not be considered a valid response.

5.2.4 Any line left open shall result in the specification being **considered incomplete** and **SHALL** lead to the **immediate disqualification** of the individual tenderer.

5.2.5 In respect of the paragraph(s) and / or sub-paragraph(s) where the item(s) and / or service(s) offered are not in compliance with the requirement(s) specified, tenderers shall be required to indicate the non-compliance and shall list the deviation(s) from that stated / specified in the specification.

5.2.6 A separate attached **signed letterhead** shall be used if space provided is inadequate for listing the deviation(s). It shall clearly reference the relevant paragraph(s) and, in detail, the deviation(s) from that stated / specified against that offered.

RESTRICTED

5.3 Validation.

5.3.1 The SA Navy reserves the right to confirm or validate with tenderers any aspect of this specification or feedback received during the technical evaluation phase. The SA Navy also reserves the right to obtain a demonstration model(s) for evaluation purposes.

5.4 Purpose.

5.4.1 This specification shall not be used for any purpose other than tendering or manufacturing. No alterations shall be allowed without the consent of the Chief of the Navy or his authorized representatives.

5.5 Documentation.

5.5.1 This specification and any relevant drawings, patterns or demonstration model(s) or any other information issued in conjunction herewith, may only be used for specific enquiries and tenders or orders placed by the South African Navy or its authorized representatives.

5.6 Authorization.

5.6.1 This specification remains the property of the South African Navy and, unless authorized in writing, shall be returned.

RESTRICTED

TENDERER'S OFFERS OR COMMENTS

(refer paragraph 5.2)

6. REQUIREMENTS

6.1 General

6.1.1 The document covers the minimum requirements by the SA Navy for the decommissioning, removal, supply, installation, testing and commissioning of automotive fuel dispensing facilities, complete with all ancillary equipment, rehabilitation and associated works, which shall comply with and be in accordance with all the documentation and standards referred to in paragraph 2 of this specification.

6.2 Technical qualification for tender

6.2.1 ALL tenderers, including Third Parties tendering, shall confirm the following by means of attaching (as Appendices) to this bid / tender specification the following required and valid mandatory documentation :

a. Proof of registration (i.e. "Active" status at time of promulgated tender closing time / date) that shall clearly indicate the company(ies) responsible for executing the work required, as specified in this specification, be compliant with the following :

i. Registered with the Construction Industry Development Board (CIDB) – grade 4 ME or higher, preferable with a track record in the installation and commissioning of public forecourt automotive fuel storage and dispensing facilities

OR

Registered with the Construction Industry Development Board (CIDB) – grade 4 CE or higher, preferable with a track record in installation and commissioning of public forecourt automotive fuel storage and dispensing facilities.

NOTES :

CIDB registration shall be a mandatory qualification requirement for this bid / tender in order to ensure compliance with paragraph 18 of the CIDB Act, Act 38 of 2000, as amended.

Any and all sub-contractors contracted by the Prime Contractor to perform any type of (petro-chemical industry) related work on the site shall be required to be registered with either the Construction Industry Development Board (CIDB) in the specified category(ies) for the work contracted or with an Institution recognised by the Engineering Council of South Africa.

ii. ALL electrical installation(s), connection(s) and related work(s), shall be executed by an Electrical Conformance Board of South Africa (ECB)

OR

an Electrical Contractors Association of South Africa (ECA(SA)) registered Contractor, preferably with a proven track record in executing electrical installation work in hazardous areas (specifically public forecourt automotive fuel storage and dispensing facilities.)

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

- b. Valid and current certificate of registration that shall clearly indicate the manufacturer of the offered automotive fuel dispensing units being a SANS (and / or ISO) 9001 accredited company. This requirement shall be to ensure that the offered dispensing units and required service shall meet applicable statutory and regulatory requirements to ensure a safe and reliable system that shall incorporate inherent quality and safety standards in its design and manufacture.

OR

Valid and current Type Approval Certificate, issued by the National Regulator for Compulsory Specifications (of the Republic of South Africa), which shall clearly indicate the offered automotive fuel dispensing units being compliant with the requirements for type approval in accordance with the Legal Metrology Act, Act 9 of 2014, as amended, and SANS 1650 and / or SANS 1020.

- c. Signed letter of accreditation (on an official letterhead from the offered dispensing units' manufacturer) indicating the company responsible for the installation and commissioning thereof, being an approved dealer / agent / installer / retailer of the offered dispensing units' manufacturer. This requirement shall be to ensure that the successful Contractor shall be able to provide periodic after sales service and support.
- d. Valid and current certificate of registration that shall clearly indicate the manufacturer of the offered underground storage tanks being a SANS (and / or ISO) 9001 accredited company. This requirement shall be to ensure that the offered products and required service shall meet applicable statutory and regulatory requirements to ensure a safe and reliable system that shall incorporate inherent quality and safety standards in its design and manufacture.
- e. Signed letter of accreditation (on an official letterhead from the offered underground storage tanks' manufacturer) indicating the company responsible for the installation and commissioning thereof, being an approved dealer / agent / installer / retailer of the offered underground storage tanks' manufacturer. This requirement shall be to ensure that the successful Contractor shall be deemed competent enough to be able to successfully install and commission the offered tanks as well as to provide periodic after sales service and support.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

- f. A waste disposal undertaking / agreement (between tenderer and waste disposal company / site) shall be submitted with the tender. This requirement shall be to ensure that the successful Contractor shall be liable for carting away and dispose of any rubble, debris and / or unserviceable equipment removed from the site during operations to a legal and recognised waste disposal facility.

NOTE : FAILURE to submit the ANY of requested mandatory documentation specified in paragraph 6.2.1 WITH this bid / tender specification SHALL lead to the immediate disqualification of the bid / tender(er).

6.3 Site inspection.

6.3.1 ALL tenderers shall be required to make a mandatory site inspection after conclusion and attendance of a compulsory briefing session.

6.3.2 The purpose for this site inspection shall be for prospective tenderers to establish the full Scope of Work required as well as to identify all possible obstructions that will or shall influence the execution of the work required.

6.3.3 Tenderers shall familiarize / inspect the site and a site inspection / explanatory meeting certificate shall be completed and signed by both parties. FAILURE to submit this signed certificate with tender documentation SHALL lead to the immediate disqualification of the bid / tender(er).

6.4 Additional site inspection date.

6.4.1 The Liaison authority shall, in conjunction with the end user and Naval Engineering Section, predetermine a set date and time for any further site inspection(s) by tenderers, if required.

6.5 Installation site.

6.5.1 The removal of the currently installed dispensing units, underground storage tanks, islands and all ancillary equipment as well as the installation of the new dispensing units, underground storage tanks and all required ancillary components and work, shall be executed at the following identified site :

Naval Harbour Master's Harbour Support Services
and NBS Fire and Rescue Services Complex
Building 150, East Dockyard
NAVAL BASE SIMON'S TOWN
Cape Town

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.6 Utility scan.

6.6.1 Due to the age of the currently installed infrastructure, the SA Navy is currently **NOT** in possession of any site plan / layout that identifies the routes of the underground supplied utilities and / or facility(ies).

6.6.2 The costing for conducting a utility scan of the area prior to commencement of any work shall therefore be included in order to determine whether or not any underground infrastructure / facilities for water, sewage and electricity are present as well as its relevant route(s).

6.7 Corrosion protection.

6.7.1 As the site is located well within a highly corrosive marine environment (coastal classification), the use of materials / parts being manufactured from approved marine grade materials or materials that shall incorporate high corrosion-resistance properties shall be implemented, taking note of preventing galvanic corrosion due to dissimilar metals coming into contact with each other.

6.7.2 Painting, plating and / or powder-coating shall **NOT** be deemed satisfactory corrosion protection / preventative measures and shall **NOT be acceptable** under any circumstances.

6.7.3 All equipment and components shall be adequately treated for protection against corrosion in a corrosive marine environment, if not manufactured from a corrosion-resistant material.

6.7.4 Where applicable and subjected to serviceable lifespan, corrosion protection shall include manufacturing parts from corrosion resistant / marine grade approved metal / materials.

6.7.5 No Cadmium plated and / or powder-coated parts and / or non-protected ancillary equipment shall be acceptable.

6.7.6 Cathodic protection of tank and pipework shall comply with EN 12954 standard, where required.

6.8 Designed lifespan.

6.8.1 The automotive fuel dispensing facilities, its support structures and all ancillary equipment and associated works, as specified in this specification, shall be designed and constructed to have an expected minimum serviceable lifespan of not less than 20 full calendar years with an additional incorporated 10 full calendar years' redundancy factor in a corrosive marine environment, when subjected to daily usage as well as yearly checks / servicing / calibration procedures.

6.8.2 Each Underground Storage Tank shall have a certified manufacturing date of between 2010 and current date in order to comply with aforementioned (**NOTE** : *Underground Storage Tanks with a manufacturing date prior to 2010, shall under NO circumstance be acceptable nor installed*).

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.9 Site decommissioning.

6.9.1 The successful Contractor shall be held liable to safely and effectively decommission the site in accordance with the OHS Act, API RP 1604, SANS 10089-3 as well as any and all relevant recognised and approved petro-chemical industry codes, standards and regulations pertaining to the decommissioning of such a site / installation, including implementing and observing any and all fire prevention methods as well as eliminating possible explosion and environmental contamination hazards.

6.9.2 The Contractor shall be held liable to remove off-site to an approved waste management facility any and all removed components from the currently installed automotive fuel dispensing facilities, complete with any and all ancillary parts / equipment / sections, including any and all civil engineering work (i.e. rubble) that was required.

6.10 Site rehabilitation.

6.10.1 The successful Contractor shall be held liable to execute any and all site contamination rehabilitation, where and if applicable, in order to comply with applicable environmental legislation prior to proceeding with the installation of the new dispensing units, storage tanks and ancillary work required.

6.11 Interface definitions.

6.11.1 The automotive fuel dispensing installation and associated equipment shall be supplied and installed on the designated site noting the following :

- a. The successful Contractor's installation and supporting services shall be installed using the existing available 220 to 240 Volts, 50 Hz electrical.
- b. It shall include the wiring and connection to the nearest electrical supply point (Distribution Board located in Building 150), which shall comply with SANS 10089-2 and SANS 10142-1 requirements. A competent and registered Master Electrician(s) shall perform and / or supervise all electrical installations / connections in order to issue a CoC to the SA Navy.
- c. In order to prevent any explosion hazards, all electrical equipment supplied and installed, shall comply with SANS 10119, SANS 60079-11, SANS 60529, SANS 61084-1 and SANS 61084-2 requirements and shall be intrinsically safe.
- d. The successful Contractor shall ensure that all piping shall be adequately marked, as specified in SANS 10140 parts 1 to 3, to indicate the relevant product conveyed within. All pipework shall comply with SANS 10089-3 requirements.
- e. Where required, the Contractor shall be held liable to renew / repair any concrete and / or asphalt covered area(s) removed and / or damaged at the site during the installation(s) of the fuel dispensing facilities.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.12 Site work requirements.

6.12.1 This defines the SA Navy's requirements for the supply, installation and commissioning of new suction-pump type automotive fuel dispensing facilities, its ancillary support structure(s) and any and all ancillary equipment and associated works required, in terms of its physical attributes.

6.12.2 The successful Contractor and / or his / her personnel / sub-contractors shall under no circumstances be allowed to alter the Scope of Work on instructions from SA Navy (and / or any other SANDF) personnel on site.

6.12.3 All components of the new automotive fuel dispensing facilities shall integrate and interface with existing infrastructure for safe and efficient operation and shall be compliant with relevant petro-chemical industry approved and recognised code(s), standards and regulations as well as SANS 10089-2 and SANS 10089-3 standards.

6.12.4 It is to be noted that the existing underground 14 m³ each storage tanks for each product (ULP fuel (RON 95) to SANS 1598 and diesel (CF1) to SANS 342) shall be excavated and removed off-site, including any and all ancillary equipment and infrastructure.

6.12.5 The required work for this contract shall be as specified below, but shall not be limited thereto :

a. General.

- i. All electrical and fuel supply lines shall effectively be shut down / disconnected prior to any work starting on the site (i.e. decommissioning of installation / site).
- ii. The existing fuel dispensing units with all ancillary equipment and support structures, including underground storage tanks (UST) with dedicated suction, vent and return lines, where applicable, shall be safely disconnected, removed and be disposed of in its entirety.
- iii. If applicable, any fuel accumulated in each dispensing unit's containment area (sumps) shall be safely pumped out and be disposed of.
- iv. Each currently installed UST shall be safely drained of all of its respective contents and it shall be adequately vented prior to performing any type of disconnection / disassembly and removal procedures.
- v. Currently installed ID collars shall be removed and replaced with new ID collars to correctly identify tank number as well as specific type of fuel product contained and volume of tank (in m³).

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

b. Electrical.

- i. All electrical wiring and connections to the applicable Distribution Board(s) (DB's) shall be made compliant with the applicable and relevant SANS 10142-1 and SANS 10089-2 standards as well as any other applicable SABS regulations for explosive atmospheres / environment.
- ii. All currently installed electrical circuit breakers on the DB board, pertaining to the applicable dispensing units only, shall be disconnected and replaced with suitable and rated new circuit breakers for the new dispensing units, unless otherwise specified.
- iii. Mains power supply to the DB board shall under NO circumstances be enhanced. Should more mains power supply be required, the Contractor shall then submit a written request via the Liaison authority for further action.
- iv. All existing wiring and glands from the DB box to the fuel dispensing units shall be removed and replaced with new wiring and glands.
- v. The complete installation shall be adequately earthed, including relevant fuel dispensing unit(s), and shall effectively prevent static electricity charge build-up. Protection against lightning shall be provided and such protection shall be in accordance with SANS 10313.
- vi. As an additional feature, the DB board shall incorporate a unique feature whereby a portable / mobile generator shall be connected to it, during mains power supply failure, to ONLY supply electrical power to the fuel dispensing units for continuous operation.
- vii. The electrical installation shall also incorporate emergency shutdown switch(es) that shall effectively cut all mains power supply to the applicable fuel dispensing unit when activated. This shall be placed in a convenient position to ensure it being within easy reach of the operator(s) should an emergency situation occur.
- viii. A suitably rated surge protector shall be incorporated into each dispensing unit's circuitry to prevent damage to any electrical components / circuitry during mains power supply failures / spikes (e.g. unscheduled load shedding etc.).

c. Underground Storage Tanks (UST).

- i. Each new UST to be installed, shall be a SANS 1535 compliant composite bonded tank that shall offer extreme corrosion resistance, especially in a highly corrosive marine environment.

RESTRICTED

RESTRICTED

TENDERER'S OFFERS OR COMMENTS (refer paragraph 5.2)

- ii. One UST tank shall be for the storage and dispensing of unleaded petrol, RON 95 grade to SANS 1598 and one UST tank shall be for the storage and dispensing of low sulphur automotive diesel, CFI grade (50 parts per million) to SANS 342.
- iii. Each bonded tank shall offer high tensile strength and impact properties and shall be extremely suitable for underground storage of ULP and diesel fuels in a corrosive coastal environment.
- iv. Each bonded tank's incorporated cladding shall have been quality checked over 100 % of its surface to ensure that there shall be no discontinuities in the coating. The tank shall have been subjected to at least a 35000 Volt holiday test by the manufacturer.
- v. Each bonded tank shall be fully insulated from the surrounding soil and shall be equipped with isolating bushes.
- vi. Each bonded tank shall not normally require cathodic protection or corrosion monitoring.
- vii. Each bonded tank shall incorporate lifting lugs as well as flanged or dished ends.
- viii. Each bonded tank shall incorporate a manhole as well as a filler, dip, breather, overfill protection feature and suction pump apertures.
- ix. Each bonded tank's design shall allow for periodic in situ internal cleaning that shall not normally require the need to dismantle / disassemble / excavate any part and / or fitting thereof, including that of the suction line and tank sump.
- x. Volume, capacities, dimensions and weight (of each UST).
 - 1.) Volume (max.) : 14 m³
 - 2.) Capacity (calculated) (max.) : 14000 to 14300 litres
 - 3.) Steel plate thickness (min.) : 6 mm
 - 4.) Bonded shell thickness (min.) : 2,5 mm
 - 5.) Outside Diameter (nom.) : 1850 ± 150 mm
 - 6.) Length (nom.) : 5500 ± 150 mm
 - 7.) Weight (max.) : 2000 kg
- xi. Each UST shall be installed and secured in its designated area as specified in SANS 10089-3, complete with its own dedicated tank sump, suction and vent line.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

xii. Dip tube

- 1.) Each UST shall be supplied with a patented dip tube that shall be a three-in-one tank profiling device for gauging, profiling as well as obtaining visual samples of product contained within each UST.
- 2.) It shall be capable of drawing representative samples directly from each UST in a cost effective way without interrupting dispensing operations at any time.
- 3.) It shall employ the principles of pressure differential, mechanical sealing and a locking mechanism that shall ensure the fuel sample shall be trapped inside an inner tube in order to accurately determine the level of the tank.
- 4.) It shall also employ the principles of density and transparency to characterise the fuel sampled in order to determine contamination as well as the level of contamination.
- 5.) The dip tube shall not make use of water finding paste to detect presence of water and / or moisture.
- 6.) The dip tube shall be capable of indicating exact level of water / moisture inside the tank.
- 7.) It shall also be capable of being used to confirm if the CORRECT product has been delivered to the intended tank.
- 8.) It shall also be capable of being used to confirm if the INCORRECT product has been delivered to the intended tank.
- 9.) The dip tube shall be safe for hazardous zone operations (i.e. manufactured from low static generating materials) and shall not contain metallic components in its design and construction.
- 10.) The dip tube shall make use of laser engraving technology that shall ensure labelling shall be permanent and shall not be affected by fluids containing hydrocarbons.
- 11.) The laser engraving shall be bold in order to ensure product level inside the tube shall be easily observable by the operator, thereby reducing human error(s).
- 12.) The dip tube shall be labelled in both centimetres and litres (refer also paragraph c (x) (3)) and shall be self-converting.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS

(refer paragraph 5.2)

13.) The dip tube shall be incremented in millimetres between each centimetre reading, thereby ensuring the tube to be accurate to the last millimetre of the tank.

14.) The dip tube shall not be affected by weather conditions and shall give accurate readings day or night.

15.) As a back-up, a wooden fuel tank measuring stick shall form part of the deliverables.

d. UST's vent pipes.

i. Each UST shall be fitted with a dedicated vent pipe in order to comply with SANS 10089-3 standard.

ii. Each vent pipe shall comply with and be located as specified in SANS 10089-3.

iii. Each vent pipe shall be equipped with a dedicated up-draught type vent rose that shall effectively prevent ingress of (rain) water and / or moisture and / or rodents / reptiles and / or birds and / or any other foreign object(s) that may cause clogging or an obstruction thereof.

iv. Each vent rose shall not inhibit nor restrict the flow of air when the respective tank is being (gravity) filled (i.e. cause an exceedingly prolonged / delayed period when being filled by means of road tanker) or during fuel dispensing operations (i.e. cause a dispensing pump to "run dry" / sucking air etc.).

v. Each vent pipe, including any and all ancillary fittings, shall be manufactured from a marine grade approved material with inherent high corrosion-resistance properties.

vi. Each vent pipe shall be capable of withstanding heavy-vehicle traffic over it once buried.

e. Suction line.

i. Each UST's suction line shall be compliant with SANS 10089-3 standards.

ii. It shall be of a co-axial or concentric design (aka "double wall") type. This shall be required in order to render the installation compliant with SANS 10089-3 specifications regarding secondary containment fields for preventing hazardous materials / substances contaminating the surrounding environment should a leak occur.

iii. The new suction line's material shall be extremely suitable for use in a corrosive marine environment and shall be suitable for the respective conveyance of RON 95 ULP and CP1 50 ppm diesel fuel (i.e. it shall not be adversely affected / degraded / weakened when conveying fluids containing hydrocarbons).

RESTRICTED

TENDERER'S OFFERS OR COMMENTS (refer paragraph 5.2)

- iv. Each line shall, once buried, be capable to withstand heavy-vehicles travelling over it without collapsing or being damaged.
 - v. Each line shall be installed at a suitable gradient between the respective tank and respective fuel dispensing unit, as specified in SANS 10089-3.
 - vi. Each line shall incorporate a straining filter unit that shall adequately prevent any contaminants and particles suspended within the fuel and tank from being dispensed.
 - vii. Installation of an inline straining filter system, complete with a removable / replaceable filter element shall be preferred.
 - viii. Each line shall also incorporate a flashback arrestor, breakaway or pressure loss shut-off valve(s), by-pass valve(s), pressure relief valve(s), control valve, check valve and foot valve, where required.
 - ix. An inline filtration system shall be supplied and installed, complete with removable / replaceable filter element, which shall effectively remove or trap any moisture / water contained within the fuel being dispensed.
 - x. Each inline filtration system(s) shall incorporate a non-digital or analogue status information indicator to monitor the flow rate over each of the filtering systems (i.e. to determine whether filter(s) are in need of replacement). However, each filtration system shall not adversely restrict or reduce specified pressures and flow rates at the dispensing unit's nozzle, unless the applicable replaceable filter becomes unserviceable and requires replacement.
 - xi. All replaceable filter elements shall be of South African origin and obtaining it shall not unnecessary delay the dispensing of fuel or cause elongated delays in returning to service the respective fuel dispensing unit(s). No special tools shall be required to change any filters.
 - xii. The design of the respective filtering systems and its installation position within the suction line shall be such that no unauthorized dispensing of fuel shall occur nor access be given for any suction device to be inserted for illegal fuel dispensing operations.
- f. Fuel-dispensing units
- i. Each product (ULP and diesel) shall be dispensed by its own dedicated dispensing unit.
 - ii. Each new fuel dispensing unit set shall be SANS 1020 compliant and certified and shall be of the aboveground, vertical stand-up, suction pump type.

RESTRICTED

TENDERER'S OFFERS OR COMMENTS

(refer paragraph 5.2)

iii. Each fuel dispensing unit shall incorporate the following :

- 1.) It shall be of a robust design with proven engineering features.
- 2.) It shall be for a private fuel user (i.e. no cost per litre indicator required).
- 3.) It shall be a single hose, single product dispensing unit.
- 4.) It shall incorporate a micro-accurate two-piston flow meter or a suitable accurate equivalent thereto.
- 5.) It shall incorporate a compact pumping unit, complete with self-priming feature(s), which shall offer high capacity – high speed delivery.
- 6.) Each pump unit shall incorporate an enclosed and re-sealable containment casing, complete with drain to in-feed side prior to the filtering system(s), which shall effectively catch and recycle any fuel leaking from the pump. The drain maybe routed back to the fuel storage tank's sump area for collection, if practical and economical viable to do so.
- 7.) It shall incorporate a tamper-proof Veeder-Root or equivalent mechanical register with a non-resettable totalizer, capable of totalling up to and indicating a maximum of 9 999 999,9 litres of fuel dispensed.
- 8.) It shall incorporate an intrinsically safe heavy-duty electric motor that shall drive the pumping unit by means of a non-spark belt and pulley system.
- 9.) The pump shall be switched "ON" when lifting of the delivery nozzle to dispense fuel shall occur and shall be switched "OFF" once delivery nozzle is returned / replaced by means of a manually operated lever. A locking feature shall be incorporated.
- 10.) It shall incorporate a Zero-reset handle that shall be situated on the side panel.
- 11.) It shall incorporate an open-frame register that shall be capable of recording up to and indicating a maximum of 999,9 litres of fuel dispensed per delivery.

RESTRICTED

TENDERER'S OFFERS OR COMMENTS (refer paragraph 5.2)

- 12.) It shall incorporate a high-speed constantly-engaged emergency hand driven crank and handle for use during mains power outages. Emergency hand driven crank and handle for each respective pump shall form part of the deliverable.
- 13.) Frame and cover panels of dispensing unit shall be manufactured from an approved marine grade (i.e. highly corrosion-resistant and non-magnetic) material.
- 14.) It shall incorporate an approved fuel (hydrocarbon resistant) dispensing hose, complete with a ZVA or equivalent automatic nozzle, and compatible couplings. Overall nominal length of assembled dispensing hose shall not be less than 7000 mm.
- 15.) Each dispensing pump shall have a maximum delivery flow rate, measured at the dispensing nozzle, of between 45 and 50 litres per minute at 0,35 MPa (350 kPa) nominal pressure through a 25 mm diameter delivery hose and nozzle.
- 16.) Each dispensing pump unit shall have a minimum delivery flow rate, measured at the dispensing nozzle, of not less than 5 litres per minute at 0,05 MPa (50 kPa) nominal pressure through a 25 mm diameter delivery hose and nozzle.
- 17.) Each automatic nozzle shall incorporate an encapsulated coloured body that shall effectively identify the specific product being dispensed (i.e. light-green for ULP, black for diesel), as per normal public forecourt industry standard.
- 18.) It shall incorporate a Stainless Steel to AISI 304 L or Aluminium alloy hose hook bracket that shall be affixed on the same side as the dispensing hose, for storing hose when not in use.
- 19.) It shall incorporate a tamper-proof (non-removable) nozzle hook that shall incorporate a feature for securing the nozzle by means of a padlock. The nozzle hook shall be manufactured from a corrosion resistant and non-magnetic metal.
- 20.) It shall incorporate a lockable emergency crank access cover hatch that shall effectively prevent any unauthorized access to the high-speed constantly-engaged emergency hand drive. (**NOTE** : securing of this access hatch by means of a screw or bolt only, shall not be deemed a suitable security measure and shall under **NO** circumstances be acceptable).

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS

(refer paragraph 5.2)

21.) It shall incorporate a nozzle boot that shall be manufactured from a corrosion-resistant and non-magnetic metal.

22.) It shall incorporate an intrinsically safe backlit LED type energy saving light and fitting for night time fuel dispensing operations.

h. Additional installation requirements.

- i. As the location of the UST's installation site are within the high-water mark and in reclaimed seabed, the installation of a geotextile fabric or an equivalent preventative measure that shall effectively prevent rising groundwater / seawater from entering and / or spilled / leaked fuel from exiting the installation location once backfilled, shall preferably be installed and shall cover all sides of the excavation, preferably on the concrete slab or prior to putting down the dead man anchors and executing backfill.
- ii. Each UST shall be supplied with a hydrocarbon and corrosion-resistant tank sump as well as lockable dip and filler caps.
- iii. Each UST, once installed and compliant with SANS 10089-3 requirements, shall be capable of accommodating traffic from heavy-vehicles travelling over it without becoming dislodged or developing leaks, cracks etc.
- iv. Each UST shall be equipped with a minimum of four (4) observation wells on its perimeter, which shall comply with SANS 10089-3 requirements.
- v. A new spill slab shall be cast, complete with spill slab grids and pipes.
- vi. A new separator shall also be constructed and connected to the existing drainage system.
- vii. The new separator shall effectively prevent spilled fuel (ULP and / or diesel) from entering the municipal sewage system.
- viii. A new reinforced concrete island shall be cast to accommodate the two respective dispensing units, each complete with its own dedicated sump area, which shall effectively prevent accumulated spilled / leaked fuel from seeping into the surrounding environment / soil / groundwater / sewage system.
- ix. Each sump area shall be adequately sealed to ensure its integrity and tightness upon completion.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

- x. Each sump area shall be lined or be fitted with a hydrocarbon resistant material that shall effectively form a second barrier within the cavity. This shall be required to comply with regulations regarding secondary containment fields for preventing hazardous materials / substances contaminating the surrounding environment.
- xi. Each dispensing unit's containment area shall also be equipped with a self-resettable monitoring device that shall sound an audible alarm or RED flashing light to indicate or make the attending operator aware of fuel leaking and accumulating within the containment area, which is not to exceed set safe standard petro-chemical industry levels.
- xii. The monitoring device shall also effectively shut down any and all electrical supply, once activated, to the dispensing unit until such time that the containment area shall be pumped out, fuel leak(s) contained or repaired and the monitoring device can no longer detect a dangerous level of accumulating fuel. Only then shall electrical power be capable of being restored and fuel dispensing operations may resume.
- xiii. Vehicle arrestors / barriers that shall effectively prevent / stop a fully loaded SAMIL 100 truck, travelling at a maximum speed of 40 km/h, from reaching / smashing into and dislodging any dispensing unit, shall be provided around the dispensing units and the island and shall be concreted into the existing surface. Particular attention should be paid to chassis heights of trucks operating in the fuel dispensing area.
- xiv. A 2 x 3 meter (W x L) sized canopy with no front bollards shall be installed over the dispensing units in order to minimize environmental wear and tear on the units as well as to give weather protection to operator(s).
- xv. The canopy shall be of such design and construction that it shall be able to withstand the heavy corrosion marine atmosphere as well as the strong winds (> 100 km/h), severe gusts and heavy rainfall experienced in and around the vicinity during the year without becoming dislodged, warped or in any way damage itself or its surrounding infrastructure.
- xvi. The canopy shall be fitted with corrosion-resistant, vandal-proof, sealed high intensity energy saving LED lights with an IP 65 or better rating, in accordance with SANS 60529. All lighting shall be connected to an IR light intensity monitor that shall allow for automated operation during day /night time.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

xvii. The following symbolic safety signs, as per OHS Act regulations, shall be supplied and secured in an unobstructed and clearly observant position at the site, in the vicinity of the dispensing units:

- 1.) No naked flames.
- 2.) No smoking.
- 3.) No cell phones or any other ignition source allowed.
- 4.) Vehicles to be switched off when refuelling.

xviii. The flammable store's double wooden door, complete with its entire frame, shall be removed and replaced and shall be finished in red paint, complete with all safety signs affixed.

xix. The door shall be equipped with a corrosion-resistant hinges, security lock and latch as well as a corrosion-resistant door handle and stays (in order to prevent damage to doors and frame from the wind).

xx. Each installation shall be provided with a spill containment kit, applicable for the respective product to be contained / cleaned.

xxi. Each installation shall be provided with a first-off emergency response firefighting / fire suppression kit in close proximity of the dispensing units.

6.13 Ad hoc requirements

6.13.1 The successful Contractor shall comply with the following:

- a. The Contractor shall, at own cost, generate and issue all approved drawings and notices in respect of the installation to the local authorities, if any, and shall indemnify and exempt the SA Navy (and SANDF) from all losses, cost or expenditure which may arise as a result of the Contractor's negligence to comply with the requirements of the regulations.
- b. The Contractor shall be conversant with the relevant requirements. Should any requirement, by-law or regulation, which contradicts the requirements of this document, apply or become applicable during the installation, such requirement, by-law or regulation shall overrule this document and the Contractor shall immediately inform the SA Navy (or SANDF) of such a contradiction.
- c. The Contractor shall not carry out any variations to the installation in terms of such contradictions without obtaining written permission to do so from the SA Navy and endorsed by the Liaison authority.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

- d. The Contractor shall be held liable for the effortless interface and integration of the new automotive fuel dispensing units with the existing surrounding infrastructure.
- e. The Contractor shall assist and train (refer par. 6.16) designated SA Navy personnel in the required daily / monthly / yearly maintenance / checks and use of each installation and shall be liable for continued assistance and support up to and including successful commissioning.

6.14 System testing.

6.14.1 Each complete automotive fuel dispensing system installed, in its entirety and to determine its integrity and tightness, shall be VacuSonic or MassTech tested and be certified after installation and prior to commissioning.

6.14.2 Each dispensing unit and flow meter shall be calibrated for accuracy. A calibration certificate shall be issued upon completion and commissioning for each dispensing unit, which shall handed over to the Liaison authority.

6.14.3 The SA Navy shall be required to witness the testing of each system. The successful Contractor shall give adequate notice to the Liaison authority with regards to the date and timeframe set aside for testing (preferably not less than 14 calendar days prior). FAILURE to execute and perform VacuSonic or MassTech testing as well as calibration on pump and flow meter, shall lead to payment being withheld until conformed with.

6.14.4 The Contractor shall be held liable to repair any latent leaks / damage(s) / calibrations and / or any other issues discovered whilst conducting the aforementioned testing. This shall also be applicable for replacement of any equipment malfunctioning and / or found to be inoperative / not conforming to standards / specifications.

6.15 Certificates of Conformance.

6.15.1 The successful Contractor shall be held liable to supply to the Liaison authority all relevant Certificates of Conformance / Compliance (CoC) pertaining to and required by law for this type of installation with regards to general regulations and standards to be adhered to upon decommissioning as well as recommissioning.

6.15.2 The Contractor shall be held liable to perform relevant leak testing (MassTech or VacuSonic tests) on each of the completed installed systems to ensure the integrity and tightness thereof as well as to ensure that all lines are leak proof prior to final acceptance / commissioning and shall issue the required certification to the Liaison authority upon completion.

6.15.3 Furthermore, the Contractor shall also be held liable for the calibration of each dispensing unit installed as well as the issuing of a calibration certificate(s) in this regard.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.15.4 The abovementioned testing and calibration shall be required to be witnessed by the SA Navy and the Liaison authority shall be given adequate notice **prior** to conducting the testing and calibration.

6.15.5 Test report(s) (with results) shall be handed over to the Liaison authority.

6.15.6 The Contractor shall also be held liable to have the entire installation inspected, approved and certified acceptable by the local (City of Cape Town) Fire Department **prior** to final commissioning.

6.15.7 This shall be preferably executed **prior** to any backfilling of manholes, trenches asphalt etc. The costing for this shall be included in the overall tendered price. **FAILURE to submit leak test and Fire Department certification shall lead to payment being withheld until conformed with.**

6.16 Familiarization

6.16.1 The successful Contractor and his / her designated service technicians shall be held liable to :

- a. Familiarize designated SA Navy personnel (max. of 3 persons) on the safe day-to-day operation as well as daily / monthly / yearly maintenance / checks and minor repair of the installed equipment up to and including the OEM's Level 2 competency. No training beyond Level 2 competency shall be required (i.e. no dismantling of equipment etc. to be allowed).
- b. The Contractor may subject designated SA Navy personnel to a written examination to establish their level of competence and, if acceptable, certify them as competent.
- c. Operator(s) shall also be familiarized to be confident in emergency first responder firefighting measures and procedures for the applicable product(s) being dispensed.
- d. The costs for the familiarization course specified above shall be included in the overall tendered price.

6.17 Maintenance plan

6.17.1 **Each** automotive fuel dispensing facility and its ancillary equipment installed, shall be supplied with a **36-month** preventative / corrective maintenance plan (any day any time dispensing unit break down) that shall be inclusive, but not be limited, to that specified below :

- a. Labour.
- b. Travelling (at applicable AA rates, determined to and from Contractor's premises in Cape Town Metropole only).

RESTRICTED

TENDERER'S OFFERS OR COMMENTS (refer paragraph 5.2)

- c. All required lubricants
- d. All mechanical components
- e. All electrical components
- f. All piping, valves, filters, fittings etc.
- g. All related sundries
- h. Yearly corrosion inspection on entire installation(s).
- i. Maintenance plan shall include all OEM scheduled routine maintenance and component repair / replacement parts as well as related sundries and vendor supplied equipment.
- j. VacuSonic or MassTech testing on both Diesel and ULP systems, in their entirety, in order to determine their integrity and tightness, shall be done once yearly on both new installations. First one shall be due 12-months after successful commissioning, thereafter every 12-month period (total of three (3) over 36-months).
- k. Calibration of each dispensing unit and flow meter shall be executed twice yearly as well as on completion of any dispensing unit breakdown repairs. First one shall be due 6-months after successful commissioning, thereafter every 6-month period (total of six (6) over 36-months).
- l. The costing of cleaning both Diesel and ULP's UST tanks shall be included. First one shall be due 18-months after successful commissioning, final one shall be due 18-months after first one (total of two (2) over 36-months).

NOTE : The abovementioned preventative / corrective maintenance plan shall become effective from the date of final commissioning of each automotive fuel dispensing facility and the cost thereof shall be included in the overall tendered price. The SA Navy reserves the right to renew this maintenance plan at its discretion

6.18 Spare parts.

6.18.1 The offered automotive fuel dispensing facilities, its support structure and all ancillary equipment, shall **NOT** be at the end of its production lifespan.

6.18.2 The Contractor shall guarantee to supply Original Equipment Manufacturers' (OEM) approved or OEM approved replacement (spare) parts thereto for all equipment, when required, in order to render the installations and ancillary equipment serviceable for the specified designed lifespan.

6.18.3 The Contractor shall also guarantee that all OEM or OFM approved equivalent parts shall be available for a period of not less than the specified designed lifespan after successful installation and commissioning.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.19 Technical documentation.

6.19.1 The Contractor shall deliver one (1) set of the following documentation to the Liaison authority (of which a copy to be forwarded to NES):

- a. Electrical Wiring certificate(s).
- b. SANS 10089-2 and SANS 10089-3 Certificates of Conformity for both installations, including compliance certification with environmental regulations, where applicable.
- c. The 35 000 Volt holiday test certificate, issued by the tank manufacturer.
- d. Fire Department approval certification for the installation(s).
- e. Operating Regulations, in accordance with the applicable petro-chemical industry / authority's rules and regulations.
- f. Operating instructions and illustrated parts lists of all equipment installed.
- g. A general arrangement / assembly drawing of each fuel dispensing unit (if not common), indicating all parts, as installed.
- h. Dispensing units' electrical wiring diagrams, in full detail.
- i. An "AS INSTALLED" site plan layout drawing showing the entire installation in relation to the surrounding infrastructure, complete with all cable trunking provided for electrical cabling and fuel suction / vent lines to and from the tanks.
- j. An "AS INSTALLED" electrical distribution / wiring layout from the source of supply (DB box). This shall include all / any electrical connections and cable numbers applied to cables.
- k. All other relevant drawings / documentation pertaining to the installation.

NOTE : FAILURE to provide the abovementioned specified documentation at site hand-over, shall lead to payment being withheld until conformed with.

6.20 Warranty.

6.20.1 **ALL** work, equipment and associated work(s) and parts supplied (vendor or OEM) and installed, as specified in this specification, shall carry a comprehensive warranty period of 12-months against all and any faulty parts, poor workmanship, design and / or manufacturing processes or incorrect installation procedures with effect from the date that final payment shall be made to the successful Contractor.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.20.2 Each automotive fuel dispensing unit, its structure and all ancillary equipment fitted, shall be covered by a 12-month anti-corrosion warranty from date that final payment shall be made to the successful Contractor.

6.20.3 All warranty periods shall be applicable for the entire 12-month period and SHALL NOT be subjected to the amount of operating hours

6.20.4 Malicious and / or accidental damages or damages due to negligence shall be excluded from this warranty cover, although the Contractor may be requested to submit a quotation for the repair / replacement and re-commissioning of the affected system(s) or area(s) after repair.

6.20.5 All warranty claims within this period shall be directed to the Contractor whom shall be responsible to take the required corrective action. No negotiations shall be entered into with any sub-contractors used by the prime Contractor.

6.21 Acceptance authority.

6.21.1 Designated representatives from the Liaison authority, SA Navy and the successful Contractor's duly appointed engineer / representatives shall be responsible for, against signature, the acceptance and approval of each installation before, during and after installation.

6.21.2 The duly appointed engineer/ representatives from the successful Contractor as well as designated representatives from the Liaison authority and the SA Navy, shall be present to conduct the acceptance and approval inspection(s) at the following intervals :

- a. After decommissioning, prior to excavating and disconnecting pipes / electrical etc.
- b. After excavating and removal of tanks, dispensing units and ancillary equipment (NOTE : *rehabilitation maybe required at this stage*).
- c. After installation of new tanks, dispensing units, required civil engineering work, integrity testing and electrical connections.
- d. After completion of entire installation, as specified in this specification.

6.21.3 Any unsatisfactory or incomplete installation work / operation of equipment shall result in payment being withheld until such time as the corrective measures have been taken to rectify the problem areas to the full satisfaction of the representatives of the SA Navy and the Liaison authority.

6.21.4 A Certificate(s) of Completion, signed by all relevant parties, shall be submitted with the original invoice(s) to the Liaison authority for payment procedures upon satisfactory acceptance.

RESTRICTED

TENDERER'S OFFERS
OR COMMENTS
(refer paragraph 5.2)

6.22 Liaison authority

6.22.1 Unless otherwise instructed, all tenderers shall contact (*during official office hours only*) the following person(s) or his / her duly authorized delegate(s) with regards to any queries :

Bid Invitation Section

Simon's Town Procurement Services Centre

Att. : WO¹ T. S. Tsogang

Tel. No. : 021 787 5144 / 5131 / 5146

E-mail : tsogangts@gmail.com / spsebidinvitation@gmail.com

RESTRICTED

LIST OF ABBREVIATIONS

Abbreviations used in this specification are explained in the list hereunder :

aka	: also known as
CoC	: Certificate of Compliance / Conformance
DB	: (Electrical) Distribution Box
DoD	: Department of Defence
NBS	: NAVAL BASE SIMON'S TOWN
NES	: Naval Engineering Section
OEM	: Original Equipment Manufacturer
OHS Act	: Occupational Health and Safety Act
RSA	: Republic of South Africa
SANS	: South African National Standards (previously titled "SABS" standards)
SANDF	: South African National Defence Force
SPSC	: Simon's Town Procurement Services Centre
UST	: Underground Storage Tank
CONTRACTOR	: The tenderer awarded the bid to execute the work as defined in this specification.
CUSTOMER	: The term Customer is understood to mean the SA Navy, with Simon's Town Procurement Services Centre as the nodal Liaison authority.

RESTRICTED

DEPARTMENT OF DEFENCE
SPECIAL CONDITIONS OF CONTRACT
(SCC's)

TABLE OF CLAUSES

1. GENERAL
2. CHANGED REQUIREMENT
3. CO-ORDINATED ACTIVITIES
4. SUB-CONTRACTING
5. VALUE ADDED TAX (VAT)
6. LIABILITY AND DAMAGE COMPENSATION
7. WAIVER
8. ACKNOWLEDGEMENT

RESTRICTED

SPECIAL CONDITIONS OF CONTRACT

GENERAL

1. The conditions contained in the General Bid Conditions (GBC's) and General Conditions of Contract (GCC's) as well as all other conditions shall apply.
2. The Contractor accepts full liability, responsibility and accountability for the Scope of Work, as specified in / relating to this contract.
3. Installation.
 - a. The installation, testing, certification and commissioning of these automotive fuel dispensing units / installations, its support structure and all ancillary equipment and associated works, shall be a considered a turnkey project.
 - b. The Department of Defence shall therefore **NOT** supply any labour, materials, consumables and / or equipment for the manufacture, installation, testing, certification and commissioning of these automotive fuel dispensing installations, its support structure and all ancillary equipment and associated works.
 - c. The Contractor shall be held liable to supply all the necessary labour, materials, consumables and equipment, including all system specific equipment and ancillary accessories, for the satisfactory and effective manufacture, installation, testing, certification and operation of these automotive fuel dispensing facilities, its support structure and all ancillary equipment and associated works.
 - d. Each installation shall be certified to be in accordance and compliant with SANS 10089-2 and SANS 10089-3 standards.
 - e. All materials / equipment to be installed shall be intrinsically safe and shall comply with the relevant SABS specifications or an equivalent recognized international standard / specification.
 - f. The offered equipment shall be standard supply items that can readily be supported / replaced from local (RSA) agents. Special / one-offs / sub-standard equipment shall not be used nor be acceptable and / or installed.
 - g. The offered equipment shall **NOT** be second hand / refurbished / previously owned equipment and any such equipment offered and or installed, shall not be acceptable under any circumstances and where found, shall be removed and replaced with new equipment at the Contractor's expense.
4. Site clean-up.
 - a. The Contractor and / or his / her sub-contractor(s) shall be held responsible for the removal of **ALL** rubble and debris, where applicable, from the designated site(s) to an approved waste management site.
 - b. A **waste disposal** undertaking (between tenderer and waste disposal company) shall be **submitted** with the tender.
 - c. Extreme care shall be taken not to mix cement / concrete on existing paving, grass, tarred road surfaces etc.
 - d. After completion of all work, the Contractor shall ensure that each site shall be cleaned to the full satisfaction of the Department of Defence's representatives.

RESTRICTED

RESTRICTED

5. Warning boards.

- a. Clearly readable warning boards in English and one other official language or equivalent symbolic safety signs, in accordance with the OHS Act, Act No. 85 of 1993, as amended, shall be exhibited in situations where the rendering of the service(s) may cause injuries to a person(s).

6. Occupational Health and Safety.

- a. All safety regulations in terms of Personal Protective Equipment (PPE) and facilities as well as Personal Breathing Equipment (PBE), as laid down in the Occupational Health and Safety (OHS) Act, Act 85 of 1993, as amended, shall apply in respect of this contract.
- b. The Department of Defence reserves the right to have all work ceased on any site(s) should the Contractor and / or his / her personnel / sub-contractors be found transgressing OHS Act regulations.
- c. The Department of Defence shall not be held liable in this regard for any time or costs lost by the Contractor and / or his / her sub-contractors until such time that OHS Act regulations are correctly implemented and adhered to at all times whilst on a particular site(s).
- c. All specialized protective safety equipment that may be required in terms of the execution of this contract shall be provided by the Contractor. The cost of any such equipment lost or damaged by the Contractor's personnel / sub-contractors, shall be for the Contractor's account.
- d. The Contractor shall be responsible at all times for the safety of his / her personnel / sub-contractors when they are executing the required service(s) on Department of Defence property.
- e. The Contractor and his / her personnel / sub-contractors shall enter Department of Defence property at their own risk.
- f. Should any of the Contractor's personnel / sub-contractors sustain any injuries, whilst on Department of Defence property, through the Contractor's action, the Contractor shall be responsible for the rendering of medical attention.
- g. Treatment for any injuries sustained by the Contractor's personnel / sub-contractors, caused by Department of Defence action, but not due to negligence or malicious intent on the part of the Department of Defence, shall be for the responsibility of the Contractor. Furthermore, the Department of Defence shall not accept legal liability for such injuries.
- h. The Department of Defence may, according to its discretion, render limited medical assistance to the Contractor's personnel / sub-contractors. The Department of Defence, however, shall not accept any liability for the outcome of such medical assistance rendered. The Department of Defence may, according to its discretion, charge the Contractor for such medical assistance services rendered.

RESTRICTED

- i. The Contractor shall, upon appointment and prior to commencing with any work on the relevant site, deliver his / her comprehensive Safety File to the appointed Department of Defence Safety Officer for approval.
- j. At the discretion of the Department of Defence, the Contractor and his / her personnel / sub-contractors shall be required to undergo screening or testing for any highly infectious diseases (such as Covid-19 etc.).
- k. All costing relating to testing and testing reports / results required, shall be for the Contractor's own account, but the outcome of such results shall be forwarded to the Department of Defence's Safety Officer for final (work permit) decision.
- l. It shall be and remain the full responsibility of the Contractor to continuously monitor his / her personnel / employees / associates / sub-contractors / suppliers etc. for signs of being infected / or where / when they come / came into contact with infected persons and it shall be a mandatory requirement to immediately report any such cases found and / or suspicions to the Department of Defence's Safety Officer in order to take the necessary precautionary steps.
- m. All the Contractor's personnel / sub-contractors shall be required to attend and complete a mandatory Safety Induction, presented by the relevant Department of Defence Health and Safety Officer, and only thereafter shall work be allowed to commence. This shall also be applicable to any extra and / or replacement personnel brought on site by the Contractor and / or his / her sub-contractor(s).

7. Working Hours.

- a. Normal working hours shall be restricted between 07H30 AM to 16H00 PM on Mondays to Fridays and shall exclude Public Holidays and weekends, unless otherwise instructed or permitted.
- b. The Contractor shall obtain prior written permission from the Department of Defence should he / she or his / her personnel / sub-contractors be required to work outside the aforementioned days and hours, including during / over Public Holidays and weekends.

8. Inflammable and poisonous substances.

- a. The Contractor shall NOT use nor store any poisonous or highly inflammable substances of any kind on any of the Department of Defence's premises / properties.

9. Payment.

- a. No payment shall be made to the Contractor for any services rendered / goods delivered to the Department of Defence before commencement of or after the official printed Government Order start / completion date.
- b. Any claims made for services rendered / goods delivered before / after the official printed Government Order stipulated start / completion dates, shall not be accepted by the Department of Defence and shall thus be for the Contractor's own account.
- c. No payment shall be made to the Contractor for any services rendered or goods delivered to the Department of Defence without written authority from the Procurement Entity.

RESTRICTED

- d. When all deliverables / services, as specified in this contract, have been satisfied, payment shall be made within approximately 30-days after receipt of original invoice(s) and the original Acceptance / Completion Certificate.
 - e. There shall be no milestone (or phase) payments made to the Contractor or to any of his / her personnel / sub-contractors / suppliers etc. until final and successful commissioning and acceptance of these automotive fuel dispensing facilities, its support structure and all ancillary equipment and associated works by the Department of Defence.
 - f. The Department of Defence, via the respective Procurement Entity, reserves the right to consider partial payment of vendor supplied equipment and / or services to the Contractor that shall be required to fulfil this contract.
 - g. Partial payment of vendor supplied equipment and / or services shall be subject to the Contractor submitting to the relevant Procurement Entity such a request together with the vendor's original supplied invoice (or waybill), banking details and physical proof that such equipment and / or services have been installed and / or rendered on Department of Defence's property / premises.
 - h. Under no circumstances shall a request for partial payment be consider by the Department of Defence for equipment supplied and / or services rendered prior to it not being installed and / or provided.
10. Escalation
- a. No additional work or costs (other than that authorized by the original printed Government Order) shall be incurred in terms of this contract without the specific permission from the Department of Defence as well as written permission from the Procurement Entity.
11. Copyright
- a. The Contractor shall agree and grant to the Department of Defence a royalty, free, non-exclusive and irrevocable licence to reproduce all data covered by copyright with the limitation that such data should not be released outside of the Department of Defence.
 - b. When the Contractor uses a manual or data which covers a vendor's components or portions thereof, and the vendor's manual contains copyrighted material, the Contractor shall be responsible for obtaining a copyright release from the vendor and furnishing such release to the Department of Defence with the limitation that such data should not be released outside of the Department of Defence.

CHANGED REQUIREMENT

12. If Department of Defence institutions participating in this contract are disbanded or relocated or for reasons unknown at the time of concluding the contract, the Department of Defence shall reserve the right to cancel the contract or parts thereof on written notice of 90 days sent to the Contractor at the address appearing in the contract.

CO-ORDINATED ACTIVITIES

13. Whilst on Department of Defence premises, personnel of the Contractor will have access to all areas, subject to other stipulations in the relevant contract, to render services.

RESTRICTED

14. If the Contractor's service(s) is not rendered / required in a specific area at a given time, access to that area(s) shall be forbidden.
15. The work to be executed shall under no circumstances disrupt the daily routine activities taking place at the institution or on the premises where the service(s) is to be provided.

CONTRACTOR'S PERSONNEL

16. Security.

- a. The Contractor, including his / her personnel / employees / associates / sub-contractors / suppliers shall at all times adhere and be subjected to the relevant security rules and regulations in place when entering Department of Defence's property / premises.
- b. No undocumented foreign national(s) shall be allowed onto Department of Defence's property / premises, even when in possession of a valid RSA residency and / or work / study and / or working permit.
- c. Documented foreign national(s) shall only be allowed onto Department of Defence's property / premises when written ministerial approval has been given to such a individual person(s). This shall be strictly enforced without exceptions.
- d. No weapons of any type / kind nor any alcohol or any other mind altering substance(s) shall be allowed on the Department of Defence's property / premises.
- e. Anyone suspected being in possession of a weapon(s) of any type / kind or of being under the influence of mind altering or any other intoxicating substance(s), shall not be allowed on the premises and if so found, shall be removed from the Department of Defence property / premises accordingly.
- f. The Department of Defence and its employees shall not be held responsible for any claim for any time and / or production lost by the aforementioned action. Any claim for time and / or production lost shall be for the Contractor's own account without any cost implication to the Department of Defence.

17. Identification.

- a. To identify the Contractor's personnel on the premises of the Department of Defence, the personnel shall comply with the following, with any costs for the account of the Contractor:
 - i. Personnel shall wear a company identification card with an employee photograph on it, conspicuously on his / her person at all times.
 - ii. Personnel shall wear identifiable uniforms whilst on duty.

18. Attitude towards Safety, Health, Security and Service delivery.

- a. Without prejudice to the Contractor's responsibility and right to select and appoint his / her own personnel, the Department of Defence shall at all times retain the right to identify personnel of the Contractor whom are considered to be undesirable, a safety and / or health and / or security risk.
- b. In such case(s), the Contractor shall be requested not to utilize such person(s) any longer to honour his / her obligations in terms of this contract.

RESTRICTED

- c. The Contractor shall immediately comply with the request and he / she shall not, as a result of such request, be entitled to institute any claim against the Department of Defence for any loss or otherwise suffered as a result of such a request.
- d. The Contractor therefore indemnifies the Department of Defence against any claim whatsoever from the employee(s) concerned.

19. Name List.

- a. The Contractor shall submit a complete name list of all personnel to be employed on Department of Defence premises to provide the service(s) according to the contract, to the Department of Defence official at the institution or on the premises where the service(s) is to be provided, whom shall arrange for entry permits for the Contractor.
- b. Any changes to the personnel shall be communicated to the designated official without delay.

20. Personnel on site.

- a. The Contractor shall ensure that the total number of personnel offered, for the execution and completion of this contract, shall be on duty on a daily basis until completion and / or final acceptance by the Department of Defence of the service(s) to be provided under this contract.
- b. Provision shall therefore be made for temporary or stand-in personnel for cases where personnel shall be on leave or sick leave.

21. Control of personnel.

- a. The Contractor shall at all times properly supervise all of his / her personnel / sub-contractors whilst on Department of Defence property.
- b. The Department of Defence shall at no time be expected to provide the Contractor's personnel / sub-contractors with supervision whilst work is being carried out in accordance with this Scope of Work.
- c. The Contractor shall establish the necessary control measures to prevent continued entry of his / her personnel into Department of Defence's property / premises after completion of this contract, unless otherwise permitted / authorized.

22. Non-performance.

- a. Should the service(s) to be rendered by the Contractor and / or his / her personnel / sub-contractor(s) be found to be sub-standard or non-existent, the Department of Defence shall then have the right to reject acceptance of or refuse to scrutinise such service(s) and shall require its immediate correction from the Contractor.
- b. If the Contractor persists in non-performance, the Department of Defence then shall have the right to refuse to scrutinise any service(s) rendered for acceptance until the quality control system of the Contractor has been corrected.

RESTRICTED

- c. If the Contractor fails to adhere to or satisfy any of the clauses, conditions or responsibilities, as specified in this contract, the Department of Defence shall then move to terminate the contract.
- d. Services rendered, which have been rejected, shall be rectified and be re-submitted for approval and the cost thereof, if any, shall be for the Contractor's account.

SUB-CONTRACTING

- 23. The Contractor may sub-contract part(s) of this contract, which shall be subject to the Department of Defence's rules and regulations as well as the Standard Bid Documents (SBD's) and General Bid Conditions (GBC's).
- 24. In the event that sub-contractors are to be used to execute the contract or part thereof, the following shall apply:
 - a. Prior Approval
 - i. Once the contract signing formalities have been concluded, the Contractor shall obtain prior approval from the Department of Defence before appointing any sub-contractor(s).
 - b. Payment
 - i. The Contractor shall remain liable to reimburse any and all sub-contractor(s) for goods delivered and / or services rendered to the Department of Defence relating to the execution of this contract.
 - c. Responsibility
 - i. The Contractor shall remain at all times fully responsible, legally and technically, for any and all services rendered / goods delivered by any sub-contractor and / or contracted-in support.

VALUE ADDED TAX (VAT)

- 25. All monies paid in terms of this bid, shall be subjected to value added tax, calculated at the appropriate tariff from time to time as provided for in the Value Added Tax (VAT) Act, Act 89 of 1991, as amended, the schedules thereto and Rulings as issued by the South African Revenue Services in regard to value added tax.

LIABILITY AND DAMAGE COMPENSATION

- 26. The Contractor herewith indemnifies the Department of Defence from any claim that may arise from a third party, including any and all costs or legal expenses resulting from such claim, for loss or damage resulting from the death, injury(ies) or disability of any such person(s) or the damage to property of the Contractor or any other person(s) that may result from or be related to the execution of this contract.
- 27. The Contractor shall be held responsible for any damage and / or contamination to the environment and / or to infrastructure as well as theft on or from the premises and / or content that may be caused by the Contractor and / or his / her employees / sub-contractor(s) or due to their negligence, whether in the normal execution of their duties or otherwise, and a claim for indemnification shall accordingly be imposed by the Department of Defence against the Contractor. The Contractor shall ensure that sufficient and paid-up insurances are in place to cover any of these eventualities.

RESTRICTED

28. In the case of damage(s) and / or environmental related contingencies to or on the premises or content resulting from the work done, the Contractor shall undertake to rectify the damage(s) immediately to the satisfaction of the Department of Defence.
29. If the Contractor fails to act immediately after notification, the Department of Defence shall rectify such damage(s) at will and the cost thereof shall be recovered from any monies outstanding and / or due to the Contractor for service(s) rendered.
30. The Department of Defence and its employees shall not be held responsible for any claim or injury to the Contractor's personnel whilst they are on Department of Defence property or in the execution of their tasks on Department of Defence property.

WAIVER

31. No waiver of any of the terms and conditions of the contract shall be binding or effectual for any purpose, unless expressed in writing and signed by the relevant parties thereto.
32. Any such waiver shall be effective only in specific instances and for the purpose given.
33. No failure or delay on the part of either party in exercising any right, power or privilege hereunder shall operate as a waiver thereof, nor shall any single or partial exercise of any right, power or privilege preclude any other or further exercise thereof or the exercise of any other right, power or privilege.

SEVERABILITY

34. Should any of the terms and conditions of the contract be held to be invalid or unlawful, such terms and conditions shall be severable from the remaining terms and conditions, which shall continue to be valid and enforceable.

ACKNOWLEDGEMENT

35. I, _____ (title / initial / surname of company representative),
on behalf of _____ (Company name submitting tender / bid)
acknowledge that I read and understood the content(s) of the Special Conditions of Contract,
as specified above, and considered it acceptable and applicable to the execution of this
contract.

Signed at _____ on this the _____ day of _____ 20____

TENDERER / BIDDER

DATE



CONSTRUCTION INDUSTRY DEVELOPMENT BOARD (CIDB)

Construction Industry Development Board (CIDB): The bidder's must be registered for Grade 4 ME or higher / Grade 4 CE or higher. Proof to be attached.

Failure to comply will invalidate this offer. Appendix N

**Failure to submit this document as indicated by the
closing date and time will invalidate this offer
Appendix N**



ELECTRICAL CONFORMANCE BOARD OF SOUTH AFRICA (ECB(SA) AND/OR ELECTRICAL CONTRACTORS ASSOCIATION OF SOUTH AFRICA (ECA(SA)

Electrical Conformance Board of South Africa (ECB(SA) and/or Electrical Contractors Association of South Africa (ECA(SA): The bidder's must be registered with ECB (SA) and/or ECA (SA) with a proven track record in executing electrical installation work in hazardous areas (specifically public forecourt automotive fuel storage and dispensing facilities.) Proof to be attached.

Failure to comply will invalidate this offer. Appendix O

Failure to submit this document as indicated by the closing date and time will invalidate this offer
Appendix O



TYPE APPROVAL CERTIFICATE SANS 1650 or SANS 1020 and/or ISO 9001

Type Approval Certificate SANS 1650 or SANS 1020 and/or ISO 9001: The bidder to provide a Certificate clearly indicate the manufacturer of the offered automotive fuel dispensing unit being a SANS accredited company or ISO 9001 to be offered for Aboveground Fuel Dispensers.

Failure to comply will invalidate this offer. Appendix P

**Failure to submit this document as indicated by the
closing date and time will invalidate this offer
Appendix P**




TYPE APPROVAL CERTIFICATE ISO 9001

Type Approval Certificate ISO 9001: The bidder to provide Certificate of Registration that shall clearly indicate the manufacturer of the offered Underground Storage Tanks OEM being ISO 9001 accredited company. Signed letter of accreditation to be attached.

Failure to comply will invalidate this offer. Appendix Q

**Failure to submit this document as indicated by the
closing date and time will invalidate this offer
Appendix Q**




WASTE DISPOSAL UNDERTAKING / AGREEMENT

Waste disposal undertaking / agreement: The bidder's shall provide agreement of a legal and recognised waste disposal facility. Proof to be submitted.

Failure to comply will invalidate this offer. Appendix R

**Failure to submit this document as indicated by the
closing date and time will invalidate this offer
Appendix R**




LETTER OF ACCREDITATION FROM OFFERED FUEL DISPENSERS OEM:

Letter of accreditation from offered Fuel Dispensers OEM: Bidder to submit a letter of accreditation from offered fuel dispensers OEM confirming tenderer and accredited/approved agent/installer thereof.

Failure to comply will invalidate this offer. Appendix S

Failure to submit this document as indicated by the closing date and time will invalidate this offer
Appendix S



LETTER OF ACCREDITATION FROM OFFERED FUEL DISPENSERS OEM:

Letter of accreditation from offered Underground Storage Tanks OEM: Bidder to submit a letter of accreditation from offered fuel dispensers OEM confirming tenderer and accredited/approved agent/installer thereof.

Failure to comply will invalidate this offer. Appendix T

Failure to submit this document as indicated by the closing date and time will invalidate this offer
Appendix T



SPECIAL CONDITIONS OF CONTRACT



SPECIAL CONDITIONS OF CONTRACT

DEPARTMENT OF DEFENCE

SPECIAL CONDITIONS OF CONTRACT
(SCCs)

TABLE OF CLAUSES

1. Changed Requirement
2. Co-ordinated activities
3. Contractor's Personnel
4. Value Added Tax (VAT)
5. Damage Compensation
6. Waiver
7. Severability
8. Sub-contracting

SPECIAL CONDITIONS OF CONTRACT

CHANGED REQUIREMENT

1. If Department of Defence institutions participating in this contract are disbanded or relocated or for reasons unknown at the time of concluding the contract, the Department of Defence reserves the right to cancel the contract or parts thereof on written notice of 90 days sent to the contractor at the address appearing in the contract.

CO-ORDINATED ACTIVITIES

2. Whilst on Department of Defence premises, personnel of the contractor will have access to all areas, subject to other stipulations in the relevant contract, to render the services. If the contractor's service is not rendered in a specific area at a given time, access to that area is forbidden.
3. The work to be executed must under no circumstances disrupt the routine activities taking place in the institution or on the premises where the service is to be provided.

CONTRACTOR'S PERSONNEL

4. Identification. To identify the contractor's personnel on the premises of the Department of Defence, the personnel will comply with the following, with any costs for the account of the contractor:
 - a. Personnel will wear company identification cards with an employee photograph on it, conspicuously on his/her person at all times;
 - b. Personnel will wear identifiable uniforms whilst on duty.
5. Attitude towards Safety, Health, Security and Service Delivery. Without prejudice to the contractor's responsibility and right to select and appoint his/her own personnel, the Department of Defence will at all times have the right to identify personnel of the contractor whom are considered to be safety and/or health and/or security risk and/or personnel whom are undesirable. In such case the contractor will be requested not to utilise such person(s) any longer to honour his/her obligations in terms of this contract. The contractor will immediately comply with the request and he/she will not, as a result of such a request, be entitled to institute any claim against the Department of Defence for any loss or otherwise suffered as a result of such a request. The contractor therefore indemnifies the Department of Defence against any claim whatsoever from the employee concerned.
6. Name List. The contractor must submit a complete name list of all personnel to be employed on Department of Defence premises to provide the service according to the contract, to the Department of Defence official at the institution or on the premises where the service is to be provided, who will arrange for entry permits for the contractor. Any changes to the personnel must be communicated to the designated official without delay.
7. Personnel on Site. The contractor must ensure that the total number of personnel offered for the execution of this contract is on duty on a daily basis. Provision must therefore be

made for temporary or stand-in personnel for cases where personnel are on leave or sick leave.

VALUE ADDED TAX (VAT)

8. All monies paid in terms of this bid is subject to value added tax calculated at the appropriate tariff from time to time as provided for in the Value Added Tax Act, Act 89 of 1991, the schedules thereto and Rulings as issued by the South African Revenue Services in regard to value added tax.

DAMAGE COMPENSATION

9. The contractor herewith indemnifies the Department of Defence from any claim that may arise from a third party and all costs or legal expenses in this regard, to such a claim for loss or damage resulting from the death, injuries or disability of any such person(s), or the damage to property of the contractor or any other person(s) that may result from or be related to the execution of this contract.
10. The contractor will be held responsible for any damage or theft that may be caused, to the premises or content by him or his employees or be due to their neglect whether in the normal execution of their duties or otherwise and a claim for indemnification can accordingly be imposed by the Department of Defence against the contractor.
11. In the case of damages to premises or content resulting from the work done, the contractor will undertake to rectify the damage immediately to the satisfaction of the Department of Defence. If the contractor fails to act immediately after notification, the Department of Defence will rectify the damage at will and the cost thereof will be recovered from any moneys outstanding.
12. The Department of Defence and its employees will not be held responsible for any claim or injury to the contractor's personnel whilst on Department of Defence property or in the execution of their tasks on Department of Defence property.

WAIVER

13. No waiver of any of the terms and conditions of the contract will be binding or effectual for any purpose unless expressed in writing and signed by the parties thereto, and any such waiver will be effective only in specific instances and for the purpose given. No failure or delay on the part of either party in exercising any right, power or privilege hereunder will operate as a waiver thereof, nor will any single or partial exercise of any right, power or privilege preclude any other or further exercise thereof or the exercise of any other right, power or privilege.

SEVERABILITY

14. Should any of the terms and conditions of the Contract be held to be invalid or unlawful, such terms and conditions will be severable from the remaining terms and conditions, which will continue to be valid and enforceable.

SUB-CONTRACTING

15. In the event that sub-contractors are used to execute the contract or part thereof, the following shall apply:

- a. Prior Approval. Once the contract has been concluded, the contractor shall obtain prior approval from the Department of Defence before the appointment of any sub-contractor.
- b. Payment. The contractor shall remain liable to reimburse the sub-contractors for goods delivered or services rendered to the Department of Defence.