




132kV CB CONTROL

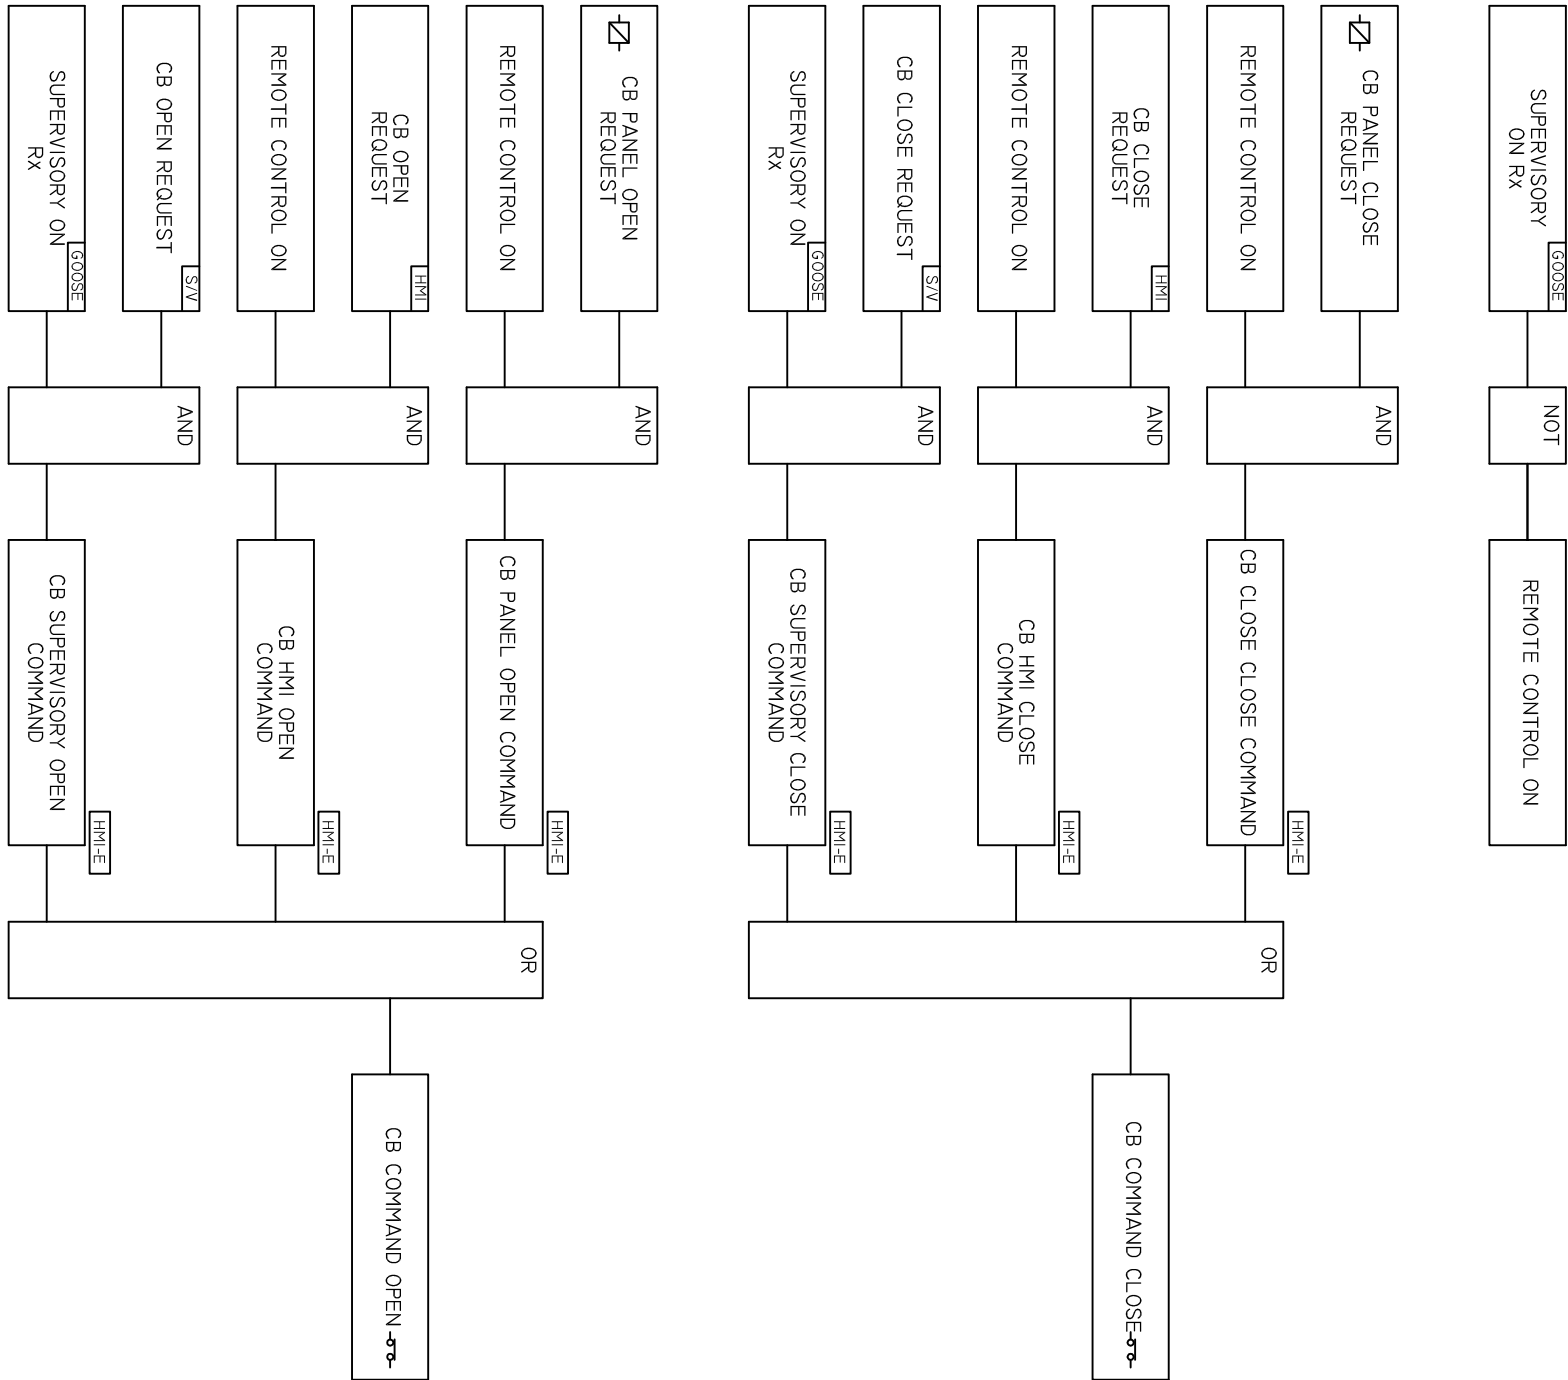


TRIPPING

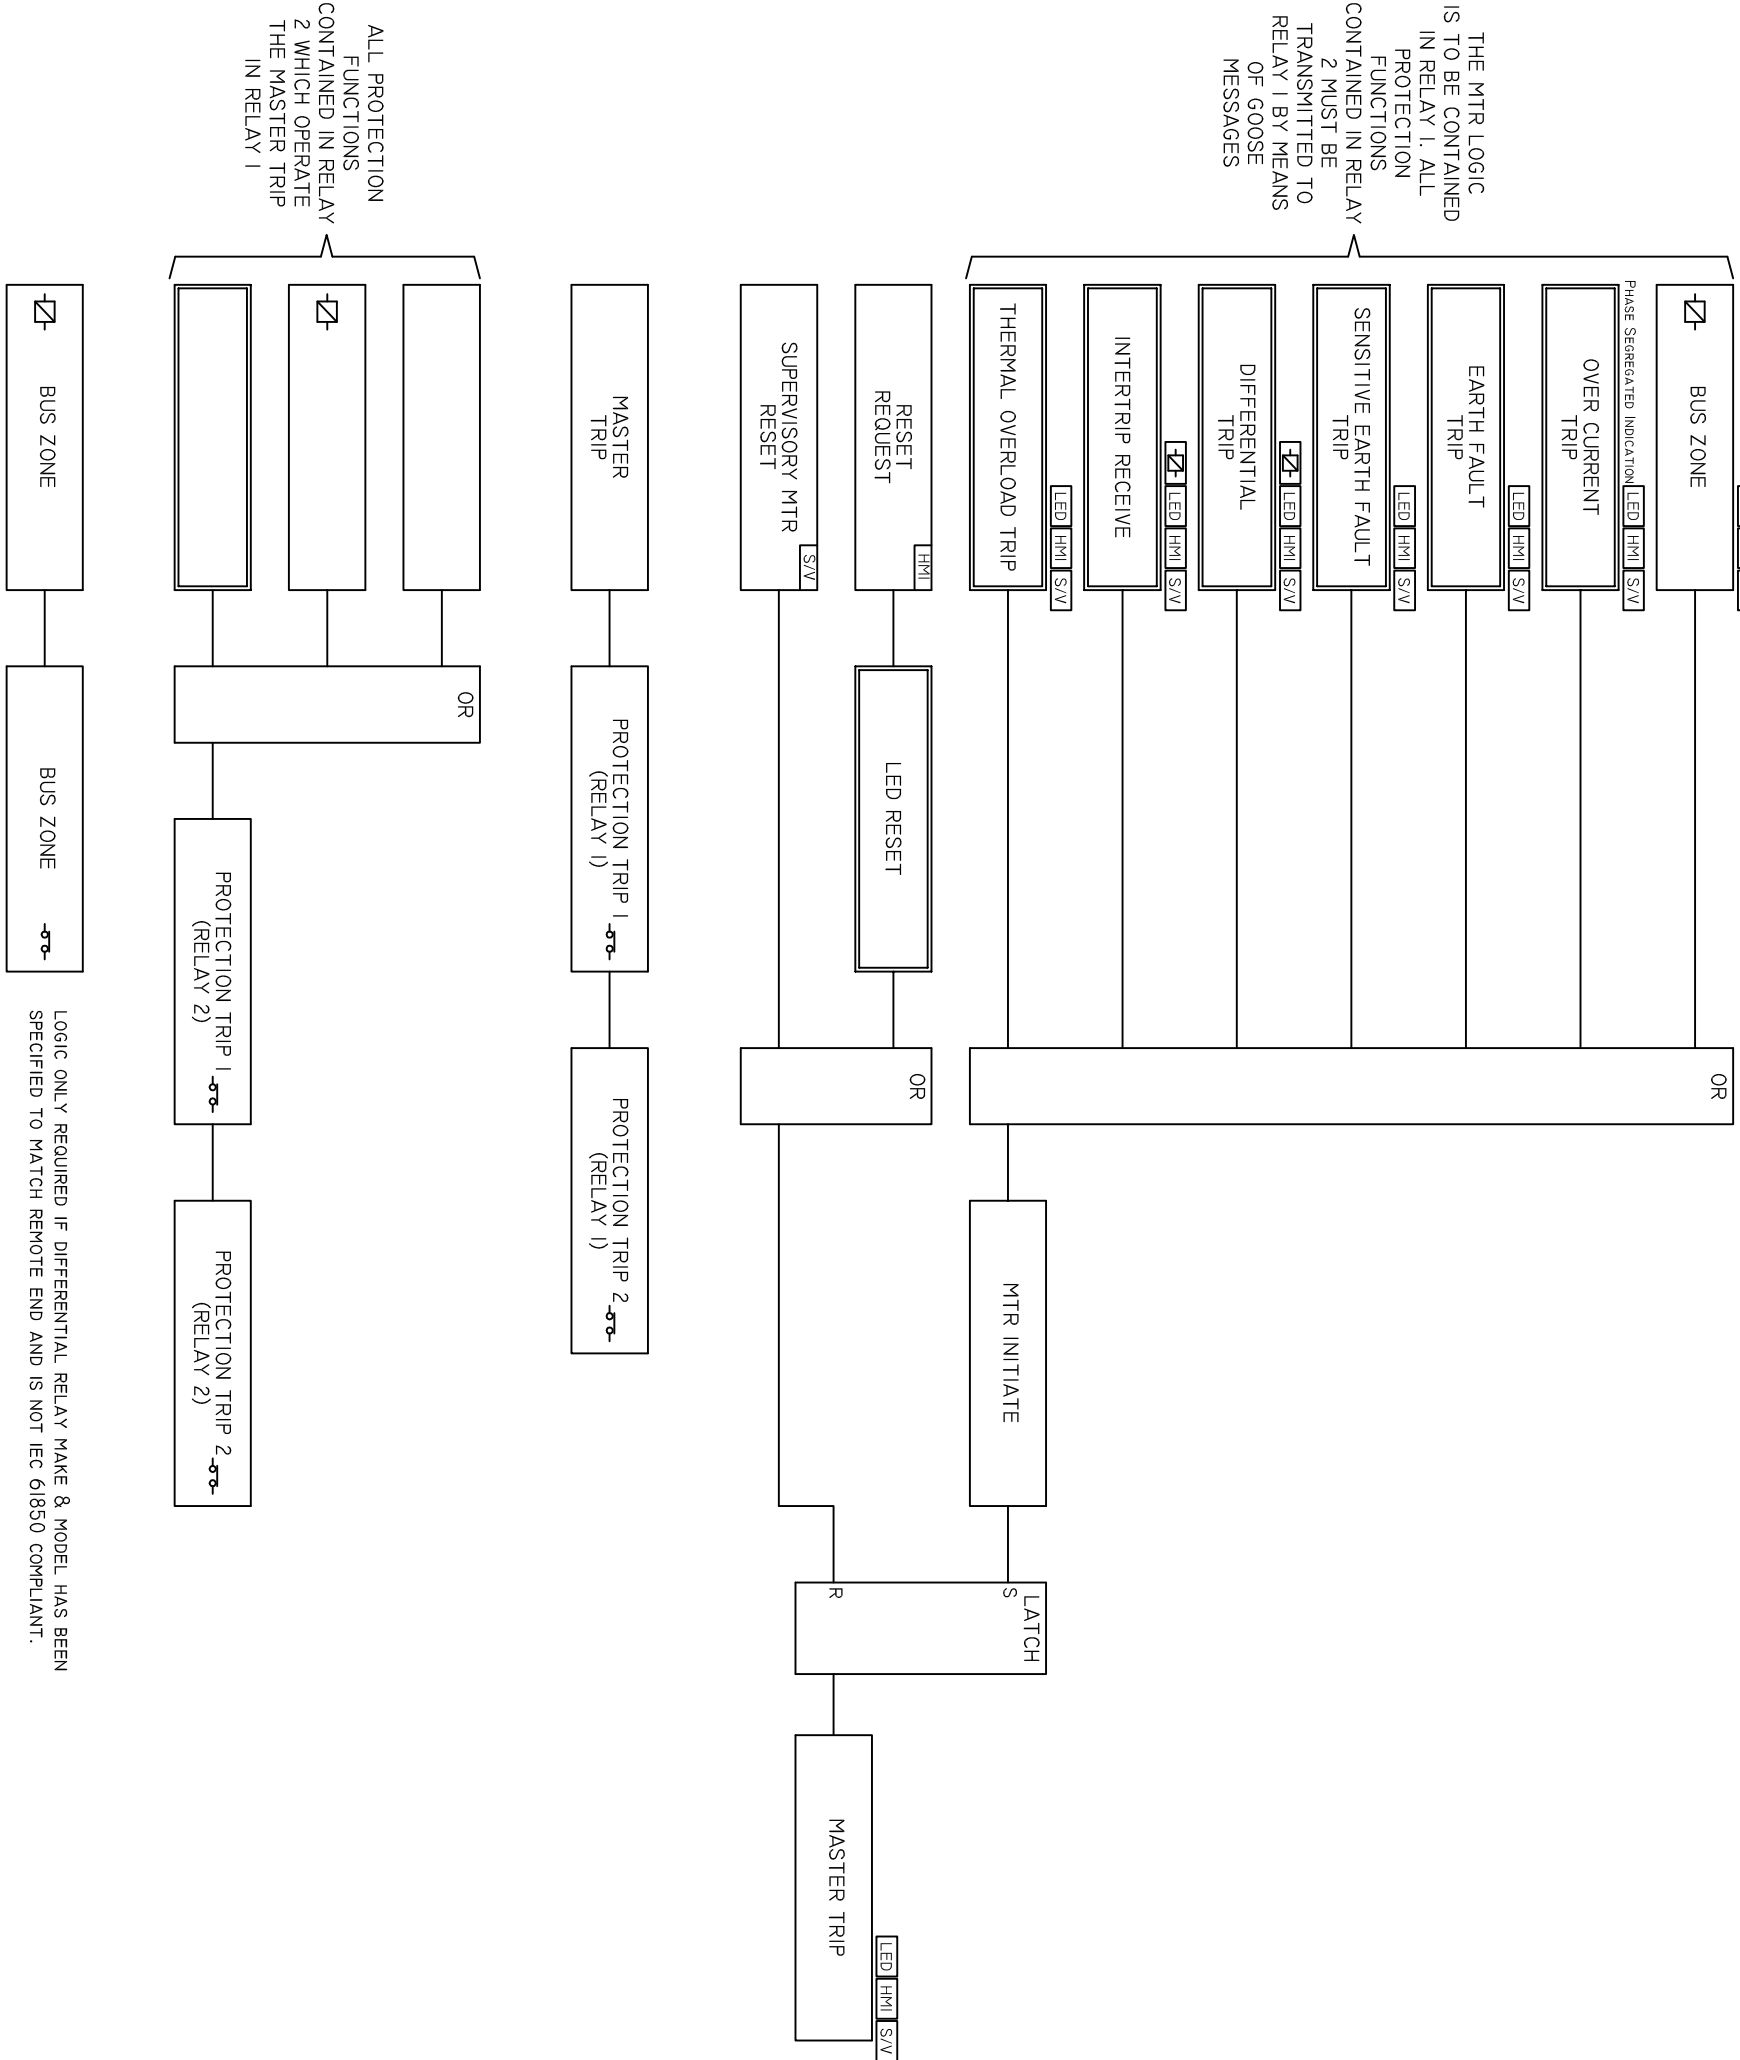



BREAKER FAIL

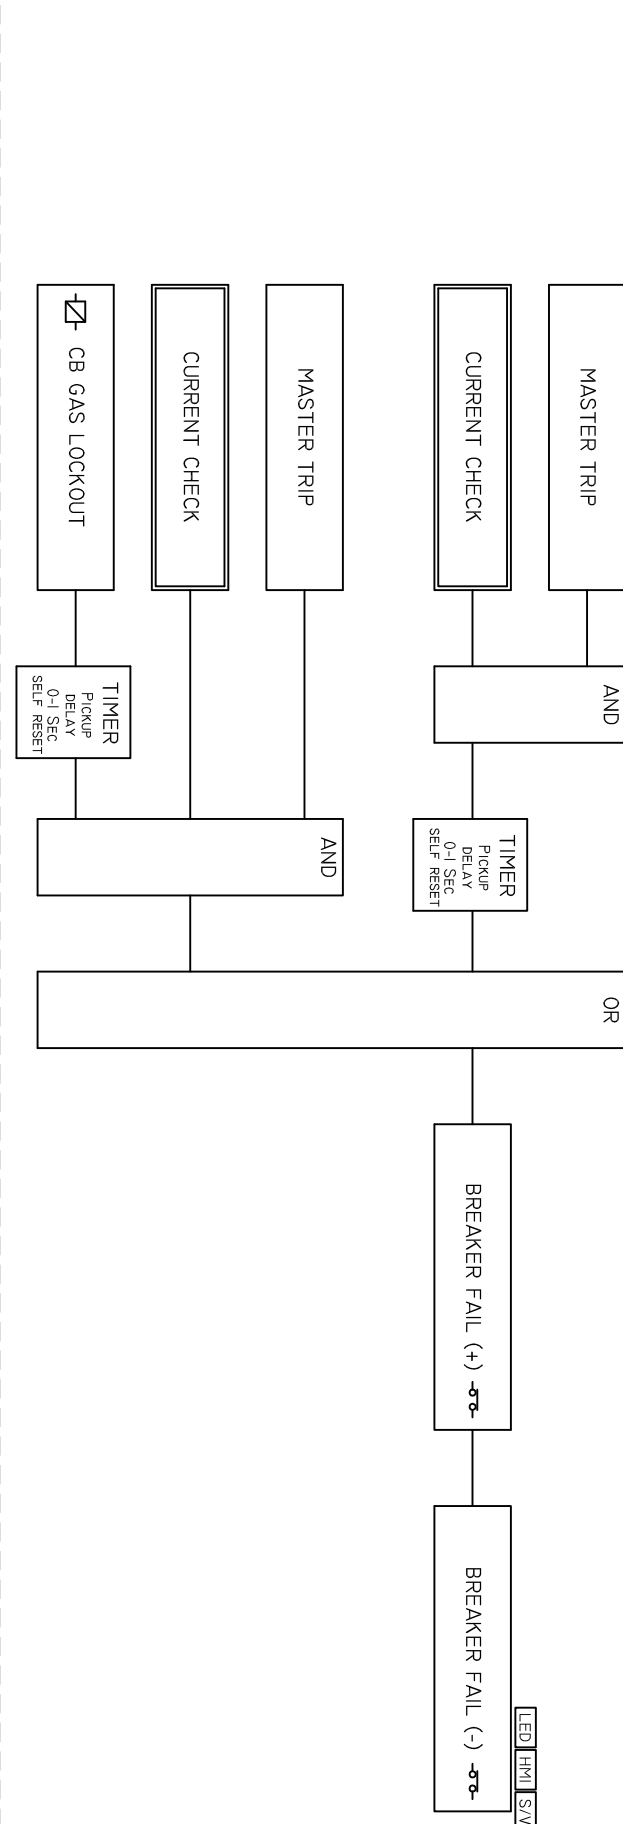


INTERLOCKING

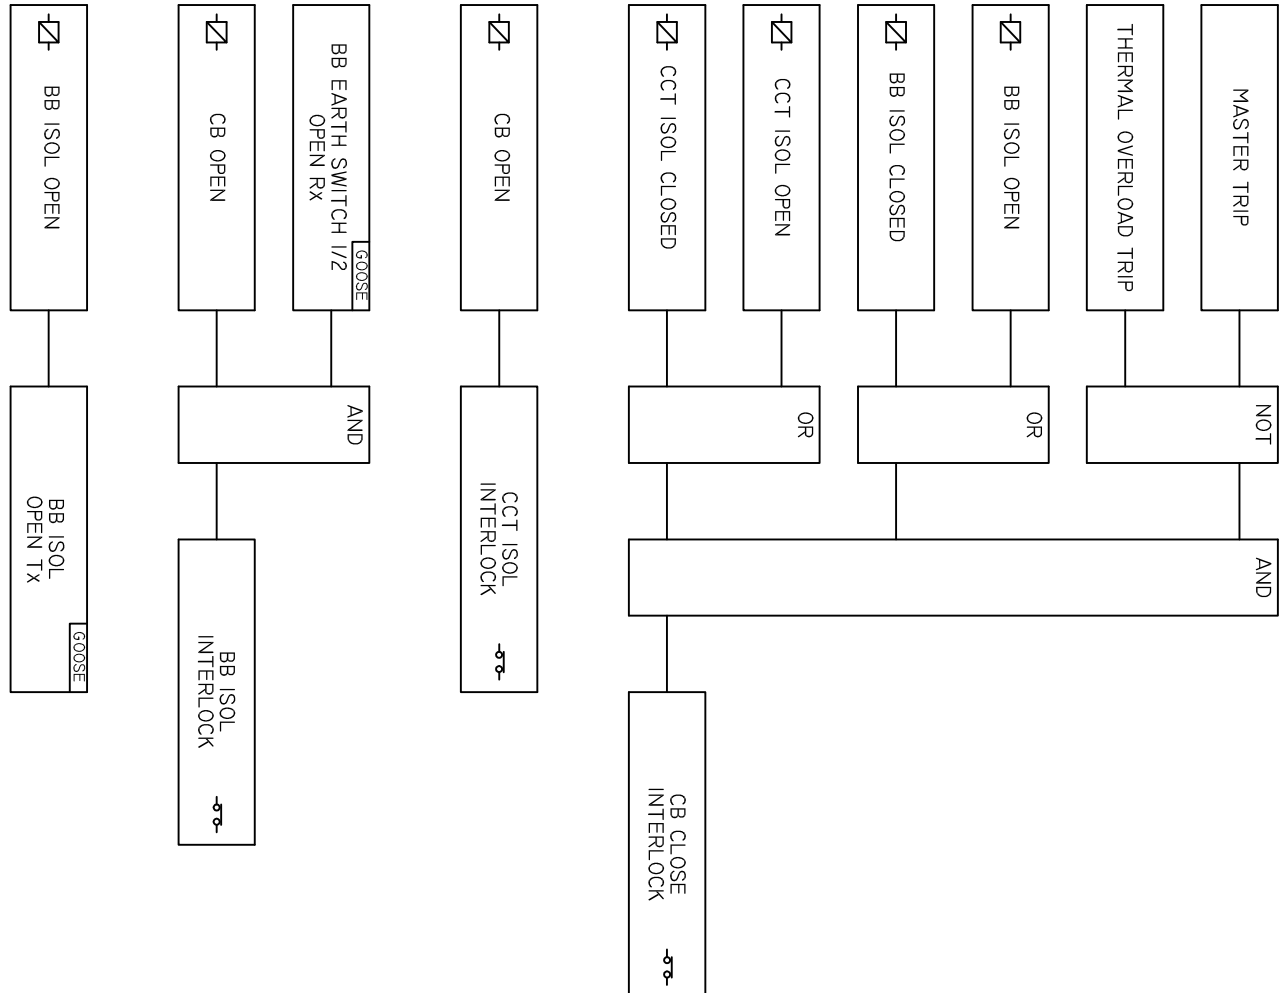

ALARMS & INDICATION

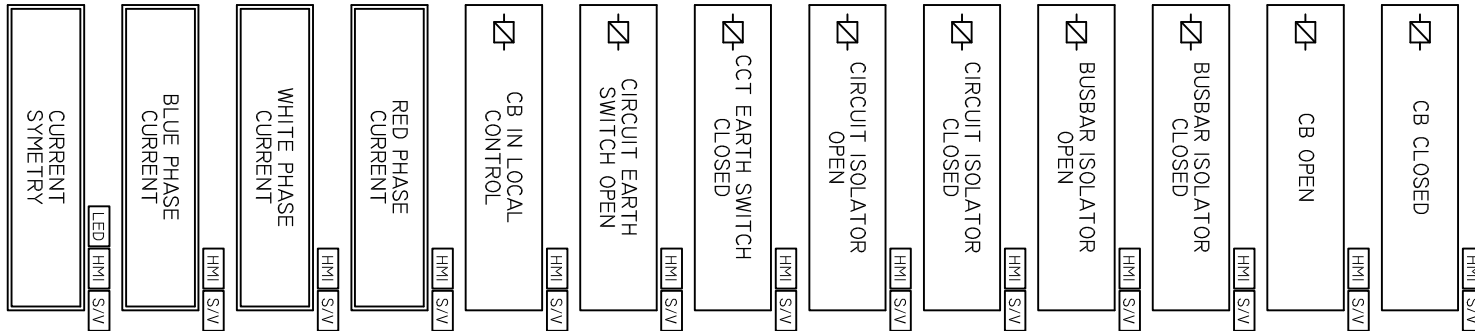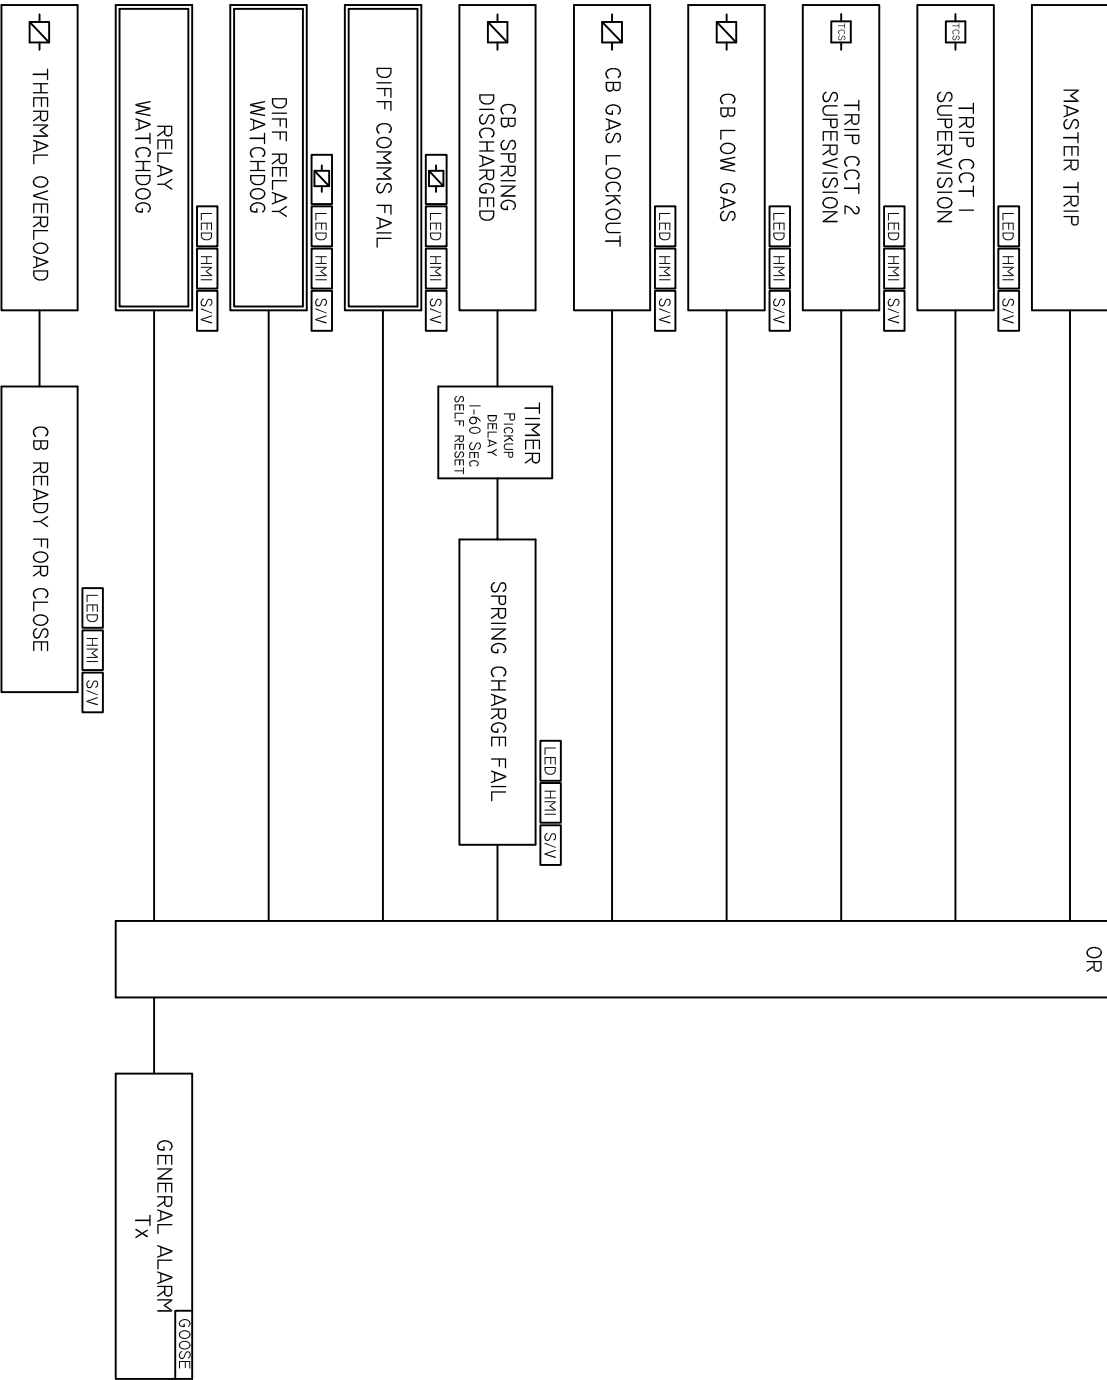

LEGEND

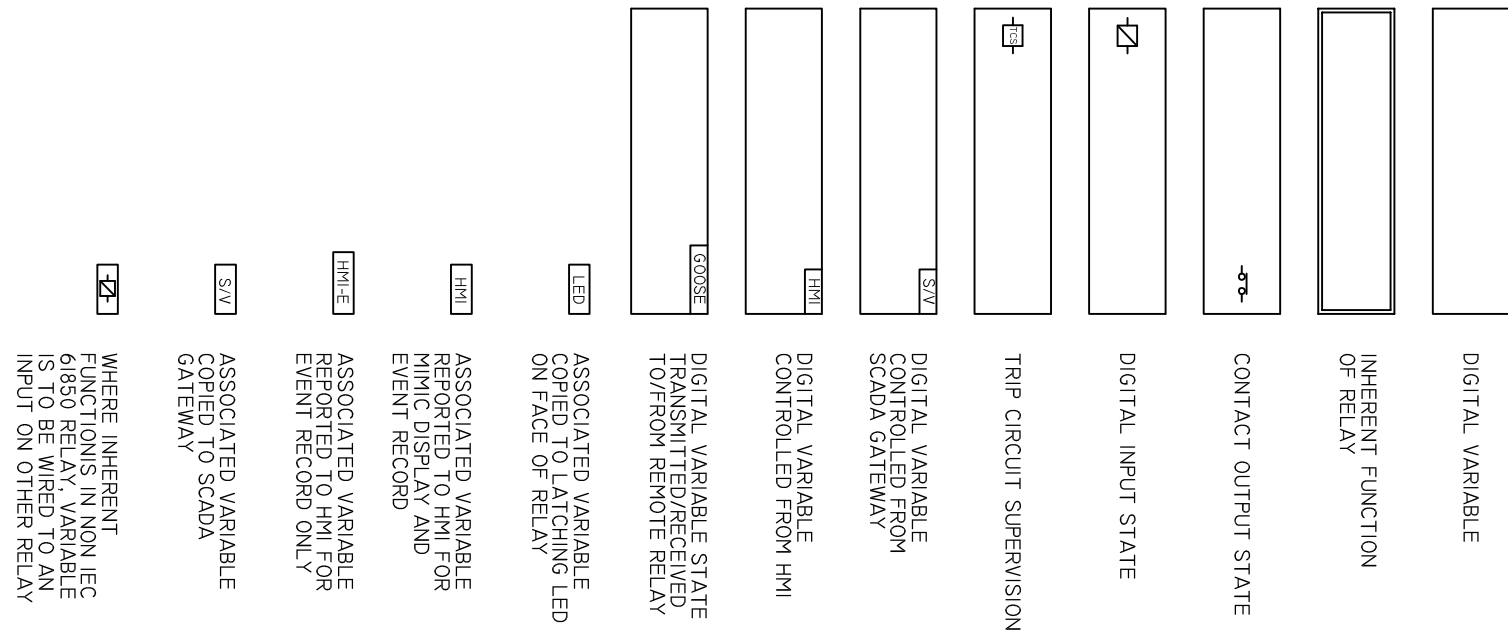

NOTE:  
1. THE PURPOSE OF THIS DRAWING IS TO CLARIFY THE REQUIREMENTS OF THE ASSOCIATED CONTRACT ENQUIRY SPECIFICATION AND THE ISSUE OF THIS WITH THE SPECIFICATION DOES NOT ABSOLVE THE SUCCESSFUL CONTRACTOR FROM HIS NORMAL RESPONSIBILITY TO PROVIDE A SATISFACTORY SCHEME OR SUBMIT DRAWINGS OF SYSTEMS PROPOSED FOR APPROVAL BY THE ENGINEER.

|              |            |              |                                   |     |      |
|--------------|------------|--------------|-----------------------------------|-----|------|
| DESIGN       | A.J.R.W.   |              |                                   |     |      |
| DATE         | 01.06.2005 | REVISIONS    |                                   |     |      |
| TRACED       |            | 1            | ADDED THERMAL OVERLOAD PROTECTION | BY  | DATE |
| DESIGNED BY  |            |              |                                   |     |      |
| PLANNING     |            |              |                                   |     |      |
| OFFICER      |            |              |                                   |     |      |
| ENGINEER     |            |              |                                   |     |      |
| FINAL REVIEW |            |              |                                   |     |      |
| FINAL REVIEW |            |              |                                   |     |      |
| APPROVED     |            |              |                                   |     |      |
| DESIGNER     |            |              |                                   |     |      |
| SCALE        | N.T.S.     | SHEET NUMBER | TD 22                             | REV | 1    |