

**YOU ARE HEREBY INVITED TO BID FOR REQUIREMENTS OF THE DEPARTMENT OF HEALTH AND WELLNESS:
WESTERN CAPE GOVERNMENT**

BID NUMBER: **WCGHIC0008/2025**

CLOSING DATE: **6 February 2026**

CLOSING TIME: **11:00**

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

The successful bidder will be required to complete and sign a written contract form (WCBD 7.1).

BID DOCUMENTS MUST BE DEPOSITED IN THE BID BOX MARKED "DEPARTMENT OF HEALTH & WELLNESS" SITUATED AT:

The foyer of the main entrance, 4 DORP STREET
Western Cape Government Building (**Adjacent to the Cape High Court**)
Junction of Dorp and Keerom Streets, Cape Town

Please ensure that bids are delivered **to the correct address on time**. If the bid is late, it will not be accepted for consideration. If you are uncertain about the location of the Department's bid box, please contact the responsible official, Mr Nico M Rudolf / Mrs Shireen Smith on 021 – 483 9903 / 021 – 483 7302 or at Nico.Rudolf@westerncape.gov.za / Shireen.Smith@westerncape.gov.za for assistance during office hours. The bid box is generally open from 07:30 – 16:00, 5 days a week, Monday to Friday.

Please submit your bid on the official, **not re-typed** forms. Only original, signed documents will be considered. Failure to complete and sign the bidding documents, certificates, questionnaires and specification forms in all respects may invalidate the bid. Each bid must be deposited in a **sealed envelope** with the **name and address of the Bidder, the bid number and closing date**. The envelope shall not contain documents related to any bid other than that indicated on the envelope.

All Bidders must be duly registered on the Central Supplier Database (CSD) at the time of bid closing.

Any prospective **unregistered Bidders** must register as a supplier on the CSD prior to bidding and bid closure.

Central Supplier Database	
Self-registration	www.csd.gov.za (self-registration only)
Contact email	SCM.eProcurementWCGHW@westerncape.gov.za

Bidders already registered on the CSD must have confirmation of their registration AND ensure that their status is up to date prior to bidding by contacting www.csd.gov.za.

The tax Compliance Status (TCS) will be verified on the CSD. Ensure that your TCS is up to date on the CSD at the time of closing, failure to do so will invalidate your bid.

Only the B-BBEE status reflected on form WCBD 6.1 in the bid document will apply to the evaluation of the relevant formal bids and not the B-BBEE status on CSD. Bidders are further required to complete the attached WCBD4 form. All other mandatory documents held on CSD will be accepted by Western Cape Government Health & Wellness (WCGHW) for the consideration of formal bids.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

This bid is subject to the General Conditions of Contract (GCC) and, if applicable, any other Special Conditions of Contract. **The 80:20 Preferential Procurement Points System is applicable to this bid.**

Please refer all technical enquiries in writing to Mr Hein Grebe / Mr Lesley Semono at Hein.Grebe@westerncape.gov.za / Leslie.Semono@westerncape.gov.za. No telephonic enquiries will be entertained.

The date stamp at the bottom of each page is for official use only and not for completion by bidders.

Bidders must submit their offers in a D-ring file or appropriate ring binder with file dividers between sections where necessary.


pp.....
HEAD OF DEPARTMENT

DATE: 28 NOVEMBER 2025

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....	2).....
SIGNED	SIGNED

PART A INVITATION TO BID

ZERO-TOLERANCE TO FRAUD, THEFT AND CORRUPTION (ANTI-FRAUD, THEFT AND CORRUPTION)

THE WCG IS COMMITTED TO GOVERN ETHICALLY AND TO COMPLY FULLY WITH ANTI-FRAUD, THEFT AND CORRUPTION LAWS AND TO CONTINUOUSLY CONDUCT ITSELF WITH INTEGRITY AND WITH PROPER REGARD FOR ETHICAL PRACTICES.

THE WCG HAS A ZERO TOLERANCE APPROACH TO ACTS OF FRAUD, THEFT AND CORRUPTION BY ITS OFFICIALS AND ANY SERVICE PROVIDER CONDUCTING BUSINESS WITH THE WCG.

THE WCG EXPECTS ALL ITS OFFICIALS AND ANYONE ACTING ON ITS BEHALF TO COMPLY WITH THESE PRINCIPLES TO ACT IN THE BEST INTEREST OF THE WCG AND THE PUBLIC AT ALL TIMES.

THE WCG IS COMMITTED TO PROTECTING PUBLIC REVENUE, EXPENDITURE, ASSETS AND REPUTATION FROM ANY ATTEMPT BY ANY PERSON TO GAIN FINANCIAL OR OTHER BENEFIT IN AN UNLAWFUL, DISHONEST OR UNETHICAL MANNER.

INCIDENTS AND SUSPICIOUS ACTIVITIES WILL BE THOROUGHLY INVESTIGATED AND WHERE CRIMINAL ACTIVITY IS CONFIRMED, RESPONSIBLE PARTIES WILL BE PROSECUTED TO THE FULL EXTENT OF THE LAW.

YOU ARE HEREBY INVITED TO BID FOR REQUIREMENTS OF THE (NAME OF DEPARTMENT/ PUBLIC ENTITY)					
BID NUMBER:	WCGHIC0008/2025	CLOSING DATE:	6 FEBRUARY 2026	CLOSING TIME:	11:00
DESCRIPTION	SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)				
BID RESPONSE DOCUMENTS MAY BE DEPOSITED IN THE BID BOX SITUATED AT (STREET ADDRESS)					
The foyer of the main entrance ,4 DORP STREET Western Cape Government Building (adjacent to Cape High Court) Junction of Dorp and Keerom Streets, Cape Town					
BIDDING PROCEDURE ENQUIRIES MAY BE DIRECTED TO:			TECHNICAL ENQUIRIES MAY BE DIRECTED TO:		
CONTACT PERSON	Mr NM Rudolf and Ms. S Smith		CONTACT PERSON	Mr Hein Grebe and Mr Lesley Semono	
TELEPHONE NUMBER	021 483 9903 / 021 483 7302		TELEPHONE NUMBER	021 830 3753 / 021 830 3770	
FACSIMILE NUMBER	N/A		FACSIMILE NUMBER	N/A	
E-MAIL ADDRESS	Nico.Rudolf@westerncape.gov.za Shireen.Smith@westerncape.gov.za		E-MAIL ADDRESS	Hein.Grebe@westerncape.gov.za Leslie.Semono@westerncape.gov.za	
SUPPLIER INFORMATION					
NAME OF BIDDER					
POSTAL ADDRESS					
STREET ADDRESS					
TELEPHONE NUMBER	CODE		NUMBER		
CELLPHONE NUMBER					
FACSIMILE NUMBER	CODE		NUMBER		

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WCBD1

E-MAIL ADDRESS					
VAT REGISTRATION NUMBER					
SUPPLIER COMPLIANCE STATUS	N/A		AND	CENTRAL SUPPLIER DATABASE No:	MAAA
B-BBEE STATUS LEVEL VERIFICATION CERTIFICATE	[TICK APPLICABLE BOX] ☐ Yes ☐ No		B-BBEE STATUS LEVEL SWORN AFFIDAVIT	[TICK APPLICABLE BOX] ☐ Yes ☐ No	
IF YES, WAS THE CERTIFICATE ISSUED BY A VERIFICATION AGENCY ACCREDITED BY THE SOUTH AFRICAN NATIONAL ACREDITATION SYSTEM (SANAS)	[TICK APPLICABLE BOX] ☐ Yes ☐ No				
[A VALID B-BBEE STATUS LEVEL VERIFICATION CERTIFICATE/SWORN AFFIDAVIT (FOR EMEs & QSEs) MUST BE SUBMITTED TOGETHER WITH A COMPLETED 6.1 IN ORDER TO QUALIFY FOR PREFERENCE POINTS FOR B-BBEE]					

ARE YOU THE ACCREDITED REPRESENTATIVE IN SOUTH AFRICA FOR THE GOODS /SERVICES /WORKS OFFERED?	☐ Yes ☐ No [IF YES ENCLOSE PROOF]	ARE YOU A FOREIGN BASED SUPPLIER FOR THE GOODS /SERVICES /WORKS OFFERED?	☐ Yes ☐ No [IF YES, ANSWER THE QUESTIONNAIRE BELOW]
QUESTIONNAIRE TO BIDDING FOREIGN SUPPLIERS			
IS THE ENTITY A RESIDENT OF THE REPUBLIC OF SOUTH AFRICA (RSA)? ☐ YES ☐ NO DOES THE ENTITY HAVE A BRANCH IN THE RSA? ☐ YES ☐ NO DOES THE ENTITY HAVE A PERMANENT ESTABLISHMENT IN THE RSA? ☐ YES ☐ NO DOES THE ENTITY HAVE ANY SOURCE OF INCOME IN THE RSA? ☐ YES ☐ NO IS THE ENTITY LIABLE IN THE RSA FOR ANY FORM OF TAXATION? ☐ YES ☐ NO			
WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... 2)..... SIGNED SIGNED			
IF THE ANSWER IS "NO" TO ALL OF THE ABOVE, THEN IT IS NOT A REQUIREMENT TO REGISTER FOR A TAX COMPLIANCE STATUS SYSTEM PIN CODE FROM THE SOUTH AFRICAN REVENUE SERVICE (SARS) AND IF NOT REGISTER AS PER 2.2 BELOW.			

PART B
TERMS AND CONDITIONS FOR BIDDING

1. BID SUBMISSION:
1.1. BIDS MUST BE DELIVERED BY THE STIPULATED TIME TO THE CORRECT ADDRESS. LATE BIDS WILL NOT BE ACCEPTED FOR CONSIDERATION.
1.2. ALL BIDS MUST BE SUBMITTED ON THE OFFICIAL FORMS PROVIDED – (NOT TO BE RE-TYPED) OR IN THE MANNER PRESCRIBED IN THE BID DOCUMENT.
1.3. THIS BID IS SUBJECT TO THE PREFERENTIAL PROCUREMENT POLICY FRAMEWORK ACT, 2000 AND THE PREFERENTIAL PROCUREMENT REGULATIONS, 2017, THE GENERAL CONDITIONS OF CONTRACT (GCC) AND, IF APPLICABLE, ANY OTHER SPECIAL CONDITIONS OF CONTRACT.
1.4. THE SUCCESSFUL BIDDER WILL BE REQUIRED TO FILL IN AND SIGN A WRITTEN CONTRACT FORM (WCBD7).
2. TAX COMPLIANCE REQUIREMENTS
2.1 BIDDERS MUST ENSURE COMPLIANCE WITH THEIR TAX OBLIGATIONS.
2.2 APPLICATION FOR TAX COMPLIANCE STATUS (TCS) MAY BE MADE VIA E-FILING THROUGH THE SARS WEBSITE WWW.SARS.GOV.ZA.
2.3 BIDDERS MAY ALSO SUBMIT A PRINTED TCS CERTIFICATE WITH A RESULT SUMMARY PAGE (DOWNLOADED FROM EFILING) TOGETHER WITH THE BID.
2.4 IN BIDS WHERE CONSORTIA / JOINT VENTURES / SUB-CONTRACTORS ARE INVOLVED; EACH PARTY MUST SUBMIT A SEPARATE TCS CERTIFICATE AND CSD NUMBER AS MENTIONED IN 2.2 ABOVE.
2.5 NO BIDS WILL BE CONSIDERED FROM PERSONS IN THE SERVICE OF THE STATE, COMPANIES WITH DIRECTORS WHO ARE PERSONS IN THE SERVICE OF THE STATE, OR CLOSE CORPORATIONS WITH MEMBERS PERSONS IN THE SERVICE OF THE STATE."
NB: FAILURE TO PROVIDE / OR COMPLY WITH ANY OF THE ABOVE PARTICULARS MAY RENDER THE BID INVALID

SIGNATURE OF BIDDER:

CAPACITY UNDER WHICH THIS BID IS SIGNED:
(Proof of authority must be submitted e.g. company resolution)

DATE:

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED



WESTERN CAPE DEPARTMENT OF HEALTH AND WELLNESS

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

NAME OF BIDDING COMPANY.....

NAME OF BIDDER / CONTACT PERSON

CONTACT NUMBER.....(w).....(cell)

BID NUMBER: WCGHIC0008/2025

1. APPLICABLE DOCUMENTS	
<i>The onus rests with the prospective bidder to acquaint them of the following documents which forms part of this specification:</i> 1.1 General Conditions of Contract 1.2 Special Conditions of Contract 1.3 The Hazardous Substances Act No. 15 of 1973, latest edition / amendments 1.4 IEC 60601-1 Medical Electrical Equipment 1.5 Occupational Health and Safety Act no 85 of 1993 and Regulations, latest edition / amendments. 1.6 Check core standards, National guidelines for ideal hospitals / clinics	
2. GENERAL	
2.1 The bidder shall include illustrative brochures/technical details of the spare parts offered which can be used to verify compliance with the specifications. All spare parts to comply with the minimum standards (SABS) and comply with the manufacturer's minimum requirements. This needs to be verified / checked with Directorate Engineering and Technical services. 2.2 Please note that this offer shall be awarded in part or whole to ensure the standardisation within the region. 2.3 Bidder to quote on all the items per region and amounts as listed. 2.4 Bidder must ensure the availability of spare parts and accessories during the full-service period.	

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... SIGNED 2)..... SIGNED

IMPORTANT NOTICE

COMPULSORY SITE BRIEFING SESSION

BIDDERS ARE REQUESTED TO ATTEND A COMPULSORY SITE BRIEFING SESSION TO ACQUAINT THEMSELVES WITH THE SCOPE OF THE SERVICE TO BE PROVIDED AS DETAILED IN THE BID SPECIFICATIONS.

THE DETAILS OF THE COMPULSORY SITE CLARIFICATION ARE AS FOLLOWS:

DATE : **5 December 2025**
TIME : **STRICTLY 10:00 AM**
VENUE : **Karl Bremer Engineering Offices Training Center
Site of Karl Bremer Hospital
CO Mike Pienaar and Frans Conradie
Bellville
7530**

CONTACT PERSON: HEIN GREBE / LESLEY SEMONO

THE COMPLETION OF THE ATTENDANCE REGISTER WILL CONSTITUTE PROOF OF ATTENDANCE.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

BID BOX DIRECTIONS



WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

TERMS OF REFERENCE		Comments/ Complies/ Does not Comply /Yes/No
NOTE	<i>In the column provided for this purpose, please indicate next to each paragraph whether your offer complies with the bid specification by writing "Complies/Does not-comply/Noted" and/or provide comment or make reference to attached documentation, if any, as required. Additional documentation provided by you must clearly show the paragraph in the bid document to which it relates, please. Where applicable, please acknowledge you have read and understood conditions by writing "Yes" or "No" in the next column.</i>	
1.1	SCOPE:	
	WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.	
1.2	REGULATORY REQUIREMENTS	
1.2.1	THE INFORMATION CONTAINED IN THE TABLE BELOW IS MANDATORY FOR YOUR SUBMISSION AND WILL BE USED IN ASSESSING THE RESPONSIVENESS OF BIDDERS. FAILURE TO SUBMIT AND COMPLETE ALL MANDATORY INFORMATION WILL RESULT IN OFFERS BEING DEEMED NULL AND VOID AND SHALL BE CONSIDERED "NON-RESPONSIVE" AND THEREFORE NOT CONSIDERED.	
	SECTION 2 - THE BID PROCESS	
2.1	<i>Closing date of bid</i> 6 February 2026 @ 11:00am <i>Validity of bid</i> 60 days from closing.	WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... SIGNED 2)..... SIGNED
	SECTION 3 - Instructions for completing bid documents.	
3.1	Please provide all compulsory documents required in the bid invitation in the full name of the bidder.	
3.2	Please include a letter from the bidding entity authorising the signatory of the WCBD1 bid form to submit this bid on behalf of the bidder.	
3.3	Please complete all the documents and forms provided in this bid document and furnish all the requested information.	
3.4	Please complete the bid response document by stating in the block opposite each subsection whether you will comply or will not comply with the requirements in that subsection.	
3.5	A response of "Noted" will be taken to mean "Comply". Please provide an explanatory note in a separate document with a clear reference to the corresponding paragraph number or beneath each point in the bid document. The numbering in the bid document may not be altered.	

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

TERMS OF REFERENCE		Comments/ Complies/ Does not Comply /Yes/No
3.6	It will be to your disadvantage if the document is not completed in this way and can lead to the exclusion of your offer if the trend persists throughout your document.	
3.7	If you are unable to comply with a particular requirement or specification, please provide a comment/explanation for not complying.	
3.8	If additional supporting documents are provided as part of this bid, please give it a document number that is clearly marked on each page of the document.	
3.9	Please provide an index/summary of all supporting documents with your bid response.	
3.10	The absence of evidence required to prove your compliance with the bid requirements will be taken to indicate that you lack the necessary knowledge or capacity to provide the service.	
3.11	Re-typing, PDF or other digital conversions and/or amendment of the original bid document are not allowed and will invalidate your bid response.	
4.1	SECTION 4 - BID CLARITY (i) The Department reserves the right to request clarifying information from a bidder. (ii) Bidders or interested parties may contact the Department to request clarity or additional information to assist their compiling of a bid. The Department will respond via electronic mail, which will be provided to all the interested parties. No one interested party will be provided with any information before any other, to promote the principle of unbiased communication with all bidders.	
5.1	SECTION 5 - BID AWARDING All bids duly lodged shall be taken into consideration and evaluated for compliance, based on the principles set forth in this document.	
5.2	Bids that are found compliant in terms of the mandatory and statutory requirements will be evaluated.	
5.3	The bids will be evaluated according to the National Treasury Supply Chain legislation and policies, legislation and policies of the Western Cape Provincial Treasury and the Department's procurement parameters.	
5.4	The Department will establish a bid evaluation committee to evaluate this bid using a pre-defined set of evaluation criteria. This committee will assess the offer using this document as the basis for the evaluation. Please refer to Functionality Criteria.	

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

TERMS OF REFERENCE		Comments/ Complies/ Does not Comply /Yes/No	
5.5	The Western Cape Government Health & Wellness reserves the right to award the bid in whole or in part and will determine the award to the successful bidder per item/site, based on price, preference points and other criteria outlined in the bid document.		
5.6	Equipment hand over will be granted at the discretion of the Department and not necessarily be aligned with the award of this contract.		
6	SECTION 6 - EVALUATION PROCESS Phase 1: Compliance with compulsory Central Supplier Database registration and completion of the bid document. All bidders who comply with phase 1 will proceed to phase 2. Phase 2: Compliance with functionality criteria, as outlined below (section 7). All bidders who comply with phase 2 will proceed to phase 3. Phase 3: Application of points for price and B-BBEE status in accordance with the Preferential Procurement Policy Framework Act 2000 and the Preferential Procurement Regulations 2022, to determine the highest total points scored by a bidder.		
7	SECTION 7 – COMPULSORY REQUIREMENTS The information contained in the table below is mandatory for your submission and will be used in assessing the responsiveness of bidders. Failure to submit and complete all mandatory information will result in submissions being deemed null and void and shall be considered “non-responsive” and therefore not considered.		
7.1	Form WCBD1 – Full particulars of the bidding entity	Yes	No
7.2	Form WCBD3.1 – Fully completed Price Schedule	Yes	No
7.3	Form WCBD4 – Declaration of Interest	Yes	No
7.4	Form WCBD6.1 – Serves for claiming preference points, to claim points for Broad-Based Black Economic Empowerment level of contribution	Yes	No
7.5	Provide proof of CSD registration document	Yes	No
7.6	A valid letter of Good Standing from the Dept of Labour (Compensation Commissioner)	Yes	No
7.7	Comprehensive company profile with a list of similar, previous, successfully completed projects with contactable references	Yes	No
7.8	Electrical Artisan Qualifications with relevant 5 years' experience – Attach CV plus qualifications	Yes	No
7.9	Diesel Mechanic Qualifications with minimum 5 years' experience on fault finding and repair of standby generators – Attach CV plus qualifications	Yes	No
7.10	Proof that one of your artisans attended the latest Deep-Sea Controller course as presented by an accredited service supplier. Must be familiar with	Yes	No

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

TERMS OF REFERENCE		Comments/ Complies/ Does not Comply /Yes/No	
	the operation and programming of the latest Deep-Sea Controller 4520 & 7320.		
7.11	Proof of fully equipped office and Workshop registered in your company name / long term rental agreement to service and repair the listed standby generators, within 50km radius from Karl Bremer Hospital. (to provide company profile)	Yes	No
7.12	List of company vehicles registered in the company name equipped with tools and spares as listed under Part 2, item 14 – Tools & Spares in the bid document	Yes	No
7.13	Company registration certificate from CIPC	Yes	No
7.14	A valid B-BBEE Verification Certificate issued by a verification agency accredited by the South African National Accreditation System (SANAS) (certificates/scorecards and EME/QSE affidavits) of main contractor, or an affidavit confirming annual total revenue and level of black ownership, or Registered Auditors approved by IRBA. Where a joint venture or subcontractors are involved, this documentation must be provided by each legal entity.	Yes	No
7.15	Joint Venture Agreement. (if applicable)	Yes	No
7.16	OHS Agreement	Yes	No
	SECTION 8 – PRICING AND PAYMENT		
8.1	The bidder must quote in accordance with the items included in the Price Schedule in the WCBD3.1 section of this document.		
8.2	In the interest of security and expeditious payment, it is the policy of the Department to effect payments by electronic funds transfer (EFT) into a supplier's South African bank account as far as possible. If a successful bidder is not yet a regular participant in Departmental contracts and has not been CSD registered already, the service-provider will be required to furnish the Department with its banking details to effect payment in line with the systems in operation (Logis, BAS, Syspro) to be registered. Successful bidders must ensure, therefore, that their banking details are provided to institutions on request where necessary.		
8.3	On receipt of the invoice by the Department in accordance with the agreed procedure, the relevant officials will verify its correctness. If the invoice is correct, the amount due will be payable within thirty (30) calendar days from date of receipt of a valid invoice , subject to any penalty deductions by the Department. If the Department identifies any discrepancies, or if penalties are not reflected correctly or at all, the invoice will be returned to the supplier and the amount due will be payable within thirty (30) calendar days from receipt of the corrected invoice. If a service-provider disputes a penalty amount, the Department will have the right to set-off the penalty amount against any amount/invoice payable to the supplier.		

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

TERMS OF REFERENCE		Comments/ Complies/ Does not Comply /Yes/No
9.1	SECTION 9 – NEGOTIATIONS The Department reserves the right to enter into negotiations with bidders (before the contract is concluded) if the bid prices are not deemed to be market related.	
10.1	SECTION 10 - PERFORMANCE MONITORING Constant performance monitoring will be conducted to ensure that the Contractor meets their contractual obligations and that contracts run with as little disruption as possible. Regular meetings with the Contractor will be performed to discuss contract issues. The bidder shall grant the Department reasonable access when requested.	
11.1	SECTION 11 – GENERAL Receipt of the invitation to bid does not confer any right on any party in respect of the services or in respect of, or against, the Department. The Department reserves the right, in its sole discretion: (i) To amend the bid process, closing date or any other date at its sole discretion; (ii) To cancel the bid or any part of the bid before the bid has been awarded; (iii) Not to accept the lowest or any other bid and to accept the bid which it deems shall be in the best interest of the Department; (iv) Not to award the bid to the highest points scorer or lowest price; (v) To reject all responses submitted and to embark on a new bid process; (vi) To withdraw any services from the bid process; (vii) To terminate any party's participation in the bid process; (viii) To accept or reject any response to this invitation to bid on notice to the bidders without liability to any party; (ix) To extend or expand the contract on written request from the Department.	
11.2	Accordingly, parties have no rights, expressed or implied, with respect to any of the services as a result of their participation in the bid process.	

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

PART - 1 SPECIAL CONDITIONS OF CONTRACT

WESTERN CAPE GOVERNMENT: HEALTH

DIRECTORATE: SUPPLY CHAIN

(INFRASTRUCTURE SOURCING)

BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

1. DEFINITIONS, ABBREVIATIONS AND ACRONYMS

"Owner or Client" means **Western Cape Government: Health & Wellness (WCGHW)**.

"Local authority" means the authority having jurisdiction over the premises involved in this contract. This authority could be one or more of the following:

- ESKOM
- A municipality
- A Government department
- The Owner

The **"Contractor"** is the party indicated as such and includes the contractor's directors, managers, workers, labourers, other employees, or subcontractors;

"Engineer" means the owner acting through the officer deputed generally or specifically to control or supervise the works, also referred to as the "representative" and as the Facility Manager.

"Response time" will mean the time from when the contractor was notified to the time that he reports on site.

Maintenance Contractor	Contractor
User	Department of Health & Wellness
WCGHW Engineering's Representative	List of representatives and phone numbers is supplied in Annexure B
Facility Manager	Department of Health & Wellness: Maintenance and Operations: Energy manager or duly delegated

"Premises" are the Department of Health & Wellness.

in, on or about which the contractor (as defined above) is present at any time in connection with any contract work or sub-contract work being carried out on or in respect of the premises or any part of or any machinery, plant, equipment, fixtures, or fittings in, or to the premises or any part of the premises.

1.1 Acronyms

BS	British Specification
SABS	South African Bureau of Standards
OHSA	Occupational and Health and Safety Act

1.2 Abbreviations

No	number
SA	South Africa
Ltd	limited
i.e.	namely
e.g.	example
EM	Emergency Maintenance
PM	Planned Maintenance
"the Act"	OHSA
WCGHW	Western Cape Government: Health & Wellness

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

2. ACCEPTANCE AWARDING OR REJECTION OF BID

The WCGHW reserves the right to accept or reject an offer if it does not comply to terms of reference. The WCGHW reserves the right to award the bid in whole or in part and will determine the award to the successful bidder per item, based on price and preference points as well as other criteria as outlined in the bid document.

3. ANNUAL PRICE ADJUSTMENT

The price for all spares listed and priced in the document will be fixed for the first year. Thereafter invoices must be attached for all spares supplied at cost plus % mark-up. An annual price adjustment will be effective in line with CPAP workgroup 170, in line with mechanical related items. Contractors need to motivate for a price increase and apply in writing for approval.

4. GENERAL

Unless specified in writing by WCGHW, the general conditions as noted below shall apply to all work undertaken on site. It is the intention of this agreement to provide for the efficient maintenance, servicing and testing of all Emergency power standby generators and related equipment within agreed time frames.

It is the duty of the contractor to ensure the availability of material and labour, to be able to execute planned and breakdown maintenance on a daily basis within the given time frame with minimum disruption.

This contract will be a direct contract between the successful bidder and the Client under the Conditions of Contract as laid down in the Conditions and Contract Agreement.

4.1 Liability for loss

Should the successful bidder fail to enter into a contract with the Client after the Client has requested him in writing to do so, the successful bidder will be liable for any loss which may be incurred by the owner as a result of having to have the work enumerated in the bid document executed at a higher price than the successful bidder's bid price.

4.2 General Guidelines for Site Work

In general, all workmen employed on site shall be required to adhere to the following guidelines:

At the completion of repairs, replacements or upgrades, the Contractor shall sign off that all work undertaken is now completed and that the equipment has been handed back to WCGHW: Engineering's Representative.

No equipment including spare parts shall be removed from site without the prior written consent of WCGHW Engineering's Representative.

4.3 Logging and Recording Procedures

The Contractor shall as part of this contract institute a recording system as part of the Maintenance Control Plan. This shall consist of a record book (service job cards to be supplied by contractor) which shall be utilised to log and record all faults, system checks, services, overhauls, breakdowns, maintenance visits, inspections, etc.

The Contractor together with the six-monthly report to The Engineer shall submit a copy of the six-monthly entries and recordings into the job cards and tick sheets.

This logbook shall be structured to at least include the following:

- Six-monthly inspection and maintenance actions.

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

- Scheduled services.
- Breakdown / call out reports including all emergency call outs.
- Major overhaul or battery replacements.

4.4 Items Requiring Particular Care

Particular attention shall be given to the following:

- Safe handling of any property removed for any reason to allow access to service ducts, cables trays etc.
- Replacement of any ceiling tiles, wall cladding, etc. removed for any reason;
- Isolating / switching off / closing is done prior to work commencing, and that equipment, plant or machinery is reconnected / switched on / opened at completion of the works;
- Notifying WCGHW Engineering's Representative verbally immediately and in writing within twenty-four hours of any damage or defect being caused or noted to any property. Failure to do so will result in WCGHW assuming that the Contractor was responsible for such damage or defect, and the cost of making good will be deducted from any payments to be made by WCGHW;
- Working with due regard to the environment, so that disruptions to other staff / people / tenants are minimized. It is important to note that some maintenance will have to take place outside normal working hours.
- Any work undertaken that is noisy, dirty, dusty or is disruptive in any other way to staff / people / tenants, shall be duly authorised in writing and coordinated by WCGHW Engineering's Representative prior to the works commencing;
- WCGHW does not recognize any Contractor's "Automatic Right to Salvage" and therefore no material, used parts or components may be removed without the proper signed authority;
- No digging or excavations anywhere on **WCGHW Premises** shall be undertaken without the written clearance and authority of **WCGHW Engineering's Representative**, as due cognisance must be taken of electrical, telephone, water and other underground services;
- That all work undertaken on the listed sites will be in accordance with the Occupational Health and Safety Act and Regulations, plus any relevant SABS "Codes of Practice", and any other terms and conditions relating to safety as advised by **The Engineer or WCGHW maintenance representative**.
- Ensure that the status of the generator system, changeover panel and controls will result in automatic generator start-up under mains power supply failure (Here after referred to as to "Auto") before leaving the standby plant room.
- All load tests shall be scheduled with WCGHW Engineering's Representative. It should be noted that some testing might have to be scheduled outside normal working hours and at a time planned by the Facility.

4.5 Compliance with Occupational Health & Safety Act

WCGHW and the Contractor hereby agree, in terms of the provisions of Section 37(2) of the Occupational Health and Safety Act, 1993 (Act 85 of 1993, hereinafter referred to as "the Act"), that the following arrangements and procedures shall apply between them to ensure compliance by the Contractor with the provisions of the Act, namely:

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

The Contractor undertakes that the appropriate officials and employees of the Contractor will fully acquaint themselves with all relevant provisions of the Act and the Regulations promulgated in terms of the Act;

The Contractor undertakes that all relevant duties, obligations and prohibitions imposed in terms of the Act and Regulations will be fully complied with;

The Contractor hereby accepts sole liability for such due compliance with the relevant duties, obligations and prohibitions imposed by the Act and Regulations, and expressly absolves WCGHW from itself being obliged to comply with any of the aforesaid duties, obligations and prohibitions.

The Contractor agrees that any duly authorised official or appointed agent of WCGHW shall be entitled (though not obliged) to take such steps as may be necessary to ensure that the Contractor has complied with his undertakings as set out more fully in the paragraphs above, which steps may include, but will not be limited to, the right to inspect any appropriate site or Premises occupied by the Contractor, or to inspect any appropriate records held by the Contractor;

The Contractor shall be obliged to report forthwith to The Engineer any investigation, complaint or criminal charge which may arise as a consequence of the provisions of the Act and Regulations, pursuant to work performed in terms of this contract, and shall, on written demand, provide full details in writing of such investigation, complaint or criminal charge;

All services, inspections, maintenance work and testing will be carried out in a legal, safe and responsible manner as contained in your Health and Safety File. A Health and Safety File must be provided within 2 weeks after award of the tender.

5. ENTRY TO THE PREMISES

The Contractor shall be subject to **WCGHW** Security regulations or arrangements in force and acknowledges that it will be obliged at all times to obtain security clearance to enter & work on the Premises.

The Contractor shall only use that part of the Premises necessary to carry out its duties. The Contractor is not permitted to have access to any other part of the Premises unless specifically authorised in writing and in advance by The Representative.

Contractors and their staff are to be presentably dressed and prominently displaying their Company's logo whilst on site. Should there be protest / unrest at any facility, the Contractor needs to contact the facility manager / WCGHW representative to assist with access to the Premises. This means that contact details need to be readily available for communication purposes. They may also ask onsite security to assist or alternatively make use of any other access point e.g., road to the facility.

6. VEHICLES ON THE PREMISES

The Contractor agrees that it's vehicles will be driven, parked and otherwise dealt with on the Premises at the owner's or user's own risk and subject to rules or regulations in force at any given time.

7. WORK ON THE SITE PREMISES AFFECTING THE OCCUPANTS

Where any work to be carried out by the Contractor on the Premises is likely to interrupt or in any other way affect the work carried out on or by the Client or the operation of any plant or equipment or machine used on the Premises, the Contractor shall obtain the timeous prior written consent from WCGHW Engineering's Representative to carry out such work.

Where any work to be carried out is liable to be dangerous to its employees or WCGHW personnel, students or the public, the Contractor shall take all necessary safety precautions, which shall include but not be limited to the erection of appropriate signage and the cordoning of the appropriate work area. The Contractor shall comply with all statutory regulations on site.

8. CONTRACTORS EQUIPMENT AND MATERIALS

The Contractor shall be solely responsible for ensuring the security and safety of its own personal property, including all equipment and material brought onto the Premises for use by the Contractor, and the Client shall not be responsible for loss or damage thereto, howsoever caused.

9. SUB-CONTRACTORS

It is the express responsibility of the Contractor to ensure that all employees, agents, other persons and or sub-contractors engaged by it to work on the Premises are made aware of the contents of this document and comply with it at all times whilst working on the Premises.

10. ACCIDENTS

The Contractor, whether involving persons or property, shall report every accident on the Premises, immediately to WCGHW Engineering's Representative, including accidents, which did not but could have led to personnel injury or loss of limb or damage to property. Reportable incidents shall be dealt with as prescribed in the Act. If the person is not directly employed by the Contractor, the accident shall in addition, be reported by the Contractor, to the injured person's employer. Any accidents involving loss of limb are to be reported directly to the Department of Labour and copied to WCGHW Engineering's Representative immediately.

11. FIRE PRECAUTIONS

The Contractor shall ensure that all persons engaged by it to work on the Premises are aware of and familiar with the protection procedures and systems in operation on the Premises. Contractors are to bring their own safety equipment & portable fire extinguishers to site and not make use of equipment on the Premises.

12. PROGRAM

A detailed program shall be compiled within 14 days of acceptance of this offer for a period of one year, indicating all maintenance / servicing / inspection in terms of this agreement. It shall be the responsibility of the Contractor to advise The Engineer of progress on site, and he shall advise The Engineer in writing at the earliest possible date of any delays in completing the works. It shall be at The Engineer's discretion to accept these delays, and The Engineer shall confirm acceptance of any such delays in writing.

13. STANDARD OF MATERIALS

All materials and equipment supplied and/or installed under this contract shall be new and the best of their respective kinds and shall comply with the requirements laid down in the latest editions of the relevant SABS or BS codes and their amendments and with the requirements of this agreement.

All filters shall comply with Original Manufacturer's Specifications. All other replacement parts shall be sourced from the Manufacturers Agents.

All lubricants, radiator fluid and other consumables shall comply with original manufacturer's specifications. E.g. Lubricant for Detroit engines.

14. ADDITIONAL SERVICE & EMERGENCY REPAIRS & RENOVATIONS (refer to Task Order – Annexure D)

(a) Subject always to the availability of labour, parts and transport, the Contractor shall:

- (i) Carry out any additional work over and above the six-monthly maintenance service, which the Client may require to maintain the plant in a proper and safe working condition. However, it will remain

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

the responsibility of the Contractor to identify and bring these items to the attention of the client.

- (ii) Supply any parts or components that may be required for that purpose, during the period of this agreement. The Contractor will be remunerated for parts and components on a proven cost-plus mark-up basis as indicated in the price schedules. Only original parts will be accepted. Any deviation from original parts will be with the prior written approval of the Client.
- (b) All work carried out by the Contractor in terms of 14 (a) shall be carried out on the agreements' terms and conditions and at the rates of remuneration which are in force.
- (c) All parts, components and liquids supplied by the Contractor in terms of 14 (a) shall be supplied on this agreement's conditions of payment and the price schedules.
- (d) The Client shall not carry out any work on or repairs to or permit anyone else other than the Contractor to carry out any work on or repairs to the plant, unless emergency repairs are required and the Contractor, after being notified of the need for the repairs, is unable to carry them out within reasonable time under the circumstances.

15. QUALIFIED PERSONNEL TO BE USED

Only suitably trained and qualified personnel that have an intimate knowledge of the whole system at the facility shall be allowed to work on the system.

The Diplomas / Training Certificates of these staff shall be submitted with Offers for this Contract for verification.

All maintenance work and servicing shall be carried out by:

Electrical work - A qualified certificated electrician.

Work on diesel engine – Qualified diesel mechanic.

Electronic wiring, programming, etc. – Electronic technician, panel-wiring specialist who received Basic Configuration Software Training by an accredited Deep-Sea Electronics Distributor.

It shall be a prerequisite for this Contract that the Maintenance Staff employed can prove that they have been suitably trained and accredited by the manufacturers and suppliers of all systems and components included in the detailed Specification.

Should the responsible staff employed and specified for this Contract change at any stage, the change of staff shall be subject to the prior written approval of The Engineer.

Suitably trained and qualified staff, with at least 5 years practical experience and knowledge in the repair and fault finding of standby generators, may perform inspections and general cleaning of diesel engines. CVs of these staff shall be submitted with Offers for this Contract for verification.

Repair work, servicing, starting of engines or all electrical work and electrical inspections will be carried out by qualified artisans.

16. SUBMISSION OF OFFERS FOR MISCELLANEOUS WORK

Any work required to be done to ensure the generators and associated systems remain in good and proper working order, and for which the cost has not been included in this Maintenance Contract, shall be identified and cost for authorisation by WCGHW Engineering's Representative in writing prior to the work taking place.

The WCGHW Representative has the right to provide the bidder with the necessary materials should he think that prices are unreasonable or obtain 3 quotes if prices are exorbitant.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Any offers and quotations submitted shall be in accordance with the terms and conditions of the "General Conditions of Contract".

Any Offers shall be submitted within seven working days of any request for any additional work over and above the work specified in this document. Acceptance of these offers shall be granted only in writing by WCGHW Engineering's Representative

All offers submitted shall be valid for a period of at least thirty days.

17. COST OF PARTS

A pro-forma invoice must be obtained from the Agents and submitted to the WCGHW for all mechanical parts of a generator that need to be replaced and to obtain approval from the WCGHW before the Contractor may replace the parts.

Permission is to be obtained from the Chief Engineer if replacement parts are to be used.

18. REWORK

All rework will be for the Contractor's account and the rework data will be captured by WCGHW Engineering's Representative and will be used during the Contractor's performance evaluation. If repairs are not done to the satisfaction of the WCDHW, a contractor of their choice can be appointed to do or complete the repairs for the expense of the Contractor. Damage done to infrastructure or equipment while doing repairs will be rectified for the contractor's account.

19. EMERGENCY CALL OUTS

All emergency repair call outs shall be responded to within 1 hour.

20. PENALTIES

20.1 Servicing:

A penalty for the amount of ten percent of the monthly contract value for each and every calendar day shall be deducted from the "agreed service contract value" for completion after the "agreed delivery date", up to a maximum of one monthly instalment payment, unless the Maintenance Contractor can demonstrate that the failure to render services was due to circumstances beyond their control. For the purposes of this contract, the delivery date shall be the date by which any maintenance, repairs, upgrading, making good or any other work was agreed by means of an agreed work schedule or order in writing. Should the work defined in terms of this contract not be completed within thirty days of the "agreed delivery date", **WCGHW** reserves the right to cancel this Contract at their discretion. The calculation and imposition of this penalty shall be at **WCGHW** discretion, and no correspondence will be entered into on any disputes. The penalty amount will be deducted from the service invoice amount.

20.2 Call outs:

As this contract deals with Health facilities the response time to an emergency call out is of utmost importance. The gravity of the situation is determined by the services being rendered at the facility as well as the nature of the defect as indicated in the matrix below:

Type of facility/ service	Nature of defect				
	No power being generated	High probability of failure or damage to equipment	Quality of supply	Constant attention required	Monitoring required
Hospital more than 100 beds					

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Hospital more than 30 beds					
Hospitals less than 30 beds					
CHC/Day Hospital with MOU or Emergency unit					
Community Day Centre					
EMS					
Ambulance Station					
Forensic Pathology Laboratory (FPL)					
Mortuary					
Other					

Reaction times and Penalties

	Response time	Penalty
	1 Hour	R 1000/Hour
	2 Hours	R 800/Hour
	4 Hours	R 500/Hour
	24 Hours	R 500/24 Hours
	72 Hours	R 1000/5 working days
Late submission of report – see section 11		R200 per day

Response Time shall mean the time lapsed from the time the call out is logged by the system operator or person making the call, until the Contractor responds on site.

21. NON-COMPLIANCE

Should the Contractor not comply with the requirements as specified, WCGHW shall without prejudice of any other right that it may have taken the following action:

- Notify the Contractor in writing about its non-compliance.
- Allow the Contractor 5 working days and correct the non-compliance.

If the Contractor fails to rectify or provide the required service, WCGHW shall be entitled to the following:

- Have the work executed by a third party at the cost of the Contractor.
- Non-performance will be dealt with in terms of the GCC stipulations.

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... 2)..... SIGNED SIGNED	
---	--

22. GUARANTEES

All work undertaken on or off site and any equipment supplied shall be unconditionally guaranteed for a period of at least twelve months from the final delivery date (reference copies of repair or supply job cards to be kept at facilities).

23. PAYMENTS

The Contractor will be required to submit an invoice, in the form of an original "Tax Invoice", for work completed on site once every six (6) months for servicing of the generators (either minor or major service) after all listed generators were serviced and within 30 days for emergency repairs. Invoices will only be accepted if accompanied by the completed Task Orders, tick lists, copies of signed off job cards and copies of invoices for all materials used for the claim period. The Client undertakes to pay for claims submitted, if in accordance with prior agreements, within thirty days of receipt of

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

correct "Tax Invoices". Failure to quote WCGHW's "Order Number" on all delivery notes, job cards and invoices will result in the delaying of payment. **No advance payments will be entertained for this contract.**

Payments shall be monthly in arrears.

Hard copies of the invoices must be hand delivered or couriered to the following address:

Chief Engineer: Directorate Engineering and Technical services

Department of Health & Wellness

Boiler house

Karl Bremer Hospital

Parow

7499

Attention: Chrizzell Alkaster

Tel No (021) 830 3776

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

24. WORKING HOURS

24.1 Working hours

Services shall only be carried out on the days and times as agreed in the approved program. WCGHW Engineering Representative reserves the right to schedule such services / tests outside of normal working hours or over weekends.

Six monthly load tests will have to be scheduled to fit the client's schedule. Thus, allowance should be made in 15% of cases for this to take place during non-working hours.

With regard to routine periodic services, the Contractor shall notify the Regional Representative and the User Department at least 7 days in advance.

24.2 Call Outs & Emergency Calls

In the event of faults or other events requiring urgent attention, the Maintenance Contractor shall guarantee attending to the system within the specified period. Any work / event requiring extended repair time shall be discussed and agreed between WCGHW Engineering Representative and the Maintenance Contractor.

25. ITEMS EXCLUDED FROM THE RESPONSIBILITIES OF THE CONTRACTOR

Fair wear and tear in terms of normal usage, however, the responsibility for identifying, reporting, and repairing such defects on time remains the responsibility of the Contractor.

Defects, faults, damages caused by unauthorised use, misuse, and negligence or otherwise than in the course of proper normal use and operation of the system as specified in terms of the original installation.

Defects, faults, damage due to operation in environmental conditions outside original specifications and requirements, such as lightning, theft, unrest, fire, water, or any other Act of God beyond the control of the Maintenance Contractor.

26. DEPARTMENT OF HEALTH OBLIGATIONS

WCGHW shall be responsible to ensure that:

- The system is used in accordance with the original specification and manufacturer's requirements;
- That adequate records are kept detailing all usage, faults, repairs, events and changes;
- That no unauthorised usage of the system or its components take place;

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

The environment in which the equipment is installed is maintained to ensure the system operates within environmental conditions set in terms of original specifications and manufacturer's requirements;

Ensure that unauthorised persons in terms of this Maintenance Contract do not perform maintenance or extensions to the system or its components.

27. INSURANCE

The Contractor shall procure adequate public liability insurance to provide cover for liability arising out of the death and or bodily injury of any person or the loss of or damage to any property arising out of the performance (or the failure to do so) by the Contractor of any services in, on or about the Premises. The insurance policy shall inter alia provide for general liability and public liability.

- General liability of R10 000 000,00 per occurrence, and
- Public liability of R10 000 000,00 in the annual aggregate.

The Contractor shall, if requested to do so by WCGHW Engineering's Representative, furnish written evidence of the procurement of such insurance to WCGHW and of the fact that the premiums in respect thereof are paid up.

28. SKILL, CARE AND DILIGENCE

The Contractor shall exercise reasonable skill, care and diligence in the performance of its service and shall carry out its responsibilities in accordance with good standards of workmanship and shall only use new, good and adequate materials according to the Occupational Health & Safety Act No. 85 of 1993 latest edition / amendments.

29. LIABILITY OF CONTRACTOR – INDEMNITY

Notwithstanding anything to the contrary contained herein, the Contractor hereby indemnifies and holds harmless WCGHW and the occupancies for any and all claims for damages to or loss of property of any person and for the injury or death of any person and for all expenses or costs directly or indirectly related to or arising from such damage or loss or injury or death, which damage or loss or injury or death arises directly or indirectly as a result of or in connection with the performance (or failure to do so) by the Contractor of any work on, in or about the Premises in terms of any contract or sub-contract or by virtue of whatever other cause the work is performed.

30. STATUS

The Contractor is an independent contractor with respect to the services to be provided and nothing contained herein shall be construed as establishing or creating an agency or employer/employee relationship between the parties.

31. LABOUR LEGISLATION

The Contractor acknowledges that it is familiar and compliant with the latest amendments to all Labour Legislation including Workman's Compensation Act and Basic Conditions of Employment.

32. NEGLIGENCE

The indemnity furnished in this document shall not be vitiated by virtue of the fact that any damage or loss or injury or death in respect of which the indemnity is given is partly or wholly the result of the Contractor's own negligence or other fault.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

33. NON-VARIATION

No addition to, alteration, variation or neither consequential cancellation of this indemnity nor the waiver of any right arising by virtue hereof shall be of any force of effect unless reduced to writing and signed by both parties.

34. SERVICE LEVEL AGREEMENT

The Contractor will enter into a service level agreement with the client before the contract commences.

35. REFERENCES

Previous experience in the servicing of generators is compulsory for this bid. A minimum of five (5) years' experience in the relevant field must be submitted together with contactable references with the completed bid document. List only contracts with a minimum of 50 listed standby generators. It is advised that the referees are standby generator managers or the head of the facilities/buildings. The Department may visit, or call the referees, and may conduct site visits to evaluate service standards to determine the bidder's ability to fulfil the bid requirements.

NO	FACILITY/BUILDING/ COMPANY	REFERENCE	CONTACT DETAILS	CONTRACT ACTIVE YES OR NO
1				
2				
3				
4				
5				

36. HEALTH FACILITIES PROPERTY FOUND

The Contractor shall **immediately** return to the authorised WCGHW representative any item/s of Health Facilities' property found/recovered by the Contractors staff during their duties.

37. LOCATION OF OFFICE / WORKSHOP

The Contractor must have a fully equipped Office and Workshop in the Western Cape Metro. WCGHW may inspect to verify such premises.

38. BREACH

Should a party breach any or all of the terms and conditions of the contract and remain in such breach for 14 (fourteen) calendar days after receipt of a written notice calling upon it to remedy such breach, then the party who served such notice shall be entitled, in addition to any remedy which it may have in law, to cancel the contract, to remedy the breach itself, claim specific performance and/or to claim damages.

Notwithstanding the conditions above, the WCGHW reserves the right to extend to the successful bidder the opportunity to rectify shortcomings in the successful bidder's service.

In the case where the successful bidder remains in breach despite the notice as contemplated in paragraph 1, the WCGHW may impose penalties as contemplated by paragraph 2 above or claim damages in lieu of penalties.

Notwithstanding the provisions contained in paragraphs above, the WCGHW may elect to appoint a third party without notice to render the services at the successful bidder's expense as an interim

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

measure if the Contractor fails to render the services for a period of more than 7 (seven) calendar days. In the event of identification of any erroneous mistakes/low prices/omissions of any sort, the WCGHW shall seek written clarification from bidders.

39. FORCE MAJEURE

The successful bidder accepts and understands that the nature of the services requires it to perform in terms thereof despite the potential impact of any future pandemic that might arise and accordingly the successful bidder shall not be excused from the performance of its obligations and needs to ensure that it has procedures in place to ensure that it renders the services as and when required by the WCGHW.

Neither of the Parties shall be liable for a failure to perform any of its obligations insofar as it proves –

- that the failure was due to an impediment beyond its control;
- that it could not reasonably be expected to have taken the impediment and its effects upon the Party's ability to perform into account at the time of the conclusion of this Agreement; and
- that it could not reasonably have avoided or overcome the impediment or its effects.

An impediment, as aforesaid, may result from events such as the following (this list is not exhaustive)–

- war, whether declared or not, civil war, civil violence, riots and revolutions, acts of sabotage;
- natural disasters such as violent storms, cyclones, earthquakes, tidal waves, floods, destruction by lightning;
- explosions, fires, destruction of machines, of factories and of any kind of installations;
- acts of authority, whether lawful or unlawful, apart from acts from which the party seeking relief has assumed the risk by virtue of any other provisions of this Agreement.

Relief from liability for non-performance by reason of the provisions of this clause shall commence on the date upon which the Party seeking relief gives notice of the impediment relied upon, and shall terminate upon the date upon which such impediment ceases to exist; provided that if such impediment continues for a period of more than 60 (sixty) Business Days, any of the Parties shall be entitled to terminate this Agreement on 30 (thirty) Business Days written notice.

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

PART - 2 GENERAL MAINTENANCE SPECIFICATIONS

WESTERN CAPE GOVERNMENT: HEALTH

DIRECTORATE: SUPPLY CHAIN

(INFRASTRUCTURE SOURCING)

BID OPENED 11:00

2026-02-06

1).....

SIGNED

2).....

SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

1. GENERAL

The specification covers the provision of services for the comprehensive maintenance and repair, if necessary, of the equipment as per **asset register Annexure B** attached to the Agreement.

The BID PRICE SCHEDULES and all other Schedules in the document shall be completed in full and submitted with the bid.

No deviation from the contractual conditions will be considered.

Bidders are advised to familiarise themselves with the site conditions as no claim for ignorance will be considered after bid stage.

The Contractor shall only employ permanent staff to execute the maintenance work.

No sub-contractors shall be allowed unless prior approval was obtained from WCGHW Engineering's Representative.

2. DOCUMENT SCOPE

This document covers the provision of planned and breakdown maintenance of the following broadly defined sections of equipment in terms of this Contract:

- The diesel engine;
- The generator set;
- Distribution and control panels, complete with automatic change-over switchgear;
- Day and bulk fuel tanks;
- Starter batteries and chargers;
- Generator canopies, enclosures, and plant rooms; and
- Other miscellaneous equipment essential to the proper working of the diesel generator set.

3. CONTRACT PERIOD

This comprehensive maintenance contract shall endure for a period of 36 months from the date the site is handed over to the Contractor.

All generators listed in the bid documentation shall be serviced every six months by the successful bidder.

The attached Maintenance Service Agreement forms part of this specification and shall be concluded between the successful bidder and the WCGHW.

4. TRAVELLING CLAIMS

Traveling cost – Bidders shall provide a unit price per kilometre according to the Vehicle Engine Capacity. Traveling costs for servicing to be included in service price.

Maximum of two trips per call out to repair or service in addition to the normal services of generators will be allowed. Should more than two trips be required, a trip authority is to be obtained from the WCGHW – Directorate: Engineering and Technical Support Services. The application to make more than two trips is to be accompanied with reasons for the required additional trip/s. If such approval has not been granted by the WCGHW, the traveling cost will be borne by the Contractor.

All claims shall be accompanied with detailed invoices stating the service cost every six months.

Travel Cost Claims should be accompanied with Vehicles Log Sheets, indicating the date of trip, kilometres travelled point to point and purpose of trip and name of facility generator repaired.

5. ACCOMMODATION CLAIMS

Written approval is to be obtained from the WCGHW if and when the Contractor requires accommodation, should the Contractor's technicians stay overnight to repair a generator that could not be repaired in one day. **Note:** This is only applicable on a 200 kilometres radius from Cape Town. The maximum accommodation rates authorized by the WCGHW may not exceed the market related rates of three (3) star rated Hotels or Bed and Breakfast Guesthouses in the particular area and town where accommodation is required for the technicians to stay over for the night.

The Contractor shall make use of the most economical accommodation. Claims for meals will be capped at an amount of R250 per person per day.

Note: Accommodation for servicing should be included in bid price for servicing.

6. REFERENCE DOCUMENTS

The **latest approved revisions** of the following documents apply: All information provided in this Section shall be verified by the WCGHW.

All installations and work will comply with the latest amendment of the following standards, codes and statutory requirements, stipulations, regulations and provisions and all maintenance and workmanship shall be carried out in accordance with the relevant safety procedures:

- Environmental Conservation Act No. 73 of 1989;
- Compensation for Occupational Injuries and Diseases Act 130 of 1993;
- The Occupational Health and Safety Act, Act No 85 of 1993;
- The SABS Code of Practice for the Wiring of Premises, SANS 10142;
- Municipal by-laws and Local Governing Body;
- Local Fire-Brigade Regulations;
- National Building Regulations SABS 0400;
- All applicable SANS / SABS specifications, or BS specifications where no SANS / SABS specifications exist.
- Where conflict exists between any of the above regulations and the specification, the said conflict must be referred to WCGHW Engineering Representative in writing for his ruling.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

7. EQUIPMENT COVERED UNDER THIS AGREEMENT

The systems to be maintained consists of all Items contained in the attached **Asset register (Annexure B)**.

7.1 CHANGES IN ASSET REGISTER

WCGHW reserves the right to remove assets from this contract in case of e.g., de-commissioning, or to add assets in case of new installations. In both cases a new contract price will be negotiated based on the Contractor's cost breakdown in this document. The asset register list can be amended during the contract period meaning that the contractor needs to familiarise them with the generator on site in instances where the equipment may have changed. In these instances, remuneration would be similar for the same size generator or model in that area. The list must be updated regularly by the Contractor and forwarded to the WCGHW Engineering Representative. Approximately 20 new generators will be added to the asset list.

8. CONTRACTOR'S PLANT AND TOOLS

The Contractor shall have enough plant, tools and test equipment in sound working condition available and of the required capacity for carrying out the work as contained in this document in an efficient and effective manner. All tools / equipment should be appropriately marked. Should The Client be of the opinion that the plant, tools, or test equipment used by the Contractor are inefficient, inadequate or otherwise unsuitable for use on the works, the WCGHW Engineering Representative will have the right to instruct the Contractor to provide such additional or approved plant, tools and test

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

equipment which the WCGHW considers necessary for carrying out the work in a satisfactory manner. Under no circumstances may tools / equipment be loaned from WCGHW maintenance staff.

9. EXISTING WORKS AND SERVICE

The Contractor is responsible for obtaining information regarding services and existing works, which may be affected by the maintenance work. Prior to the commencement of the contract the Contractor must engage and obtain approval from the WCGHW Engineering Representative regarding the proposed method for safeguarding existing works the Contractor may encounter during maintenance operations. The cost of all precautionary measures, which may be necessary to ensure the safety of such services and existing works, as well as the protection of all persons, environment, and animals, shall be borne by the Contractor. The Contractor shall be held responsible for any damage, injury or accident caused as a result of their failure to take the necessary precautionary measures.

The Contractor shall take note of the fact that all services in the existing system are in operation and shall not be interrupted without written approval from WCGHW Engineering's Representative.

Should the Contractor in any event be responsible for the interruption of the power supply or services to the existing buildings and equipment he shall be held responsible for any claims that may arise in this regard.

10. DAMAGE TO BUILDINGS AND INJURY TO PERSONS

The Contractor will be held responsible for any damage caused by him, their employees or subcontractors to buildings, structures or other services. Any damage done to buildings or services by the Contractor, their men or subcontractors will immediately be made good by the Contractor. If the Contractor fails to rectify the damaged works, it will be made good by the WCGHW but the cost of such making good will be deducted from the Contractor's future claims.

The Contractor shall, during the execution of this contract, suitably protect the working area and shall indemnify WCGHW in respect of all claims arising out of injury or deaths of any persons lawfully on the Premises, whose injury or death is caused by the execution of this contract.

11. COMMUNICATION AND AVAILABILITY

The Contractor shall provide the WCGHW representative with a list of telephone numbers whereby they can be contacted day and night. In addition, these names with their phone numbers will be entered into the job cards.

For this purpose, it is a Bid requirement that the Contractor shall provide a 24 hour, 365 days a year service. The Contractor shall be in possession of a cell phone, to be available 24 hours, 365 days a year.

12. SHUTDOWNS AND LOAD TESTS

The scheduled maintenance requiring shutdowns and six-monthly load tests shall be arranged between the Contractor and WCGHW Engineering's Representative. Notice periods for shutdowns and load tests will be at least one calendar month. Services affected by this shutdown shall be clearly defined in writing.

13. MAINTENANCE MANUALS

Where maintenance manuals are available on site the Contractor may use these manuals for maintenance. The Contractor shall, however, not remove these manuals from site nor remove specific pages or soil the manuals.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Where maintenance manuals are not available, the Contractor shall obtain typical maintenance manuals from the Manufacturer. These manuals shall become WCGHW property at the end of the contract.

The Contractor shall maintain the equipment according to the maintenance schedules and as prescribed in the maintenance manuals. The maintenance manuals, including the manuals at WCGHW must be updated whenever the Contractor modifies the equipment on site or when equipment is replaced.

The service schedules in the maintenance manuals take preference over the equipment maintenance manuals.

14. TOOLS AND SPARES

The Contractor shall always carry the following spares:

All V-belts and flat belts required replacing those on equipment listed in Annexure B of this section of this document.

All oil and fuel filters required to replace those on equipment listed in Annexure B of this section of this document.

Assortment of water hoses and collars, fuel hoses and clamps required to replace any of those on equipment listed in Annexure B of this section of this document.

Deep Sea Model 7310 or 7320 auto start control module or equivalent Lovato approved in writing equivalent or similar. The Mains failure controller shall be of the type Deep Sea Model 7310 or 7320 auto transfer switch control module; approved equivalent or similar.

Deep Sea 12V as well as 24V Battery charger; approved equivalent or similar.

If equivalent or similar products are offered the WCGHW reserves the right to evaluate the compatibility of the products offered. If equivalent or similar product is offered, the Bidder to confirm with the WCGHW prior to the closing date if equivalent or similar product is acceptable for pricing purposes.

Tools and sundries to be carried at all times.

Two (2) 105 AH 12V heavy duty battery, equivalent or similar to Deltec, Royal or Willard Maintenance Free with minimum a 5-year life span.

One (1) 120 AH 12V heavy duty battery, equivalent or similar to Deltec, Royal or Willard Maintenance Free with minimum a 5-year life span.

One (1) 150 AH 12V heavy duty battery, equivalent or similar to Deltec, Royal or Willard Maintenance Free with minimum a 5-year life span.

Pressure wash to clean engines & radiators with engine & radiator cleaning liquid;

Small grinder, drill, soldering iron, extension leads;

Gasket maker and gasket material to make up emergency gaskets;

24V + 12V Trickle Charger;

Distribution Board key (3 off);

Distribution Board face plate square key (3 off);

Alarm panel key (3 off);

20L HD diesel oil as per engine manufacturer's specification;

Oil funnel;

25L distilled water;

Battery hydrometer;

20L standby generator radiator fluid (50% ethylene glycol premix at correct ph);

Coolant hydrometer;

12V diesel jockey pump;

5m of 10mm diesel hose;

5m of 12.5 mm diesel hose;

5m of 19 mm reinforced rubber hose suitable for diesel and radiator liquid;

5m of 25 mm reinforced rubber hose suitable for diesel and radiator liquid;

5m of 32 mm reinforced rubber hose suitable for diesel and radiator liquid;


Hose clamps to suite;

10mm² battery jumper cables: 1 pair;

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Fully fitted mechanical toolbox;
Fully fitted electrical toolbox;
Fuel solenoid valve;
Battery load tester;
5 x positive and 5 x negative battery clamps;
Heavy duty fuel solenoids 12V and 24V;
Oil pressure VDO Switch 0 -10 Bar;
Oil pressure VDO Switch Sender 0 - 6 Bar;
Carl Hirsch Body Solenoid 12V + 24V DC;
Temp Switch VDO 126 °C;
Temp Switch 105 °C;
12 – 24V Bosch 5 pin relays;
AVR 4 – 6 Amp Excitation;
AVR 6 – 15 Amps Excitation;
Jacket water heater element 1KW;
Heater thermostat;
Fuel lines – 10m each of ¼" and ½";
Non return valves – 2 each of 3/8" and ½";
Heater pipes 10m each of ½" and ¾";
Four (4) different radiator cap sizes;
Different radiator top and bottom hoses 90 degrees;
Several common water separator fuel filters;
Oil spill kit, drainage buckets and rags for cleaning;
O-ring kits red and green (metric and imperial);
Various sizes bolts, nuts, washers, etc.;
Engine wiring – 2.5mm² and 1mm² (one roll of each);
Lux and ferrule kit complete;
Normal consumables on service van to do repairs and service work on the generators;
You will service generators from 10kVA to 1000kVA;
The correct spec & quantity oil, different types of filters, etc. must be transported to site when servicing the standby generators.

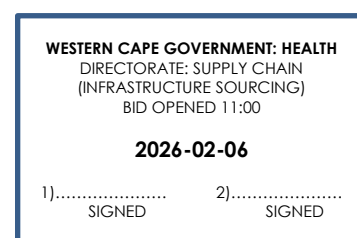

15. TEST EQUIPMENT

- The bidder shall provide the list of minimum test equipment required for this project.
- The test equipment shall be available and operational on a continuous basis.
- The test equipment shall be calibrated on an annual basis by a recognised Authority.

16. CLEANING

The Contractor must thoroughly clean the location and all equipment as specified.
All equipment shall be cleaned on the inside and outside where possible. The Contractor shall be required to use an industrial type of vacuum cleaner and high-pressure washer / cleaner and degreaser for this purpose. All small rust spots shall be treated and painted with rust converter and paint as per paint specialist specification before leaving the site.

17. OTHER CONTRACTORS ON SITE

The Contractor shall take notice of the fact that other contractors will from time to time be present on site.

18. STORE AREA

The Contractor will not be allowed to store any material on site. All rubble & rubbish shall be removed from site before the Contractor leaves the site.

19. KEYS

Keys to be issued by WCGHW Engineering's Representative must be returned the same day.

20. MAINTENANCE

20.1 MINOR REPAIRS

Minor repairs form an essential part of preventative maintenance. A minor repair is any repair that can be affected with the tools and spares listed in Part 2 of this document Paragraph 14. Minor repairs shall form part of monthly inspections and services and shall be recorded in the logbook and tick sheets.

Minor repairs shall be limited in material costs to R 2 500,00 per installation. All repairs in excess of R2 500,00 (material costs) and requiring labour in excess of 1 hour shall be dealt with as described in Part 1 of this document Paragraph 15/16/17/18 where approval is required on a quotation basis and a Task Order is issued to perform the work.

Examples of minor repairs are replacement of cracked fan belts, replacing hose clamps and collars, pulling-up gaskets, etc. This limit is not applicable to battery replacements.

20.2 PREVENTATIVE MAINTENANCE

The maintenance agreement is structured to promote scheduled maintenance in order to reduce breakdown maintenance. Preventative maintenance will therefore also include the removal from the system of unreliable components, and replacement with approved components, equipment or subsystems, which will improve reliability.

Preventative maintenance tasks must be planned and carried out as per the maintenance schedules attached. Where equipment shutdowns are involved, the Contractor shall first obtain permission and approval of such a shut down from WCGHW Engineering's Representative.

The maintenance Contractor will be responsible for all switching and isolating actions required by him to perform the maintenance service. The Contractor will be required to obtain all equipment data as part of the first round of Preventative Maintenance.

The Contractor shall submit at the beginning of the contract an annual maintenance program for approval and as per Item 12 page 19 of Part One of this Document.

20.3 EMERGENCY MAINTENANCE

Equipment breakdowns can necessitate emergency maintenance at any point in time. The cause of a fault requiring unscheduled maintenance may be any reason including floods, misuse of equipment, malicious damage, normal wear and tear or general failure.

The following actions will be regarded as reasons causing faults or damage, which are within the control of the user:

- Damage or faults caused by incorrect operation of the equipment by the user. The Contractor shall ensure that the user's personnel are adequately trained to avoid misunderstanding of operating procedures. The user will also provide notices and preventive measures to obviate damage or faults caused by incorrect operation.
- Damage to equipment caused by Contractor's personnel during maintenance actions.
- The Contractor will rectify any faulty condition of which he becomes aware even if it has not been covered by the original Task Order - Such repairs will be recorded as a separate corrective or emergency maintenance Task Order.
- It will be the sole responsibility of the Contractor to identify the cause, irrespective of what has been reported by the user.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

- WCGHW reserves the right to request a detailed engineering report (within reason) on any failure that might occur. The cost of such report will be for the contractor's account.

Should a fault occur requiring attention during normal working hours within two weeks before a due date of a scheduled six (6) monthly service, the scheduled service shall be carried out simultaneously.

The corresponding periodic service is then taken as completed. On completion of the maintenance, visit or call out, the Contractor shall submit a test/fault report based on the maintenance schedules to WCGHW Engineering's Representative for record purposes.

20.4 PLANNED CORRECTIVE MAINTENANCE

Planned corrective maintenance constitutes corrective maintenance that cannot be carried out immediately but is planned to be conducted at a later stage.

Planned corrective maintenance tasks can be generated at any stage from different sources, e.g. Planned Maintenance Work, customer complaints, maintenance inspections, etc. Demand maintenance tasks must be scheduled and carried out as per the requirements stated in the service standards.

Before replacing any mechanical parts of a generator, a technical report is to be submitted to WCGHW Engineering & Technical Support Services.

Such a report shall be obtained by the Contractor from the agents serving as proof that the parts to be replaced are faulty or un-repairable. The Contractor will carry the cost of such a report.

Authority will only be granted by the WCGHW after such a report has been submitted to the WCGHW Engineering & Technical Support Services before the Contractor may proceed with the replacement of the faulty mechanical component.

20.5 STARTER BATTERIES

The starter battery shall comply with the requirements specified in the General Technical Specification: Electrical Standby Generating Plant. Batteries to be fully charged and be of the lead-acid type battery, complete with necessary electrolyte. The battery shall be of the same capacities as specified by the original manufacturer. In general, capacity shall not be less than 105 Ah and 120 Ah for sets with capacities between 150 and 400 kVA, 150 Ah for sets with a capacity of up to 650 kVA, 220Ah for capacities larger than 650 kVA and shall be capable of providing three consecutive start attempts from cold and thereafter a fourth attempt under manual control of not less than 20 seconds duration each. Batteries must be heavy duty "low maintenance" type, housed in a suitable battery box. Equal or similar to Deltec, Royal or Willard Maintenance Free with a minimum life span of 5 years. Deltec, Royal and Willard are batteries that the WCGHW found to be of a high quality. Contractors can quote on other batteries, but the WCGHW reserves the right to reject batteries of a sub-standard quality which is not SABS approved.

20.6 UPS BATTERIES

Supply and installation of UPS LED Acid Batteries as instructed by WCGHW Representative (12V 5.2Ah / 12V 7Ah). Equal or similar to CSB / CETRO / Blue Nova batteries.

21. REPORTING

21.1 SERVICE AND MAINTENANCE RECORDS

WCGHW Engineering Representative will keep a file for each of the generators. Feedback on all replacements is to be reported back to WCGHW Engineering's Representative via the Task Order feedback for the task. The Contractor shall forward all tick lists and up to date copies of job cards to WCGHW Engineering's Representative every six (6) months.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

21.2 TASK ORDERS

The following reporting aspects form part of the Task Order to be completed for each task. On completion, the Task Order to be signed off by the WCGHW Representative. Task Orders for all tasks will be issued which will provide for the following times to be reported:

- Time and date that the artisan arrived on site;
- Time that the work was completed;
- Names of artisans and assistants;
- Labour hours;
- List of materials and spares used;
- Description of fault and fault-finding diagnosis;
- Distance travelled; and
- Description of work done;

21.3 COMPULSORY MEETINGS

Compulsory meetings shall be held on a six (6) monthly basis when all contract related items shall be addressed. A suitable date and venue for the meetings shall be confirmed within 7 days of appointment.

21.4 QUALITY CONTROL

On submission of a maintenance/fault repair report, WCGHW Engineering's Representative, may check the quality of workmanship and if not satisfactorily executed, request the Contractor to re-do the work at the company's own expense. The Contractor shall take before and after photos of new and old oil filters, air filters, diesel filters, etc. as proof of work done. Additionally, the Contractor shall write the installation date on the replacement parts with a durable permanent marker (Tippex).

21.5 EQUIPMENT RECORD

This record should contain incidents of damage to equipment during maintenance or installation activities, such damage, however insignificant, should be noted on the Task Order and reported to ensure traceability of functional failures, should it be due to historic damage.

21.6 DISPOSAL OF HAZARDOUS EQUIPMENT OR MATERIAL

The disposal of hazardous materials shall be in strict accordance with statutory requirements. Contractors must supply proof of correct disposal of hazardous material after a service or repair which must be attached to the job cards. Any corrective action to be taken by the Contractor will be at the Contractors own cost.

21.7 OBSOLETE EQUIPMENT

If any equipment that is identified to be obsolete during the maintenance process, excluding normal replacements, shall be reported at the six-monthly compulsory meeting. It shall be decided by WCGHW Engineering & Technical Support Services whether obsolete equipment shall be returned to WCGHW Engineering & Technical Support Services or disposed of by the Contractor when components are replaced.

22. SERVICE STANDARDS

22.1 STANDARDISATION

No deviation will be allowed from the original specifications, unless agreed to in writing with and by the Chief Engineer.

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

22.2 RESPONSE AND REPAIR TIMES

The response and repair times applicable to emergency maintenance activities are as follows:

ITEM	CALL OUT	RESPONSE TIME	REPAIR TIME
1	Critical	1 Hour	1 Hour or as mutually agreed
2	Non-critical	4 Hours	24 Hours or as Mutually agreed.

Response Time shall mean the time lapsed from the time the call out is logged by the WCGHW Representative, until the Contractor report on site. The time arrived will be recorded on the job card.

Repair Time shall mean the maximum time taken by the Contractor to repair the fault, in order to limit the downtime of the system to a minimum. Repair time will be measured from the time the Contractor's arrived on site, until such time as the fault is rectified and signed off by the WCGHW Representative.

Downtime, with respect to call outs, shall mean the total time for which the system is not 100% operational, i.e. Response time plus Repair time.

22.3 SUPERVISION

A suitably competent person qualified as an artisan with a minimum of 5 years generator fault finding and repair experience must represent the Contractor's maintenance team on site and will be the designated point of contact.

22.4 QUALITY OF WORK AND MATERIALS

The Contractor will restore the maintained equipment to a condition equal to its required specifications and re-commission the equipment on completion of each maintenance service or activity carried out. Any materials used are to comply with the relevant SANS, SABS, BS or applicable European (for instance DIN) standard.

A WCGHW Representative is responsible for inspecting all service and repair work and report thereon at the six-monthly compulsory meeting. A representative of the Contractor may accompany the WCGHW Representative during such inspections. All inferior work shall be rectified immediately at the expense of the Contractor.

22.5 PLANT SPECIFIC DOCUMENTS

Service reports, tick sheets and job cards shall be provided to WCGHW Engineering & Technical Support Services and the User after each service or repair.

An emergency restoration procedure will be prominently displayed. The Emergency Order number or Task Order number will be displayed in a prominent position.

Copies of test and performance records (tick sheets) as completed during maintenance or other visits shall accompany the Task Orders returned to WCGHW Engineering Representative.

22.6 DRAWINGS

The Contractor shall be responsible for ensuring that all "As Built" drawings are kept up to date as far as any detailed changes or developments are concerned.

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

22.7 ALTERNATE EQUIPMENT AND MAINTENANCE

In general, deviations from the methods and practices as specified in this document will not be tolerated. Should the Contractor wish to propose changes to the requirements detailed herein, these shall be submitted in writing to the Chief Engineer for written approval.

Should the Chief Engineer accept these changes, it shall be the responsibility of the Contractor to:

- Update "As Built" drawings and Maintenance Manuals; and
- Update procedures, practices, methods and materials.

23. SERVICE CHARGE

23.1 PREVENTATIVE MAINTENANCE CHARGE

The service charge for comprehensive maintenance (**See Annexure A for complete lists of what needs to be done**) shall include the following:

- Labour cost;
- Travelling cost;
- Overhead cost;
- Consumables;
- Top-up oil and radiator liquid up to 5% of the system capacity for the minor service – (6 monthly);
- Replace oil and filters during major service (12 monthly);
- Cleaning equipment;
- Test equipment;
- Job cards and service reports;
- Maintenance tools; and
- Accommodation if necessary.

23.2 CALL OUT CHARGE

The service charge for call outs other than normal maintenance shall be paid extra and shall include the following:

- Standard Call out charge (which will include the first 50km of traveling as measured from Karl Bremer Hospital plus first half an hour on site) **
- Labour cost**
- Travelling cost*
- Overhead cost**
- Maintenance tools**
- Test equipment**

* Rates as per price schedule.

**Included in call out rate as per price schedule.

Not included are the costs of replacement materials and parts.

The payment for repair of faults and damages as well as the replacement of parts due to accidents, mal operation, short-circuits from outside, malicious damage, fire, theft, water or other reason shall only be considered if the Contractor can prove that it was beyond their responsibility and control.

The Contractor shall furnish a quotation for the work to be carried out in the above regard for approval before commencing with the repair. WCGHW Engineering & Technical Support Services will give approval before any work commences.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

PART – 3

SPECIFIC REQUIREMENTS FOR THE MAINTENANCE OF EMERGENCY DIESEL GENERATORS

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

1 MAINS FAILURE TEST / VISUAL CHECKS ON EMERGENCY DIESEL GENERATOR

The frequency of the schedule will be according to the requirements of the Bid Document. **See Annexure A** for details of schedule.

2 MAIN SERVICE ON EMERGENCY DIESEL GENERATOR

See Annexure A for details of schedule.

3 MINOR SERVICE ON EMERGENCY DIESEL GENERATOR

See Annexure A for details of schedule.

3.1 PREVENTATIVE MAINTENANCE INSPECTION ON DIESEL GENERATOR CHANGE-OVERBOARD AND ASSOCIATED RETICULATION SYSTEMS

It will be the sole responsibility of the Contractor to identify the real fault, irrespective of what has been reported by the User. The Chief Engineer reserves the right to request a detailed engineering report on any failure that might occur. The cost of such report will be for the Contractor's account.

3.2 CLEANING OF EQUIPMENT, PLANT ROOMS AND ENCLOSURE

The Contractor shall ensure that all equipment as per this document shall be thoroughly cleaned inside and outside where possible during the scheduled service or as dictated by environmental conditions.

The Contractor shall be responsible for cleaning of the plant rooms where applicable. (Safety awareness).

All enclosures will be inspected on a six-monthly basis for corrosion. Corroded areas will be sanded down to bare metal, treated with an etching primer and three coats of enamel paint to match existing.

4 EXISTING ELECTRICAL INSTALLATIONS IN EMERGENCY DIESEL GENERATOR ROOMS

The Contractor shall ensure that the plugs and lights in the emergency diesel generator rooms and enclosures are operational when visiting locations – Any non-conformance shall be reported in writing to WCGHW Engineering's Representative.

4.1 TESTS

The following annual tests will be done in accordance with the schedules in **Annexure A**.

Oil Tests on all generators 100kVA and larger; Oil to be analysed by a reputable laboratory, e.g., wear check.

Fuel test: Microbial contamination, total contamination (Solid) and entrained water.

The Contractor must supply a comprehensive report from an accredited body for each test. The cost thereof must be catered for in the service cost.

4.2 OIL AND FILTER CHANGE AND DISPOSAL THEREOF

All oil, oil filters and diesel filters shall be replaced during the main service of the equipment. Air filters will only be replaced once during the contract.

The Contractor shall be responsible for the disposal of the used oil removed from the existing diesel engines during the preventive maintenance procedure in accordance with environmental regulations.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

4.3 DIESEL FUEL TANK

The maintenance Contractor shall be responsible to report on the fuel levels in all fuel tanks. The Contractor will record the fuel levels before and after each test. Fuel will only be added, if required for the performance of tests and only after approval by the Directorate Engineering's representative. Fuel quantities added to the tanks shall be recorded in the logbooks and on the tick lists. These quantities shall be witnessed and signed off by the contact person as indicated in the asset register **(Annexure B)**. The Contractor shall be remunerated for fuel at the fuel price at the time plus a handling fee as recorded in the price schedule.

4.4 CABLES AND CABLE CONNECTIONS

The maintenance Contractor shall only be responsible for those cables connected to the emergency alternators, starters, starter batteries and the battery chargers.

4.5 CONTROL PANELS, CIRCUIT-BREAKERS, CONNECTION BARS AND WIRING

Under no circumstances may distribution boards, control panels, switches and outlets be left open or unattended during maintenance or repair.

Temporary "bridges" and "makeshift repairs" will not be permitted.

A "lockout" label shall be affixed below each main isolator or main circuit breaker. A notice detailing the requirements with regards to cascading as detailed in SANS 10142 code shall be affixed to the door of each DB.

A yellow flash triangle shall be fixed to the outside of each distribution board as well as the enclosure doors where this has not been done or where the label has been removed or damaged.

4.6 COMMON SYSTEMS REQUIRING MAINTENANCE

The following systems are common to many systems, and for which detailed requirements are detailed later. These items are:

- Wiring and wire-ways;
- Normal power supplies;
- Back-up power supplies;
- Earthing system;
- Flexible connections;

All the elements of the system as existing and/or as modified / added to from time to time not described above.

5 ELECTRICAL MAINTENANCE REQUIREMENTS

5.1 WIRING AND WIRE-WAYS

- Examine and check all field wiring including continuity, terminations, connections, strapping and fastening;
- Check all wire-ways to ensure installed as approved;
- Check that all and any wiring or wire-ways passing through fire seals / stop have not disturbed seal / stop.

5.2 NORMAL POWER SUPPLIES & ELECTRICAL LIGHTING

- Check that mains supply is at correctly rated input voltage;
- Check that supply protection circuitry is in working order;
- Check that pilot lights and local / remote alarms are functioning as well as plantroom or container lighting. If no plug point in plantroom or near generator, mention in 3-monthly report.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

5.3 EARTHING SYSTEMS

- Check all terminations of earthing conductors;
- Check to see that any PVC insulation on clean earths is not damaged / broken / burnt;
- If possible, measure loop impedances and record;
- Check connection to main earth bar.

5.4 FLEXIBLE CONNECTIONS

- Check that covering sheaths are not damaged / broken / cracked;
- Check that terminations are in good working order;
- Check that any waterproofing employed is still in good working condition.

6 DETAILED DESCRIPTION OF MAINTENANCE WORK

6.1 LOAD TEST

In general, the Client or Contractors representative shall be present during all tests undertaken on diesel driven generating sets.

Check the operation of the set as follows:

- That the set starts up automatically on tripping of the "normal" power supply to the change-over panel;
- That any pre-set delays on the closing of contactors for the running up of the engine and the actuation of the alternator are functioning in accordance with the original manufacturer's specification;
- That the load is automatically reconnected to the "normal" power supply once the "normal" power supply has been restored;
- That the "stop delay" timer operates ensuring that the engine runs through the cooling cycle required in terms of the original manufacturer's specifications;
- That the "operating selector" is left in the proper (automatic) state following the successful completion of the testing;
- With the selector on "auto", the set must stop and start automatically;
- With the selector on "manual" the set shall take up the electrical load, but it shall not be possible to connect the load to the "normal" mains supply at the same time.

6.2 THE DIESEL ENGINE

Run the set up to as close as possible to maximum allowable working load and allow to run for a period of at least 30 minutes. The full load test must be done at the same time when the facility plans to do their full load test. Contractor needs to co-ordinate with the facility and obtain written approval from them with regards to the load test.

With regards to the loading of the set, ensure as far as possible that the full electrical load connected to the set is connected and switched on, including typically the following:

- Lighting;
- Lifts;
- UPS supplies;
- Electronic systems such as public address, fire detection; etc.
- Smoke exhaust and stairwell pressurisation fans;

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

Any other load, which forms a significant portion of the "emergency power", backup system, and which can be run without detriment to the integrity of the system.

- Inspect engine with regards to:
 - Cleanliness, ensuring that there is no build-up of dust, sludge, grime or other signs of possible problems;
 - Oil leaks, ensuring that all gaskets, seals, covers, etc. are in proper working order and that there is no leakage of oil. Also check that any drip trays fitted under the engine are cleaned and replaced in the correct positions;

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

- Check the level of the engine lubricating oil, plus check the date by when the oil is due for replacement;
- At the end of the test, inspect the level and condition of the oil lubricant used in the engine;
- Arrange for the annual presentation of a sample of the engine oil to be analysed indicating the condition of both the lubricating oil and of the internal working parts of the engine. Replace oil only after oil analysis has verified necessity;
- Inspect condition of all belts and belt drives;
- Check and record the engine oil pressure under test load conditions;
- Couplings, ensuring that the bolts are properly fastened and that any flexible joints are in proper working order and free of obstructions to hinder proper working function of couplings;
- Exhaust manifold and pipework for possible exhaust leakage, ensuring that any leaks are detected early and that all lagging and pipework are in a proper working state at all times. Inspect all exhaust hangers and couplings to ensure that they are in good working order, with any anti-vibration systems fully operational. Ensure that all lagging is correctly fixed and that the heat dissipation properties of the lagging are maintained.
- Operation of fuel pump ensuring that fuel is delivered to the engine in the manner prescribed by the manufacturer;
- Starting of the engine, ensuring that the engine starts quickly and effectively takes up the generator load, in accordance with the original manufacturer's specifications;
- Visually inspect exhaust emissions at start-up, and note excessive smoke in logbook and tick sheets
- Stopping of the engine, ensuring that the engine runs the prescribed "cool down" cycle period before shutting down;
- Engine mountings, ensuring that the bolts are correctly fastened, and that flexible seating's are correctly seated, are not worn or corroded, and are not obstructed from allowing designed flexible movement of the engine;
- Speed governors, ensuring that the speed is governed to within the limits as prescribed in the original specification, despite fluctuations in the generator load;
- Inspect condition of air filters including "air filter indicators", ensuring that no dust enters the inlet manifold during the removal of the filter element;
- Clean filter housing, clean filter element with compressed air and replacing the filter element as and when required;
- Inspect condition of oil filter, ensuring that there is no oil leakage around the lip / seal of the filter, recording the oil filter differential pressure, and replacing the filter cartridge every year or one hundred working hours, whichever is the sooner, or as prescribed by the manufacturer in its original specification;
- Inspect all fuel lines and fuel system for leaks, replace if necessary;
- Inspect condition of fuel filter, ensuring that there is no fuel leakage around the inlet or outlet, that there are no air leaks (bleeding off any air noted in the system), and replacing the filter cartridge every year or one hundred working hours, whichever is the sooner, or as prescribed by the manufacturer in its original specification;
- Inspect operation of the coolant system ensuring that the engine runs up to its designed operating temperature and then is able to maintain the steady working temperature of the set.

6.3 AIR COOLED ENGINES

- Ensure that cooling fins are clean and that dust, dirt, loose equipment and any other type of obstruction do not obstruct air paths and passages.
- Ensure that all belts are in an excellent condition and free of cracks.

6.4 WATER-COOLED ENGINES

Inspect and report on the condition of all radiator hoses, connections, clips, radiator cores, fins, etc. ensuring that all are in good condition and are not rusted, perished or have deteriorated in any way; Wash down radiator fins during every service. Report on need of coating of radiator fins with anti-corrosion layer;

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Ensure that make-up / expansion tank is clean and that coolant levels are clearly visible;
Check the level of the radiator liquid and top up as necessary, ensuring that the radiator liquid is maintained in accordance with the original manufacturer's specifications;
Check specific gravity of the radiator liquid and replace the radiator liquid if not correct. Contractor to report the volumes added in 6-monthly reports.

Have the radiator liquid replaced within the first 6 months of the contract as well as the last 6 months of the contract as directed in accordance with the original manufacturer's specification;
Inspect the operation of the temperature gauge and any protection system, ensuring that the monitoring system is in good and proper working order;
Inspect and check the operation of any "pre-heating system" ensuring that the engine is maintained at the prescribed operating temperature at all times;
Replace pre-heater hoses annually during the major service to be included in annual service price;
Perform pressure test on radiator fluid system, including operation of float switch.

6.5 THE ALTERNATOR

With the set running at or as close as possible to the maximum working load, check and inspect the following:

- That the temperature rise of the alternator does not rise above the safe working maximum prescribed temperature by the manufacturer and as monitored by the system control panel;
- That the output voltage and frequency are as prescribed in terms of the original manufacturer's specifications;
- That the voltage regulation system is in proper working order, maintaining the operating voltage at all times within the manufacturer's specifications despite fluctuations of the electrical load;
- The alternator is able to provide the required voltage rapidly following the application of the electric load;
- Check, inspect and test the operation of all couplings and mountings as described above for the diesel engine.

6.6 DISTRIBUTION AND CONTROL PANELS

Check, inspect and test the following:

Note: If any of the items below are not included on the Tick Sheet, then the Contractor must mention it in its 6-monthly report.

- All safety warning notices are in place;
- That the ventilation to the panels is in order and is not obstructed in any way;
- That circuit breakers are set to the correct positions;
- That, the ammeters are in proper working order. Check the settings of the maximum demand ammeter, recording any readings noted;
- That, the voltmeters are in proper working order. Check the output voltage of the set, recording any readings noted;
- *That kilowatt hour meters are in proper working order, recording any readings noted;
- *That running hour meters are in proper working order, recording any readings noted;
- That selector switches are fully functional and in good working order;
- That all fuses and switches are in correct positions, and are fully functional, noting any defects;
- *That frequency meters are in proper working order, and that the frequency of the set is correctly set, recording the frequencies noted;
- That protection relays / devices provided for the following are in good and proper working order:
 - High engine temperature;
 - Oil pressure low;
 - Over-speed;
 - Engine under temperature;
 - Start-failure;
 - Battery charger failure;
 - Supply circuit breaker failure;
 - Low coolant level;

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

- Emergency stop;
- Ensure that any control gear operated by any of the above relay's functions in accordance with the original manufacturer's specifications;
- That the battery charger system installed, including ammeters, voltmeters, push-buttons and selector switches, is in good working order and operates in accordance with the original manufacturer's specification;
- That the generator system earthing is intact and installed in accordance with the original installation;
- That all power cabling is in good order and has not been damaged in any way, and that any sealant applied to penetrations between the generator room and outside rooms is intact and in good order including water proofing and indicators of water ingress;
- Inspect contactors for chatter, if required disassemble contactors and clean. Take note of paragraph 12 of Part 2 of this document regarding shut down procedure and planned maintenance.
- *Where installed.

6.7 FUEL TANKS

Before starting any testing of the engine, check the level of fuel in fuel tanks; record the levels in the job card, and tick sheets before and after the servicing and verbally report fuel level to responsible person (Facility Manager) at facility before leaving the site.

Arrange to have samples of the fuel tested every twelve months. A comprehensive report to be submitted to WCGHW Engineering's Representative, indicating the safe usage of the diesel fuel in the diesel engines as encompassed in paragraph 21 of Part 2 of this document. The report shall also indicate the percentage water, corrosion and general properties, thus ensuring that the fuel tanks are in good working order at all times.

Ensure that proper records are kept of all fuel levels, plus fuel added to the tanks and of reports of samples submitted for analysis. All fuel added shall be witnessed and signed off by WCGHW's Representative.

During each of the services 5 litres of fuel will be drained from the bottom of the tank and visually inspected for water contamination.

6.8 STARTER BATTERIES

Check and inspect the following:

- Level of the electrolyte in each cell;
- The specific gravity of each cell;
- The battery output voltage, as well as the charger voltage, under "no load" and "full load" conditions;
- The condition of interconnecting cabling, ensuring that there is no corrosion;
- Clean battery terminals and treat with anti-corrosion treatment;
- That there is no build-up of acid and residue at terminals;
- That the battery stand is in good working order;
- That the battery ventilation system is in good working order;
- That the battery charging system is in good working order, recording the standing load of the control charger;
- Have a full load test completed on each battery at least once a year to ensure that the battery is able to cope with the demand and report in writing.
- Rock batteries during every inspection.

6.9 MISCELLANEOUS EQUIPMENT

Check and inspect the following:

- Generator room / enclosure door locks and hinges;
- Corrosion and oil-based enamel paint;
- Lighting in generator room;

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

- Obstruction to air-intakes, exhaust or radiators;
- Ensure that spare parts kept with the generator set are stored in their correct positions ready for use;
- Any other system or miscellaneous equipment installed not described above but necessary for the safe and reliable operation of the generator set.
- Check that electrical plugs are operational and if no plug is available report back in writing.

6.10 CONTRACTOR

Ensure that staff is fully conversant with the systems, their controls and operations.

Check that all faults have been properly recorded, including any work undertaken to rectify such work.

The Engineer or WCGHW Representative will conduct regular random inspections to ensure that the contract is honoured, and that work is carried out to the required standard.

6.11 OTHER WORK

Check that the system and its components are installed in accordance with the original manufacturer's specifications and "as built" drawings.

Check that wiring and control diagrams are up to date.

Ensure that the total standby diesel driven generator system is in good working order with no defects.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

ANNEXURE A

PREVENTATIVE MAINTENANCE SCHEDULES

WESTERN CAPE GOVERNMENT: HEALTH

DIRECTORATE: SUPPLY CHAIN

(INFRASTRUCTURE SOURCING)

BID OPENED 11:00

2026-02-06

1).....

SIGNED

2).....

SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

<u>MAINTENANCE SCHEDULE (MINOR SERVICE)</u>					
Facility name:		kVA rating:		Engine brand name:	
Building:				Engine no:	
Alternator make:		Alternator Capacity:		Order no:	
SYSTEM TYPE:		DIESEL GENERATOR AND COMMON SYSTEM			
TASK FREQUENCY:		6 MONTHLY (minor service)			
TASK DESCRIPTION:		LOAD RUN TEST / MAINS FAILURE TEST / VISUAL CHECKS ON EMERGENCY DIESEL GENERATOR			
Check/inspect will imply that:		If a defect is detected that the said defect will be rectified within the provisions of this AGREEMENT (This list must be signed and be submitted with the invoice)			

SUB-TASKS		
ITEM	SUB TASK DESCRIPTION	RESULT
1	PRE-RUN CHECKS	
	Lubrication system	
1.1	Check engine oil level, top up if required	
1.2	Inspect all Gaskets and seals for oil leaks and/or streak marks	
1.3	Visually inspect oil for contaminants	
	Fuel system	
1.4	Check operation of fuel transfer pump if applicable	
1.5	Check for fuel leaks	
1.6	Record condition of fuel hoses	
1.7	Record fuel level in tank	
	Coolant system	
1.8	Check operation of pre-heating system (heater and thermo siphon), replace heater elements/thermostats if required	
1.9	Check condition of radiator hoses (flexibility, leak-free)	
1.10	Check coolant level, top up with radiator liquid if required	
1.11	Check for coolant leaks	
1.12	Record Coolant Specific Gravity and adjust if necessary	
1.13	Visually inspect for and record contaminants if any	
	General	
1.14	Check V-belt and flat belt condition	
1.15	Check operation of intake restriction indicator	
1.16	Check all fasteners	
1.17	Check that room / enclosure intakes are free from obstructions	
1.18	Clean plant room	
1.19	Check that fire extinguisher annual test certificate is valid.	
1.20	Issue of temporally service (job card) certificate to the facility after service completion as proof of service	
	Batteries	
1.21	Record battery voltage before start-up	
1.21	Check battery electrolyte level, top up if required	
1.22	Check battery connections and condition	
1.23	Record electrolyte specific gravity	
1.24	Record voltage during test run	
	Control panel	
1.25	Check that breaker status is correct	
1.26	Check that selector switches are correct (manual position)	
1.27	Record standing alarms	

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... 2)..... SIGNED SIGNED	
---	--

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

SUB-TASKS		
ITEM	SUB TASK DESCRIPTION	RESULT
1.28	Check operation of control panel	
1.29	Check low oil pressure alarm	
1.30	Check coolant level alarm	
1.31	Check charger fail alarm	
1.32	Reset all alarms	
1.33	Record pre-run data before start-up	
	Exhaust system	
1.34	Inspect exhaust for leaks	
1.35	Inspect insulation and cladding	
1.36	Inspect all anchors and mounting brackets	
	Enclosure	
1.37	Inspect enclosure inclusive of roof for corrosion	
1.38	Inspect hinges, latches and padlocks for smooth operation, lubricate if required	
1.39	Inspect acoustic lining, fix if required	
1.40	Inspect for corrosion of metal surfaces, derusting and paint with oil-based paint to prevent further rust	
2	TEST RUN	
2.1	Switch control panel to manual	
2.2	Record on which attempt did engine start	
2.3	Check operation of all gauges and meters	
2.4	Record test run data after start-up	
2.5	Record test run data after 10 minutes	
2.6	Check for abnormal vibrations	
2.7	Check airflow through radiator	
2.8	Check for excessive exhaust smoke	
2.9	Check for exhaust leaks	
2.10	Check for operation of fans (radiator)	
2.11	SWITCH CONTROLLER TO "AUTO" POSITION	
3	LOAD TEST	
3.0	Arrange and schedule test 1 month in advance	
3.1	Record fuel levels before and after load test	
3.2	Fail the mains supply NB – only according to prior arranged schedule in the presence of WCGHW Engineering's Representative	
3.3	Check operation of the start-up delay timer	
3.4	Check auto start of generator	
3.5	Check operation off the changeover contactor timer	
3.6	Check load acceptance	
3.7	Check operation of all gauges and meters	
3.8	Record test run data after start-up	
3.9	Record test run data after 30 minutes	
3.10	Check for abnormal vibrations	
3.11	Check airflow through radiator	
3.12	Check for excessive exhaust smoke	
3.13	Check for exhaust leaks	
3.14	Check for operation of fans (radiator)	
3.15	Restore mains supply after 35 minutes	
3.16	Check operation of mains restoration timer	
3.17	Check operation of cool down period timer	
3.18	Check operation of <i>mains failure and standby running</i> alarms	

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

SUB-TASKS		
ITEM	SUB TASK DESCRIPTION	RESULT
3.19	Check if the current transformers are installed, if not report in writing	
4	POST RUN CHECKS	
4.1	Check breaker status – correct	
4.2	Check selector switches – correct (AUTO)	
4.3	Record post run data	
4.4	Record potential (Voltage) readings per phase	
4.5	Record current (Amps) readings per phase	
4.6	Record frequency (Hz)	
4.7	Reset maximum demand Ammeters, after recording highest reading	
4.8	Reset all alarms	
4.9	Check for fuel leaks	
4.10	Check for oil leaks	
4.11	Check for coolant leaks	
5	GENERAL	
5.1	Clean up work area	
5.2	Check general condition of the system for safety compliance and good house keeping	
5.3	Fill in and complete Mains Failure Test Sheet	
5.4	Complete job card in detail	
5.5	Pictures before and after service by Contractor to form part of the 6-monthly reports.	

I certify that the above test/maintenance has been carried out

Artisan

Date

Contractor

Date

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

MAINTENANCE SCHEDULE (MAJOR SERVICE)					
Facility name:		kVA rating:		Engine brand name:	
Building:				Engine no:	
Alternator make:		Alternator Capacity:		Order no:	
SYSTEM TYPE:		DIESEL GENERATOR AND COMMON SYSTEM			
TASK FREQUENCY:		12 MONTHLY (major service)			
TASK DESCRIPTION:		MAIN SERVICE ON EMERGENCY DIESEL GENERATOR			
Check/inspect will imply that:		If a defect is detected that the said defect will be rectified within the provisions of this AGREEMENT			

SUB-TASKS		
ITEM	SUB TASK DESCRIPTION	RESULT
1	MAINS FAILURE TEST	
	This shall include all inspections and tests as to be performed for the 6-monthly inspections and tests	
2	ENGINE AND ALTERNATOR	
2.1	Obtain oil sample *(before service) (generators 100 kVA and larger)	
2.2	Drain, refill and dispose of old oil	
2.3	Change oil filter	
2.4	Change fuel filter	
2.5	Check for oil leaks – all seals and gaskets	
2.6	Check crank case breather	
2.7	Check oil transfer pump (when installed)	
2.8	Check for rust in radiator, ensure that expansion tank is clean at all times. Drain system completely and flush until water is clean. Fill with approved radiator liquid as per manufacturer's recommendation. To be done during the first 6 months of the contract and last 6 months of the contract.	
2.9	Check and flush cooling system if necessary	
2.10	Record and adjust coolant SG (Glycol concentration)	
2.11	Pressure test coolant system	
2.12	Check radiator cap and valve	
2.13	Clean air cleaner element and housing	
2.14	Change air cleaner filter element every 12 months	
2.15	Change oil in air filter where required (according to engine specifications)	
2.16	Check V-belt condition and tension	
2.17	Check starter motor and solenoid	
2.18	Check injector/fuel pump timing	
2.19	Check injector seals for leaks	
2.20	Adjust valve clearance and replace gasket	
2.21	Inspect turbo charger/s, function and lubrication and air pipes	
2.22	Check all links and moving parts for operation	
2.23	Check operation of electronic governor	
2.24	Change fuel filter	
2.25	Check water and drain fuel filter and separator (Devalco fuel filtration system)	
2.26	Check all foundation bolts, alternator bolts and engine holding down bolts	
2.27	Check anti vibration mountings on the plant	
2.28	Check anti vibration mountings on the engine panel	

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

SUB-TASKS		
ITEM	SUB TASK DESCRIPTION	RESULT
2.29	Check anti vibration mountings on the control panel. Report all faulty vibration mountings in writing.	
2.30	Check engine / alternator coupling	
2.31	Inspect for abnormal audible noise	
2.32	Check fuel tank for condensate	
2.33	Obtain fuel sample and sent to laboratory for analysis for all standby generators with a capacity in excess of 100kVA (attach test report to 6 monthly report.)	
3	CONTROL PANEL	
3.1	Check over / under speed alarm	
3.2	Check functioning of high temperature alarm, by simulation	
3.3	Check functioning of low coolant level alarm, by simulation	
3.4	Check functioning of low oil pressure	
3.5	Check functioning of emergency stop alarm	
3.6	Check voltage monitors (calibrate)	
3.7	Check all fuses	
3.8	Check all alarm relays	
3.9	Inspect all cabling and wiring	
3.10	Check all cable connections	
3.11	Report old pop out panels to upgrade panels	
3.12	All existing programs on all controllers of the WCGHW standby generators to be downloaded on an external hard drive in separate files (per facility/generator make and model/engine type /controller type) and handed to Engineering Department (Mr G Willemse: Electrical Foreman) for record/safekeeping purposes.	
4.	BATTERY	
4.1	Clean battery terminals and stand	
4.2	Perform Load test	
4.3	Treat terminals with corrosion inhibitor	
4.4	Rock batteries	
5	GENERAL	
5.1	Check plugs and lights in plant room/container. Report in writing if not operational.	
5.2	Check for correct danger signs and notices	
5.3	Clean up work area	
5.4	Test for correct operation of all sub-systems	
5.5	Check general condition of the system for safety compliance and good housekeeping.	
5.6	Fill in and complete Preventive Maintenance Service Sheet	
5.7	Inspect enclosure paintwork and lining, take corrective actions	
5.8	Inspect all hinges, latches and padlocks	

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

I certify that the above test/maintenance has been carried out

Artisan

Date

Contractor

Date

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

MAINTENANCE SCHEDULE (MINOR & MAJOR)

FACILITY NAME AND BUILDING: _____

SYSTEM TYPE:

TASK FREQUENCY:

TASK DESCRIPTION:

Check/inspect will imply that:

ELECTRICAL SYSTEM

6 MONTHLY

**PREVENTIVE MAINTENANCE INSPECTION ON
DIESEL GENERATOR CHANGE-OVERBOARD**

If a defect is detected that the said defect will be rectified within the provisions of this AGREEMENT

In addition, this inspection will be performed on commencement of this contract

SUB-TASKS

ITEM	SUB TASK DESCRIPTION	RESULT
1	SYSTEMS	
1.1	Ensure that trip settings of circuit breakers are correct	
1.2	Compare legend cards to circuit labelling for correctness	
1.3	Ensure that all cable terminations are secure	
1.4	Ensure that there are no loose connections	
1.5	Check for damage by vermin	
1.6	Check for signs of overheating and/or overloading	
1.7	Check if all panel covers and face plates are secure and in position	
1.8	Check that labels, signs and notices comply to legislation (OHSA)	
1.9	Check condition of cable and DB labels	
1.10	Check shrouds and seals for ingress of dust, moisture and/or bugs	
1.11	Check integrity of surge and lightning arrestors where applicable	
1.12	Record voltage, current, maximum demand, and power factor readings	
1.13	Do an earth continuity test only on the standby generator to the main distribution board and record	
1.14	Do an earth loop test on the standby generator and record	
1.15	Do an earth resistance test on the standby generator and record	
1.16	Verify phase rotation is correct and record	
1.17	Ensure that all unused spaces in DB are blanked off with blank covers	
1.18	Ensure buss bar terminations do a visual check for any hotspots and report	
1.19	Check all electrical components for hot spots & repair & report in writing	
1.20	Ensure insulators are not cracked and report	
1.21	Check circuit breakers for mechanical operation and report	
1.22	Ensure correct rated fuses in fuse switches	
1.23	Ensure that there are fire barriers in the cable shafts and that they are in a good condition	
1.24	Check condition of cable fixing to supports, ladders and/or trays	
1.25	Check earth cable connection is present (not stolen and/or removed). Report immediately to WCGHW Engineering and Facility Manager. Replace with Kwena earth cable.	
2	GENERAL	
2.1	Ensure workplace is tidy when inspection is completed	
2.2	Complete 'PREVENTIVE MAINTENANCE SERVICE SHEET' when finished	
2.3	Check general condition of DB rooms for good housekeeping and safety compliance	

**WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00**

2026-02-06

1)..... 2).....
SIGNED SIGNED

I certify that the above test/maintenance has been carried out

Artisan

Date

Contractor

Date

ANNEXURE B

ASSET REGISTER

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

Metro North									
No	Facility	Facility Type	Capacity (kVA)	Make	Year Model	Geographical Area	Facility HUB	Contact person	Contact Number
1	Bellville W/S	Spare (GS18)	12	Kohler	2015	BMW	Metro North	Gawain Willemse	081 864 9119
2	Bellville W/S	Spare (GS78)	33	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
3	Bellville W/S	Spare	22	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
4	Bellville W/S	Spare (GS28)	20	ADE	1984	BMW	Metro North	Gawain Willemse	081 864 9119
5	Bellville W/S	Trailer (GS197)	22	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
6	Bellville W/S	Spare (GS206)	22	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
7	Bellville W/S	Spare (GS218)	16	Perkins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
8	Bellville W/S	Spare (GS79)	16	Perkins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
9	Bellville W/S	Spare (GS134)	30	Hu Dong		BMW	Metro North	Gawain Willemse	081 864 9119
10	Bellville W/S	Spare	100	GM Detroit		BMW	Metro North	Gawain Willemse	081 864 9119
11	Bellville W/S	Spare (GS185)	100	Volvo Penta	2006	BMW	Metro North	Gawain Willemse	081 864 9119
12	Bellville W/S	Spare (GS148)	150	Deutz Ex-Saltriver		BMW	Metro North	Gawain Willemse	081 864 9119
13	Bellville W/S	Spare (GS242)	60	Perkins		BMW	Metro North	Gawain Willemse	081 864 9119
14	Bellville W/S	Spare	20	ADE X	1984	BMW	Metro North	Gawain Willemse	081 864 9119
15	Bellville W/S	Spare	150	John Deere Ex-Brooklyn		BMW	Metro North	Gawain Willemse	081 864 9119
16	Bellville W/S	Spare (GS154)	50	Deutz Ex-Touwsriver		BMW	Metro North	Gawain Willemse	081 864 9119
17	Bellville W/S	Spare (GS241)	250	Scania	2015	BMW	Metro North	Gawain Willemse	081 864 9119
18	Bellville W/S	Spare (GS53)	150	Mitsubishi	1994	BMW	Metro North	Gawain Willemse	081 864 9119
19	Booth Memorial	Hospital (GS85)	220	Komatsu	1994	BMW	Metro North	Yazeed Oosthuizen	074 429 1156
20	Brackengate	Hospital (GS233)	350	Scania	2015	BMW	Metro North	Gawain Willemse	081 864 9119
21	Brooklyn Chest	Hospital (GS88)	450	Volvo Penta	2015	BMW	Metro North	Cecil Van Houten	021 508 8333
22	Brooklyn Chest	Hospital (GS155)	315/250	Rolls Royce	1966	BMW	Metro North	Cecil Van Houten	021 508 8333
23	Du Noon	CHC (GS178)	200	John Deere	2015	BMW	Metro North	Gawain Willemse	081 864 9119
24	Eerste River	Hospital (GS93)	450	Volvo Penta	2009	BMW	Metro North	Ismael Karriem	076 685 0206

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

25	Elsies River	CHC (GS202)	200	Volvo Penta	2015	BMW	Metro North	Dewan Bosman	076 313 9101
26	Fisantekraal	CDC (GS224)	150	Iveco	2021	BMW	Metro North	Gawain Willemse	081 864 9119
27	Goodwood	Non-Clinical (GS12)	50	Deutz	1984	BMW	Metro North	Ken Lutchman	021 591 7126
28	Hope Street	Dental (GS33)	100	Volvo Penta	2006	BMW	Metro North	Str Windt	021 467 4017
29	Karl Bremer	Hospital (GS14)	500	Volvo Penta	2006	BMW	Metro North	Gawain Willemse	081 864 9119
30	Karl Bremer	Nurses Home (GS01)	250	Dorman	1969	BMW	Metro North	Gawain Willemse	081 864 9119
31	Karl Bremer	Lab (GS110)	42.5	Ford	1981	BMW	Metro North	Gawain Willemse	081 864 9119
32	Karl Bremer	Health Park Office (GS147)	315	John Deere	2016	BMW	Metro North	Gawain Willemse	081 864 9119
33	Klapmuts	Clinic (GS99A)	22	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
34	Kleinvelei	CDC (GS40)	90	Cummins	1994	BMW	Metro North	Moosa Vister	084 403 0501
35	Kraaifontein	CDC (GS21)	90	Deutz	1981	BMW	Metro North	Gawain Willemse	081 864 9119
36	O & P Centre	Non-Clinical (GS36)	50	Komatsu	1990	BMW	Metro North	Rushdi Noordien	076 5403860
37	Ruyterwacht	CDC (GS67A)	33	Cummins	2015	BMW	Metro North	Gawain Willemse	081 864 9119
38	Somerset	Hospital (GS150)	500	Scania	2015	BMW	Metro North	Alf Challis	072 970 9119
39	Somerset	Hospital (GS151)	500	Scania	2015	BMW	Metro North	Alf Challis	072 970 9119
40	Somerset	Hospital (GS152)	400	MAN	1994	BMW	Metro North	Alf Challis	072 970 9119
41	Tygerberg	U2 Building (GS194)	33	Cummins	2015	BMW	Metro North	Elthen Frasenbourg	071 212 5895
42	Tygerberg	Collage (GS13)	150	Scania	2004	BMW	Metro North	Koos Nel	084 444 9950
43	Tygerberg	Laundry (GS149)	550	Yanmar		BMW	Metro North	Elthen Frasenbourg	071 212 5895
44	Tygerberg	FPL (GS10)	90	MAN	1984	BMW	Metro North	Stephen Cloete	083 207 6084
45	Tygerberg	CDU (GS239)	70	Cummins	1984	BMW	Metro North	Elthen Frasenbourg	071 212 5895
46	Scottsdene	CHC (GS228)	50	FAW		BMW	Metro North	Asive Sasa	063 184 3713

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

Metro East									
No	Facility	Facility Type	Capacity (kVA)	Make	Year Model	Geographical Area	Facility HUB	Contact person	Contact Number
47	Athlone WCCN	Non-Clinical (GS144)	500	Volvo Penta	2006	Metro East	Metro East	Moosa Vister	084 403 0501
48	Bishop Lavis	CHC (GS09)	90	Deutz	1981	Metro East	Metro East	Moosa Vister	084 403 0501
49	Cross Roads	CDC (GS172)	60	Perkins Lovol	2008	Metro East	Metro East	Moosa Vister	084 403 0501
50	Delft	CHC	90	Deutz	2004	Metro East	Metro East	Moosa Vister	084 403 0501
51	Gugulethu	CHC (GS60)	90	Cummins	1994	Metro East	Metro East	Moosa Vister	084 403 0501
52	Heideveld	CDC (GS22)	90	MAN	1994	Metro East	Metro East	Moosa Vister	084 403 0501
53	Heideveld	CDC (GS189)	180	Cummins	2014	Metro East	Metro East	Moosa Vister	084 403 0501
54	Helderberg	Hospital (GS163)	350	Rolls Royce	1966	Metro East	Metro East	Dewald Geldenhuys	073 552 1895
55	Helderberg	Hospital (GS196)	450	Perkins	2015	Metro East	Metro East	Dewald Geldenhuys	073 552 1895
56	Inzame Zabantu	CDC (GS179)	50	Ford		Metro East	Metro East	Moosa Vister	084 403 0501
57	Khayelitsha	Hosp Fire pump	100	John Deere	2010	Metro East	Metro East	Nkosana Bavuma	081 333 4525
58	Khayelitsha Michael-M	CHC (GS61)	200	Volvo Penta	2006	Metro East	Metro East	Nkosana Bavuma	081 333 4525
59	Khayelitsha EMS	EMS (GS112)	75	Cummins	2007	Metro East	Metro East	Nkosana Bavuma	081 333 4525
60	Khayelitsha Hosp	Hospital (GS104)	800	Perkins	2010	Metro East	Metro East	Nkosana Bavuma	081 333 4525
61	Khayelitsha Hosp	Hospital (GS105)	800	Perkins	2010	Metro East	Metro East	Nkosana Bavuma	081 333 4525
62	Khayelitsha Site B	CHC (GS37)	200	Cummins	1994	Metro East	Metro East	Nkosana Bavuma	081 333 4525
63	Lentegeur H	Ward 78 (GS107)	50	Iveco	2008	Metro East	Metro East	Moosa Vister	084 403 0501
64	Lentegeur H	Ward 80 (GS100)	100	Volvo Penta	2006	Metro East	Metro East	Moosa Vister	084 403 0501
65	Lentegeur H	Ward 104 (GS102)	50	Iveco	2006	Metro East	Metro East	Moosa Vister	084 403 0501
66	Lentegeur H	Aquarius (GS51)	100	John Deere	2010	Metro East	Metro East	Moosa Vister	084 403 0501
67	Lentegeur H	Magnolia (GS27)	100	Volvo Penta	2006	Metro East	Metro East	Moosa Vister	084 403 0501
68	Lentegeur H	Admin (GS164)	200	GM Detroit		Metro East	Metro East	Moosa Vister	084 403 0501
69	Lentegeur H	Laundry (GS164)	500	Scania	2015	Metro East	Metro East	Moosa Vister	084 403 0501

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

70	Lentegeur H	Conference centre (GS131)	250	Scania	2015	Metro East	Metro East	Moosa Vister	084 403 0501
71	Lentegeur H	Ward 16 (GS106)	50	Iveco	2008	Metro East	Metro East	Moosa Vister	084 403 0501
72	Lentegeur H	WC: Rehab (GS146)	100	Volvo Penta	2006	Metro East	Metro East	Moosa Vister	084 403 0501
73	Lentegeur H	EMS (GS107)	50	Iveco	2006	Metro East	Metro East	Koos Nel	084 444 9950
74	Macassar	CDC (GS34)	50	Cummins	1994	Metro East	Metro East	Moosa Vister	084 403 0501
75	Mfuleni	CDC (GS221)	150	Kirloskar	2015	Metro East	Metro East	Moosa Vister	084 403 0501
76	Mitchell's Plain	CHC (GS159)	220	Volvo Penta	2009	Metro East	Metro East	Moosa Vister	084 403 0501
77	Mitchell's Plain	Hospital (GS157)	625	MTU	2011	Metro East	Metro East	Abduragmaan Achmat	084 773 6243
78	Mitchell's Plain	Hospital (GS158)	625	MTU	2011	Metro East	Metro East	Abduragmaan Achmat	084 773 6243
79	Nomzamo	CDC (GS52)	125	Deutz	2015	Metro East	Metro East	Moosa Vister	084 403 0501
80	Stellenbosch	Hospital (GS196)	400	Scania	2017	Metro East	Metro East	Redginald Rooi	065 813 2004
81	Stellenbosch: Cloeteville	CDC (GS41)	60	Cummins	1984	Metro East	Metro East	Redginald Rooi	065 813 2004
82	Stikland	Psychology / Euro (GS32)	100	Volvo Penta	2006	Metro East	Metro East	Deon Polliandi	073 990 8505
83	Stikland	Admin (GS42)	50	Ford	1984	Metro East	Metro East	Deon Polliandi	073 990 8505
84	Stikland	Kitchen (GS66)	150	Cummins	1984	Metro East	Metro East	Deon Polliandi	073 990 8505
85	Stikland	Nursing Home	50	Iveco	2007	Metro East	Metro East	Deon Polliandi	073 990 8505
86	Stikland	New Beginnings (GS45A)	125	John Deere		Metro East	Metro East	Deon Polliandi	073 990 8505
87	Symphony Way	CDC (GS186)	150	Perkins Lovol	2013	Metro East	Metro East	Moosa Vister	084 403 0501

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1) _____ 2) _____
SIGNED SIGNED

Metro West									
No	Facility	Facility Type	Capacity (kVA)	Make	Year Model	Geographical Area	Facility HUB	Contact person	Contact Number
88	Alexandra	Ward 3 to 8 (GS69)	100	Volvo Penta	2006	Metro West	Metro West	Jody Petersen	071 353 7226
89	Alexandra	Kitchen (GS87)	265	CAT	2000	Metro West	Metro West	Jody Petersen	071 353 7226
90	Alexandra	Wards 1,2, Pharmacy, Admin (GS68)	315	Scania	2000	Metro West	Metro West	Jody Petersen	071 353 7226
91	Alexandra	Ward 9 to 16 (GS199)	160	GM Detroit	1981	Metro West	Metro West	Jody Petersen	071 353 7226
92	District Six	CDC (GS237)	500	Volvo Penta	2018	Metro West	Metro West	Dewan Bosman	076 313 9101
93	DP Marais	Hospital (GS62)	200	Volvo Penta	2012	Metro West	Metro West	Dewan Bosman	076 313 9101
94	Dr. Abdurahman	CDC (GS214)	22	Kohler	2015	Metro West	Metro West	Moosa Vister	084 403 0501
95	False Bay	Hospital (GS145)	250	John Deere	2014	Metro West	Metro West	Fabian Dixon	076 176 4076
96	Grassy Park	CDC (GS24)	63	Perkins	2011	Metro West	Metro West	Dewan Bosman	076 313 9101
97	Hanover Park	CHC (GS156)	50	Cummins	1984	Metro West	Metro West	Dewan Bosman	076 313 9101
98	Lady Michaelis	CDC (GS25)	100	Lovol	1960	Metro West	Metro West	Dewan Bosman	076 313 9101
99	Lotus River	CDC (GS29)	50	Deutz	1984	Metro West	Metro West	Dewan Bosman	076 313 9101
100	Maitland Cottage	Hospital (GS132)	50	Deutz	1982	Metro West	Metro West	Miss Koen	021 674 2090
101	Mowbray Maternity	Hospital (GS160)	630	MAN	2003	Metro West	Metro West	Kamona Mubita	021 659 5582
102	Observatory	FPL (GS232)	830	Perkins	2021	Metro West	Metro West	Steven Cloete	083 207 6084
103	Pinelands	CDC Trailer (GS221)	350	Scania	1984	Metro West	Metro West	Garry Walker	082 487 2532
104	Pinelands	Trailer (GS180)	60	Perkins		Metro West	Metro West	Garry Walker	082 487 2532
105	Pinelands	EMS (GS161)	140	GM Detroit		Metro West	Metro West	Garry Walker	082 487 2532
106	Red Cross Sub-A	Hospital (GS142)	214	Volvo Penta	2008	Metro West	Metro West	Kimesh Chauhan	073 942 0552

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

107	Red Cross Sub-B	Hospital (GS141)	400	Scania	2007	Metro West	Metro West	Kimesh Chauhan	073 942 0552
108	Red Cross Sub-C	Hospital (GS139)	500	Volvo Penta	2015	Metro West	Metro West	Kimesh Chauhan	073 942 0552
109	Retreat	CHC (GS227)	180	John Deere	1984	Metro West	Metro West	Dewan Bosman	076 313 9101
110	Valkenberg H	Ward 11 (GS54)	20	ADE	1984	Metro West	Metro West	Willie Roos	082 482 3014
111	Valkenberg H	Ward 4 (GS119)	50	Iveco	2008	Metro West	Metro West	Willie Roos	082 482 3014
112	Valkenberg H	Education (GS117)	50	Iveco	2008	Metro West	Metro West	Willie Roos	082 482 3014
113	Valkenberg H	Kitchen (GS116)	100	Volvo Penta	2008	Metro West	Metro West	Willie Roos	082 482 3014
114	Valkenberg H	Ward 20 (GS121)	60	Ford	2006	Metro West	Metro West	Willie Roos	082 482 3014
115	Valkenberg H	Admissions (GS118)	100	Perkins	2008	Metro West	Metro West	Willie Roos	082 482 3014
116	Valkenberg H	Ward 1 (GS04)	20	ADE	1984	Metro West	Metro West	Willie Roos	082 482 3014
117	Valkenberg H	Admin (GS191)	500	Volvo Penta	2018	Metro West	Metro West	Willie Roos	082 482 3014
118	Vanguard	CHC (GS17)	100	Volvo Penta		Metro West	Metro West	Dewan Bosman	076 313 9101
119	Victoria	Hospital (GS15)	500	Volvo Penta	2021	Metro West	Metro West	Jean-Pierre Mozes	084 805 4712
120	Victoria	Hospital (GS234)	500	Iveco (FPT)	2021	Metro West	Metro West	Jean-Pierre Mozes	084 805 4712

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

REQUIRED BY DIRECTORATE:
WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

West Coast									
No	Facility	Facility Type	Capacity (kVA)	Make	Year Model	Geographical Area	Facility HUB	Contact person	Contact Number
121	Citrusdal	Hospital (GS124)	150	Rolls Royce	1980	West Coast	Vredendal	Elroy Luskam	022-921 2153
122	Citrusdal	Clinic (GS212)	22	Cummins	1984	West Coast	Vredendal	Elroy Luskam	022-921 2153
123	Clanwilliam	Hospital (GS43)	110	Yanmar	1984	West Coast	Vredendal	Joseph Martins	073 016 6574
124	Clanwilliam	Clinic (GS216)	16	Kohler	2015	West Coast	Vredendal	Joseph Martins	073 016 6574
125	Gouda	Clinic (GS77)	33	Cummins	2015	West Coast	Swartland	Imraan Daniels	081 553 0758
126	Huis Macrone (Wellington)	Clinic (GS138)	60	Cummins	1984	West Coast	Paarl	Imraan Daniels	081 553 0758
127	Klawer	Clinic (GS209)	33	Cummins	2015	West Coast	Vredendal	Albertus Rossouw	066 238 2411
128	Lamberts Bay	Clinic/EMS (GS169)	50	Ford	1984	West Coast	Vredendal	Joseph Martins	073 016 6574
129	Malmsbury CDC	CDC (GS129)	125	John Deere	2012	West Coast	Swartland	Collin Vermaak	073 163 3446
130	Mamre	CDC (GS215)	33	Cummins	2015	West Coast	Swartland	Ricardo Cupido	067 614 2005
131	Moorreesburg	Clinic (GS76)	33	Cummins	2015	West Coast	Swartland	Collin Vermaak	073 163 3446
132	Paarl	EMS (GS208)	16	Kohler	2015	West Coast	Paarl	Koos Nel	084 444 9950
133	Paarl	Hospital (GS140)	800	Perkins	2010	West Coast	Paarl	Greg Abrahams	073 255 3246
134	Paarl	Hospital (GS166)	800	Perkins	2009	West Coast	Paarl	Greg Abrahams	073 255 3246
135	Paarl	FPL (GS99)	135	Cummins	2010	West Coast	Paarl	Stephen Cloete	083 207 6084
136	Paarl: Sonstraal	Hospital (GS190)	200	John Deere	2008	West Coast	Paarl	Herchel Siegelaar	082 384 4075
137	Piketberg	Hospital (GS162)	50	Deutz	1979	West Coast	Swartland	Colin Vermaak	073 163 3446
138	Piketberg	EMS (GS203)	12	Kohler	2015	West Coast	Swartland	Colin Vermaak	073 163 3446
139	Piketberg	Clinic (GS204)	22	Kohler	2015	West Coast	Swartland	Colin Vermaak	073 163 3446
140	Porterville	Hospital (GS130)	50	Deutz	1979	West Coast	Swartland	Colin Vermaak	073 163 3446
141	Swartland	Hospital (GS186)	350	Yanmar		West Coast	Swartland	Colin Vermaak	073 163 3446
142	Swartland	FPL (GS128)	135	Cummins	2009	West Coast	Swartland	Stephen Cloete	083 207 6084
143	TC Newman	CDC (GS114)	380	Volvo Penta	2011	West Coast	Paarl	Imraan Daniels	081 553 0758
144	Velddrif	Clinic (GS207)	30	John Deere	2018	West Coast	Swartland	Colin Vermaak	073 163 3446
145	Vredenburg	Hospital (GS182)	500	Perkins	1981	West Coast	Vredenburg	Joseph Martins	073 016 6574

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

146	Vredenburg	Hospital (GS168)	500	Perkins	2015	West Coast	Vredenburg	Joseph Martins	073 016 6574
147	Vredendal	Hospital (GS219)	200	Volvo Penta	2015	West Coast	Vredendal	Bertus Rossouw	066 238 2411
148	Vredendal	EMS (GS03)	25	ADE	1984	West Coast	Vredendal	Koos Nel	084 444 9950
149	Vredendal	FPL (GS157)	50	Perkins		West Coast	Vredendal	Stephen Cloete	083 207 6084
150	Wellington	CDC (GS144)	160	Volvo Penta	2007	West Coast	Paarl	Imraan Daniels	081 553 0758
151	Wellington: Mbekweni	CDC (GS08)	50	Ford	1984	West Coast	Paarl	Imraan Daniels	081 553 0758
152	Wesfleur	Hospital (GS11)	350	GM Detroit	1981	West Coast	Swartland	Ricardo Cupido	067 614 2005

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

2026-02-06

1)..... 2).....
SIGNED SIGNED

Winelands/Overberg									
No	Facility	Facility Type	Capacity (kVA)	Make	Year Model	Geographical Area	Facility HUB	Contact person	Contact Number
153	Barrydale	Clinic (GS67A)	33	Cummins	2015	Overberg	Swellendam	Tyrone De Wett	082 323 9640
154	Botrivier	Clinic/EMS (GS78)	16	Perkins	2015	Overberg	Caledon	Eric Le Keur	072 214 0306
155	Bredasdorp	Hospital (GS19)	100	Iveco	2011	Overberg	Caledon	Lusanus Finnes	071 081 5408
156	Brewelskloof	Hospital (GS181)	500	Scania		Winelands	Worcester	Christo van der Westhuizen	083 430 4714
157	Caledon	Hospital (GS231)	315	Perkins/Rolls	1980	Overberg	Caledon	Eric Le Keur	072 214 0306
158	Caledon	Clinic (GS212)	22	Cummins	2015	Overberg	Caledon	Eric Le Keur	072 214 0306
159	Ceres	Hospital (GS123)	250	John Deere	2011	Winelands	Worcester	Clint Gabriels	073 461 8653
160	Ceres - Nduli	Clinic (GS201)	16	Kohler	2015	Winelands	Worcester	Clint Gabriels	073 461 8653
161	Cogmanskloof (Ashton)	Clinic (GS210)	22	Cummins	2015	Winelands	Worcester	Mouton Van Eeden	081 4626751
162	Eben Donges	Hospital (GS176)	1100	CAT	2010	Winelands	Worcester	Christo van der Westhuizen	083 430 4714
163	Eben Donges	Hospital (GS175)	1000	CAT 3508	2004	Winelands	Worcester	Christo van der Westhuizen	083 430 4714
164	Gansbaai	Clinic (GS71)	22	Cummins	2015	Overberg	Caledon	Moosa Vister	084 403 0501
165	Grabouw	CHC (GS47)	130	John Deere	2010	Overberg	Caledon	Eric Le Keur	072 214 0306
166	Hawston	Clinic (GS96)	22	Cummins	2015	Overberg	Caledon	Moosa Vister	084 403 0501
167	Hermanus	Hospital (GS193)	250	Volvo Penta	2008	Overberg	Caledon	Moosa Vister	084 403 0501

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

168	Hermanus	CDC (GS133)	100	Volvo Penta	2013	Overberg	Caledon	Moosa Vister	084 403 0501
169	Hermanus	FPL (GS39)	100	Volvo Penta	2013	Overberg	Caledon	Moosa Vister/ Stephen Cloete	084 403 0501/ 083 207 6084
170	Montagu	Hospital (GS44)	100	Volvo (Ex-Bredasdorp)	1981	Winelands	Worcester	Mouton van Eden	081 4626751
171	Op Die Berg (Ceres)	Clinic (GS82)	22	Cummins	2015	Winelands	Worcester	Clint Gabriels	073 461 8653
172	Riviersonderend	Clinic/EMS (GS217)	22	Cummins	2015	Overberg	Caledon	Koos Nel	084 444 9950
173	Robertson	Hospital (GS49)	250	John Deere	1980	Winelands	Worcester	Mouton Van Eeden	081 4626751
174	Robertson (Bergsig)	Clinic (GS83)	33	Cummins	2015	Winelands	Worcester	Mouton Van Eeden	081 4626751
175	Swellendam	EMS (GS211)	16	Kohler	2015	Overberg	Swellendam	Koos Nel	084 444 9950
176	Swellendam	Hospital (GS126)	90	Perkins	2004	Overberg	Swellendam	Tyrone De Wett	082 323 9640
177	Touws River	Clinic/EMS (GS55)	50	Deutz	1984	Winelands	Worcester	Christo van der Westhuizen	083 430 4714
178	Tulbagh	EMS (GS196)	16	Kohler	2015	Winelands	Worcester	Koos Nel	084 444 9950
179	Worcester	FPL (GS184)	135	Cummins	2007	Winelands	Worcester	Stephen Cloete	083 207 6084
180	Worcester	CDC (GS171)	50	Ford	1984	Winelands	Worcester	Christo van der Westhuizen	083 430 4714
181	Worcester	EMS (GS16)	150	Volvo Penta	2011	Winelands	Worcester	Koos Nel	084 444 9950

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

ANNEXURE C

PRICING SCHEDULES

Note: Please ensure that your costing is correct as corrections cannot be made after bid closing. Note – **Failure to price all items in the pricing schedules will disqualify your bid.**

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

		2026-02-06		Metro North -AREA A					
		1)..... SIGNED	2)..... SIGNED		Minor Service		Major Service		Total as on Date of Tender
No	Facility	Facility Type	Capacity (kVA)	Make	Rate / Service	Total Minor Services X 4	Rate/ Service	Total Major Services X 3	For all services in the 36-month period. 4x minor & 3x major
1	Bellville W/S	Spare (GS18)	12	Kohler	R	R	R	R	R
2	Bellville W/S	Spare (GS78)	33	Cummins	R	R	R	R	R
3	Bellville W/S	Spare	22	Cummins	R	R	R	R	R
4	Bellville W/S	Spare (GS28)	20	ADE	R	R	R	R	R
5	Bellville W/S	Trailer (GS197)	22	Cummins	R	R	R	R	R
6	Bellville W/S	Spare (GS206)	22	Cummins	R	R	R	R	R
7	Bellville W/S	Spare (GS218)	16	Perkins	R	R	R	R	R
8	Bellville W/S	Spare (GS79)	16	Perkins	R	R	R	R	R
9	Bellville W/S	Spare (GS134)	30	Hu Dong	R	R	R	R	R
10	Bellville W/S	Spare	100	GM Detroit	R	R	R	R	R
11	Bellville W/S	Spare (GS185)	100	Volvo Penta	R	R	R	R	R
12	Bellville W/S	Spare (GS148)	150	Deutz Ex- Saltriver	R	R	R	R	R

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

13	Bellville W/S	Spare (GS242)	60	Perkins	R	R	R	R	R
14	Bellville W/S	Spare	20	ADE X	R	R	R	R	R
15	Bellville W/S	Spare	150	John Deere Ex-Brooklyn	R	R	R	R	R
16	Bellville W/S	Spare (GS154)	50	Deutz Ex-Touwsriver	R	R	R	R	R
17	Bellville W/S	Spare (GS241)	250	Scania	R	R	R	R	R
18	Bellville W/S	Spare (GS53)	150	Mitsubishi	R	R	R	R	R
19	Booth Memorial	Hospital (GS85)	220	Komatsu	R	R	R	R	R
20	Brackengate	Hospital (GS233)	350	Scania	R	R	R	R	R
21	Brooklyn Chest	Hospital (GS88)	450	Volvo Penta	R	R	R	R	R
22	Brooklyn Chest	Hospital (GS155)	315/250	Rolls Royce	R	R	R	R	R
23	Du Noon	CHC (GS178)	200	John Deere	R	R	R	R	R
24	Eerste River	Hospital (GS93)	450	Volvo Penta	R	R	R	R	R
25	Elsies River	CHC (GS202)	200	Volvo Penta	R	R	R	R	R
26	Fisantekraal	CDC (GS224)	150	Iveco	R	R	R	R	R
27	Goodwood	Non-Clinical (GS12)	50	Deutz	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

28	Hope Street	Dental (GS33)	100	Volvo Penta	R	R	R	R	R
29	Karl Bremer	Hospital (GS14)	500	Volvo Penta	R	R	R	R	R
30	Karl Bremer	Nurses Home (GS01)	250	Dorman	R	R	R	R	R
31	Karl Bremer	Lab (GS110)	42.5	Ford	R	R	R	R	R
32	Karl Bremer	Health Park Office (GS147)	315	John Deere	R	R	R	R	R
33	Klapmuts	Clinic (GS99A)	22	Cummins	R	R	R	R	R
34	Kleinvele	CDC (GS40)	90	Cummins	R	R	R	R	R
35	Kraaifontein	CDC (GS21)	90	Deutz	R	R	R	R	R
36	O & P Centre	Non-Clinical (GS36)	50	Komatsu	R	R	R	R	R
37	Ruyterwacht	CDC (GS67A)	33	Cummins	R	R	R	R	R
38	Somerset	Hospital (GS150)	500	Scania	R	R	R	R	R
39	Somerset	Hospital (GS151)	500	Scania	R	R	R	R	R
40	Somerset	Hospital (GS152)	400	MAN	R	R	R	R	R
41	Tygerberg	U2 Building (GS194)	33	Cummins	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

42	Tygerberg	Collage (GS13)	150	Scania	R	R	R	R	R
43	Tygerberg	Laundry (GS149)	550	Yanmar	R	R	R	R	R
44	Tygerberg	FPL (GS10)	90	MAN	R	R	R	R	R
45	Tygerberg	CDU (GS239)	70	Cummins	R	R	R	R	R
46	Scottsdale	CHC (GS228)	50	FAW	R	R	R	R	R

Provisional: Generators that could possibly be added to this the area during contract period. Quantities, make and models may vary from below and will be adjusted accordingly

	Metro North	Clinic/FPL	50	Iveco	R	R	R	R	R
	Metro North	Clinic/FPL	50	Cummins	R	R	R	R	R
	Metro North	CDC/CDC	100	Volvo	R	R	R	R	R
	Metro North	Hospital	350	Scania	R	R	R	R	R

Metro North: Total for all services for the period of 36 Months carried forward to Combined Price Schedule for Metro North - page 73

R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro North Pricing Schedule: Callouts and Spares.					
Item	Description	Unit	Qty	Rate	Submitted Price / Offer
EQUIPMENT COST					
	The supplier shall discount all lead levies payable and shall treat all batteries to be priced below as replacements.			R	R
A.1	Supply, install and connect to controller, VDO low coolant level sensor	Each	15	R	R
A.2	Supply and install 12V 105 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE.	Each	38	R	R
A.3	Supply and install 12V 120 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	25	R	R
A.4	Supply and install 12V 150 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	20	R	R
A.5	Supply and install 12V 180 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	6	R	R
A.6	Supply and install 12V 220 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	6	R	R
A.7	Supply and install 12V 7 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.8	Supply and install 12V 18 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

A.9	Supply and install 12V 24 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.10	Supply and install 12V 100 Ah deep cycle flooded lead acid battery and maintenance free. Design life: 5 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 250 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.11	Supply and install 12V 120 Ah deep cycle Absorbent Glass Mat (AGM) maintenance free. Design life: 10 years in standby service @ 25°C Eurobat (20°C): >12 years. 400 Cycles to 50% Depth of Discharge (DOD)	Each	20	R	R
A.12	Supply, install and commission 12V charger as specified	Each	6	R	R
A.13	Supply, install and commission 24V charger as specified	Each	6	R	R
A.14	Supply, install and commission Deep Sea Model 7310 auto start control module	Each	8	R	R
A.15	Supply, install and commission Deep Sea Model 7320 auto start control module	Each	8	R	R
A.16	Supply, install and commission of heater element in standby generator alternator – Generator size 500 kVA or smaller	Each	42	R	R
A.17	Supply, install and commission of 2 X heater elements in standby generator alternator – Generator size 500 kVA or larger.	Each	4	R	R
	DRAIN AND FLUSH ALL RADIATORS WITH WATER UNTIL CLEAN AND FILL WITH CUMMINS ES COMPLETE 50/50 OR EQUALLY APPROVED (50% ETHYLENE GLYCOL PREMIX AT CORRECT PH) RADIATOR FLUID AS PER MANUFACTURER RECOMMENDATION FOR ALL STANDBY GENERATORS LISTED ABOVE FOR THIS				

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

	REGION WHEN INSTRUCTED BY THE EMPLOYER				
A.18	Price for estimated radiator fluid mix to be replaced during the contract period inclusive of top-ups	l	2500	R	R
A.19	Labour to drain, flush, clean & replace radiator fluid for 46 listed standby generators	Lot	-	R	R
CALL OUT FEES					
B.1	Call out rates: Normal hours (includes first half and hour on site)	Each	45	R	R
B.2	Travelling cost (Travelling as measured from Karl Bremer Hospital for emergency and breakdown repairs. Travelling to include travel, labour hours, fuel, wear and tear, etc)	km	4000	R	R
RENTAL COSTS					
C.1	Crane truck rental per hr – 5 ton	per/hour	63	R	R
C.3	Crane truck rental per km – 5 ton	rate/km	1000	R	R
C.3	Crane truck rental per hr – 10 ton	per/hour	50	R	R
C.4	Crane truck rental per km – 10 ton	rate/km	400	R	R
LABOUR RATES					
D.1	Normal hours - Foreman	rate/hour	500	R	R
D.2	After hours & Saturdays - Foreman	rate/hour	8	R	R
D.3	Public Holidays & Sundays - Foreman	rate/hour	16	R	R
D.4	Normal hours - Artisan	rate/hour	1000	R	R
D.5	After hours & Saturdays - Artisan	rate/hour	25	R	R
D.6	Public Holidays & Sundays - Artisan	rate/hour	25	R	R
D.7	Normal hours - Unqualified Artisan	rate/hour	500	R	R
D.8	After hours & Saturdays - Unqualified Artisan	rate/hour	8	R	R
D.9	Public Holidays & Sundays - Unqualified Artisan	rate/hour	8	R	R
D.10	Normal hours - Assistant	rate/hour	1000	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

D.11	After hours & Saturdays - Assistant	rate/ hour	25	R	R
D.12	Public Holidays & Sundays - Assistant	rate/ hour	25	R	R
STANDARD COSTS					
E.1	Allowance for S&T and Sleep Out accommodation for repairs outside 200km radius from Karl Bremer Hospital. Invoices to be supplied as proven cost with claim	item	item	NO FILL	R10 000.00
E.2	Allowance for diesel tank repairs and corrosion protection and painting of corroded surfaces. Material and labour based items	item	item	NO FILL	R150 000.00
E.3	Estimate: Spares for repairs proven cost Item (allowance only) all spares for servicing included in service price	item	item	NO FILL	R300 000.00
E.4	Percentage mark-up on spares (max mark-up allowed 15%)	%	0.15	NO FILL	R45 000.00
Metro North: Total Price for call outs and spares carried forward to Combined Price Schedule for Metro North- page 73					R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro North Combined Pricing Schedule:		
		Sub Totals from above
A	Total price for all services for the period of 36 months	R
B	Total price for call outs and spares	R
	Metro North: Sub Total	R
	VAT	R
	Metro North: Total Price to be carried forward to Pricing Schedule page - 107 (VAT Inclusive)	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06					Metro East AREA-B				
1)..... SIGNED					Minor Service		Major Service		Total as on Date of Tender
No	Facility	Facility Type	Capacity (kVA)	Make	Rate / Service	Total Minor Services X 4	Rate/ Service	Total Major Services X 3	For all services in the 36-month period. 4x Minor & 3x Major
47	Athlone WCCN	Non-Clinical (GS144)	500	Volvo Penta	R	R	R	R	R
48	Bishop Lavis	CHC (GS09)	90	Deutz	R	R	R	R	R
49	Crossroads	CDC (GS172)	60	Perkins Lovol	R	R	R	R	R
50	Delft	CHC	90	Deutz	R	R	R	R	R
51	Gugulethu	CHC (GS60)	90	Cummins	R	R	R	R	R
52	Heideveld	CDC (GS22)	90	MAN	R	R	R	R	R
53	Heideveld	CDC (GS189)	180	Cummins	R	R	R	R	R
54	Helderberg	Hospital (GS163)	350	Rolls Royce	R	R	R	R	R
55	Helderberg	Hospital (GS196)	450	Perkins	R	R	R	R	R
56	Inzame Zabantu	CDC (GS179)	50	Ford	R	R	R	R	R
57	Khayelitsha	Hosp Fire pump	100	John Deere	R	R	R	R	R
58	Khayelitsha Michael-M	CHC (GS61)	200	Volvo Penta	R	R	R	R	R
59	Khayelitsha EMS	EMS (GS112)	75	Cummins	R	R	R	R	R

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

60	Khayelitsha Hosp	Hospital (GS104)	800	Perkins	R	R	R	R	R
61	Khayelitsha Hosp	Hospital (GS105)	800	Perkins	R	R	R	R	R
62	Khayelitsha Site B	CHC (GS37)	200	Cummins	R	R	R	R	R
63	Lentegeur H	Ward 78 (GS107)	50	Iveco	R	R	R	R	R
64	Lentegeur H	Ward 80 (GS100)	100	Volvo Penta	R	R	R	R	R
65	Lentegeur H	Ward 104 (GS102)	50	Iveco	R	R	R	R	R
66	Lentegeur H	Aquarius (GS51)	100	John Deere	R	R	R	R	R
67	Lentegeur H	Magnolia (GS27)	100	Volvo Penta	R	R	R	R	R
68	Lentegeur H	Admin (GS164)	200	GM Detroit	R	R	R	R	R
69	Lentegeur H	Laundry (GS164)	500	Scania	R	R	R	R	R
70	Lentegeur H	Conference centre (GS131)	250	Scania	R	R	R	R	R
71	Lentegeur H	Ward 16 (GS106)	50	Iveco	R	R	R	R	R
72	Lentegeur H	WC: Rehab (GS146)	100	Volvo Penta	R	R	R	R	R
73	Lentegeur H	EMS (GS107)	50	Iveco	R	R	R	R	R
74	Macassar	CDC (GS34)	50	Cummins	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

75	Mfuleni	CDC (GS221)	150	Kirloskar	R	R	R	R	R
76	Mitchell's Plain	CHC (GS159)	220	Volvo Penta	R	R	R	R	R
77	Mitchell's Plain	Hospital (GS157)	625	MTU	R	R	R	R	R
78	Mitchell's Plain	Hospital (GS158)	625	MTU	R	R	R	R	R
79	Nomzamo	CDC (GS52)	125	Deutz	R	R	R	R	R
80	Stellenbosch	Hospital (GS196)	400	Scania	R	R	R	R	R
81	Stellenbosch: Cloetesville	CDC (GS41)	60	Cummins	R	R	R	R	R
82	Stikland	Psychology / Euro (GS32)	100	Volvo Penta	R	R	R	R	R
83	Stikland	Admin (GS42)	50	Ford	R	R	R	R	R
84	Stikland	Kitchen (GS66)	150	Cummins	R	R	R	R	R
85	Stikland	Nursing Home	50	Iveco	R	R	R	R	R
86	Stikland	New Beginings (GS45A)	125	John Deere	R	R	R	R	R
87	Symphony Way	CDC (GS186)	150	Perkins Lovol	R	R	R	R	R

Provisional: Generators that could possibly be added to this the area during contract period. Quantities, make and models may vary from below and will be adjusted accordingly

	Metro East	Clinic/FPL	50	Cummins	R	R	R	R	R
--	------------	------------	----	---------	---	---	---	---	---

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

	Metro East	CDC/CHC	100	Iveco	R	R	R	R	R
	Metro East	CDC/CHC	250	John Deere	R	R	R	R	R
Metro East total for all services for the period of 36 months carried forward to Combined Price Schedule for Metro East - page 82									R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....

SIGNED

2).....

SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro East Pricing Schedule: Callouts and Spares.					
Item	Description	Unit	Qty	Rate	Submitted Price / Offer
EQUIPMENT COST					
	The supplier shall discount all lead levies payable and shall treat all batteries to be priced below as replacements.			R	R
A.1	Supply install and connect to controller, VDO low coolant level sensor	Each	13	R	R
A.2	Supply and install 12V 105 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE.	Each	33	R	R
A.3	Supply and install 12V 120 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	22	R	R
A.4	Supply and install 12V 150 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	18	R	R
A.5	Supply and install 12V 180 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	6	R	R
A.6	Supply and install 12V 220 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	6	R	R
A.7	Supply and install 12V 7 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.8	Supply and install 12V 18 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

A.9	Supply and install 12V 24 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.10	Supply and install 12V 100 Ah deep cycle flooded lead acid battery and maintenance free. Design life: 5 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 250 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.11	Supply and install 12V 120 Ah deep cycle Absorbent Glass Mat (AGM)maintenance free. Design life: 10 years in standby service @ 25°C Eurobat (20°C): >12 years. 400 Cycles to 50% Depth of Discharge (DOD)	Each	20	R	R
A.12	Supply, install and commission 12V charger as specified	Each	6	R	R
A.13	Supply, install and commission 24V charger as specified	Each	6	R	R
A.14	Supply, install and commission Deep Sea Model 7310 auto start control module	Each	7	R	R
A.15	Supply, install and commission Deep Sea Model 7320 auto start control module	Each	7	R	R
A.16	Supply, install and commission of heater element in standby generator alternator – generator size 500 kVA or smaller	Each	39	R	R
A.17	Supply, install and commission of 2 X heater elements in stand by generator alternator – generator size 500 kVA or larger.	Each	2	R	R
	DRAIN AND FLUSH ALL RADIATORS WITH WATER UNTIL CLEAN AND FILL WITH CUMMINS ES COMPLETE 50/50 OR EQUALLY APPROVED (50% ETHYLENE GLYCOL PREMIX AT CORRECT PH) RADIATOR FLUID AS PER MANUFACTURER RECOMMENDATION FOR ALL STANDBY GENERATORS LISTED ABOVE FOR THIS				

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

	REGION WHEN INSTRUCTED BY THE EMPLOYER				
A.18	Price for estimated radiator fluid mix to be replaced during the contract period inclusive of top-ups	l	2200	R	R
A.19	Labour to drain, flush clean & replace radiator fluid for 41 listed standby generators	Lot	-	R	R
CALL OUT FEES					
B.1	Call out rates: Normal hours (includes first half and hour on site as well as traveling as measured from Karl Bremer Hospital)	Each	40	R	R
B.2	Travelling cost (Travelling as measured from Karl Bremer Hospital for emergency and breakdown repairs. Travelling to include travel, labour hours, fuel, wear and tear, etc)	km	6000	R	R
RENTAL COSTS					
C.1	Crane truck rental per hr – 5 ton	per/ hour	56	R	R
C.3	Crane truck rental per km – 5 ton	rate/ km	1500	R	R
C.3	Crane truck rental per hr – 10 ton	per/ hour	35	R	R
C.4	Crane truck rental per km – 10 ton	rate/ km	800	R	R
LABOUR RATES					
D.1	Normal hours - Foreman	rate/ hour	440	R	R
D.2	After hours & Saturdays - Foreman	rate/ hour	8	R	R
D.3	Public Holidays & Sundays - Foreman	rate/ hour	16	R	R
D.4	Normal hours - Artisan	rate/ hour	890	R	R
D.5	After hours & Saturdays - Artisan	rate/ hour	22	R	R
D.6	Public Holidays & Sundays - Artisan	rate/ hour	22	R	R
D.7	Normal hours - Unqualified Artisan	rate/ hour	445	R	R
D.8	After hours & Saturdays - Unqualified Artisan	rate/ hour	8	R	R
D.9	Public Holidays & Sundays - Unqualified Artisan	rate/ hour	8	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

D.10	Normal hours - Assistant	rate/ hour	890	R	R
D.11	After hours & Saturdays - Assistant	rate/ hour	22	R	R
D.12	Public Holidays & Sundays - Assistant	rate/ hour	22	R	R
STANDARD COSTS					
E.1	Allowance for S&T and Sleep Out accommodation for repairs outside 200km radius from Karl Bremer Hospital. Invoices to be supplied as proven cost with claim	item	item	NO FILL	R8 900.00
E.2	Allowance for diesel tank repairs and corrosion protection and painting of corroded surfaces. Material and labour based items	item	item	NO FILL	R150 000.00
E.3	Estimate: Spares for repairs proven cost Item (allowance only) all spares for servicing included in service price	item	item	NO FILL	R300 000.00
E.4	Percentage mark-up on spares (max mark-up allowed 15%)	%	0.15	NO FILL	R45 000.00
Metro East: Total Price for call outs and spares carried forward to Combined Price Schedule for Metro East - page 82					R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro East Combined Pricing Schedule:		
		Sub Totals from above
A	Total price for all services for the period of 36 months	R
B	Total price for call outs and spares	R
	Metro East: Sub Total	R
	VAT at 15%	R
	Metro East: Total Price to be carried forward to Pricing Schedule - page 107 (VAT Inclusive)	R

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... SIGNED		2)..... SIGNED
--	--	-------------------

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

		2026-02-06		Metro West AREA -C					
		1)..... SIGNED	2)..... SIGNED			Minor Service	Major Service		Total as on Date of Tender
No	Facility	Facility Type	Capacity (kVA)	Make	Rate / Service	Total Minor Services X 4	Rate/ Service	Total Major Services X 3	For all services in the 36-month period. 4x Minor & 3x Major
88	Alexandra	Ward 3 to 8 (GS69)	100	Volvo Penta	R	R	R	R	R
89	Alexandra	Kitchen (GS87)	265	CAT	R	R	R	R	R
90	Alexandra	Wards 1,2, Pharmacy, Admin (GS68)	315	Scania	R	R	R	R	R
91	Alexandra	Ward 9 to 16 (GS199)	160	GM Detroit	R	R	R	R	R
92	District Six	CDC (GS237)	500	Volvo Penta	R	R	R	R	R
93	DP Marais	Hospital (GS62)	200	Volvo Penta	R	R	R	R	R
94	Dr. Abdurahman	CDC (GS214)	22	Kohler	R	R	R	R	R
95	False Bay	Hospital (GS145)	250	John Deere	R	R	R	R	R
96	Grassy Park	CDC (GS24)	63	Perkins	R	R	R	R	R
97	Hanover Park	CHC (GS156)	50	Cummins	R	R	R	R	R
98	Lady Michaelis	CDC (GS25)	100	Lovol	R	R	R	R	R

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

99	Lotus River	CDC (GS29)	50	Deutz	R	R	R	R	R
100	Maitland Cottage	Hospital (GS132)	50	Deutz	R	R	R	R	R
101	Mowbray Maternity	Hospital (GS160)	630	MAN	R	R	R	R	R
102	Observatory	FPL (GS232)	830	Perkins	R	R	R	R	R
103	Pinelands	CDC Trailer (GS221)	350	Scania	R	R	R	R	R
104	Pinelands	Trailer (GS180)	60	Perkins	R	R	R	R	R
105	Pinelands	EMS (GS161)	140	GM Detroit	R	R	R	R	R
106	Red Cross Sub-A	Hospital (GS142)	214	Volvo Penta	R	R	R	R	R
107	Red Cross Sub-B	Hospital (GS141)	400	Scania	R	R	R	R	R
108	Red Cross Sub-C	Hospital (GS139)	500	Volvo Penta	R	R	R	R	R
109	Retreat	CHC (GS227)	180	John Deere	R	R	R	R	R
110	Valkenberg H	Ward 11 (GS54)	20	ADE	R	R	R	R	R
111	Valkenberg H	Ward 4 (GS119)	50	Iveco	R	R	R	R	R
112	Valkenberg H	Education (GS117)	50	Iveco	R	R	R	R	R
113	Valkenberg H	Kitchen (GS116)	100	Volvo Penta	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

114	Valkenberg H	Ward 20 (GS121)	60	Ford	R	R	R	R	R
115	Valkenberg H	Admissions (GS118)	100	Perkins	R	R	R	R	R
116	Valkenberg H	Ward 1 (GS04)	20	ADE	R	R	R	R	R
117	Valkenberg H	Admin (GS191)	500	Volvo Penta	R	R	R	R	R
118	Vanguard	CHC (GS17)	100	Volvo Penta	R	R	R	R	R
119	Victoria	Hospital (GS15)	500	Volvo Penta	R	R	R	R	R
120	Victoria	Hospital (GS234)	500	Iveco (FPT)	R	R	R	R	R
Provisional: Generators that could possibly be added to this the area during contract period. Quantities, make and models may vary from below and will be adjusted accordingly									
	Metro West	Clinic/FPL	50	Iveco	R	R	R	R	R
	Metro West	CDC/CHC	100	Cummins	R	R	R	R	R
	Metro West	CDC/CHC	200	Volvo	R	R	R	R	R
Metro West total for all services for the period of 36 months carried forward to Combined Price Schedule for Metro West- page 90									R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro West Pricing Schedule: Callouts and Spares.					
Item	Description	Unit	Qty	Rate	Submitted Price / Offer
EQUIPMENT COST					
	The supplier shall discount all lead levies payable and shall treat all batteries to be priced below as replacements.			R	R
A.1	Supply, install and connect to controller, VDO low coolant level sensor	Each	11	R	R
A.2	Supply and install 12V 105 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE.	Each	29	R	R
A.3	Supply and install 12V 120 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	19	R	R
A.4	Supply and install 12V 150 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	15	R	R
A.5	Supply and install 12V 180 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	5	R	R
A.6	Supply and install 12V 220 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	5	R	R
A.7	Supply and install 12V 7 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.8	Supply and install 12V 18 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

A.9	Supply and install 12V 24 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	40	R	R
A.10	Supply and install 12V 100 Ah deep cycle flooded lead acid battery and maintenance free. Design life: 5 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 250 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.11	Supply and install 12V 120 Ah deep cycle Absorbent Glass Mat (AGM)maintenance free. Design life: 10 years in standby service @ 25°C Eurobat (20°C): >12 years. 400 Cycles to 50% Depth of Discharge (DOD)	Each	20	R	R
A.12	Supply, install and commission 12V charger as specified	Each	5	R	R
A.13	Supply, install and commission 24V charger as specified	Each	5	R	R
A.14	Supply, install and commission Deep Sea Model 7310 auto start control module	Each	6	R	R
A.15	Supply, install and commission Deep Sea Model 7320 auto start control module	Each	6	R	R
A.16	Supply, install and commission of heater element in standby generator alternator – generator size 500 kVA or smaller	Each	28	R	R
A.17	Supply, install and commission of 2 X heater elements in standby generator alternator – generator size 500 kVA or larger.	Each	7	R	R
	DRAIN AND FLUSH ALL RADIATORS WITH WATER UNTIL CLEAN AND FILL WITH CUMMINS ES COMPLETE 50/50 OR EQUALLY APPROVED (50% ETHYLENE GLYCOL PREMIX AT CORRECT PH) RADIATOR FLUID AS PER MANUFACTURER RECOMMENDATION FOR ALL STANDBY GENERATORS LISTED ABOVE FOR THIS				

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

	REGION WHEN INSTRUCTED BY THE EMPLOYER				
A.18	Price for estimated radiator fluid mix to be replaced during the contract period inclusive of top-ups	l	1900	R	R
A.19	Labour to drain, flush clean & replace radiator fluid for 33 listed standby generators	Lot	-	R	R
CALL OUT FEES					
B.1	Call out rates: Normal hours (includes first half and hour on site)	Each	34	R	R
B.2	Travelling cost (Travelling as measured from Karl Bremer Hospital for emergency and breakdown repairs. Travelling to include travel, labour hours, fuel, wear and tear, etc)	km	7000	R	R
RENTAL COSTS					
C.1	Crane truck rental per hr – 5 ton	per/ hour	48	R	R
C.3	Crane truck rental per km – 5 ton	rate/ km	1700	R	R
C.3	Crane truck rental per hr – 10 ton	per/ hour	35	R	R
C.4	Crane truck rental per km – 10 ton	rate/ km	800	R	R
LABOUR RATES					
D.1	Normal hours - Foreman	Rate/ hour	390	R	R
D.2	After hours & Saturdays - Foreman	Rate/ hour	8	R	R
D.3	Public Holidays & Sundays - Foreman	Rate/ hour	16	R	R
D.4	Normal hours - Artisan	Rate/ hour	760	R	R
D.5	After hours & Saturdays - Artisan	Rate/ hour	19	R	R
D.6	Public Holidays & Sundays - Artisan	Rate/ hour	19	R	R
D.7	Normal hours - Unqualified Artisan	Rate/ hour	380	R	R
D.8	After hours & Saturdays - Unqualified Artisan	Rate/ hour	8	R	R
D.9	Public Holidays & Sundays - Unqualified Artisan	Rate/ hour	8	R	R
D.10	Normal hours - Assistant	Rate/ hour	760	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

D.11	After hours & Saturdays - Assistant	Rate/ hour	19	R	R
D.12	Public Holidays & Sundays - Assistant	Rate/ hour	19	R	R
STANDARD COSTS					
E.1	Allowance for S&T and Sleep Out accommodation for repairs outside 200km radius from Karl Bremer Hospital. Invoices to be supplied as proven cost with claim	item	item	NO FILL	R7 600.00
E.2	Allowance for diesel tank repairs and corrosion protection and painting of corroded surfaces. Material and labour based items	item	item	NO FILL	R150 000.00
E.3	Estimate: Spares for repairs proven cost Item (allowance only) all spares for servicing included in service price	item	item	NO FILL	R300 000.00
E.4	Percentage mark-up on spares (max mark-up allowed 15%)	%	0.15	NO FILL	R45 000.00
Metro West: Total Price for call outs and spares carried forward to Combined Price Schedule for Metro West - page 90					R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Metro West Combined Pricing Schedule:		
		Sub Totals from above
A	Total price for all services for the period of 36 months	R
B	Total price for call outs and spares	R
	Metro West: Sub Total	R
	VAT at 15%	R
	Metro West: Total Price to be carried forward to Pricing Schedule – page 107 (VAT Inclusive)	R

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00	
2026-02-06	
1)..... SIGNED	2)..... SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

West Coast AREA-D									
					Minor Service		Major Service		Total as on Date of Tender
No	Facility	Facility Type	Capacity (kVA)	Make	Rate / Service	Total Minor Services X 4	Rate/ Service	Total Major Services X 3	For all services in the 36-month period. 4x Minor & 3x Major
121	Citrusdal	Hospital (GS124)	150	Rolls Royce	R	R	R	R	R
122	Citrusdal	Clinic (GS212)	22	Cummins	R	R	R	R	R
123	Clanwilliam	Hospital (GS43)	110	Yanmar	R	R	R	R	R
124	Clanwilliam	Clinic (GS216)	16	Kohler	R	R	R	R	R
125	Gouda	Clinic (GS77)	33	Cummins	R	R	R	R	R
126	Huis Macrone (Wellington)	Clinic (GS138)	60	Cummins	R	R	R	R	R
127	Klawer	Clinic (GS209)	33	Cummins	R	R	R	R	R
128	Lamberts Bay	Clinic/EMS (GS169)	50	Ford	R	R	R	R	R
129	Malmesbury CDC	CDC (GS129)	125	John Deere	R	R	R	R	R
130	Mamre	CDC (GS215)	33	Cummins	R	R	R	R	R
131	Moorreesburg	Clinic (GS76)	33	Cummins	R	R	R	R	R
132	Paarl	EMS (GS208)	16	Kohler	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

133	Paarl	Hospital (GS140)	800	Perkins	R	R	R	R	R
134	Paarl	Hospital (GS166)	800	Perkins	R	R	R	R	R
135	Paarl	FPL (GS99)	135	Cummins	R	R	R	R	R
136	Paarl: Sonstraal	Hospital (GS190)	200	John Deere	R	R	R	R	R
137	Piketberg	Hospital (GS162)	50	Deutz	R	R	R	R	R
138	Piketberg	EMS (GS203)	12	Kohler	R	R	R	R	R
139	Piketberg	Clinic (GS204)	22	Kohler	R	R	R	R	R
140	Porterville	Hospital (GS130)	50	Deutz	R	R	R	R	R
141	Swartland	Hospital (GS186)	350	Yanmar	R	R	R	R	R
142	Swartland	FPL (GS128)	135	Cummins	R	R	R	R	R
143	TC Newman	CDC (GS114)	380	Volvo Penta	R	R	R	R	R
144	Velddrif	Clinic (GS207)	30	John Deere	R	R	R	R	R
145	Vredenburg	Hospital (GS182)	500	Perkins	R	R	R	R	R
146	Vredenburg	Hospital (GS168)	500	Perkins	R	R	R	R	R
147	Vredendal	Hospital (GS219)	200	Volvo Penta	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

148	Vredendal	EMS (GS03)	25	ADE	R	R	R	R	R
149	Vredendal	FPL (GS157)	50	Perkins	R	R	R	R	R
150	Wellington	CDC (GS144)	160	Volvo Penta	R	R	R	R	R
151	Wellington: Mbekweni	CDC (GS08)	50	Ford	R	R	R	R	R
152	Wesfleur	Hospital (GS11)	350	GM Detroit	R	R	R	R	R
Provisional: Generators that could possibly added to this the area during contract period. Quantities and make and models may vary from below and will be adjusted accordingly									
	West Coast	Clinic/FPL	33	Cummins	R	R	R	R	R
	West Coast	CDC/CHC	50	Cummins	R	R	R	R	R
	West Coast	CDC/CHC	100	Iveco	R	R	R	R	R
West Coast total for all services for the period of 36 months carried forward to Combined Price Schedule for West Coast - page 98									R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

West Coast Pricing Schedule: Callouts and Spares.					
Item	Description	Unit	Qty	Rate	Submitted Price / Offer
EQUIPMENT COST					
	The supplier shall discount all lead levies payable and shall treat all batteries to be priced below as replacements.			R	R
A.1	Supply, install and connect to controller, VDO low coolant level sensor	Each	11	R	R
A.2	Supply and install 12V 105 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE.	Each	27	R	R
A.3	Supply and install 12V 120 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	18	R	R
A.4	Supply and install 12V 150 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	14	R	R
A.5	Supply and install 12V 180 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	4	R	R
A.6	Supply and install 12V 220 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	4	R	R
A.7	Supply and install 12V 7 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.8	Supply and install 12V 18 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

A.9	Supply and install 12V 24 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.10	Supply and install 12V 100 Ah deep cycle flooded lead acid battery and maintenance free. Design life: 5 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 250 Cycles to 50% Depth of Discharge (DOD)	Each	20	R	R
A.11	Supply and install 12V 120 Ah deep cycle Absorbent Glass Mat (AGM)maintenance free. Design life: 10 years in standby service @ 25°C Eurobat (20°C): >12 years. 400 Cycles to 50% Depth of Discharge (DOD)	Each	15	R	R
A.12	Supply, install and commission 12V charger as specified	Each	4	R	R
A.13	Supply, install and commission 24V charger as specified	Each	4	R	R
A.14	Supply, install and commission Deep Sea Model 7310 auto start control module	Each	5	R	R
A.15	Supply, install and commission Deep Sea Model 7320 auto start control module	Each	5	R	R
A.16	Supply, install and commission of heater element in standby generator alternator – generator size 500 kVA or smaller	Each	29	R	R
A.17	Supply, install and commission of 2 X heater elements in standby generator alternator – generator size 500 kVA or larger.	Each	4	R	R
	DRAIN AND FLUSH ALL RADIATORS WITH WATER UNTIL CLEAN AND FILL WITH CUMMINS ES COMPLETE 50/50 OR EQUALLY APPROVED (50% ETHYLENE GLYCOL PREMIX AT CORRECT PH) RADIATOR FLUID AS PER MANUFACTURER RECOMMENDATION FOR ALL STANDBY GENERATORS LISTED				

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

	ABOVE FOR THIS REGION WHEN INSTRUCTED BY THE EMPLOYER				
A.18	Price for estimated radiator fluid mix to be replaced during the contract period inclusive of top-ups	l	1600	R	R
A.19	Labour to drain, flush clean & replace radiator fluid for 32 listed standby generators	Lot	-	R	R
CALL OUT FEES					
B.1	Call out rates: Normal hours (includes first half and hour on site)	Each	32	R	R
B.2	Travelling cost (Travelling as measured from Karl Bremer Hospital for emergency and breakdown repairs. Travelling to include travel, labour hours, fuel, wear and tear, etc)	km	10000	R	R
RENTAL COSTS					
C.1	Crane truck rental per hr – 5 ton	per/ hour	45	R	R
C.3	Crane truck rental per km – 5 ton	Rate/ km	2800	R	R
C.3	Crane truck rental per hr – 10 ton	per /hour	15	R	R
C.4	Crane truck rental per km – 10 ton	Rate/ km	1000	R	R
LABOUR RATES					
D.1	Normal hours - Foreman	Rate/ hour	350	R	R
D.2	After hours & Saturdays - Foreman	Rate/ hour	4	R	R
D.3	Public Holidays & Sundays - Foreman	Rate/ hour	8	R	R
D.4	Normal hours - Artisan	Rate/ hour	720	R	R
D.5	After hours & Saturdays - Artisan	Rate/ hour	18	R	R
D.6	Public Holidays & Sundays - Artisan	Rate/ hour	18	R	R
D.7	Normal hours - Unqualified Artisan	Rate/ hour	360	R	R
D.8	After hours & Saturdays - Unqualified Artisan	Rate/ hour	8	R	R
D.9	Public Holidays & Sundays - Unqualified Artisan	Rate/ hour	8	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

D.10	Normal hours - Assistant	Rate/ hour	720	R	R
D.11	After hours & Saturdays - Assistant	Rate/ hour	18	R	R
D.12	Public Holidays & Sundays - Assistant	Rate/ hour	18	R	R
STANDARD COSTS					
E.1	Allowance for S&T and Sleep Out accommodation for repairs outside 200km radius from Karl Bremer Hospital. Invoices to be supplied as proven cost with claim	item	item	NO FILL	R7 600.00
E.2	Allowance for diesel tank repairs and corrosion protection and painting of corroded surfaces. Material and labour based items	item	item	NO FILL	R150 000.00
E.3	Estimate: Spares for repairs proven cost Item (allowance only) all spares for servicing included in service price	item	item	NO FILL	R300 000.00
E.4	Percentage mark-up on spares (max mark-up allowed 15%	%	0.15	NO FILL	R45 000.00
West Coast: Total Price for call outs and spares carried forward to Combined Price Schedule for West Coast - page 98					R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

West Coast Combined Pricing Schedule:		
		Sub Totals from above
A	Total price for all services for the period of 36 months	R
B	Total price for call outs and spares	R
	West Coast: Sub Total	R
	VAT at 15%	R
	West Coast: Total Price to be carried forward to Pricing Schedule page 107 (VAT Inclusive)	R

WESTERN CAPE GOVERNMENT: HEALTH
 DIRECTORATE: SUPPLY CHAIN
 (INFRASTRUCTURE SOURCING)
 BID OPENED 11:00

2026-02-06

1).....
 SIGNED

2).....
 SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

Winelands/Overberg AREA -E									
					Minor Service		Major Service		Total as on Date of Tender
No	Facility	Facility Type	Capacity (kVA)	Make	Rate / Service	Total Minor Services X 4	Rate/ Service	Total Major Services X 3	For all services in the 36-month period. 4x Minor & 3x Major
153	Barrydale	Clinic (GS67A)	33	Cummins	R	R	R	R	R
154	Botrivier	Clinic/EMS (GS78)	16	Perkins	R	R	R	R	R
155	Bredasdorp	Hospital (GS19)	100	Iveco	R	R	R	R	R
156	Brewelskloof	Hospital (GS181)	500	Scania	R	R	R	R	R
157	Caledon	Hospital (GS231)	315	Perkins/Rolls	R	R	R	R	R
158	Caledon	Clinic (GS212)	22	Cummins	R	R	R	R	R
159	Ceres	Hospital (GS123)	250	John Deere	R	R	R	R	R
160	Ceres - Nduli	Clinic (GS201)	16	Kohler	R	R	R	R	R
161	Cogmanskloof (Ashton)	Clinic (GS210)	22	Cummins	R	R	R	R	R
162	Eben Donges	Hospital (GS176)	1100	CAT	R	R	R	R	R
163	Eben Donges	Hospital (GS175)	1000	CAT 3508	R	R	R	R	R
164	Gansbaai	Clinic (GS71)	22	Cummins	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

165	Grabouw	CHC (GS47)	130	John Deere	R	R	R	R	R
166	Hawston	Clinic (GS96)	22	Cummins	R	R	R	R	R
167	Hermanus	Hospital (GS193)	250	Volvo Penta	R	R	R	R	R
168	Hermanus	CDC (GS133)	100	Volvo Penta	R	R	R	R	R
169	Hermanus	FPL (GS39)	100	Volvo Penta	R	R	R	R	R
170	Montagu	Hospital (GS44)	100	Volvo (Ex-Bredasdorp)	R	R	R	R	R
171	Op Die Berg (Ceres)	Clinic (GS82)	22	Cummins	R	R	R	R	R
172	Riviersonderend	Clinic/EMS (GS217)	22	Cummins	R	R	R	R	R
173	Robertson	Hospital (GS49)	250	John Deere	R	R	R	R	R
174	Robertson (Bergsig)	Clinic (GS83)	33	Cummins	R	R	R	R	R
175	Swellendam	EMS (GS211)	16	Kohler	R	R	R	R	R
176	Swellendam	Hospital (GS126)	90	Perkins	R	R	R	R	R
177	Touws River	Clinic/EMS (GS55)	50	Deutz	R	R	R	R	R
178	Tulbagh	EMS (GS196)	16	Kohler	R	R	R	R	R
179	Worcester	FPL (GS184)	135	Cummins	R	R	R	R	R
180	Worcester	CDC (GS171)	50	Ford	R	R	R	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3) YEARS.

181	Worcester	EMS (GS16)	150	Volvo Penta	R	R	R	R	R
Provisional: Generators that could possibly added to this the area during contract period. Quantities and make and models may vary from below and will be adjusted accordingly									
	Winelands/Overberg	Clinic/FPL	33	Cummins	R	R	R	R	R
	Winelands/Overberg	CDC/CHC	50	Cummins	R	R	R	R	R
	Winelands/Overberg	CDC/CHC	100	Iveco	R	R	R	R	R
Winelands/Overberg total for all services for the period of 36 months carried forward to Combined Price Schedule for Winelands/Overberg – page 106									R

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06 1)..... SIGNED		2)..... SIGNED
--	--	-------------------

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

Winelands/Overberg Pricing Schedule: Callouts and Spares.					
Item	Description	Unit	Qty	Rate	Submitted Price / Offer
EQUIPMENT COST					
	The supplier shall discount all lead levies payable and shall treat all batteries to be priced below as replacements.			R	R
A.1	Supply, install and connect to controller, VDO low coolant level sensor	Each	9	R	R
A.2	Supply and install 12V 105 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE.	Each	24	R	R
A.3	Supply and install 12V 120 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	16	R	R
A.4	Supply and install 12V 150 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	13	R	R
A.5	Supply and install 12V 180 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	4	R	R
A.6	Supply and install 12V 220 Ah heavy duty battery similar or equivalent to, Deltec, Royal or Willard MAINTENANCE FREE	Each	4	R	R
A.7	Supply and install 12V 7 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.8	Supply and install 12V 18 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

A.9	Supply and install 12V 24 Ah Absorbent Glass Mat (AGM) rechargeable, highly efficient, leak proof and maintenance free. Design life: 8 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 500 Cycles to 50% Depth of Discharge (DOD)	Each	30	R	R
A.10	Supply and install 12V 100 Ah deep cycle flooded lead acid battery and maintenance free. Design life: 5 years in standby service @ 25°C Eurobat (20°C): 10/12 years. 250 Cycles to 50% Depth of Discharge (DOD)	Each	20	R	R
A.11	Supply and install 12V 120 Ah deep cycle Absorbent Glass Mat (AGM)maintenance free. Design life: 10 years in standby service @ 25°C Eurobat (20°C): >12 years. 400 Cycles to 50% Depth of Discharge (DOD)	Each	15	R	R
A.12	Supply, install and commission 12V charger as specified	Each	4	R	R
A.13	Supply, install and commission 24V charger as specified	Each	4	R	R
A.14	Supply, install and commission Deep Sea Model 7310 auto start control module	Each	5	R	R
A.15	Supply, install and commission Deep Sea Model 7320 auto start control module	Each	5	R	R
A.16	Supply, install and commission of heater element in standby generator alternator – generator size 500 kVA or smaller	Each	26	R	R
A.17	Supply, install and commission of 2 X heater elements in standby generator alternator – generator size 500 kVA or larger.	Each	3	R	R
	DRAIN AND FLUSH ALL RADIATORS WITH WATER UNTIL CLEAN AND FILL WITH CUMMINS ES COMPLETE 50/50 OR EQUALLY APPROVED (50% ETHYLENE GLYCOL PREMIX AT CORRECT PH) RADIATOR FLUID AS PER MANUFACTURER RECOMMENDATION FOR ALL STANDBY GENERATORS LISTED ABOVE FOR THIS REGION WHEN INSTRUCTED BY THE EMPLOYER				

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

A.18	Price for estimated radiator fluid mix to be replaced during the contract period inclusive of top-ups	l	1600	R	R
A.19	Labour to drain, flush clean & replace radiator fluid for 29 listed standby generators	Lot	-	R	R
CALL OUT FEES					
B.1	Call out rates: Normal hours (includes first half and hour on site)	Each	28	R	R
B.2	Travelling cost in R/km (Travelling as measured from Karl Bremer Hospital for emergency and breakdown repairs. Travelling to include travel, labour hours, fuel, wear and tear, etc)	km	13000	R	R
RENTAL COSTS					
C.1	Crane truck rental per hr – 5 ton	per/ hour	39	R	R
C.3	Crane truck rental per km – 5 ton	Rate/ km	3000	R	R
C.3	Crane truck rental per hr – 10 ton	per/ hour	15	R	R
C.4	Crane truck rental per km – 10 ton	rate/ km	1000	R	R
LABOUR RATES					
D.1	Normal hours - Foreman	Rate/ hour	320	R	R
D.2	After hours & Saturdays - Foreman	Rate/ hour	4	R	R
D.3	Public Holidays & Sundays - Foreman	Rate/ hour	8	R	R
D.4	Normal hours - Artisan	Rate/ hour	630	R	R
D.5	After hours & Saturdays - Artisan	Rate/ hour	16	R	R
D.6	Public Holidays & Sundays - Artisan	Rate/ hour	16	R	R
D.7	Normal hours - Unqualified Artisan	Rate/ hour	315	R	R
D.8	After hours & Saturdays - Unqualified Artisan	Rate/ hour	8	R	R
D.9	Public Holidays & Sundays - Unqualified Artisan	Rate/ hour	8	R	R
D.10	Normal hours - Assistant	Rate/ hour	630	R	R
D.11	After hours & Saturdays - Assistant	Rate/ hour	16	R	R
D.12	Public Holidays & Sundays - Assistant	Rate/ hour	16	R	R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

STANDARD COSTS					
E.1	Allowance for S&T and Sleep Out accommodation for repairs outside 200km radius from Karl Bremer Hospital. Invoices to be supplied as proven cost with claim	item	item	NO FILL	R 6 300.00
E.2	Allowance for diesel tank repairs and corrosion protection and painting of corroded surfaces. Material and labour based items	item	item	NO FILL	R 150 000.00
E.3	Estimate: Spares for repairs proven cost Item (allowance only) all spares for servicing included in service price	item	item	NO FILL	R 300 000.00
E.4	Percentage mark-up on spares (max) mark-up allowed 15%	%	0.15	NO FILL	R45 000.00
Winelands/Overberg: Total Price for call outs and spares carried forward to Combined Price Schedule for Winelands/Overberg page 106					R

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

Winelands/Overberg Combined Pricing Schedule:		
		Sub Totals from above
A	Total price for all services for the period of 36 months	R
B	Total price for call outs and spares	R
	Winelands / Overberg: Sub Total	R
	VAT at 15%	R
	Winelands / Overberg: Total Price to be carried forward to Pricing schedule – page 107 (VAT Inclusive)	R

WESTERN CAPE GOVERNMENT: HEALTH

DIRECTORATE: SUPPLY CHAIN

(INFRASTRUCTURE SOURCING)

BID OPENED 11:00

2026-02-06

1).....

SIGNED

2).....

SIGNED

PRICING SCHEDULE – FIRM PRICES
(PURCHASES)
NOTE: ONLY FIRM PRICES WILL BE ACCEPTED.

NON-FIRM PRICES (INCLUDING PRICES SUBJECT TO RATES OF EXCHANGE VARIATIONS) WILL NOT BE CONSIDERED

NAME OF BIDDER: _____ BID NUMBER: **WCGHIC0008/2025**

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

THE OFFERED TOTAL OF THE PRICES INCLUSIVE OF VALUE ADDED TAX IS:

.....
.....Rand (in words);
R..... (in figures).

Item	FROM	AREA A TO E	TOTAL BID PRICE OF AREA
1.	Page 73	METRO NORTH AREA-A	R..... (VAT INCL)
2.	Page 82	METRO EAST AREA- B	R..... (VAT INCL)
3.	Page 90	METRO WEST AREA -C	R..... (VAT INCL)
4.	Page 98	WEST COAST AREA-D	R..... (VAT INCL)
5.	Page 106	WINELANDS / OVERBERG AREA -E	R..... (VAT INCL)
TOTAL BID PRICE (INCL VAT) CARRIED FROM PRICE SCHEDULE SUMMARY (ITEMS 1 TO 5)			R.....

PRICE STRUCTURE

- Prices should include all labour, material / components and all associated costs to provide a fully operational final product to the client inclusive of VAT.

All prices must be fixed for three years except spares, which will be subject to ROE (Rate of Exchange) fluctuations after one year of award. Failure to adhere will result in your offer being disqualified.

ANNEXURE D – TASK ORDER

Servicing & Repair of Hospital Standby Generators at Various Health Institutions in the Western Cape

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

TASK ORDER (ANNEXURE D)

DEPARTMENT OF HEALTH AND WELLNESS: ENGINEERING AND TECHNICAL SERVICES

Pro Forma Task Order for use when work within the service is instructed to be carried out within a stated time period on a Task-by-Task basis

This Task Order is issued in accordance with Sections 15 to 24, Part 1 & Sections 20 & 21, Part 2 of Contract WCGHIC0008/2025

Task Order No: **To** (Contractor)

The Task is as follows:

Description

.....

.....

Instruction Date & Time: Expected Completion Date:

please submit your quotation and programme proposals for approval.

Signed on behalf of Employer: Date:

Quotation total for items of work on the Pricing Schedules (details attached)	R.....
Quotation total for items of work not on the Pricing Schedules (details attached)	R.....
Total Quotation Price	R

The programme for the Task is (attached)

All work will be guaranteed for 12 months.

Signed on behalf of Contractor: Date:

I accept the above quotation and programme and instruct you to carry out the Task

Signed on behalf of Employer: Date:

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED
2).....
SIGNED



PROVINCIAL GOVERNMENT WESTERN CAPE

DECLARATION OF INTERESTS, BIDDERS PAST SCM PRACTICES AND INDEPENDENT BID DETERMINATION

1. To give effect to the requirements of the Western Cape Provincial Treasury Instructions, 2019: Supply Chain Management (Goods and Services), Public Finance Management Act (PFMA) Supply Chain Management (SCM) Instruction No. 3 of 2021/2022 - SBD 4 Declaration of Interest, Section 4 (1)(b)(iii) of the Competition Act No. 89 of 1998 as amended together with its associated regulations, the Prevention and Combating of Corrupt Activities Act No 12 of 2004 and regulations pertaining to the tender defaulters register, Paragraph 16A9 of the National Treasury Regulations and/or any other applicable legislation.
2. Any person (natural or juristic) may make an offer or offers in terms of this invitation to bid. In line with the principles of transparency, accountability, impartiality, and ethics as enshrined in the Constitution of the Republic of South Africa and further expressed in various pieces of legislation, it is required for the bidder to make this declaration in respect of the details required hereunder.
3. All prospective bidders intending to do business with the Institution must be registered on the Central Supplier Database (CSD) by bid closing date.
4. It is advisable to register on the Western Cape Supplier Evidence Bank (WCSEB) to ensure that the compulsory schedules (included in this bid), i.e., WCBD4 and WCBD 6.1 and BBBEE certificate/affidavit are annually updated (before expiry) on the WCSEB.
5. The status of enterprises and persons listed on the National Treasury's Register for Tender Defaulters will be housed on the ePS. Institutions may not under any circumstances procure from enterprises and persons listed on the Database of Tender Defaulters.
6. The status of suppliers listed on the National Treasury's Database of Restricted Suppliers will be housed on the ePS; however, it remains incumbent on institutions to check the National Treasury Database of Restricted Suppliers before the conclusion of any procurement process. For suppliers listed as restricted, institutions must apply due diligence and risk assessment before deciding to proceed with procurement from any such supplier.
7. **Definitions**

"bid" means a bidder's response to an institution's invitation to participate in a procurement process which may include a bid, price quotation or proposal;

"Bid rigging (or collusive bidding)" occurs when businesses, that would otherwise be expected to compete, secretly conspire to raise prices or lower the quality of goods and / or services for purchasers who wish to acquire goods and/or services through a bidding process. Bid rigging is, therefore, an agreement between competitors;

"business interest" means -

- (a) a right or entitlement to share in profits, revenue or assets of an entity;
- (b) a real or personal right in property;
- (c) a right to remuneration or any other private gain or benefit, or
- (d) includes any interest contemplated in paragraphs (a), (b) or (c) acquired through an intermediary and any potential interest in terms of any of those paragraphs;

"Consortium or Joint Venture" means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract;

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.

“Controlling interest” means, the power, by one person or a group of persons holding the majority of the equity of an enterprise, alternatively, the person/s having the deciding vote or power to influence or to direct the course and decisions of the enterprise;

“Corruption”- General offences of corruption are defined in the Combating of Corrupt Activities Act, 2004 (Act No 12 of 2004) as:

Any person who directly or indirectly -

- (a) accepts or agrees or offers to accept an! gratification from any other person, whether for the benefit of himself or herself or for the benefit of another person; or
- (b) gives or agrees or offers to give to any other person any gratification, whether for the benefit of that other person or for the benefit of another person., in order to act personally or by influencing another person so to act, in a manner—
 - (i) that amounts to the-
 - (aa) illegal. dishonest. unauthorised. incomplete. or biased; or
 - (bb) misuse or selling of information or material acquired in the course of the exercise, carrying out or performance of any powers, duties or functions arising out of a constitutional, statutory, contractual or any other legal obligation;
 - (ii) that amounts to-
 - (aa) the abuse of a position of authority;
 - (bb) a breach of trust; or
 - (cc) the violation of a legal duty or a set of rules;
 - (iii) designed to achieve an unjustified result; or
 - (iv) that amounts to any other unauthorised or improper inducement to do or 45 not to do anything. of the, is guilty of the offence of corruption.

“CSD” means the Central Supplier Database maintained by National Treasury;

“employee”, in relation to –

- (a) a department, means a person contemplated in section 8 of the Public Service Act, 1994 but excludes a person appointed in terms of section 12A of that Act; and
- (b) a public entity, means a person employed by the public entity;

“entity” means any -

- (a) association of persons, whether or not incorporated or registered in terms of any law, including a company, corporation, trust, partnership, close corporation, joint venture or consortium; or
- (b) sole proprietorship;

“entity conducting business with the Institution” means an entity that contracts or applies or tenders for the sale, lease or supply of goods or services to the Province;

“Family member” means a person’s -

- (a) spouse; or
- (b) child, parent, brother, sister, whether such a relationship results from birth, marriage or adoption or some other legal arrangement (as the case may be);

“intermediary” means a person through whom an interest is acquired, and includes a representative or agent or any other person who has been granted authority to act on behalf of another person;

“Institution” means –

a provincial department or provincial public entity listed in Schedule 3C of the Act;

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.

www.westerncape.gov.za

“Provincial Government Western Cape (PGWC)” means

- (a) the Institution of the Western Cape, and
- (b) a provincial public entity;

“RWOEE” means -

Remunerative Work Outside of the Employee's Employment

“spouse” means a person's -

- (a) partner in marriage or civil union according to legislation;
 - (b) partner in a customary union according to indigenous law; or
 - (c) partner with whom he or she cohabits and who is publicly acknowledged by the person as his or her life partner or permanent companion.
8. Regulation 13(c) of the Public Service Regulations (PSR) 2016, effective 1 February 2017, prohibits any employee from conducting business with an organ of state, or holding a directorship in a public or private company doing business with an organ of state unless the employee is a director (in an official capacity) of a company listed in schedules 2 and 3 of the Public Finance Management Act.
- a) Therefore, by 31 January 2017 all employees who are conducting business with an organ of state should either have:
- i. resigned as an employee of the government institution or;
 - ii. cease conducting business with an organ of state or;
 - iii. resign as a director/ shareholder/ owner/ member of an entity that conducts business with an organ of state.
9. Any legal person, or their family members, may make an offer or offers in terms of this invitation to bid. In view of potential conflict of interest, in the event that the resulting bid, or part thereof, be awarded to family members of persons employed by an organ of state, it is required that the bidder or his/her authorised representative declare his/her position in relation to the evaluating/adjudicating authority where the bidder is employed by the Institution.
10. The bid of any bidder may be disregarded if that bidder or any of its directors have abused the institution's supply chain management system; committed fraud or any other improper conduct in relation to such system; or failed to perform on any previous contract.
11. Section 4 (1) (b) (iii) of the Competition Act No. 89 of 1998, as amended, prohibits an agreement between, or concerted practice by firms, or a decision by an association of firms, if it is between parties in a horizontal relationship and if it involves collusive bidding (or bid rigging). Collusive bidding is a *per se* prohibition meaning that it cannot be justified under any grounds.
12. Treasury Regulation 16A9 prescribes that accounting officers and accounting authorities must take all reasonable steps to prevent abuse of the supply chain management system and authorises accounting officers and accounting authorities to:
- a. disregard the bid of any bidder if that bidder, or any of its directors have abused the institution's supply chain management system and or committed fraud or any other improper conduct in relation to such system.
 - b. cancel a contract awarded to a supplier of goods and services if the supplier committed any corrupt or fraudulent act during the bidding process or the execution of that contract.
13. Communication between partners in a joint venture or consortium will not be construed as collusive bidding.
14. In addition and without prejudice to any other remedy provided to combat any restrictive practices related to bids and contracts, bids that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and or may be reported to the National Prosecuting Authority (NPA) for criminal investigation and or may be restricted from conducting business with the public sector for a period not exceeding ten (10) years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.

SECTION A: DETAILS OF THE ENTITY

A1.

CSD Registration Number
IMPORTANT: PLEASE NOTE:

MAAA.....

A2

Name of the Entity

A3.

Entity registration Number
(where applicable)

A4.

Entity Type

A5.

Tax Reference Number

Full details of directors, shareholder, member, partner, trustee, sole proprietor or any persons with a right or entitlement to share in profits, revenue or assets of an entity, of the entity should be disclosed in the Table A below.

TABLE A

FULL NAME	DESIGNATION (Where a director is a shareholder, both should be confirmed.)	IDENTITY NUMBER	PERSONAL TAX REFERENCE NO.	PERCENTAGE INTEREST IN THE ENTITY

(if not enough space, attach additional pages)

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.
www.westerncape.gov.za

Page 113 of 139

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

WCBD 4

SECTION B: DECLARATION OF THE BIDDER'S INTEREST

The supply chain management system of an institution must, irrespective of the procurement process followed, prohibit any award to an employee of the state, who either individually or as a director of a public or private company or a member of a close corporation, seek to conduct business with the WCG, unless such employee is in an official capacity a director of a company listed in Schedule 2 or 3 of the PFMA as prescribed by the Public Service Regulation 13 (c).

Furthermore, an employee employed by an organ of state conducting remunerative work outside the public enterprise should first obtain the necessary approval (RWOPS), failure to submit proof of such authority, where applicable, may result in disciplinary action.

B1.	Are any persons listed in Table A identified on the CSD as employees of the Institution? (If yes, refer to Public Service Circular EIM 1/2016 to exercise the listed actions)	☐ NO	☐ YES
B2.	Are any employees of the entity also employees of an organ of state? (If yes complete Table B and attach their approved "RWOP")	☐ NO	☐ YES
B3.	Are any family members of the persons listed in Table A employees of an organ of state? (If yes complete Table B)	☐ NO	☐ YES

TABLE B

Details of persons connected with the bidder who are employees of the Institution as defined should be disclosed in Table B below.

FULL NAME OF EMPLOYEE	IDENTITY NUMBER	DEPARTMENT/ ENTITY OF EMPLOYMENT	DESIGNATION / RELATIONSHIP TO BIDDER**	INSTITUTION EMPLOYEE NO./PERSAL NO. (Indicate if not known)

(if not enough space, attach additional pages)

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.

SECTION C: PERFORMANCE MANAGEMENT AND BIDDER'S PAST SUPPLY CHAIN MANAGEMENT PRACTICES
To enable the prospective bidder to provide evidence of past and current performance.

C1.	Did the entity conduct business with an organ of state in the last twelve months? (If yes complete Table C)	NO	YES
-----	--	----	-----

C2.
TABLE C

Complete the below table to the maximum of the last 5 contracts.

NAME OF CONTRACTOR	PROVINCIAL DEPARTMENT OR PROVINCIAL ENTITY	TYPE OF SERVICES OR COMMODITY	CONTRACT / ORDER NUMBER	PERIOD OF CONTRACT	VALUE OF CONTRACT

(if not enough space, attach additional pages)

C3.	Is the entity or its principals listed on the National Database as companies or persons prohibited from doing business with the public sector?	NO	YES
-----	--	----	-----

C4.	Is the entity or its principals listed on the National Treasury Register for Tender Defaulters in terms of section 29 of the Prevention and Combating of Corrupt Activities Act (No. 12 of 2004)? (To access this Register enter the National Treasury's website, www.treasury.gov.za , click on the icon "Register for Tender Defaulters" or submit your written request for a hard copy of the Register to facsimile number (012) 3265445.)	NO	YES
-----	---	----	-----

C5.	If yes to C3 or C4, were you informed in writing about the listing on the database of restricted suppliers or Register for Tender Defaulters by National Treasury?	NO	YES	N/A
-----	--	----	-----	-----

C6.	Was the entity or persons listed in Table A convicted for fraud or corruption during the past five years in a court of law (including a court outside the Republic of South Africa)?	NO	YES
-----	--	----	-----

C7	Was any contract between the bidder and any organ of state terminated during the past five years on account of failure to perform on or comply with the contract?	NO	YES
----	---	----	-----

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.
www.westerncape.gov.za

SECTION D: DULY AUTHORISED REPRESENTATIVE TO DEPOSE TO AFFIDAVIT
This form must be signed by a duly authorised representative of the entity in the presence of a commissioner of oaths.

I, hereby swear/affirm;

(i) that the information disclosed above is true and accurate;

(ii) that I understand the content of the document;

(iii) the entity undertakes to independently arrive at any offer at any time to the Institution without any consultation, communication, agreement or arrangement with any competitor. In addition, that there will be no consultations, communications, agreements or arrangements with any competitor regarding the quality, quantity, specifications and conditions or delivery particulars of the products or services to the Institution.

(iv) that the entity or its representative are aware of and undertakes not to disclose the terms of any bid, formal or informal, directly or indirectly, to any competitor, prior to the awarding of the contract.

.....

DULY AUTHORISED REPRESENTATIVE'S SIGNATURE

I certify that before administering the oath/affirmation I asked the deponent the following questions and wrote down his/her answers in his/her presence:

1.1. Do you know and understand the contents of the declaration? ANSWER:

1.2. Do you have any objection to taking the prescribed oath? ANSWER:

1.3. Do you consider the prescribed oath to be binding on your conscience? ANSWER:.....

1.4. Do you want to make an affirmation? ANSWER:

2. I certify that the deponent has acknowledged that he/she knows and understands the contents of this declaration, which was sworn to/affirmed and the deponent's signature/thumbprint/mark was place thereon in my presence.

.....

SIGNATURE FULL NAMES Commissioner of Oaths

Designation (rank) ex officio: Republic of South Africa

Date:..... Place

Business Address:

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

If you know of any corrupt, fraudulent or collusive actions in the Institution, please report it by calling the National Hotline 0800 701

This form must be completed annually. Should the information herein declared change in the course of the year or before the next renewal or in relation to any bid, quotation or contract, it is the entity's responsibility to advise the Institution in writing of the change in such details.

PREFERENCE POINTS CLAIM FORM IN TERMS OF THE PREFERENTIAL PROCUREMENT REGULATIONS 2022 AND IN TERMS OF THE WESTERN CAPE GOVERNMENTS INTERIM STRATEGY AS IT RELATES TO PREFERENCE POINTS

This preference form must form part of all bids invited. It contains general information and serves as a claim form for preference points for Broad-Based Black Economic Empowerment (B-BBEE) Status Level of Contribution

NB: BEFORE COMPLETING THIS FORM, BIDDERS (TENDERERS) MUST STUDY THE GENERAL CONDITIONS, DEFINITIONS AND DIRECTIVES APPLICABLE IN RESPECT OF THE TENDER, PREFERENTIAL PROCUREMENT REGULATIONS, 2022 AND THE BROAD BASED BLACK ECONOMIC EMPOWERMENT ACT AND THE CODES OF GOOD PRACTICE

1. DEFINITIONS

- 1.1 “**acceptable tender**” means any tender which, in all respects, complies with the specifications and conditions of tender as set out in the tender document.
- 1.2 “**affidavit**” is a type of verified statement or showing, or in other words, it contains a verification, meaning it is under oath or penalty of perjury, and this serves as evidence to its veracity and is required for court proceedings.
- 1.3 “**all applicable taxes**” includes value-added tax, pay as you earn, income tax, unemployment insurance fund contributions and skills development levies;
- 1.4 “**B-BBEE**” means broad-based black economic empowerment as defined in section 1 of the Broad-Based Black Economic Empowerment Act;
- 1.5 “**B-BBEE status level of contributor**” means the B-BBEE status of an entity in terms of a code of good practice on black economic empowerment issued in terms of section 9(1) of the Broad-Based Black Economic Empowerment Act;
- 1.6 “**bid**” means a written offer on the official bid documents or invitation of price quotations and “tender” is the act of bidding /tendering;
- 1.7 “**Code of Good Practice**” means the generic codes or the sector codes as the case may be;
- 1.8 “**consortium or joint venture**” means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract;
- 1.9 “**contract**” means the agreement that results from the acceptance of a bid by an organ of state;
- 1.10 “**EME**” is an Exempted Micro Enterprise with an annual total revenue of R10 million or less.
- 1.11 “**Firm price**” means the price that is only subject to adjustments in accordance with the actual increase or decrease resulting from

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

the change, imposition, or abolition of customs or excise duty and any other duty, levy, or tax, which, in terms of the law or regulation, is binding on the Contractor and demonstrably has an influence on the price of any supplies, or the rendering costs of any service, for the execution of the contract;

- 1.12 **"Large Enterprise"** is any enterprise with an annual total revenue above R50 million;
- 1.13 **"non-firm prices"** means all prices other than "firm" prices;
- 1.14 **"person"** includes a juristic person;
- 1.15 **"price"** means an amount of money tendered for goods or services, and includes all applicable taxes less all unconditional discounts;
- 1.16 **"proof of B-BBEE status level contributor"** means-
- (a) The B-BBEE status level certificate issued by an authorized body or person;
 - (b) A sworn affidavit as prescribed in terms of the B-BBEE Codes of Good Practice; or
 - (c) Any other requirement prescribed in terms of the Broad- Based Black Economic Empowerment Act.
- 1.17 **QSE** is a Qualifying Small Enterprise with an annual total revenue between R10 million and R50 million;
- 1.18 **"rand value"** means the total estimated value of a contract in Rand, calculated at the time of bid invitation, and includes all applicable taxes;
- 1.19 **"sub-contract"** means the primary Contractor's assigning, leasing, making out work to, or employing, another person to support such primary Contractor in the execution of part of a project in terms of the contract.
- 1.20 **"tender"** means a written offer in the form determined by an organ of state in response to an invitation to provide or services through price quotations, competitive tendering process or any other method envisaged in legislation;
- 1.21 **"tender for income-generating contracts"** means a written offer in the form determined by an organ of state in response to an invitation for the origination of income-generating contracts through any method envisaged in legislation that will result in a legal agreement between the organ of state and a third party that produces revenue for the organ of state, and includes, but is not limited to, leasing and disposal of assets and concession contracts, excluding direct sales and disposal of assets through public auctions;
- 1.22 **"the Act"** means the Preferential Procurement Policy Framework Act, 2000 (Act No. 5 of 2000);
- 1.23 **"the Regulations"** means the Preferential Procurement Regulations, 2022;
- 1.24 **"total revenue"** bears the same meaning assigned to this expression in the Codes of Good Practice on Black Economic Empowerment, issued in terms of section 9(1) of the Broad-Based Black Economic Empowerment Act and promulgated in the Government Gazette on 11 October 2013;

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

- 1.25 **“trust”** means the arrangement through which the property of one person is made over or bequeathed to a trustee to administer such property for the benefit of another person; and
- 1.26 **“trustee”** means any person, including the founder of a trust, to whom property is bequeathed in order for such property to be administered for the benefit of another person.

2. GENERAL CONDITIONS

- 2.1 The following preference point systems are applicable to all bids:
- the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and
 - the 90/10 system for requirements with a Rand value above R50 000 000 (all applicable taxes included).
- 2.2 Preference point system for this bid:
- (a) The value of this bid is estimated does not exceed R50 000 000 (all applicable taxes included) and therefore the preference point system shall be applicable; or
 - (b) The 80/20 preference point system will be applicable to this tender
- 2.3 Preference points for this bid (even in the case of a tender for income-generating contracts) shall be awarded for:
- (a) Price; and
 - (b) B-BBEE Status Level of Contribution.

- 2.4 The maximum points for this bid are allocated as follows:



	POINTS
PRICE	80
B-BBEE STATUS LEVEL OF CONTRIBUTOR	20
Total points for Price and B-BBEE must not exceed	100

- 2.5 Failure on the part of a bidder to fill in, sign this form and submit in the circumstances prescribed in the Codes of Good Practice either a B-BBEE Verification Certificate issued by a Verification Agency accredited by the South African Accreditation System (SANAS) or an affidavit confirming annual total revenue and level of black ownership together with the bid or an affidavit issued by Companies Intellectual Property Commission, will be interpreted to mean that preference points for B-BBEE status level of contribution are not claimed.
- 2.6 The organ of state reserves the right to require of a bidder, either before a bid is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the organ of state.

3. ADJUDICATION USING A POINT SYSTEM

- 3.1 Subject to Section 2 (1) (f) of the Preferential Procurement Policy Framework Act, 2000, **the bidder obtaining the highest number of total points** will be awarded the contract.
- 3.2 A tenderer must submit proof of its B-BBEE status level of contributor in order to claim points for B-BBEE.
- 3.3 A tenderer failing to submit proof of B-BBEE status level of contributor or is a non-compliant contributor to B-BBEE will not be disqualified but will only score:
 - (a) points out of 80 for price; and
 - (b) 0 points out of 20 for B-BBEE
- 3.4 Points scored must be rounded off to the nearest 2 decimal places.
- 3.5 In the event that two or more bids have scored equal total points, the successful bid must be the one scoring the highest number of preference points for B-BBEE.
- 3.6 As per section 2 (1) (f) of the Preferential Procurement Policy Framework Act, 2000, the contract may be awarded to a bidder other than the one scoring the highest number of total points based on objective criteria in addition to those contemplated in paragraph (d) and (e) of the Act that justifies the award to another tenderer provided that it has been stipulated upfront in the tendering conditions.
- 3.7 Should two or more bids be equal in all respects; the award shall be decided by the drawing of lots.

4. FORMULAE FOR PROCUREMENT OF GOODS AND SERVICES

4.1 POINTS AWARDED FOR PRICE

4.1.1 THE 80/20 OR 90/10 PREFERENCE POINT SYSTEM

A maximum of 80 or 90 points is allocated for price on the following basis:

80/20

or

90/10

$$Ps = 80 \left(1 - Pt - \frac{Pmin}{Pmin} \right)$$

or

$$Ps = 90 \left(1 - Pt - \frac{Pmin}{Pmin} \right)$$

Where

- Ps = Points scored for price of bid under consideration
- Pt = Price of tender under consideration
- Pmin = Price of lowest acceptable tender



5. FORMULAE FOR DISPOSAL OR LEASING OF STATE ASSETS AND INCOME GENERATING PROCUREMENT

5.1 POINTS AWARDED FOR PRICE

A maximum of 80 or 90 points is allocated for price on the following basis:

80/20

or

90/10

$$Ps = 80 \left(1 + \frac{Pt - Pmax}{Pmax} \right)$$

or

$$Ps = 90 \left(1 + \frac{Pt - Pmax}{Pmax} \right)$$

Where

Ps = Points scored for price of tender under consideration

Pt = Price of tender under consideration

Pmax = Price of highest acceptable tender

WESTERN CAPE GOVERNMENT: HEALTH

DIRECTORATE: SUPPLY CHAIN

(INFRASTRUCTURE SOURCING)

BID OPENED 11:00

2026-02-06

1).....

SIGNED

2).....

SIGNED

6. POINTS AWARDED FOR B-BBEE STATUS LEVEL OF CONTRIBUTION

6.1 In terms of WCG interim strategy, preference points must be awarded to a bidder for attaining the B-BBEE status level of contribution in accordance with the table below:

B-BBEE Status Level of Contributor	Number of points (90/10 system)	Number of points (80/20 system)
1	10	20
2	9	18
3	6	14
4	5	12
5	4	8
6	3	6
7	2	4
8	1	2
Non-compliant contributor	0	0

6.2 An **EME** must submit a valid, originally certified affidavit confirming annual turnover and level of black ownership or an affidavit issued by Companies Intellectual Property Commission

6.3 A **QSE that is less than 51 per cent (50% or less) black owned** must be verified in terms of the QSE scorecard issued via Government Gazette and submit a valid, original or a legible certified copy of a B-BBEE Verification Certificate issued by SANAS.

- 6.4 A **QSE that is at least 51 per cent black owned (51% or higher)** must submit a valid, originally certified affidavit confirming turnover and level of black ownership as well as declare its empowering status or an affidavit issued by Companies Intellectual Property Commission.
- 6.5 A **large enterprise** must submit a valid, original or originally certified copy of a B-BBEE Verification Certificate issued by a verification agency accredited by SANAS.
- 6.6 A trust, consortium or joint venture, will qualify for points for their B-BBEE status level as a legal entity, provided that the entity submits their B-BBEE status level certificate.
- 6.7 A trust, consortium or joint venture (including unincorporated consortia and joint ventures) must submit a consolidated B-BBEE status level verification certificate for every separate tender.
- 6.8 Tertiary institutions and public entities will be required to submit their B-BBEE status level certificates in terms of the specialized scorecard contained in the B-BBEE Codes of Good Practice.

7. BID DECLARATION

7.1 Bidders who claim points in respect of B-BBEE Status Level of Contribution must complete the following:

8. B-BBEE STATUS LEVEL OF CONTRIBUTION CLAIMED IN TERMS OF PARAGRAPH 6

8.1 B-BBEE Status Level of Contribution.....= (maximum of 20 points)

(Points claimed in respect of paragraph 7.1 must be in accordance with the table reflected in paragraph 6.1 and must be substantiated by means of a B-BBEE certificate issued by a Verification Agency accredited by SANAS or an affidavit confirming annual total revenue and level of black ownership in terms of the relevant sector code applicable to the tender.

9. SUB-CONTRACTING

9.1 Will any portion of the contract be sub-contracted? **YES/NO** (delete which is not applicable)

9.1.1 If yes, indicate:

- (i) what percentage of the contract will be subcontracted?%
- (ii) the name of the sub-Contractor?
- (iii) the B-BBEE status level of the sub-Contractor?
- (i) whether the sub-Contractor is an EME or QSE? YES/NO (delete which is not applicable)

9.1.2 Sub-contracting relates to a **particular** contract and if sub-contracting is applicable, the bidder to state in their response to a particular RFQ that a portion of that contract will be sub-contracted.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED
2).....
SIGNED

10. DECLARATION WITH REGARD TO COMPANY/FIRM

10.1 Name of company/ entity:

10.2 AT registration number:

10.3 Company Registration number.....

10.4 TYPE OF COMPANY/ FIRM

- ☐ Partnership/ Joint Venture/ Consortium
- ☐ One-person business/ sole propriety
- ☐ Close corporation
- ☐ Public Company
- ☐ Personal Liability Company
- ☐ (Pty) Limited
- ☐ Non-Profit Company
- ☐ State Owned Company



[SELECT APPLICABLE ONE]

10.5 I/we, the undersigned, who is / are duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the B-BBEE status level of contribution indicated in paragraph (7) above, qualifies the company/ firm for the preference(s) shown and I/we acknowledge that:

- a) The Western Cape Government reserves the right to audit the B-BBEE status claim submitted by the bidder.
- b) As set out in Section 13O of the B-BBEE Act as amended, any misrepresentation constitutes a criminal offence. A person commits an offence if that person knowingly:
 - (i) misrepresents or attempts to misrepresent the B-BBEE status of an enterprise;
 - (ii) provides false information or misrepresents information to a B-BBEE Verification Professional in order to secure a particular B-BBEE status or any benefit associated with compliance to the B-BBEE Act;
 - (iii) provides false information or misrepresents information relevant to assessing the B-BBEE status of an enterprise to any organ of state or public entity; or
 - (iv) engages in a fronting practice.
- c) If a B-BBEE verification professional or any procurement officer or other official of an organ of state or public entity becomes aware of the commission of, or any attempt to commit any offence referred to in paragraph 10.5 (a) above will be reported to an appropriate law enforcement agency for investigation.
- d) Any person convicted of an offence by a court is liable in the case of contravention of 10.5 (b) to a fine or to imprisonment for a period not exceeding 10 years or to both a fine and such imprisonment or, if the convicted person is not a natural person to a fine not exceeding 10 per cent of its annual turnover.

- e) The purchaser may, if it becomes aware that a bidder may have obtained its B-BBEE status level of contribution on a fraudulent basis, investigate the matter. Should the investigation warrant a restriction be imposed, this will be referred to the National Treasury for investigation, processing and imposing the restriction on the National Treasury's List of Restricted Suppliers. The bidder or Contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, may be restricted from obtaining business from any organ of state for a period not exceeding 10 years, after the audi alteram partem (hear the other side) rule has been applied.

- f) The purchaser may, in addition to any other remedy it may have -
 - (i) disqualify the person from the bidding process;
 - (ii) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
 - (iii) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation; and
 - (iv) forward the matter for criminal prosecution.

- g) The information furnished is true and correct.

- h) The preference points claimed are in accordance with the General Conditions as indicated in paragraph 2 of this form.

SIGNATURE(S) OF THE BIDDER(S):

DATE:

ADDRESS:

WITNESSES:

- 1.

- 2.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

GOVERNMENT PROCUREMENT
GENERAL CONDITIONS OF CONTRACT

NOTES

The purpose of this document is to:

- (i) Draw special attention to certain general conditions applicable to government bids, contracts and orders; and
- (ii) To ensure that clients be familiar with regard to the rights and obligations of all parties involved in doing business with government.

In this document words in the singular also mean in the plural and vice versa and words in the masculine also mean in the feminine and neuter.

- The General Conditions of Contract will form part of all bid documents and may not be amended.
- Special Conditions of Contract (SCC) relevant to a specific bid, should be compiled separately for every bid (if applicable) and will supplement the General Conditions of Contract. Whenever there is a conflict, the provisions in the SCC shall prevail.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

TABLE OF CLAUSES

1. Definitions
2. Application
3. General
4. Standards
5. Use of contract documents and information; inspection
6. Patent rights
7. Performance security
8. Inspections, tests and analysis
9. Packing
10. Delivery and documents
11. Insurance
12. Transportation
13. Incidental services
14. Spare parts
15. Warranty
16. Payment
17. Prices
18. Contract amendments
19. Assignment
20. Subcontracts
21. Delays in the supplier's performance
22. Penalties
23. Termination for default
24. Dumping and countervailing duties
25. Force Majeure
26. Termination for insolvency
27. Settlement of disputes
28. Limitation of liability
29. Governing language
30. Applicable law
31. Notices
32. Taxes and duties
33. National Industrial Participation (NIP) Programme
34. Prohibition of Restrictive practices

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

General Conditions of Contract

1. Definitions

1. The following terms shall be interpreted as indicated:
 - 1.1 "Closing time" means the date and hour specified in the bidding documents for the receipt of bids.
 - 1.2 "Contract" means the written agreement entered into between the purchaser and the supplier, as recorded in the contract form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.
 - 1.3 "Contract price" means the price payable to the supplier under the contract for the full and proper performance of his contractual obligations.
 - 1.4 "Corrupt practice" means the offering, giving, receiving, or soliciting of anything of value to influence the action of a public official in the procurement process or in contract execution.
 - 1.5 "Countervailing duties" are imposed in cases where an enterprise abroad is subsidized by its government and encouraged to market its products internationally.
 - 1.6 "Country of origin" means the place where the goods were mined, grown or produced or from which the services are supplied. Goods are produced when, through manufacturing, processing or substantial and major assembly of components, a commercially recognized new product results that is substantially different in basic characteristics or in purpose or utility from its components.
 - 1.7 "Day" means calendar day.
 - 1.8 "Delivery" means delivery in compliance of the conditions of the contract or order.
 - 1.9 "Delivery ex stock" means immediate delivery directly from stock actually on hand.
 - 1.10 "Delivery into consignees store or to his site" means delivered and unloaded in the specified store or depot or on the specified site in compliance with the conditions of the contract or order, the supplier bearing all risks and charges involved until the supplies are so delivered and a valid receipt is obtained.
 - 1.11 "Dumping" occurs when a private enterprise abroad market its goods on own initiative in the RSA at lower prices than that of the

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06


1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

country of origin and which have the potential to harm the local industries in the RSA.

- 1.12 "Force majeure" means an event beyond the control of the supplier and not involving the supplier's fault or negligence and not foreseeable. Such events may include, but is not restricted to, acts of the purchaser in its sovereign capacity, wars or revolutions, fires, floods, epidemics, quarantine restrictions and freight embargoes.
- 1.13 "Fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of any bidder, and includes collusive practice among bidders (prior to or after bid submission) designed to establish bid prices at artificial non-competitive levels and to deprive the bidder of the benefits of free and open competition.
- 1.14 "GCC" means the General Conditions of Contract.
- 1.15 "Goods" means all of the equipment, machinery, and/or other materials that the supplier is required to supply to the purchaser under the contract.
- 1.16 "Imported content" means that portion of the bidding price represented by the cost of components, parts or materials which have been or are still to be imported (whether by the supplier or his subcontractors) and which costs are inclusive of the costs abroad, plus freight and other direct importation costs such as landing costs, dock dues, import duty, sales duty or other similar tax or duty at the South African place of entry as well as transportation and handling charges to the factory in the Republic where the supplies covered by the bid will be manufactured.
- 1.17 "Local content" means that portion of the bidding price which is not included in the imported content provided that local manufacture does take place.
- 1.18 "Manufacture" means the production of products in a factory using labour, materials, components and machinery and includes other related value-adding activities.
- 1.19 "Order" means an official written order issued for the supply of goods or works or the rendering of a service.
- 1.20 "Project site," where applicable, means the place indicated in bidding documents.
- 1.21 "Purchaser" means the organization purchasing the goods.

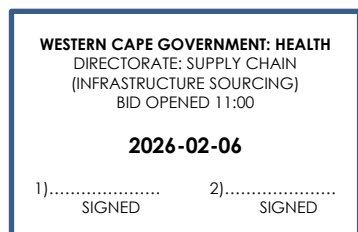

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

1.22 "Republic" means the Republic of South Africa.

1.23 "SCC" means the Special Conditions of Contract.

1.24 "Services" means those functional services ancillary to the supply of the goods, such as transportation and any other incidental services, such as installation, commissioning, provision of technical assistance, training, catering, gardening, security, maintenance and other such obligations of the supplier covered under the contract.

1.25 "Written" or "in writing" means handwritten in ink or any form of electronic or mechanical writing.

2. Application

2.1 These general conditions are applicable to all bids, contracts and orders including bids for functional and professional services, sales, hiring, letting and the granting or acquiring of rights, but excluding immovable property, unless otherwise indicated in the bidding documents.

2.2 Where applicable, special conditions of contract are also laid down to cover specific supplies, services or works.

2.3 Where such special conditions of contract are in conflict with these general conditions, the special conditions shall apply.

3. General

3.1 Unless otherwise indicated in the bidding documents, the purchaser shall not be liable for any expense incurred in the preparation and submission of a bid. Where applicable a non-refundable fee for documents may be charged.

3.2 With certain exceptions, invitations to bid are only published in the Government Tender Bulletin. The Government Tender Bulletin may be obtained directly from the Government Printer, Private Bag X85, Pretoria 0001, or accessed electronically from www.treasury.gov.za

4. Standards

4.1 The goods supplied shall conform to the standards mentioned in the bidding documents and specifications.

5. Use of contract documents and information; inspection.

5.1 The supplier shall not, without the purchaser's prior written consent, disclose the contract, or any provision thereof, or any specification, plan, drawing, pattern, sample, or information furnished by or on behalf of the purchaser in connection therewith, to any person other than a person employed by the supplier in the performance of the contract. Disclosure to any such employed person shall be made in confidence and shall extend only so far as may be necessary for purposes of such performance.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

- 5.2 The supplier shall not, without the purchaser's prior written consent, make use of any document or information mentioned in GCC clause 5.1 except for purposes of performing the contract.
- 5.3 Any document, other than the contract itself mentioned in GCC clause 5.1 shall remain the property of the purchaser and shall be returned (all copies) to the purchaser on completion of the supplier's performance under the contract if so required by the purchaser.
- 5.4 The supplier shall permit the purchaser to inspect the supplier's records relating to the performance of the supplier and to have them audited by auditors appointed by the purchaser, if so required by the purchaser.

6. Patent rights

- 6.1 The supplier shall indemnify the purchaser against all third-party claims of infringement of patent, trademark, or industrial design rights arising from use of the goods or any part thereof by the purchaser.

7. Performance security

- 7.1 Within thirty (30) days of receipt of the notification of contract award, the successful bidder shall furnish to the purchaser the performance security of the amount specified in SCC.
- 7.2 The proceeds of the performance security shall be payable to the purchaser as compensation for any loss resulting from the supplier's failure to complete his obligations under the contract.
- 7.3 The performance security shall be denominated in the currency of the contract, or in a freely convertible currency acceptable to the purchaser and shall be in one of the following forms:

WESTERN CAPE GOVERNMENT: HEALTH DIRECTORATE: SUPPLY CHAIN (INFRASTRUCTURE SOURCING) BID OPENED 11:00 2026-02-06	
1)..... SIGNED	2)..... SIGNED

- (a) a bank guarantee or an irrevocable letter of credit issued by a reputable bank located in the purchaser's country or abroad, acceptable to the purchaser, in the form provided in the bidding documents or another form acceptable to the purchaser; or
- (b) a cashier's or certified cheque

- 7.4 The performance security will be discharged by the purchaser and returned to the supplier not later than thirty (30) days following the date of completion of the supplier's performance obligations under the contract, including any warranty obligations, unless otherwise specified in SCC.

8. Inspections, tests and analyses

- 8.1 All pre-bidding testing will be for the account of the bidder.
- 8.2 If it is a bid condition that supplies to be produced or services to be rendered should at any stage during production or execution or on completion be subject to inspection, the premises of the

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

bidder or contractor shall be open, at all reasonable hours, for inspection by a representative of the Department or an organization acting on behalf of the Department.

- 8.3 If there are no inspection requirements indicated in the bidding documents and no mention is made in the contract, but during the contract period it is decided that inspections shall be carried out, the purchaser shall itself make the necessary arrangements, including payment arrangements with the testing authority concerned.
- 8.4 If the inspections, tests and analyses referred to in clauses 8.2 and 8.3 show the supplies to be in accordance with the contract requirements, the cost of the inspections, tests and analyses shall be defrayed by the purchaser.
- 8.5 Where the supplies or services referred to in clauses 8.2 and 8.3 do not comply with the contract requirements, irrespective of whether such supplies or services are accepted or not, the cost in connection with these inspections, tests or analyses shall be defrayed by the supplier.
- 8.6 Supplies and services which are referred to in clauses 8.2 and 8.3 and which do not comply with the contract requirements may be rejected.
- 8.7 Any contract supplies may on or after delivery be inspected, tested or analysed and may be rejected if found not to comply with the requirements of the contract. Such rejected supplies shall be held at the cost and risk of the supplier who shall, when called upon, remove them immediately at his own cost and forthwith substitute them with supplies which do comply with the requirements of the contract. Failing such removal the rejected supplies shall be returned at the suppliers cost and risk. Should the supplier fail to provide the substitute supplies forthwith, the purchaser may, without giving the supplier further opportunity to substitute the rejected supplies, purchase such supplies as may be necessary at the expense of the supplier.
- 8.8 The provisions of clauses 8.4 to 8.7 shall not prejudice the right of the purchaser to cancel the contract on account of a breach of the conditions thereof, or to act in terms of Clause 23 of GCC.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

9. Packing

- 9.1 The supplier shall provide such packing of the goods as is required to prevent their damage or deterioration during transit to their final destination, as indicated in the contract. The packing shall be sufficient to withstand, without limitation, rough handling during transit and exposure to extreme temperatures, salt and precipitation during transit, and open storage. Packing, case size and weights shall take into consideration, where appropriate, the

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

remoteness of the goods' final destination and the absence of heavy handling facilities at all points in transit.

- 9.2 The packing, marking, and documentation within and outside the packages shall comply strictly with such special requirements as shall be expressly provided for in the contract, including additional requirements, if any, specified in SCC, and in any subsequent instructions ordered by the purchaser.

10. Delivery and documents

- 10.1 Delivery of the goods shall be made by the supplier in accordance with the terms specified in the contract. The details of shipping and/or other documents to be furnished by the supplier are specified in SCC.

- 10.2 Documents to be submitted by the supplier are specified in SCC.

11. Insurance

- 11.1 The goods supplied under the contract shall be fully insured in a freely convertible currency against loss or damage incidental to manufacture or acquisition, transportation, storage and delivery in the manner specified in the SCC.

12. Transportation

- 12.1 Should a price other than an all-inclusive delivered price be required, this shall be specified in the SCC.

13. Incidental services

- 13.1 The supplier may be required to provide any or all of the following services, including additional services, if any, specified in SCC:

- (a) performance or supervision of on-site assembly and/or commissioning of the supplied goods;
- (b) furnishing of tools required for assembly and/or maintenance of the supplied goods;
- (c) furnishing of a detailed operations and maintenance manual for each appropriate unit of the supplied goods;
- (d) performance or supervision or maintenance and/or repair of the supplied goods, for a period of time agreed by the parties, provided that this service shall not relieve the supplier of any warranty obligations under this contract; and
- (e) training of the purchaser's personnel, at the supplier's plant and/or on-site, in assembly, start-up, operation, maintenance, and/or repair of the supplied goods.

- 13.2 Prices charged by the supplier for incidental services, if not included in the contract price for the goods, shall be agreed upon in advance by the parties and shall not exceed the prevailing rates charged to other parties by the supplier for similar services.

14. Spare parts

- 14.1 As specified in SCC, the supplier may be required to provide any or all of the following materials, notifications, and information

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

pertaining to spare parts manufactured or distributed by the supplier:

- (a) such spare parts as the purchaser may elect to purchase from the supplier, provided that this election shall not relieve the supplier of any warranty obligations under the contract; and
- (b) in the event of termination of production of the spare parts:
 - (i) Advance notification to the purchaser of the pending termination, in sufficient time to permit the purchaser to procure needed requirements; and
 - (ii) following such termination, furnishing at no cost to the purchaser, the blueprints, drawings, and specifications of the spare parts, if requested.

15. Warranty

- 15.1 The supplier warrants that the goods supplied under the contract are new, unused, of the most recent or current models, and that they incorporate all recent improvements in design and materials unless provided otherwise in the contract. The supplier further warrants that all goods supplied under this contract shall have no defect, arising from design, materials, or workmanship (except when the design and/or material is required by the purchaser's specifications) or from any act or omission of the supplier, that may develop under normal use of the supplied goods in the conditions prevailing in the country of final destination.
- 15.2 This warranty shall remain valid for twelve (12) months after the goods, or any portion thereof as the case may be, have been delivered to and accepted at the final destination indicated in the contract, or for eighteen (18) months after the date of shipment from the port or place of loading in the source country, whichever period concludes earlier, unless specified otherwise in SCC.
- 15.3 The purchaser shall promptly notify the supplier in writing of any claims arising under this warranty.
- 15.4 Upon receipt of such notice, the supplier shall, within the period specified in SCC and with all reasonable speed, repair or replace the defective goods or parts thereof, without costs to the purchaser.
- 15.5 If the supplier, having been notified, fails to remedy the defect(s) within the period specified in SCC, the purchaser may proceed to take such remedial action as may be necessary, at the supplier's risk and expense and without prejudice to any other rights which the purchaser may have against the supplier under the contract.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

- 16. Payment**
- 16.1 The method and conditions of payment to be made to the supplier under this contract shall be specified in SCC.
- 16.2 The supplier shall furnish the purchaser with an invoice accompanied by a copy of the delivery note and upon fulfilment of other obligations stipulated in the contract.
- 16.3 Payments shall be made promptly by the purchaser, but in no case later than thirty (30) days after submission of an invoice or claim by the supplier.
- 16.4 Payment will be made in Rand unless otherwise stipulated in SCC.
- 17. Prices**
- 17.1 Prices charged by the supplier for goods delivered and services performed under the contract shall not vary from the prices quoted by the supplier in his bid, with the exception of any price adjustments authorized in SCC or in the purchaser's request for bid validity extension, as the case may be.
- 18. Contract amendments**
- 18.1 No variation in or modification of the terms of the contract shall be made except by written amendment signed by the parties concerned.
- 19. Assignment**
- 19.1 The supplier shall not assign, in whole or in part, its obligations to perform under the contract, except with the purchaser's prior written consent.
- 20. Subcontracts**
- 20.1 The supplier shall notify the purchaser in writing of all subcontracts awarded under this contract if not already specified in the bid. Such notification, in the original bid or later, shall not relieve the supplier from any liability or obligation under the contract.
- 21. Delays in the supplier's performance**
- 21.1 Delivery of the goods and performance of services shall be made by the supplier in accordance with the time schedule prescribed by the purchaser in the contract.
- 21.2 If at any time during performance of the contract, the supplier or its subcontractor(s) should encounter conditions impeding timely delivery of the goods and performance of services, the supplier shall promptly notify the purchaser in writing of the fact of the delay, its likely duration and its cause(s). As soon as practicable after receipt of the supplier's notice, the purchaser shall evaluate the situation and may at his discretion extend the supplier's time for performance, with or without the imposition of penalties, in which case the extension shall be ratified by the parties by amendment of contract.
- 21.3 No provision in a contract shall be deemed to prohibit the obtaining of supplies or services from a national department, provincial department, or a local authority.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

- 21.4 The right is reserved to procure outside of the contract small quantities or to have minor essential services executed if an emergency arises, the supplier's point of supply is not situated at or near the place where the supplies are required, or the supplier's services are not readily available.
- 21.5 Except as provided under GCC Clause 25, a delay by the supplier in the performance of its delivery obligations shall render the supplier liable to the imposition of penalties, pursuant to GCC Clause 22, unless an extension of time is agreed upon pursuant to GCC Clause 21.2 without the application of penalties.
- 21.6 Upon any delay beyond the delivery period in the case of a supplies contract, the purchaser shall, without cancelling the contract, be entitled to purchase supplies of a similar quality and up to the same quantity in substitution of the goods not supplied in conformity with the contract and to return any goods delivered later at the supplier's expense and risk, or to cancel the contract and buy such goods as may be required to complete the contract and without prejudice to his other rights, be entitled to claim damages from the supplier.

22. Penalties

- 22.1 Subject to GCC Clause 25, if the supplier fails to deliver any or all of the goods or to perform the services within the period(s) specified in the contract, the purchaser shall, without prejudice to its other remedies under the contract, deduct from the contract price, as a penalty, a sum calculated on the delivered price of the delayed goods or unperformed services using the current prime interest rate calculated for each day of the delay until actual delivery or performance. The purchaser may also consider termination of the contract pursuant to GCC Clause 23.

23. Termination for default

- 23.1 The purchaser, without prejudice to any other remedy for breach of contract, by written notice of default sent to the supplier, may terminate this contract in whole or in part:

- (a) if the supplier fails to deliver any or all of the goods within the period(s) specified in the contract, or within any extension thereof granted by the purchaser pursuant to GCC Clause 21.2;
- (b) if the Supplier fails to perform any other obligation(s) under the contract; or
- (c) if the supplier, in the judgment of the purchaser, has engaged in corrupt or fraudulent practices in competing for or in executing the contract.

WESTERN CAPE GOVERNMENT: HEALTH	
DIRECTORATE: SUPPLY CHAIN	
(INFRASTRUCTURE SOURCING)	
BID OPENED 11:00	
2026-02-06	
1).....	2).....
SIGNED	SIGNED

- 23.2 In the event the purchaser terminates the contract in whole or in part, the purchaser may procure, upon such terms and in such manner as it deems appropriate, goods, works or services similar to those undelivered, and the supplier shall be liable to the

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

purchaser for any excess costs for such similar goods, works or services. However, the supplier shall continue performance of the contract to the extent not terminated.

24. Anti-dumping and countervailing duties and rights

24.1 When, after the date of bid, provisional payments are required, or anti-dumping or countervailing duties are imposed, or the amount of a provisional payment or anti-dumping or countervailing right is increased in respect of any dumped or subsidized import, the State is not liable for any amount so required or imposed, or for the amount of any such increase. When, after the said date, such a provisional payment is no longer required or any such anti-dumping or countervailing right is abolished, or where the amount of such provisional payment or any such right is reduced, any such favourable difference shall on demand be paid forthwith by the contractor to the State or the State may deduct such amounts from moneys (if any) which may otherwise be due to the contractor in regard to supplies or services which he delivered or rendered, or is to deliver or render in terms of the contract or any other contract or any other amount which may be due to him

25. Force Majeure

25.1 Notwithstanding the provisions of GCC Clauses 22 and 23, the supplier shall not be liable for forfeiture of its performance security, damages, or termination for default if and to the extent that his delay in performance or other failure to perform his obligations under the contract is the result of an event of force majeure.

25.2 If a force majeure situation arises, the supplier shall promptly notify the purchaser in writing of such condition and the cause thereof. Unless otherwise directed by the purchaser in writing, the supplier shall continue to perform its obligations under the contract as far as is reasonably practical, and shall seek all reasonable alternative means for performance not prevented by the force majeure event.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1)..... 2).....
SIGNED SIGNED

26. Termination for insolvency

26.1 The purchaser may at any time terminate the contract by giving written notice to the supplier if the supplier becomes bankrupt or otherwise insolvent. In this event, termination will be without compensation to the supplier, provided that such termination will not prejudice or affect any right of action or remedy which has accrued or will accrue thereafter to the purchaser.

27. Settlement of Disputes

27.1 If any dispute or difference of any kind whatsoever arises between the purchaser and the supplier in connection with or arising out of the contract, the parties shall make every effort to resolve amicably such dispute or difference by mutual consultation.

27.2 If, after thirty (30) days, the parties have failed to resolve their dispute or difference by such mutual consultation, then either the

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

purchaser or the supplier may give notice to the other party of his intention to commence with mediation. No mediation in respect of this matter may be commenced unless such notice is given to the other party.

27.3 Should it not be possible to settle a dispute by means of mediation, it may be settled in a South African court of law.

27.4 Mediation proceedings shall be conducted in accordance with the rules of procedure specified in the SCC.

27.5 Notwithstanding any reference to mediation and/or court proceedings herein,

- (a) the parties shall continue to perform their respective obligations under the contract unless they otherwise agree; and
- (b) the purchaser shall pay the supplier any monies due the supplier.

28. Limitation of liability

28.1 Except in cases of criminal negligence or wilful misconduct, and in the case of infringement pursuant to Clause 6;

(a) the supplier shall not be liable to the purchaser, whether in contract, tort, or otherwise, for any indirect or consequential loss or damage, loss of use, loss of production, or loss of profits or interest costs, provided that this exclusion shall not apply to any obligation of the supplier to pay penalties and/or damages to the purchaser; and

(b) the aggregate liability of the supplier to the purchaser, whether under the contract, in tort or otherwise, shall not exceed the total contract price, provided that this limitation shall not apply to the cost of repairing or replacing defective equipment.

29. Governing language

29.1 The contract shall be written in English. All correspondence and other documents pertaining to the contract that is exchanged by the parties shall also be written in English.

30. Applicable law

30.1 The contract shall be interpreted in accordance with South African laws, unless otherwise specified in SCC.

31. Notices

31.1 Every written acceptance of a bid shall be posted to the supplier concerned by registered or certified mail and any other notice to him shall be posted by ordinary mail to the address furnished in his bid or to the address notified later by him in writing and such posting shall be deemed to be proper service of such notice

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

31.2 The time mentioned in the contract documents for performing any act after such aforesaid notice has been given, shall be reckoned from the date of posting of such notice.

32. Taxes and duties

32.1 A foreign supplier shall be entirely responsible for all taxes, stamp duties, license fees, and other such levies imposed outside the purchaser's country.

32.2 A local supplier shall be entirely responsible for all taxes, duties, license fees, etc., incurred until delivery of the contracted goods to the purchaser.

32.3 No contract shall be concluded with any bidder whose tax matters are not in order. Prior to the award of a bid the Department must be in possession of a tax clearance certificate, submitted by the bidder. This certificate must be an original issued by the South African Revenue Services.

33. National Industrial Participation (NIP) Programme

33.1 The NIP Programme administered by the Department of Trade and Industry shall be applicable to all contracts that are subject to the NIP obligation.

34. Prohibition of Restrictive practices

34.1 In terms of section 4 (1) (b) (iii) of the Competition Act No. 89 of 1998, as amended, an agreement between, or concerted practice by, firms, or a decision by an association of firms, is prohibited if it is between parties in a horizontal relationship and if a bidder (s) is / are or a contractor(s) was / were involved in collusive bidding (or bid rigging).

34.2 If a bidder(s) or contractor(s), based on reasonable grounds or evidence obtained by the purchaser, has / have engaged in the restrictive practice referred to above, the purchaser may refer the matter to the Competition Commission for investigation and possible imposition of administrative penalties as contemplated in the Competition Act No. 89 of 1998.

34.3 If a bidder(s) or contractor(s), has / have been found guilty by the Competition Commission of the restrictive practice referred to above, the purchaser may, in addition and without prejudice to any other remedy provided for, invalidate the bid(s) for such item(s) offered, and / or terminate the contract in whole or part, and / or restrict the bidder(s) or contractor(s) from conducting business with the public sector for a period not exceeding ten (10) years and / or claim damages from the bidder(s) or contractor(s) concerned.

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED

WCGHIC0008/2025: SERVICING OF HOSPITAL STANDBY GENERATORS AT VARIOUS HEALTH INSTITUTIONS WITHIN THE WESTERN CAPE REQUIRED BY DIRECTORATE: ENGINEERING AND TECHNICAL SUPPORT SERVICES OF THE DEPARTMENT OF HEALTH & WELLNESS, WESTERN CAPE FOR A PERIOD OF THREE (3)

OCCUPATIONAL HEALTH AND SAFETY AGREEMENT

AGREEMENT MADE AND ENTERED INTO BETWEEN THE DEPARTMENT OF HEALTH & WELLNESS (HEREINAFTER CALLED THE "WCDOHW")

AND

.....
(Supplier/Mandatory/Company/CC Name)

IN TERMS OF SECTION 37(2) OF THE OCCUPATIONAL HEALTH AND SAFETY ACT, 85 OF 1993 AS AMENDED.

I,

representingas an employer

The Contractor acknowledges that it is an employer in its own right, and will be responsible for compliance with the OHS Act and regulations while its employees, agents, or subcontractors are performing work for the Department. I furthermore confirm that I am/we are registered with the Compensation Commissioner and that all registration and assessment monies due to the Compensation Commissioner have been fully paid or that I/We are insured with an approved licensed compensation insurer.

COID ACT Registration Number:

OR Compensation Insurer:Policy No.:

The Contractor undertakes to:

Comply with the OHS Act, regulations, and all applicable safety standards during the execution of work.

Provide a written Health and Safety Policy applicable to the work performed.

Appoint in writing a competent person as defined in the Act to oversee health and safety compliance and act as liaison with the Department.

Conduct risk assessments relevant to the work, and provide method statements and safety plans where applicable.

ensure all employees are adequately trained on health and safety applicable to the work and provide proof of such training upon request.

I further undertake to ensure that any subcontractors employed by me will enter into an occupational health and safety agreement separately, and that such subcontractors comply with the conditions set.

I hereby also undertake to comply with the Occupational Health and Safety Specification and Plan submitted and approved in terms thereof.

Signed at on the.....day of.....20....

Witness

Mandatory

Signed at..... on the.....day of.....20

Witness

for and on behalf of WCDOHW

WESTERN CAPE GOVERNMENT: HEALTH
DIRECTORATE: SUPPLY CHAIN
(INFRASTRUCTURE SOURCING)
BID OPENED 11:00

2026-02-06

1).....
SIGNED

2).....
SIGNED