



VIEW 'B'

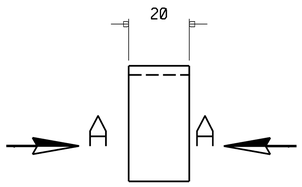



PRIMARY REHEATER EROSION CLIP
VIEW 'A'

MATERIAL:
304 STAINLESS STEEL
3mm THICK

NOTES:
1. ID = 70
2. OD = 76
3. COVERAGE = 200°
4. CLIPS ARE TO BE 20mm WIDE AND OVERLAP SHIELD BY 5mm

MATERIAL:
304 STAINLESS STEEL 3mm THICK

NOTES:
1. 180° COVERAGE
2. ID = 64
3. OD = 70

THIS DRAWING HAS BEEN CREATED ON A C.A.D. SYSTEM.
ANY AMENDMENT MUST BE EFFECTED ON THE SAME SYSTEM.

D.O.	REV	DATE	** REVISION **	REV BY	CHKD BY	AUTH BY	APPR BY	KKS APPR	REFERENCE DRAWINGS

CODIFICATION BY:
APPROVED BY:
AUTHORISED BY:
CHECKED BY: L.S
CREATED BY: M.A.P.
SCALE

CLASSIFICATION
PBS PATH

Eskom
ESKOM HOLDINGS SOC Ltd
REG No 2002/015527/30

LETHABO POWER STATION NAME
BOILER PLANT ENGINEERING
PRIMARY REHEATER
64MM STRAIGHT 3000MM LENGTH SHIELD G.A

ESKOM DRAWING NO: 0.63/59189
SHT
REV: 00

SIZE GROOTTE A1L