
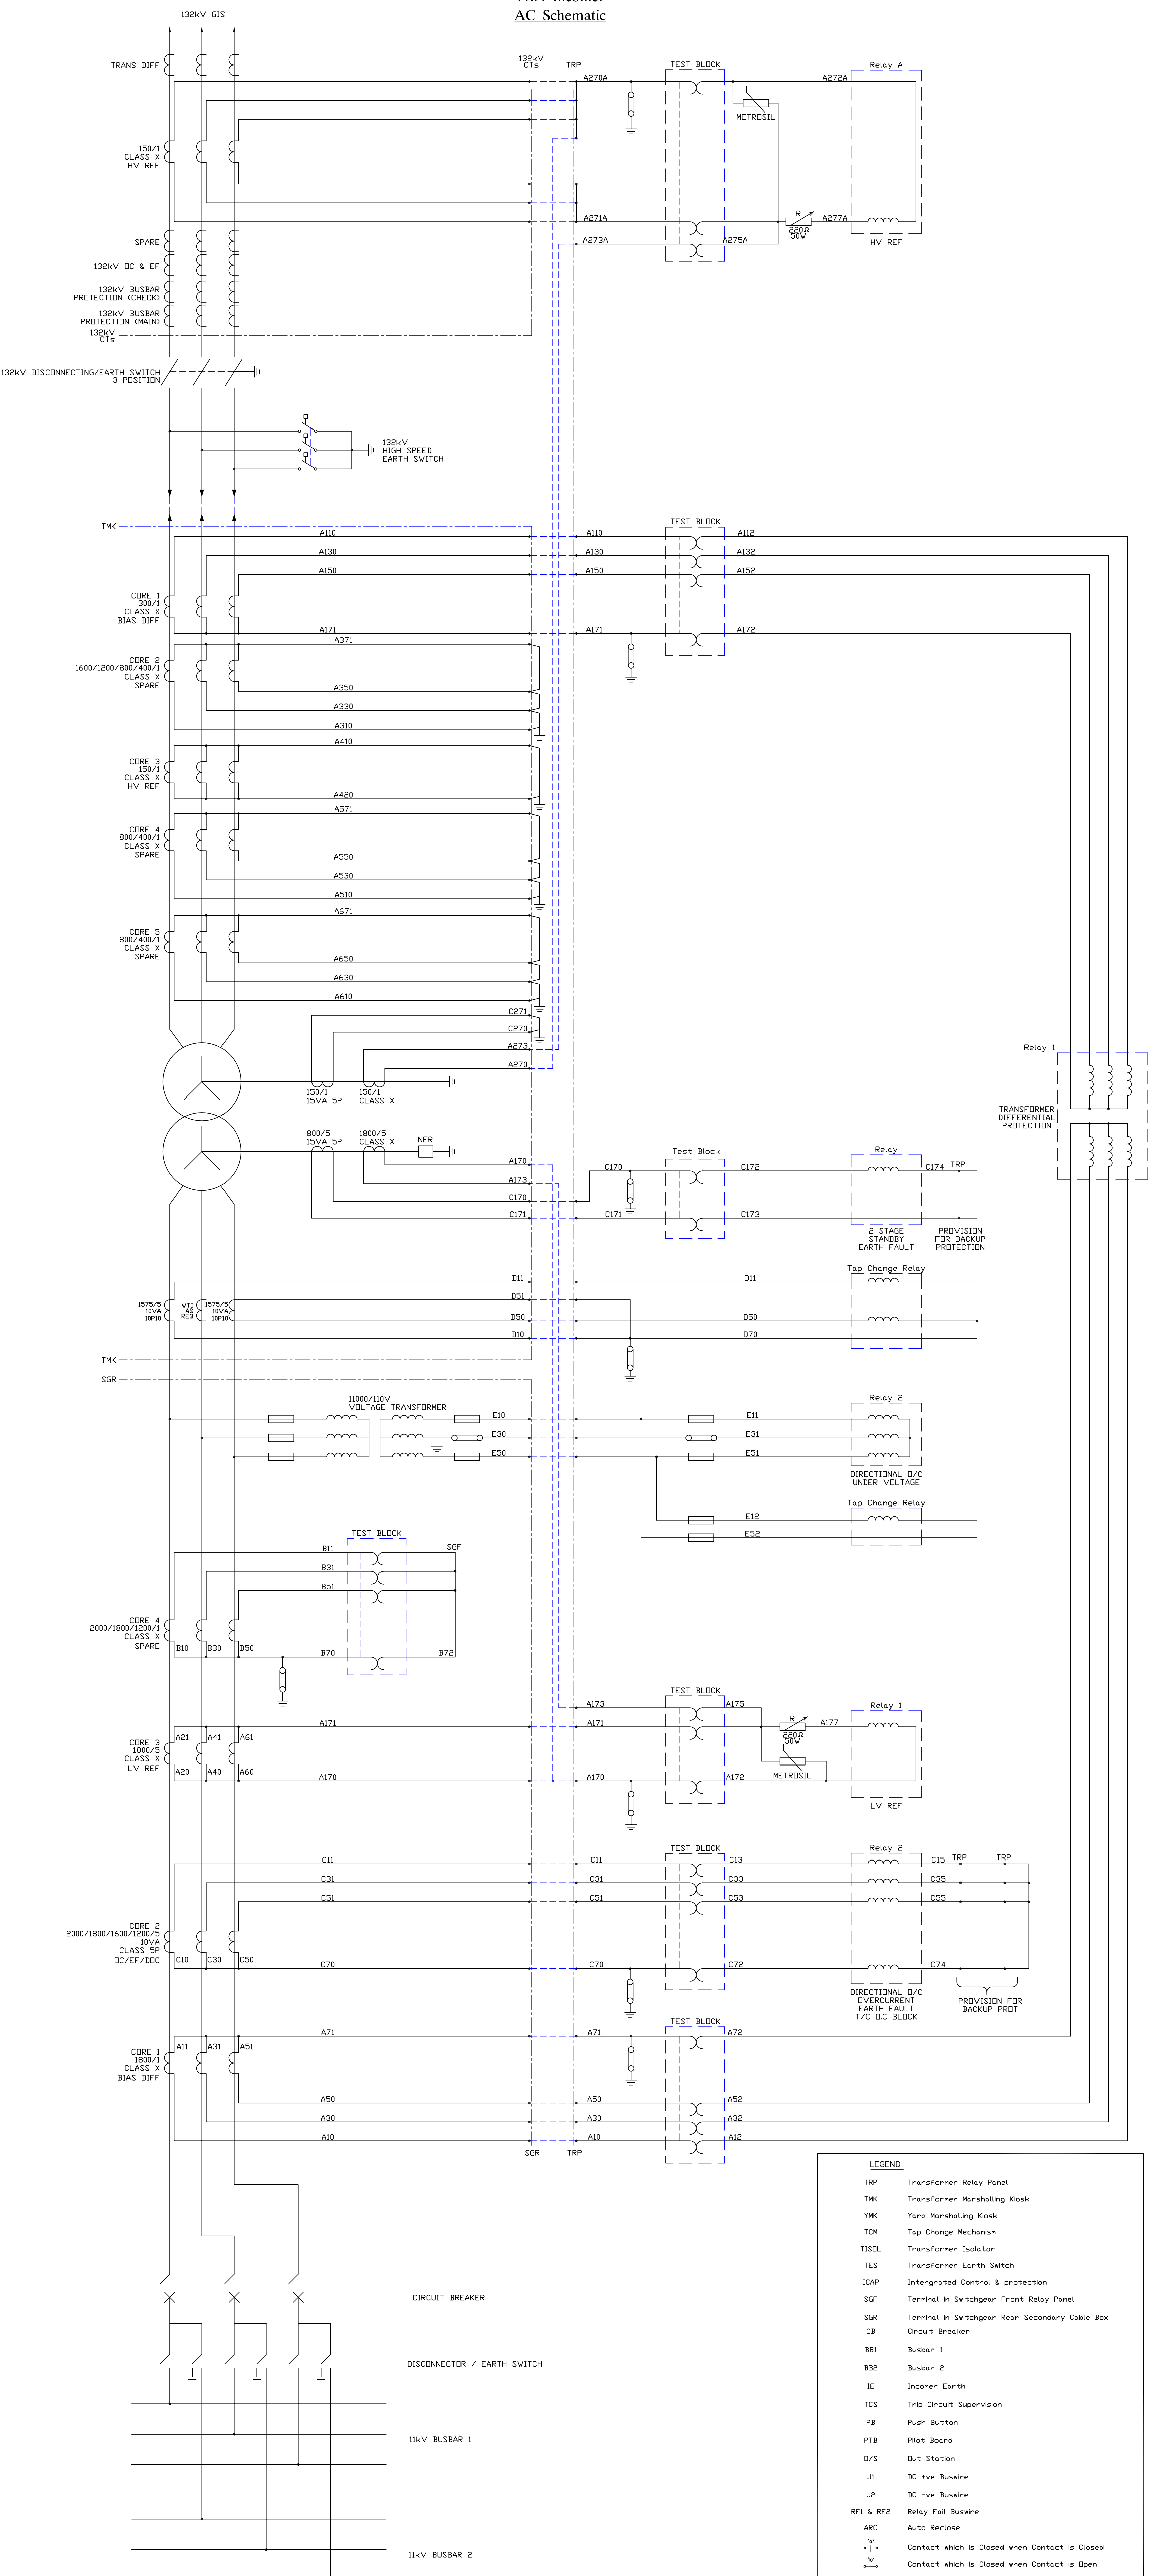


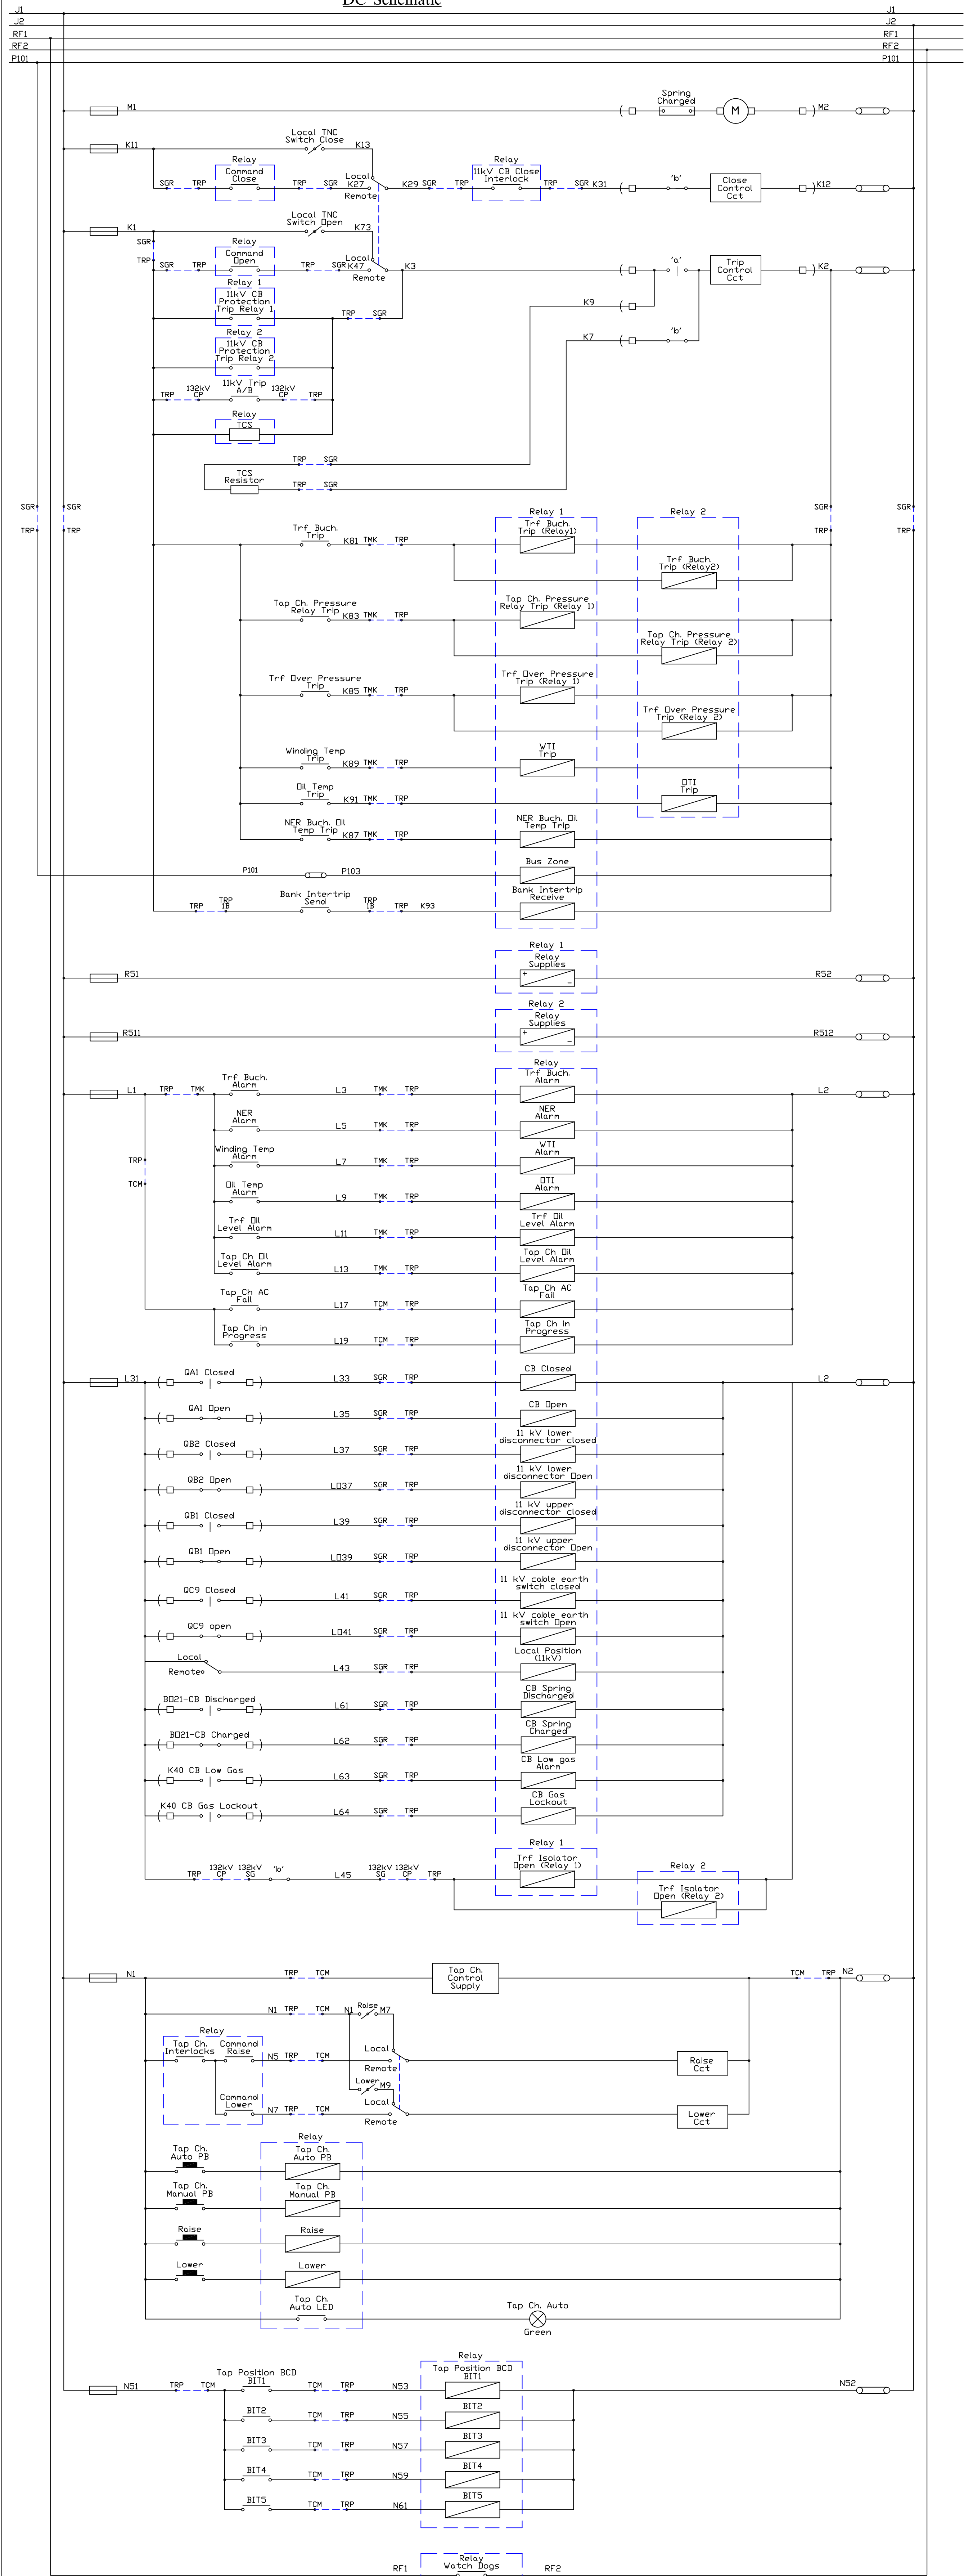

5. Test blocks have been shown schematically. The actual wiring must be such as to be, from the left, 'RED' 'WHITE' and 'BLUE' as viewed from the front of the test block.

DRWN	J. LAWRENCE				
DATE	25.03.2009				
CHEF DRAWING PLANNING DESIGN		REFERENCE DRAWING:	1. DRAWING FOR 11 kV FIXED PATTERN DISTRIBUTION	NO.	PREP-01-01
PREDICTION PLANNING DESIGN			REVISIONS	BY	DATE
PROJECTS PLANNING DESIGN		ETHEKHEM ELECTRICITY PROPOSED 132/11kV SUBSTATION WITH 132kV GIS WITH JERICHO			
PROJECTS PLANNING DESIGN		AC & DC SCHEMATIC OF 132/11kV TRANSFORMER (FIXED PATTERN)			
APPROVED		SCALE:	DRAWING NUMBER:		REV
DESIGN REVIEW H.V. OPERATIONS		NTS	TD 69		1