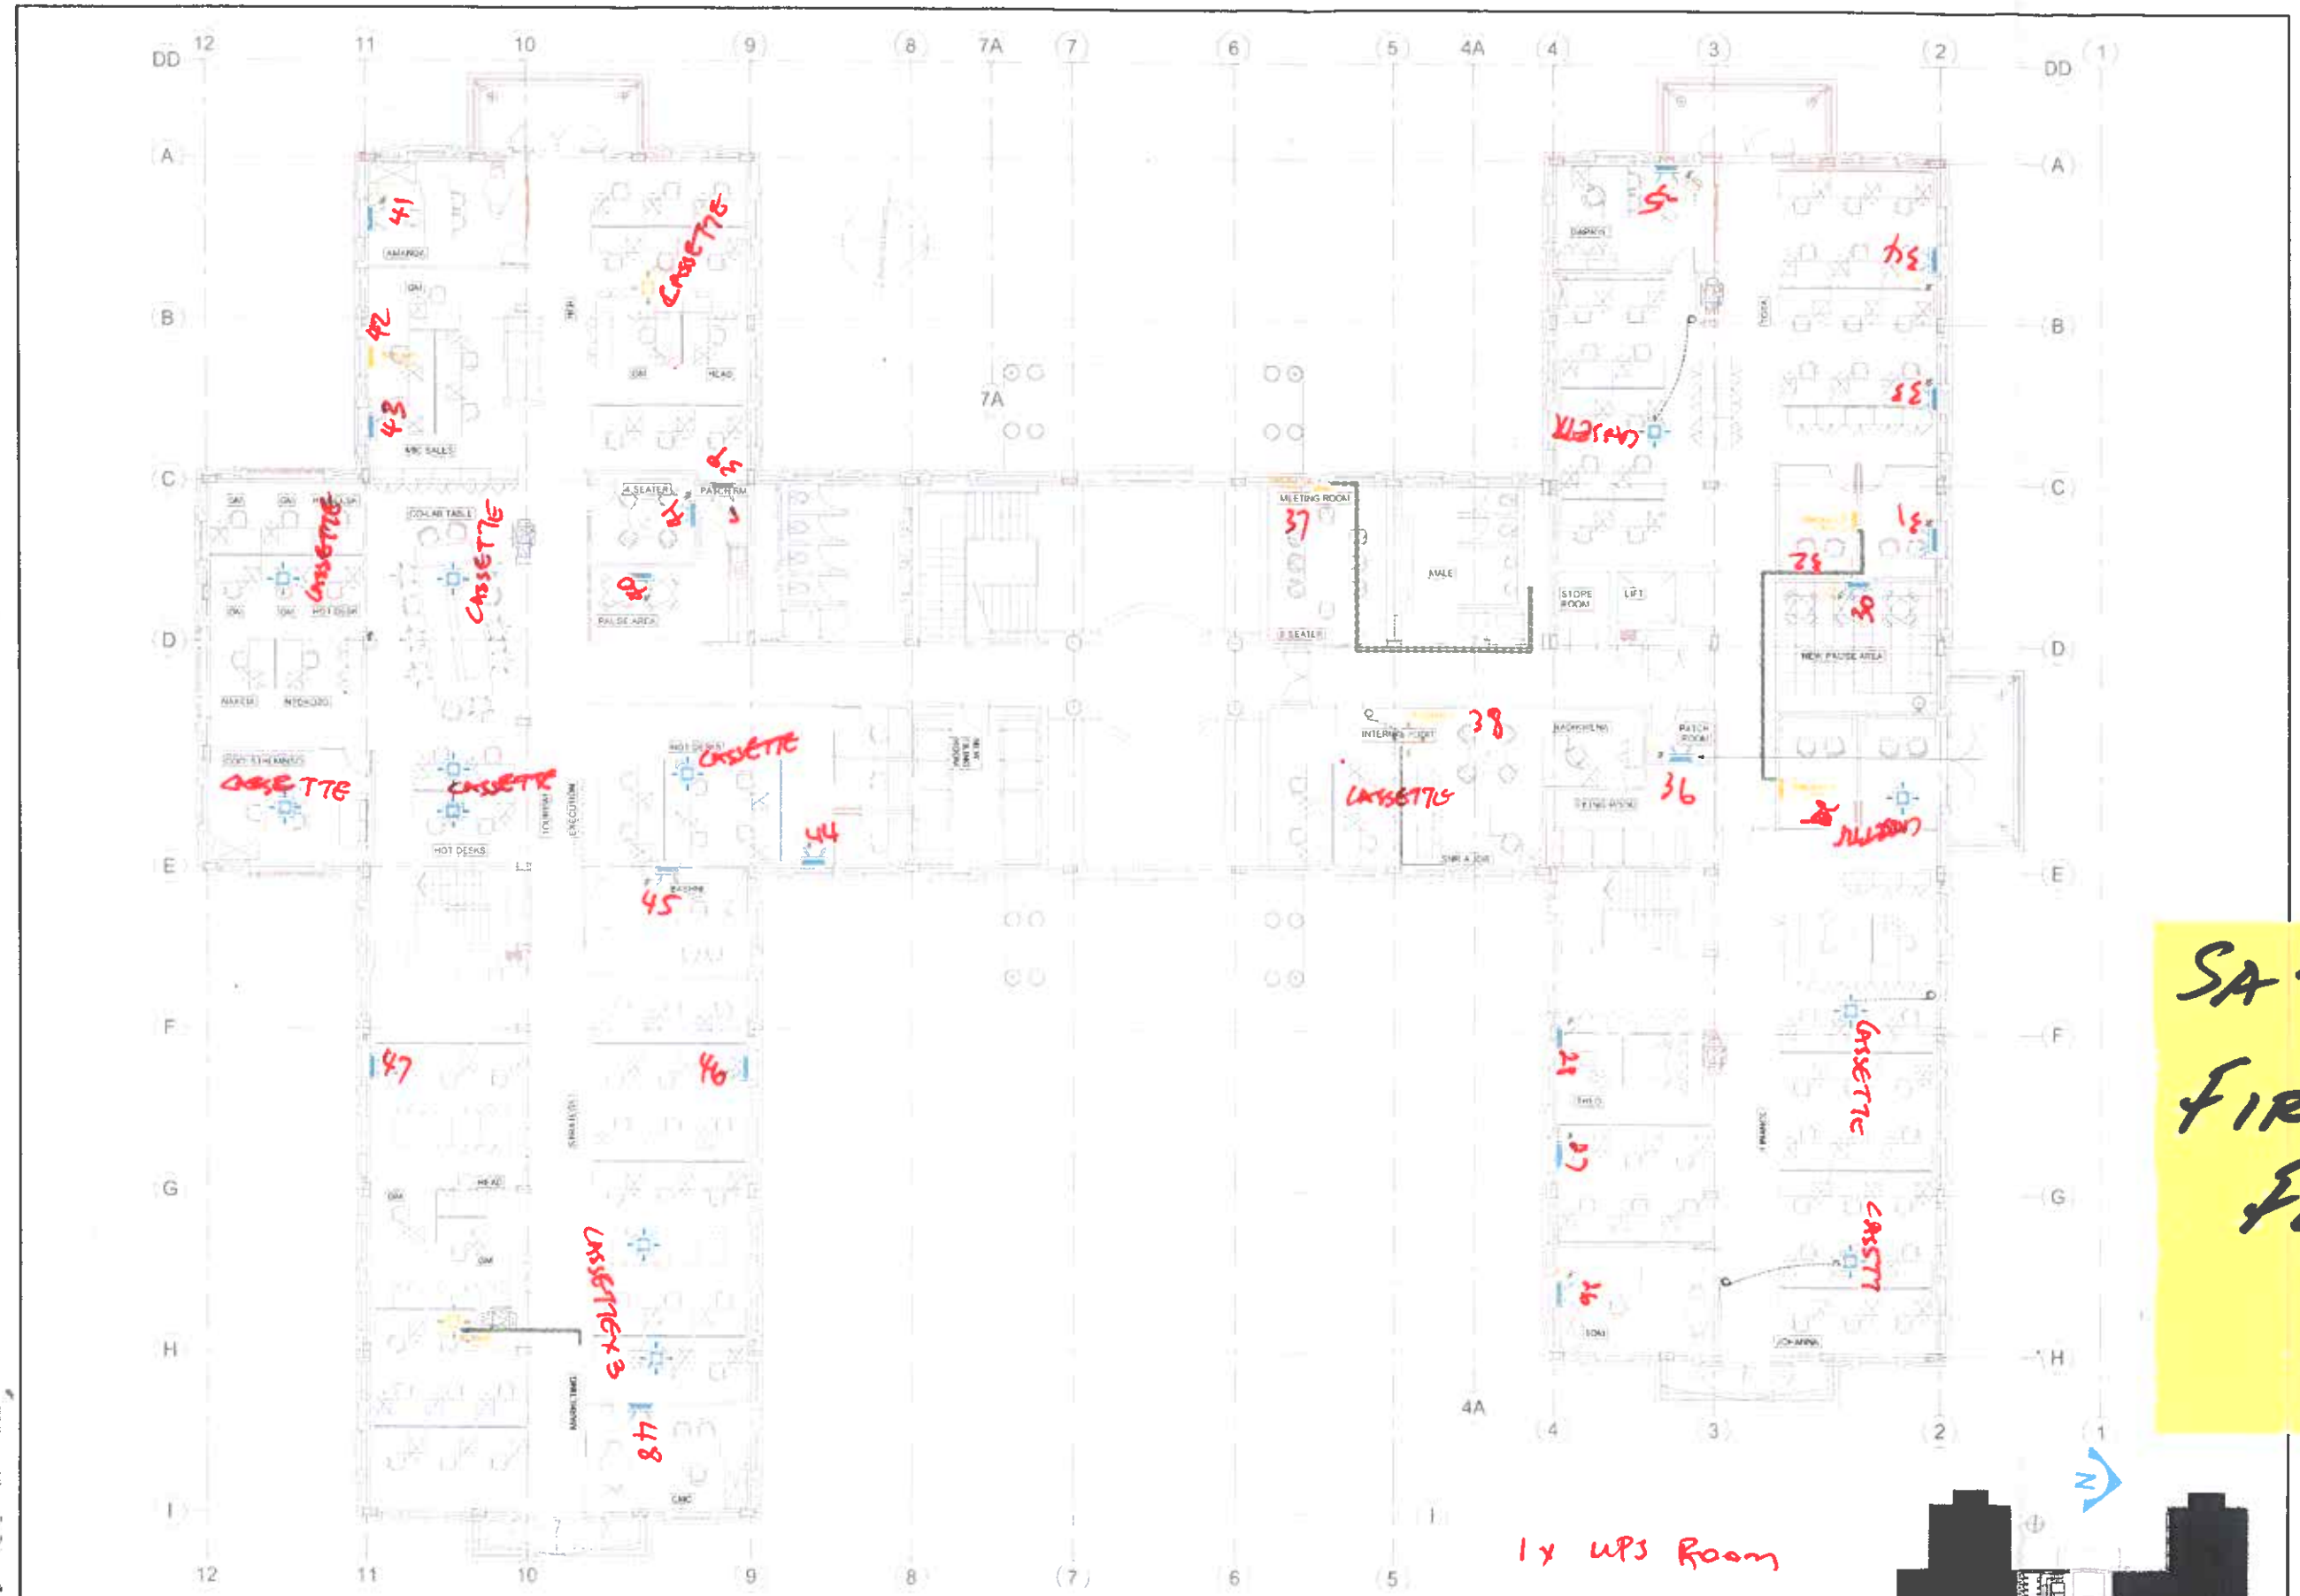

First Floor Split Unit Layout

1 : 100

First Floor - Split DX Units Schedule															
Code	Type	Capacity				Physical Properties				Power		Refrigerant	Inverter (Yes/No)	No. Off	Notes
		Cooling Total (kW)	Cooling Sensible (kW)	Heating Capacity (kW)	Air Flow (l/s)	Width (mm)	Depth (mm)	Height (mm)	Weight (kg)	Phase (V/ph/Hz)	Absorbed (kW)	Type			
SCUI-01	Cassette	8.8	8	9.2	200	620	620	275	18	231:1/50	3.00	R410-A	Yes	1	
SCUI-02	Cassette	5	4.5	5	170	620	620	275	18	231:1/50	1.70	R410-A	Yes	1	
SMUI-01	Mini wall	2.5	2	1.7	128	800	225	290	9	231:1/50	0.85	R410-A	Yes	4	

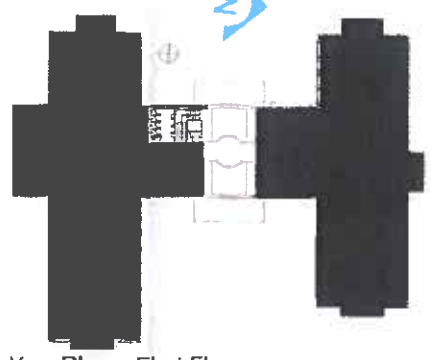

Key Plan - First Floor

N.T.S

Revisions:

Rev	Description	Date	By
0	Issued For Tender	28.02.2019	GR
1	Issued For Construction	25.04.2019	GR
1.0	WORKSHOP DRAWING	17.05.2019	GM
2	Issued For Council Approval	05.07.2019	GR
3	New split unit and isolators for switching split units added	18.07.2019	DM
AS	AS-BUILT	04.10.2019	GM

Terminals:

Rectangular Diffuser (plate)

Ducting

Uninsulated fresh air ducting

SA Tourism
First
Floor

SA TOURISM

Drawing Title:

First Floor Split Unit Layout

Designed	Drawn	Checked		Passed	Date	Size
		Quality	Design	PR Eng		A1
FJ	GM	MR	MR	RMR	04.10.2019	Scale
						As indicated

Drawing Status : AS-BUILT

Project Number	Division	Service	Drawing Number	Revision
181055	M	A	401/SU	AB

C:\Users\Desktop\Documents\181055-SA TOURISM_HVAC_(CENTRAL)_V17_Detail\Repromaster.rvt
18/07/2019 04:41:43 PM