



TENDER DOCUMENT

FOR

BID NO: SCMU3-23/24-0491-HO: SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

THREE VOLUME APPROACH:

**VOLUME 1 – TENDERING PROCEDURES
VOLUME 2 – RETURNABLE DOCUMENTS
VOLUME 3 – DRAFT CONTRACT**

PREPARED FOR:

Eastern Cape Department of Health
Dukumbana Building, Independence Avenue
P.O. Box X0038
BHISHO
6505

PREPARED BY:

Eastern Cape Department of Health
Dukumbana Building, Independence Avenue
P.O. Box X0038
BHISHO
6505

NAME OF SUPPLIER: _____

CRS NUMBER: _____

SEPTEMBER 2023

	CONTENTS	
Volume	Number	Heading
Volume 1		Tendering Procedures
	T1.1	Tender Notice And Invitation To Supplier
	T1.2	Tender Data
	T1.3	Annex F: CIDB Standard Conditions of Tender
Volume 2		Returnable Documents
	SBD1	Invitation to Bid: Part A and B
	SBD 4	Declaration of Interest
	SBD 6.1	Preference Points Claim Form In Terms Of The Preferential Procurement Regulations 2022
	T2.2r	Compulsory Enterprise Questionnaire
	T2.1	List of Returnable Schedules/Documents
	C1.1a	Final Summary Page
	C2.2	Preliminaries and General & Bill of Quantities
	T2.2a	Resolution for Signatory
	T2.2b	Resolution of Board of Directors to Enter into Consortium or Joint Venture (JV) Agreements
	T2.2c-1	Schedule of Proposed Subcontractors
	T2.2c-2	Schedule of Proposed Particulars of Mechanical and Electrical Subcontractors
	T2.2d	Schedule of Plant and Equipment
	T2.2e	Schedule of Imported Material and Equipment
	T2.2f	Bank Rating
	T2.2g	Specific goals claimed (CIPRO certificate)
	T2.2n	Record of Addenda to Supplier Documents
	T2.2y	Proof of Registration with Centralized Supplier Database
	T2.2u	CIDB grading certificate – Proof of registration
	T2.2v	CIPC - company registration certificate
	T2.2x	References
	T2.3	Returnable schedules or documents: Annexures related to evaluation
	Annexure A	Method Statement (Generic)
	Annexure A1	Summary Task
	Annexure A2	Programme with Timelines and Resources
	Annexure B1	Key personnel qualifications (Construction manager)
	Annexure B2	Key personnel qualifications (Construction Supervisor)
Volume 3	Annexure B3	Key personnel qualifications (OHS Safety officer)
	Annexure B4	Key personnel qualifications (Skilled installation/maintenance staff)
		Draft Contract
		Part C1: Agreement and Contract Data
	C1.1	Form of Offer and Acceptance
	C1.2	Contract Data
	C1.3	Fixed Performance Guarantee
	C1.4	Agreement in terms of section 37 (2) of the OH &S Act (Act no 85 of 1993)
		Part C2: Pricing Data
	C2.1	Pricing Instructions
	C2.2	Bills of Quantities
		Part C3: Scope of Work
	C3.1a	Standard Specification
	C3.6	Health and Safety Specification
	C3.7	HIV/AIDS Specification with Schedules A to C

	Part C4: Site Information
C4.1	Site Information as per Standard Specification
C4.1a	Supplementary Technical Specification

VOLUME 1: TENDERING PROCEDURES

T1.1: TENDER NOTICE AND INVITATION TO SUPPLIER

T1.1: TENDER NOTICE AND INVITATION TO SUPPLIER
THE EASTERN CAPE DEPARTMENT OF HEALTH INVITES SUPPLIERS
FOR:

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Any reference to words “Bid” or Bidder” herein and/or in any other documentation shall be construed to have the same meaning as the words “Supplier” or “Tender”.

The attention of Suppliers is drawn to the eligibility criteria in the table below. Suppliers are required to familiarise themselves thoroughly with the conditions of Supplier as contained in the Supplier Data (T1.2) and the Standard Conditions of Supplier (T1.3) which form part of the Supplier document. Only Suppliers that are responsive to responsiveness criteria contained in the table below are eligible to have their Suppliers evaluated:

☒	<u>Joint ventures are eligible to submit tenders provided that:</u> They have a signed joint venture agreement
☒	Only Suppliers who have access to a suitably qualified and experienced contract manager who will be the single-point of accountability and responsibility for the management of the contract works as described in clause F.2.1.2 shall be eligible to have their Tenders evaluated. <i>Experience must be on generator installation and maintenance industry.</i>
☒	Only Suppliers who have access to a suitably qualified and experienced contract supervisor as described in clause F.2.1.3 shall be eligible to have their Tenders evaluated. <i>Experience must be on generator installation and maintenance industry.</i>
☒	Suppliers that are responsive to the criteria stated above shall be evaluated further in accordance with the conditions of Supplier as stipulated in the Tender Data (T1.2) and the Standard Conditions of Tender (as amended), which form part of this Tender document.

Preferences are offered to Suppliers in accordance with the points systems as below:

☒ 80/20 Preference point scoring system

Preference:		Price:	
SPECIFIC GOALS Status Level:	20 Points	Price:	80 Points
Total must equal:	20 Points	Total must equal:	80 Points

1. AVAILABILITY OF SUPPLIER DOCUMENTS:

- ☒ Tender documents may be freely downloaded from Tender portal www.echealth.go.za OR www.etenders.go.za
- ☒ A compulsory clarification meeting with the representatives of the Employer will take place as follows:

Date: 11 October 2023

Venue: John Tremble Hall, Frere Hospital,
Amalinda, East London

Time: 11h00am

2. ENQUIRIES RELATED TO TENDER DOCUMENTS MAY BE ADDRESSED TO:

Procurement Contact:	Ms Thabisa Notshe	E-mail	thabisa.notshe@echealth.gov.za
Tel. No.	040 608 9641		

3. DEPOSIT / RETURN OF TENDER DOCUMENTS:

The closing time and date for submission of Tender is 11:00am on the **27 October 2023** where Tenders will be opened to the public. The following must be noted by all Suppliers;

1. Telegraphic, telephonic, telex, facsimile (faxed), email and late Tenders will not be accepted.
2. The requirements for sealing, addressing, delivery, opening and assessment of Tenders are stated in the Tender Data (T1.2)
3. All Suppliers must be submitted on the official, hardcopy documents issued with the bid including any addenda issued to prospective Suppliers by the Department.
4. Tender documents must be deposited in the Tender box at the address indicated below:

DEPOSITED IN THE TENDER BOX AT:

Department of Health
Global Life Centre,
SCM Unit
c/o Phalo Avenue and R63 (opposite Engen Garage)
BHISHO

COMPILED BY:

Section	Department	Date
Engineering and Technical Services	Lukhozi Consortium	September 2023

T1.2: TENDER DATA

T1.2: TENDER DATA

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Clause number	
	The conditions of Supplier are the Standard Conditions of Supplier as contained in Annex F of Board Notice 136 of 2015 in Government Gazette No. 38960 of 10 July 2015, Construction Industry Development Board (CIDB) Standard for Uniformity in Construction Procurement. (See www.cidb.org.za) which are reproduced without amendment or alteration for the convenience of Suppliers as an Annex to this Tender Data. The Standard Conditions of Supplier make several references to the tender Data for details that apply specifically to this Tender. The Tender Data shall have precedence in the interpretation of any ambiguity or inconsistency between it and the standard conditions of Supplier. Each item of data given below is cross-referenced to the clause in the Standard Conditions of Supplier to which it mainly applies. The following variations, amendments and additions to the Standard Conditions of Supplier as set out in the Tender Data below shall apply to this Supplier:
F.1.1	<i>Add the following:</i> The employer is the Eastern Cape Department of Health Global Life Center c/o R63 and Phalo Avenue Bhisho
F.1.2	<i>Add the following:</i> Tender documents issued by the Employer comprise of: <u>Volume 1: Tendering Procedures</u> T1.1 Tender Notice and Invitation to Supplier T1.2 Tender Data T1.3 Annex F: CIDB Standard Conditions of Tender <u>Volume 2: Returnable Documents</u> SBD1 Invitation Bid: Part A and B SBD4 Declaration of Interest SBD6.1 Preference Points Claim Form in Terms of the Preference Regulations 2022 T2.2r Compulsory Enterprise Questionnaire T2.1 List of Returnable Schedules/Documents C1.1a Final Summary Page C2.2: Preliminaries and General & Bills of Quantities T2.2a Resolution of Signatory T2.2b Resolution of Board of Directors to Enter into Consortium or Joint Venture (JV) Agreements T2.2c-1 Schedule of Proposed Subcontractors T2.2c-2 Schedule of Proposed Particulars of Mechanical and Electrical Subcontractors T2.2d Schedule of Proposed Plant and Equipment T2.2e Schedule of Proposed Imported Material and Equipment T2.2f Bank Rating T2.2g Specific goals claimed (CIPRO certificate) T2.2n Record of Addenda to Supplier Documents T2.2y Proof of Registration with Centralized Supplier Database T2.2u CIDB grading certificate – Proof of registration T2.2v CIPC – company registration certificate T2.2x References

T2.2z Valid Letter of Good Standing

T2.3 Returnable schedules or documents: Annexures related to evaluation

Annexure A: Method Statement (Generic)

Annexure B1: Key personnel qualifications (Construction manager)

Annexure B2: Key personnel qualifications (Construction Supervisor)

Annexure B3: Key personnel qualifications (OHS Safety officer)

Annexure B4: Key personnel qualifications (Skilled installation/maintenance staff)

Volume 3: The Draft Contract

Part C1: Agreement and Contract data

C1.1: Form of offer and Acceptance

C1.2: Contract Data

C1.3: Fixed Performance Guarantee

C1.4: Agreement in terms of section 37(2) of the OH&S Act (Act no 85 of 1990)

Part C2: Pricing Data

C2.1: Pricing Instructions

C2.2: Bills of Quantities

Part C3: Scope of Works

C3.1: Scope of Works

C3.6: Health and Safety Specification

C3.7: HIV/AIDS Specification with Schedules A to C

Part C4: Site Information

C4.1: Site Information as per Scope of Works

F.1.4	<i>Add the following:</i> The employer's agent: Lukhozi Consortium
F1.6.1	<i>Add the following to the clause:</i> The Department reserves the right to not accept the tender from the tenderer with the highest number of points, or award any contract.
F1.6.3	<i>Add the following:</i> A two-stage system will not be followed.
F.2.1	<i>Add the following:</i> 1. Only those Tenderers who satisfy the following eligibility criteria are eligible to submit tenders: 1. 1 Tenderers who are registered with the CIDB, or are capable of being so prior to the evaluation of submissions, in ac Contractor grading designation equal to or higher than a Contractor grading designation determined in accordance with the sum tendered, or a value determined in accordance with Regulation 25 (1B) or 25 (7A) of the Construction Industry Development Regulations, for Class EB or ME, Grade 6 PE or higher construction work, are eligible to have their tenders evaluated. 2. Joint ventures are eligible to submit tenders provided that: 2.1 Every member of the joint venture is registered with the CIDB; 2.2 The lead partner has a Contractor grading designation in Class EB or ME, Grade 6 PE construction work; 2.3 The combined Contractor grading designation calculated in accordance with the Construction Industry Development Regulations is equal or higher than the a Contractor grading designation determined in accordance with the sum tendered for Class EB or ME, Grade 6 PE or higher construction work or a value determined in accordance with Regulations 25 (1B) or 25 (7A) of the Construction Industry Development Regulations; and 2.4 The joint venture is registered on Central Supplier Database or proof of application 2.5 All members of the joint venture must submit copies of the returnable documentations or original where it is so stipulated for all members. 2.6 In the case of a Partnership/Joint Venture/Consortium the tax clearance must be the Partnership/Joint Venture/Consortium or individual valid tax clearance certificates for all the members of the Partnership/Joint Venture/Consortium. 2.7 In the case of a Partnership/Joint Venture/Consortium the CIPRO certificates must be submitted indicating percentage of ownership for specific goals points scoring, failing which the tenderer will score zero points. 2.8 The partner of the JV must be registered with CIDB with a grading that is not lower than one level of the required grading.

F2.2	Add the following to the clause: Accept that the Employer will not compensate the Tenderer for any costs incurred in attending briefing session, negotiation meetings or any meeting or interviews in the office of the Employer or Employer's agent (if required).
F.2.7	For particulars regarding a pre-Tender site inspection meeting, see Tender Notice and Invitation to Supplier T1.1 “ A compulsory briefing session will be held and no compensation will be paid for attendance at this meeting. Tenderers must be represented by a person who is suitably qualified and experience to comprehend the extent of the work involved and who is at the employ of the prospective tenderer. The tenderer's representative must sign the attendance register in the name of the tendering entity. Addenda will be issue to and tenders will be received only from those tendering entities appearing in the attendance register of the briefing session.”
F.2.12	No alternative tenders are allowed.

F.2.13.2	<i>Replace sub-clause F.2.13.2 with the following:</i> Return all returnable documents to the employer after completing them in their entirety by writing in non-erasable ink
F.2.13.3	<i>Add the following:</i> Parts of each Supplier offer communicated on paper shall be submitted as an original, plus 0 (nought) copies.
F.2.13.4	<i>Add the following:</i> The Supplier shall be signed by a person duly authorized to do so. Tenders submitted by joint ventures of two or more firms shall be accompanied by the document of formation of the joint venture, in the form of a joint venture agreement, in which it is defined precisely the conditions under which the joint venture will function, its period of duration, the persons authorized to represent and obligate it, the participation of the several firms forming the joint venture, and any other information necessary to permit a full appraisal of its functioning. Failure to provide the joint venture agreement, bound with the Supplier submission, on the date and time of the closing of the bid, shall render the Supplier non-responsive.
F.2.13.5	<i>Add the following:</i> The employer's address for delivery of Supplier offers and identification details to be shown on each Supplier offer package are: Location of Supplier box: Department of Health Physical address: Eastern Cape Department of Health Global Life Center, SCM Unit c/o Phalo Avenue and R63 Bhisho Identification details: Tender No. SCMU3-23/24-0491-HO Title of Supplier: SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES Sealed Tender with the identification details on the envelope must be placed in the appropriate official Tender box at the abovementioned address
F.2.13.6	<i>Add the following:</i> A two-envelope procedure will not be followed.
F2.13.9	Telephonic, telegraphic, telefax, facsimile or e-mailed tender offers will not be accepted.
F.2.13.10	<i>Add the following:</i> By signing the offer part of C1.1 Form of Offer and Acceptance the Supplier declares that all information provided in the Supplier submission is correct and free of misrepresentation.
F.2.15.1	<i>Add the following to F.2.15.1:</i> The closing time for submission of Supplier offers is as stated in the Tender Notice and Invitation to Supplier. Telephonic, telegraphic, telex, facsimile or e-mailed Supplier offers will not be accepted.
F.2.16.1	<i>Add the following to F.2.16.1:</i> The Supplier offer validity period is 12 weeks .
F.2.17	<i>Insert the following at the end of the last sentence of the note:</i> “.....elect to do so, provided that the competitive position of the preferred Supplier is not affected”

	A Supplier may be rejected as non-responsive if the Supplier fails to provide any clarification requested by the employer within the time for submission stated in the employer's written request for such clarification. The clarification of a Supplier offer includes the provision of the priced bills of quantities (Part C2.2: Bills of Quantities).
F.2.18	<i>Add the following:</i> The tenderer will be required to submit his fully priced Bills of Quantities (complete document inclusive of all parts) together with this tender.
F.3.4	<i>Add the following:</i> The opening of the tender offers will take place immediately after the closing time of tenders.

F.3.8	<i>Add the following:</i> Suppliers will be considered non-responsive if, inter alia: 1. the Supplier has failed to attend the compulsory briefing meeting; 2. the Supplier is submitted by Telegraphic, telephonic, telex, facsimile (faxed) or email media or if the Supplier is submitted late. 3. the Supplier does not comply with the eligibility criteria listed in F2.1 above; 4. The resolution for signatory is not attached to the Supplier submission on a company letterhead. 5. the Supplier has failed to fully complete and sign SBD1, SBD4 & the Compulsory Enterprise Questionnaire. Failure to submit the required information shall be subjected to a request from SCM to the bidder to submit the required information within 7 days of the request. Failure to comply with such request will result in the bid being deemed non-responsive
F.3.11.1	<i>Add the following:</i> This is a two-stage evaluation process: Stage 1: Administrative compliance Stage 2: Evaluation for price and preference The following procedure will be used to evaluate tender offers received: a. Open and record tender offers received b. Determine whether or not tender offers are complete. c. Determine whether or not tender offers received are responsive, and reject non-responsive tenders. d. Perform Technical Evaluation of Equipment as per technical Data Sheet. e. A bid with Equipment proposed that does not conform to scope of work or specification will be found non responsive. f. Score tender evaluation points for each price g. Confirm that tenderers are eligible for the preferences claimed and, if so, score tender evaluation points for preferencing. h. Calculate total tender evaluation points i. Rank tender offers from the highest number of tender evaluation points to the lowest. j. Perform a risk analysis on the tenderer having the highest ranking/number of points to ascertain if the submission presents an acceptable risk to the employer. k. Recommend the tenderer with the highest number of tender evaluation points for the award of the contract, unless there are compelling and justifiable reasons not to do so. The Employer shall in the evaluation of tender offers take due account of the Tenderer's past performance in the execution of similar engineering works of comparable magnitude, and the degree to which possesses the necessary technical, financial and other resources to enable him to complete the Works successfully with the contract period. The tenderer shall be required to satisfy the Employer and the Engineer as to his ability to perform and complete the Works timeously, safely and with satisfactory quality, and furnish details in section T2.2z of contracts of a similar nature and magnitude which they have successfully executed in the past. The Employer is restricted in accordance with clause 7.(c)(iii) of the Construction Regulations, 2014, to only appoint a contractor to whom he is satisfied has the necessary competencies and resource to carry out the work safely. Submitting inferior and inadequate information relating to health and safety shall be regarded as justifiable and compelling reasons not to accept the tender offer of the tenderer scoring the highest number of tender evaluation points.

F.3.11.3	The procedure for the evaluation of responsive tenders is Method 1: Administrative, Price and Specific Goals
F.3.11.7	<i>Add the following:</i> The financial offer will be scored using Formula 2 (Option 1): $N_{FO} = (1 - (P - P_M) / P_m) \times W_1$ Where. N_{FO} = number of Supplier evaluation points awarded for financial offer W_1 = the maximum possible number of Supplier evaluation points Tender P_M = the comparative offer of the most favorable Supplier offer P = the comparative offer of the Supplier offer under consideration
F.3.11.8	Up to 100 minus W_1 (refer F.3.11.7 above) Supplier evaluation points will be awarded to Suppliers according to their SPECIFIC GOALS status level, determined in accordance with section 9(1) of the Broad-Based Black Economic Empowerment Act (No 53 of 2003), and who have submitted original valid or valid, certified copies of SPECIFIC GOALS status verification certificates issued by either a verification agency accredited by the South African Accreditation System (SANAS) or a sworn affidavit in terms of the amended SPECIFIC GOALS codes. The points will be awarded as follows, based on the SPECIFIC GOALS status level of the Supplier:

	The specific goals allocated points in terms of this tender	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (80/20 system) (To be completed by the tenderer)
	Historically Disadvantaged Individuals Ownership	20% (4)	
	Women Ownership	20% (4)	
	Youth Ownership	20% (4)	
	Disability Ownership	20% (4)	
	Military Veterans Ownership	10% (2)	
	Locality Ownership (Eastern Cape)	10% (2)	
	TOTAL	100% (20)	
A trust, consortium or joint venture will qualify for points for their SPECIFIC GOALS status level as a legal entity, provided that the entity submits their SPECIFIC GOALS status level certificate. A trust, consortium or joint venture will qualify for points for their SPECIFIC GOALS status level as an unincorporated entity, provided that the entity submits their consolidated SPECIFIC GOALS scorecard as if they were a group			

BANK RATING					
Bank Rating Certificate		Bank rating of A: Undoubted for the amount of enquiry – Good to do business with	Annexure F as per returnable list Bank rating certificate issued by the bank.		
		Bank rating of B: Good for the amount of the enquiry – Amount is well within the capacity of ordinary business commitments	Annexure F as per returnable list Bank rating certificate issued by the bank.		
		Bank rating of C: Good for amount quoted if strictly in the way of business – Unlikely to commit themselves beyond their means	Annexure F as per returnable list Bank rating certificate issued by the bank.		

F.3.11.10	<i>Add the following new sub-clause:</i> The Employer will perform a risk analysis in respect of the following: (a) reasonableness of the financial offer (b) reasonableness of unit rates and prices (c) the Suppliers ability to fulfil its obligations in terms of the tender document, that is, that the Supplier can demonstrate that he/she possesses the necessary professional and technical qualifications, professional and technical competence, financial resources, equipment and other physical facilities, managerial capability, reliability, experience, reputation, personnel to perform the contract, etc.
F.3.13.1	Supplier offers will only be accepted if: a) the Supplier is registered and in good standing with the South African Revenue Service (SARS) or proof that he or she has made arrangement with SARS to meet his or her outstanding tax obligations. This will be verified by the Employer on the Centralized Supplier Database. Where the recommended bidder is not tax compliant, the bidder will be notified of the non-compliant status and be granted seven (7) working days to rectify their compliance status with the SARS. The bidder must thereafter provide the Department with proof of its tax compliance which must be verified via the CSD or eFiling. b) the Supplier or any of its directors is not listed on the Register of Supplier Defaulters in terms of the Prevention and Combating of Corrupt Activities Act of 2004 as a person prohibited from doing business with the public sector; c) the Supplier or any of its directors is not listed on the Database of Restricted Suppliers kept by the National Treasury and updated from time to time; c) the Supplier has not: i) abused the Employer's Supply Chain Management System; d) The Supplier has completed the Compulsory Enterprise Questionnaire and there are no conflicts of interest which may impact on the Supplier's ability to perform the contract in the best interests of the employer or potentially compromise the Supplier process.
F.3.17	<i>Add the following:</i> The number of paper copies of the signed contract to be provided by the Employer is one.

F.4	ADDITIONAL CONDITIONS OF TENDER The additional conditions of Tender are:
F.4.1	Invalid Tender Suppliers shall be considered invalid and shall be endorsed and recorded as such in the Supplier opening record, by the responsible official who opened the Tender, in the following circumstances: a) if the Supplier offer is not submitted on the Form of Offer and Acceptance bound into this Tender document (form C1.1, Part C1: Agreements and Contract Data); b) if the Form of Offer and Acceptance has not been completed or has not been signed by the authorised representative of the Supplier c) if the Form of Offer and Acceptance is signed, but the name of the Supplier is not stated or is indecipherable d) if the Supplier offer is not completed in non-erasable ink;
F.4.2	Negotiations with preferred Suppliers The Employer may negotiate the final terms of a contract with Suppliers identified through a competitive Supplying process as preferred Suppliers provided that such negotiation: a) does not allow any preferred Supplier a second or unfair opportunity; b) is not to the detriment of any other Supplier; and c) does not lead to a higher price than the Supplier as submitted. Minutes of any such negotiations shall be kept for record purposes
F.4.3	General supply chain management conditions applicable to Supplier In terms of its Supply Chain Management Policy the Employer may not consider a Supplier unless the provider who submitted the Supplier: a) has furnished the Employer with that provider's: • full name; • identification number or company or other registration number; and • tax reference number and VAT registration number, if any; b) has indicated whether: • the provider is in the service of the state, or has been in the service of the state in the previous twelve months; • the provider is not a natural person, whether any of the directors, managers, principal shareholders or stakeholders is in the service of the state, or has been in the service of the state in the previous twelve months; or • whether a spouse, child or parent of the provider or of a director, manager, shareholder or stakeholder referred to above is in the service of the state, or has been in the service of the state in the previous twelve months. Irrespective of the procurement process followed, the Employer is prohibited from making an award to: • a person who is in the service of the state; • a juristic entity of which any director, manager, principal shareholder or stakeholder is in the service of the state; • an advisor or consultant contracted with the Employer; or • a person, advisor or corporate entity involved with the tender specification committee, or a director of such corporate entity. In this regard, Suppliers shall complete Returnable Schedules: Compulsory Enterprise Questionnaire. Failure to complete this schedule will result in the Supplier not being considered further.

F.4.4	Combating abuse of the Supply Chain Management Policy In terms of the its Supply Chain Management Policy, the Employer may reject the Supplier of any Supplier if that Supplier or any of its directors has: - failed, during the last five years, to perform satisfactorily on a previous contract with the Employer or any other organ of state after written notice was given to that Supplier that performance was unsatisfactory; - abused the supply chain management system of the Employer or has committed any improper conduct in relation to this system; - been convicted of fraud or corruption during the past five years; - willfully neglected, reneged on or failed to comply with any government, municipal or other public sector contract during the past five years; or - been listed with the Register of Supplier Defaulters in terms of section 29 of the Prevention and Combating of Corrupt Activities Act (No 12 of 2004) or has been listed on National Treasury's database as a person or juristic entity prohibited from doing business with the public sector. In this regard, Suppliers shall complete Part T2.2: Returnable Schedules: Certificate of Independent Supplier Determination and Declaration of Supplier's Past Supply Chain Management Practices. Failure to complete these schedules will result in the Supplier not being considered further.
F.4.6	Claims arising after submission of Supplier No claim for any extras arising out of any doubt or obscurity as to the true intent and meaning of anything contained in the Conditions of Contract, Scope of Work and Pricing Data, will be admitted by the Employer after the submission of any Tender and the Supplier shall be deemed to have: - read and fully understood the whole text of the Contract Data, Scope of Work and Pricing Data and thoroughly acquainted himself with the nature of the works proposed and generally of all matters which may influence the Contract. - visited the site of any proposed works. - requested the Employer or his duly authorized agent to make clear the actual requirements of anything contained in the Scope of Work and Pricing Data, the exact meaning or interpretation of which is not clearly intelligible to the Supplier. - received any Addenda to the Supplier documents which have been issued in accordance with the Employer's Supply Chain Management Policy. Before submission of any Supplier, the Supplier should check the number of pages, and if any are found to be missing or duplicated, or the figures or writing indistinct, or if the Pricing Data contain any obvious errors, the Supplier must apply to the Employer's Agent at once to have the same rectified, as no liability will be admitted by the Employer in respect of errors in any Supplier due to the foregoing.
F.4.7	Imbalance in Supplier rates In the event of Supplier rates or lump sums being declared by the Employer to be unacceptable to it because they are either excessively low or high or not in proper balance with other rates or lump sums, the Supplier may be required to produce evidence and advance arguments in support of the Supplier rates or lump sums objected to. If, after submission of such evidence and any further evidence requested, the Employer is still not satisfied with the supplied rates or lump sums objected to, it may request the Supplier to amend these rates and lump sums along the lines indicated by it.

	The Supplier will then have the option to alter and/or amend the rates and lump sums objected to and such other related amounts as are agreed on by the Employer, but this shall be done without altering the Supplier offer as Supplied or, if applicable, the corrected total of prices in accordance with F.3.9.3. Should the Supplier fail to amend his tender in a manner acceptable to the Employer, the Employer may reject the Tender.
F.4.8	The Employer shall not formally issue Tender documents in electronic format as contemplated in F.2.13.2 and F.2.13.3 and shall only issue Supplier documents in hardcopy. An electronic version of the issued Tender documents may be made available to the Supplier, upon written request in terms of this clause, subject to the following: (a) Electronic copies of the contract document, or parts thereof, will only be provided to Suppliers who have been issued with the Tender documents as contemplated in F.1.2 in hardcopy. (b) The electronic version shall not be regarded as a substitute for the issued Tender documents. (c) The Employer shall not accept tender submitted in electronic format. Suppliers may not complete and submit a printed copy of the electronic version of the Tender document or part thereof. Only those Suppliers that have been completed on the issued hard copy Tender document shall be considered. (d) The Employer accepts no responsibility or liability arising from any reliance on or use of the electronic version provided in terms of this clause. The Employer further does not guarantee that the electronic version corresponds with the issued Tender documents in all respects. Suppliers are alerted to the fact that electronic versions of the Tender documents may not reflect any notices or addenda that amend the Tender document. (e) Any non-compliance with these provisions, including effecting any unauthorized alterations to the Supplier document as contemplated in F.2.11, shall render the Tender invalid. The Employer reserves the right to take any action against such Supplier allowed in law including, in circumstances where the Supplier had already been awarded, the right to cancel the contract. (f) In requesting the electronic version of the Tender document or parts thereof, the Supplier is deemed to have read, understood and accepted all of the above conditions.

VOLUME 2: RETURNABLE DOCUMENTS

T2.1 LIST OF RETURNABLE DOCUMENTS

T2.1: LIST OF RETURNABLE SCHEDULES/DOCUMENTS

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

T2.2: RETURNABLE SCHEDULES REQUIRED FOR SUPPLIER EVALUATION PURPOSES

	Returnable Documents	Number of pages issued	Returnable Document
SBD1	Invitation to Bid: Part A and B	2	☒ Yes ☐ No
SBD 4	Declaration of Interest	2	☒ Yes ☐ No
SBD 6.1	Preference Points Claim Form In Terms Of The Preferential Procurement Regulations 2022	4	☒ Yes ☐ No
T2.2r	Compulsory Enterprise Questionnaire	3	☒ Yes ☐ No
T2.1	List of Returnable Schedules/Documents	2	☒ Yes ☐ No
C1.1a	Final Summary Page	1	☒ Yes ☐ No
C2.2	Fixed Charge and Value related Items Applicable to All Work & Bill of Quantities	14	☒ Yes ☐ No
T2.2a	Resolution for Signatory	1	☒ Yes ☐ No
T2.2b	Resolution of Board of Directors to Enter into Consortium or Joint Venture (JV) Agreements	2	☒ Yes ☐ No
T2.2c-1	Schedule of Proposed Subcontractors	1	☒ Yes ☐ No
T2.2d	Schedule of Plant and Equipment	1	☒ Yes ☐ No
T2.2e	Schedule of Imported Material and Equipment	1	☒ Yes ☐ No
T2.2f	Bank Rating	1	☒ Yes ☐ No
T2.2v	Specific goals claimed (CIPRO certificate)	1	☒ Yes ☐ No
T2.2n	Record of Addenda to Supplier Documents	1	☒ Yes ☐ No
T2.2z	Valid Letter of Good Standing	1	☒ Yes

T2.2: OTHER DOCUMENTS REQUIRED FOR SUPPLIER EVALUATION PURPOSES

No.	Document Name	Number of pages issued	Returnable Document
Annexure A	Method Statement	1	☒ Yes ☐ No
Annexure A1	Summary Tasks	1	☒ Yes ☐ No
Annexure A2	Programme with Timelines and planned Resources	1	☒ Yes ☐ No
Annexure B	Company Experience & Contactable References	1	☒ Yes ☐ No
T2.2g	Specific Goals claimed (Cipro Certificate)	1	☒ Yes ☐ No
T2.2y	Proof of Registration with Centralized Supplier Database	1	☒ Yes ☐ No
T2.2v	CIPC – company registration certificate	1	☒ Yes ☐ No
T2.2x	References	4	☒ Yes ☐ No
T2.3	Returnable schedules or documents		☒ Yes ☐ No

(The following list of returnable schedules/documents is duplicated from the tables above however these will not appear in duplicate within the Tender document. The purpose is to bring to the Suppliers' attention the list of returnable documents/schedules that shall be incorporated into the contract)

T2.2: OTHER DOCUMENTS REQUIRED TENDER EVALUATION PURPOSES

No.	Document Name	Number of pages issued	Returnable Document
T2.2n	Record of Addenda to Supplier Documents	1	☒ Yes ☐ No
T2.2e	Schedule of Key Personnel: Contract Supervisor	1	☒ Yes ☐ No
SBD 6.1	Preference Points Claim Form In Terms Of The Preferential Procurement Regulations 2022	4	☒ Yes ☐ No

T2.2: OTHER DOCUMENTS THAT WILL BE INCORPORATED INTO THE CONTRACT

C1.1	Form of Offer and Acceptance	2	☒ Yes ☐ No
C1.2	Contract Data	7	☒ Yes ☐ No
C2.2	Fixed Charge and Value related Items Applicable to All Work & Bill of Quantities & Final Summary		☒ Yes ☐ No

T2.2: RETURNABLE SCHEDULES REQUIRED FOR SUPPLIER EVALUATION PURPOSES

T2.2a: RESOLUTION FOR SIGNATORY

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

MUST BE ON COMPANY LETTERHEAD**A: CERTIFICATE OF AUTHORITY FOR SIGNATORY**

Signatory for companies shall confirm their authority hereto by attaching a duly signed and dated copy of the relevant resolution of the board of directors to this form. This must be on a company letterhead.

An example is given below:

“By resolution of the board of directors passed at a meeting held on _____

Mr/Ms _____, whose signature appears below, has been duly authorised to

sign all documents in connection with the Supplier for Contract No. _____

and any Contract which may arise there from on behalf of (Block Capitals) _____

SIGNED ON BEHALF OF THE COMPANY: _____

IN HIS/HER CAPACITY AS: _____

DATE: _____

SIGNATURE OF SIGNATORY: _____

WITNESSES:

1. _____ SIGNATURE: _____

2. _____ SIGNATURE: _____

T2.2b: RESOLUTION OF BOARD OF DIRECTORS TO ENTER INTO CONSORTIA OR JOINT VENTURES

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

RESOLUTION of a meeting of the Board of *Directors / Members / Partners of:

(Legally correct full name and registration number, if applicable, of the Enterprise)

Held at _____(place)

On _____(date)

RESOLVED that:

1. The Enterprise submit a Bid /Supplier, in consortium/Joint Venture with the following Enterprises:

(List all the legally correct full names and registration numbers, if applicable, of the Enterprises forming the Consortium/Joint Venture)

to the Eastern Cape Department of Health in respect of the following project:

(Project description as per Bid /Supplier Document)

Bid Number: _____(Bid Number as per Document)

2. *Mr/Mrs/Ms:

in *his/her Capacity as: _____(Position in the Enterprise)

and who will sign as follows: _____

be, and is hereby, authorised to sign a consortium/joint venture agreement with the parties listed under item 1 above, and any and all other documents and/or correspondence in connection with and relating to the consortium/joint venture, in respect of the project described under item 1 above.

3. The Enterprise accepts joint and several liability with the parties listed under item 1 for the due fulfilment of the obligations of the joint venture deriving from, and in any way connected with, the Contract to be entered into with the Department in respect of the project described under item 1 above.

4. The Enterprise chooses as its domicilium citandi et executandi for all purposes arising from this joint venture agreement and the Contract with the Department in respect of the project under item 1 above:

Physical address:

Postal Code _____

Postal Address:

Postal Code _____

Telephone number:

Fax number:

	NAME	CAPACITY	SIGNATURE
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			

Note:

1. * Delete which is not applicable
2. NB. This resolution must be signed by all the Directors / Members / Partners of the Bidding Enterprise
3. Should the number of Directors / Members/Partners exceed the space available above, additional names and signatures must be supplied on a separate page

ENTERPRISE STAMP

T2.2c-1: SCHEDULE OF PROPOSED SUBCONTRACTORS

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

	We notify you that it is our intention to employ the following subcontractors for work in this contract. If we are awarded a contract, we agree that this notification does not change the requirement for us to submit the names of proposed Subcontractors in accordance with requirements in the contract for such appointments. If there are no such requirements in the contract, then your written acceptance of this list shall be binding between us.			
	Name and address of proposed Subcontractor	Nature and extent of work	Value of Work	Subcontractor CIDB grading
1.				
2.				
3.				

Signed Date

Name Position

Supplier

T2.2d: SCHEDULE OF PLANT AND EQUIPMENT

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

The following are the lists of major items of relevant equipment that I/we presently own or lease and will have available for this contract or will acquire or hire for this contract if my/our tender is accepted.

(a) Details of major equipment that is owned by and immediately available for this contract.

Quantity	Description, size, capacity etc.

Attach additional pages if more space is required

(b) Details of major equipment that be hired, or acquired for this contract if my/our tender is acceptable.

Quantity	Description, size, capacity etc.

Attach additional pages if more space is required

Signed _____ Date _____

Name _____ Position _____

Supplier _____

T2.2e: SCHEDULE OF KEY PERSONNEL

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

The Supplier is referred to clause F.2.1.3 of the Tender Data and shall insert in the spaces provided below details of the key personnel required to be in the employment of the Supplier or a specialist consultant/firm, in order for the Supplier to be eligible to submit a Tender for this project. The Curriculum Vitae of the individual must be appended to this schedule.

Notwithstanding having appended the Curriculum Vitae of the key personnel to this schedule, the Supplier must **also** append to this schedule in terms of clause F.2.1.3, a statement for the individual identified, which indicates any field(s) of specialization and any recent experience that is relevant to this particular project (which may or may not have formed part of the individual's CV). Suppliers should indicate what particular aspect of the project the specialization or experience is relevant to.

Name	Qualifications	No. of Years Specified Experience

Signed

Date

Name

Position

Supplier

T2.2f: BANK RATING

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers must submit a bank rating from a recognized financial institution as required in clause F.2.1.4 of the Tender Data. The bank rating must be attached to this schedule. Failure to comply with the requirements of F.2.1.4 shall result in the Tender not being evaluated further.

Minimum of Grade C bank required

Signed

Date

Name

Position

Supplier

T2.2n: RECORD OF ADDENDA TO SUPPLIER DOCUMENTS

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

We confirm that the following communications received from the Employer before the submission of this Supplier offer, amending the Tender documents, have been taken into account in this Supplier offer:		
	Date	Title or Details
1.		
2.		
3.		
4.		
5.		
6.		
7.		
8.		
9.		
10.		

Attach additional pages if more space is required.

Signed Date

Name Position

Supplier

*This document must form part of the returnable schedules as it is referenced in the offer portion of the Form of Offer and Acceptance.

T2.2r: COMPULSORY ENTERPRISE QUESTIONNAIRE

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

The following particulars must be furnished. In the case of a joint venture, separate enterprise questionnaires in respect of each partner must be completed and submitted.

Section 1: Name of enterprise:

Section 2: VAT registration number:

Section 3: Particulars of sole proprietors and partners in partnerships

Name*	Identity number*	Personal income tax number*

* Complete only if sole proprietor or partnership and attach separate page if more than 3 partners

Section 5: Particulars of companies and close corporations

Company registration number

Close corporation number

Tax reference number

Section 6: Record of service of the state

Indicate by marking the relevant boxes with a cross, if any sole proprietor, partner in a partnership or director, manager, principal shareholder or stakeholder in a company or close corporation is currently or has been within the last 12 months in the service of any of the following:

- | | |
|--|---|
| ☐ a member of any municipal council
☐ a member of any provincial legislature
☐ a member of the National Assembly or the National Council of Province
☐ a member of the board of directors of any municipal entity
☐ an official of any municipality or municipal entity | ☐ an employee of any provincial department, national or provincial public entity or constitutional institution within the meaning of the Public Finance Management Act, 1999 (Act 1 of 1999)
☐ a member of an accounting authority of any national or provincial public entity
☐ an employee of Parliament or a provincial legislature |
|--|---|

If any of the above boxes are marked, disclose the following:

Name of sole proprietor, partner, manager, shareholder or stakeholder	Name of institution, public office, board or organ of state and position held	Status of service (tick appropriate column)	
		Current	Within last 12 months

*insert separate page if necessary

Section 7: Record of spouses, children and parents in the service of the state

Indicate by marking the relevant boxes with a cross, if any spouse, child or parent of a sole proprietor, partner in a partnership or director, manager, principal shareholder or stakeholder in a company or close corporation is currently or has been within the last 12 months been in the service of any of the following:

- | | |
|--|---|
| ☐ a member of any municipal council | ☐ an employee of any provincial department, national or provincial public entity or constitutional institution within the meaning of the Public Finance Management Act, 1999 (Act 1 of 1999) |
| ☐ a member of any provincial legislature | ☐ a member of an accounting authority of any national or provincial public entity |
| ☐ a member of the National Assembly or the National Council of Province | ☐ an employee of Parliament or a provincial legislature |
| ☐ a member of the board of directors of any municipal entity | |
| ☐ an official of any municipality or municipal entity | |

Name of spouse, child or parent	Name of institution, public office, board or organ of state and position held	Status of service (tick appropriate column)	
		current	Within last 12 months

*insert separate page if necessary

The undersigned, who warrants that he/she is duly authorised to do so on behalf of the enterprise:

- i) authorizes the Employer to obtain a tax clearance certificate from the South African Revenue Services that my / our tax matters are in order;
- ii) confirms that the neither the name of the enterprise or the name of any partner, manager, director or other person, who wholly or partly exercises, or may exercise, control over the enterprise appears on the Register of Supplier Defaulters established in terms of the Prevention and Combating of Corrupt Activities Act of 2004;
- iii) confirms that no partner, member, director or other person, who wholly or partly exercises, or may exercise, control over the enterprise appears, has within the last five years been convicted of fraud or corruption;
- iv) confirms that I / we are not associated, linked or involved with any other Tendering entities submitting Supplier offers and have no other relationship with any of the Suppliers or those responsible for compiling the scope of work that could cause or be interpreted as a conflict of interest;
- iv) confirms that the contents of this questionnaire are within my personal knowledge and are to the best of my belief both true and correct.

Signed Date

Name Position

Enterprise
name

* The schedule should be used where Suppliers are subject to the Local Government: Municipal Finance Management Act

T2.2v: CIPC – Company registration certificate

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Tenderer to submit necessary company registration certificate

T2.2z: Valid Letter of Good Standing

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Tenderer to submit valid and up to date Letter of Good Standing certificate relevant to their services

SBD 1: INVITATION TO BID – PART A

YOU ARE HEREBY INVITED TO BID FOR REQUIREMENTS OF THE EC DEPARTMENT OF HEALTH					
BID NUMBER:	SCMU3-23/24-0491-HO	CLOSING DATE:	27 October 2023	CLOSING TIME:	11:00
DESCRIPTION	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES				
THE SUCCESSFUL BIDDER WILL BE REQUIRED TO FILL IN AND SIGN A WRITTEN CONTRACT FORM (SBD7).					
BID RESPONSE DOCUMENTS MAY BE DEPOSITED IN THE BID BOX SITUATED AT (STREET ADDRESS)					
Tender Box Department of Health Global Life Centre SCM Unit c/o Phalo Avenue and R63 (opposite Engen Garage) Bhisho					
SUPPLIER INFORMATION					
NAME OF BIDDER					
POSTAL ADDRESS					
STREET ADDRESS					
TELEPHONE NUMBER	CODE		NUMBER		
CELLPHONE NUMBER					
FACSIMILE NUMBER	CODE		NUMBER		
E-MAIL ADDRESS					
VAT REGISTRATION NUMBER					
	TCS PIN:		OR	CSD No:	
SPECIFIC GOALS STATUS LEVEL VERIFICATION CERTIFICATE [TICK APPLICABLE BOX]	☐ Yes ☐ No		SPECIFIC GOALS STATUS LEVEL SWORN AFFIDAVIT		☐ Yes ☐ No
IF YES, WHO WAS THE CERTIFICATE ISSUED BY?					
AN ACCOUNTING OFFICER AS CONTEMPLATED IN THE CLOSE CORPORATION ACT (CCA) AND NAME THE APPLICABLE IN THE TICK BOX	☐	AN ACCOUNTING OFFICER AS CONTEMPLATED IN THE CLOSE CORPORATION ACT (CCA)			
	☐	A VERIFICATION AGENCY ACCREDITED BY THE SOUTH AFRICAN ACCREDITATION SYSTEM (SANAS)			
	☐	A REGISTERED AUDITOR			
		NAME:			
[A SPECIFIC GOALS STATUS LEVEL VERIFICATION CERTIFICATE/SWORN AFFIDAVIT(FOR EMEs& QSEs) MUST BE SUBMITTED IN ORDER TO QUALIFY FOR PREFERENCE POINTS FOR SPECIFIC GOALS]					
I. ARE YOU THE ACCREDITED REPRESENTATIVE IN SOUTH AFRICA FOR THE GOODS /SERVICES /WORKS OFFERED?	☐ Yes ☐ No [IF YES ENCLOSE PROOF]		II. ARE YOU A FOREIGN BASED SUPPLIER FOR THE GOODS /SERVICES /WORKS OFFERED?		☐ Yes ☐ No [IF YES ANSWER PART B:3 BELOW]
III. SIGNATURE OF BIDDER			IV. DATE		
V. CAPACITY UNDER WHICH THIS BID IS SIGNED (Attach proof of authority to sign this bid; e.g. resolution of directors, etc.)					
VI. TOTAL NUMBER OF ITEMS OFFERED			VII. TOTAL BID PRICE (ALL INCLUSIVE)		
BIDDING PROCEDURE ENQUIRIES MAY BE DIRECTED TO:			TECHNICAL INFORMATION MAY BE DIRECTED TO:		
DEPARTMENT	ECDOH		CONTACT PERSON	Thabisa Notshe	
CONTACT PERSON	Ms Thabisa Notshe		TELEPHONE NUMBER	040 608 9641	
TELEPHONE NUMBER	040-608 9641		FACSIMILE NUMBER		
FACSIMILE NUMBER			E-MAIL ADDRESS	thabisa.notshe@echealth.gov.za	
E-MAIL ADDRESS	thabisa.notshe@echealth.gov.za				

PART B

TERMS AND CONDITIONS FOR BIDDING

1. BID SUBMISSION:
1.1. BIDS MUST BE DELIVERED BY THE STIPULATED TIME TO THE CORRECT ADDRESS. LATE BIDS WILL NOT BE ACCEPTED FOR CONSIDERATION. 1.2. ALL BIDS MUST BE SUBMITTED ON THE OFFICIAL FORMS PROVIDED–(NOT TO BE RE-TYPED) OR ONLINE 1.3. SUPPLIERS MUST REGISTER ON THE CENTRAL SUPPLIER DATABASE (CSD) TO UPLOAD MANDATORY INFORMATION NAMELY: (BUSINESS REGISTRATION/ DIRECTORSHIP/ MEMBERSHIP/IDENTITY NUMBERS; TAX COMPLIANCE STATUS; AND BANKING INFORMATION FOR VERIFICATION PURPOSES). SPECIFIC GOALS CERTIFICATE OR SWORN AFFIDAVIT FOR SPECIFIC GOALS MUST BE SUBMITTED TO BIDDING INSTITUTION. 1.4. WHERE A BIDDER IS NOT REGISTERED ON THE CSD, MANDATORY INFORMATION NAMELY: (BUSINESS REGISTRATION/ DIRECTORSHIP/ MEMBERSHIP/IDENTITY NUMBERS; TAX COMPLIANCE STATUS MAY NOT BE SUBMITTED WITH THE BID DOCUMENTATION. SPECIFIC GOALS CERTIFICATE OR SWORN AFFIDAVIT FOR SPECIFIC GOALS MUST BE SUBMITTED TO BIDDING INSTITUTION. 1.5. THIS BID IS SUBJECT TO THE PREFERENTIAL PROCUREMENT POLICY FRAMEWORK ACT 2000 AND THE PREFERENTIAL PROCUREMENT REGULATIONS, 2017, THE GENERAL CONDITIONS OF CONTRACT (GCC) AND, IF APPLICABLE, ANY OTHER LEGISLATION OR SPECIAL CONDITIONS OF CONTRACT.
2. TAX COMPLIANCE REQUIREMENTS
2.1 SUPPLIERS MUST ENSURE COMPLIANCE WITH THEIR TAX OBLIGATIONS. 2.2 SUPPLIERS ARE REQUIRED TO SUBMIT THEIR UNIQUE PERSONAL IDENTIFICATION NUMBER (PIN) ISSUED BY SARS TO ENABLE THE ORGAN OF STATE TO VIEW THE TAXPAYER'S PROFILE AND TAX STATUS. 2.3 APPLICATION FOR TAX COMPLIANCE STATUS (TCS) OR PIN MAY ALSO BE MADE VIA E-FILING. IN ORDER TO USE THIS PROVISION, TAXPAYERS WILL NEED TO REGISTER WITH SARS AS E-FILERS THROUGH THE WEBSITE WWW.SARS.GOV.ZA. 2.4 SUPPLIERS MAY ALSO SUBMIT A PRINTED TCS TOGETHER WITH THE BID. 2.5 IN BIDS WHERE CONSORTIA / JOINT VENTURES / SUB-SUPPLIERS ARE INVOLVED, EACH PARTY MUST SUBMIT A SEPARATE PROOF OF TCS / PIN / CSD NUMBER. 2.6 WHERE NO TCS IS AVAILABLE BUT THE BIDDER IS REGISTERED ON THE CENTRAL SUPPLIER DATABASE (CSD), A CSD NUMBER MUST BE PROVIDED.
3. QUESTIONNAIRE TO BIDDING FOREIGN SUPPLIERS
3.1. IS THE BIDDER A RESIDENT OF THE REPUBLIC OF SOUTH AFRICA (RSA)? ☐ YES ☐ NO 3.2. DOES THE BIDDER HAVE A BRANCH IN THE RSA? ☐ YES ☐ NO 3.3. DOES THE BIDDER HAVE A PERMANENT ESTABLISHMENT IN THE RSA? ☐ YES ☐ NO 3.4. DOES THE BIDDER HAVE ANY SOURCE OF INCOME IN THE RSA? ☐ YES ☐ NO IF THE ANSWER IS "NO" TO ALL OF THE ABOVE, THEN, IT IS NOT A REQUIREMENT TO OBTAIN A TAX COMPLIANCE STATUS / TAX COMPLIANCE SYSTEM PIN CODE FROM THE SOUTH AFRICAN REVENUE SERVICE (SARS) AND IF NOT REGISTER AS PER 2.3 ABOVE.

SBD 4: DECLARATION OF INTEREST

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

BIDDER'S DISCLOSURE

I. PURPOSE OF THE FORM

Any person (natural or juristic) may make an offer or offers in terms of this invitation to bid. In line with the principles of transparency, accountability, impartiality, and ethics as enshrined in the Constitution of the Republic of South Africa and further expressed in various pieces of legislation, it is required for the bidder to make this declaration in respect of the details required hereunder.

Where a person/s are listed in the Register for Tender Defaulters and / or the List of Restricted Suppliers, that person will automatically be disqualified from the bid process.

2. Bidder's declaration

- 2.1 Is the bidder, or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest in the enterprise?

Employed by the state?

YES/NO

- 2.1.1 If so, furnish particulars of the names, individual identity numbers, and, if applicable, state employee numbers of sole proprietor/ directors / trustees / shareholders / members/ partners or any person having a controlling interest in the enterprise, in table below.

Full Name	Identity Number	Name of institution	State

- 2.2 Do you, or any person connected with the bidder, have a relationship with any person who is employed by the procuring institution? **YES/NO**

- 2.2.1 If so, furnish particulars:

- 2.3 Does the bidder or any of its directors / trustees / shareholders / members / partners or any person having a controlling interest in the enterprise have any interest in any other related enterprise whether or not they are bidding for this contract? **YES/NO**

- 2.3.1 If so, furnish particulars:
.....

3 DECLARATION

I, the undersigned, (name)..... in submitting the accompanying bid, do hereby make the following statements that I certify to be true and complete in every respect:

- 3.1 I have read and I understand the contents of this disclosure;
- 3.2 I understand that the accompanying bid will be disqualified if this disclosure is found not to be true and complete in every respect;
- 3.3 The bidder has arrived at the accompanying bid independently from, and without consultation, communication, agreement or arrangement with any competitor. However, communication between partners in a joint venture or consortium² will not be construed as collusive bidding.
- 3.4 In addition, there have been no consultations, communications, agreements or arrangements with any competitor

¹ the power, by one person or a group of persons holding the majority of the equity of an enterprise, alternatively, the person/s having the deciding vote or power to influence or to direct the course and decisions of the enterprise.

² Joint venture or Consortium means an association of persons for the purpose of combining their expertise, property, capital, efforts, skill and knowledge in an activity for the execution of a contract.

regarding the quality, quantity, specifications, prices, including methods, factors or formulas used to calculate prices, market allocation, the intention or decision to submit or not to submit the bid, bidding with the intention not to win the bid and conditions or delivery particulars of the products or services to which this bid invitation relates.

- 3.4 The terms of the accompanying bid have not been, and will not be, disclosed by the bidder, directly or indirectly, to any competitor, prior to the date and time of the official bid opening or of the awarding of the contract.
- 3.5 There have been no consultations, communications, agreements or arrangements made by the bidder with any official of the procuring institution in relation to this procurement process prior to and during the bidding process except to provide clarification on the bid submitted where so required by the institution; and the bidder was not involved in the drafting of the specifications or terms of reference for this bid.
- 3.6 I am aware that, in addition and without prejudice to any other remedy provided to combat any restrictive practices related to bids and contracts, bids that are suspicious will be reported to the Competition Commission for investigation and possible imposition of administrative penalties in terms of section 59 of the Competition Act No 89 of 1998 and or may be reported to the National Prosecuting Authority (NPA) for criminal investigation and or may be restricted from conducting business with the public sector for a period not exceeding ten (10) years in terms of the Prevention and Combating of Corrupt Activities Act No 12 of 2004 or any other applicable legislation.

I CERTIFY THAT THE INFORMATION FURNISHED IN PARAGRAPHS 1, 2 and 3 ABOVE IS CORRECT.

I ACCEPT THAT THE STATE MAY REJECT THE BID OR ACT AGAINST ME IN TERMS OF PARAGRAPH 6 OF PFMA SCM

INSTRUCTION 03 OF 2021/22 ON PREVENTING AND COMBATING ABUSE IN THE SUPPLY CHAIN MANAGEMENT
SYSTEM SHOULD THIS DECLARATION PROVE TO BE FALSE.

.....
Signature

.....
Date

.....
Position

.....
Name of bidder

SBD 6.1

**PREFERENCE POINTS CLAIM FORM IN TERMS OF THE PREFERENTIAL PROCUREMENT
REGULATIONS 2022**

This preference form must form part of all tenders invited. It contains general information and serves as a claim form for preference points for specific goals.

NB: BEFORE COMPLETING THIS FORM, TENDERERS MUST STUDY THE GENERAL CONDITIONS, DEFINITIONS AND DIRECTIVES APPLICABLE IN RESPECT OF THE TENDER AND PREFERENTIAL PROCUREMENT REGULATIONS, 2022

I. GENERAL CONDITIONS

I.1 The following preference point systems are applicable to invitations to tender:

- the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and
- the 90/10 system for requirements with a Rand value above R50 000 000 (all applicable taxes included).

I.2 **To be completed by the organ of state**

(delete whichever is not applicable for this tender).

The applicable preference point system for this tender is the **80/20** preference point system.

The lowest/ highest acceptable tender will be used to determine the accurate system once tenders are received.

I.3 Points for this tender (even in the case of a tender for income-generating contracts) shall be awarded for:

- (a) Price; and
- (b) Specific Goals.

I.4 **To be completed by the organ of state:**

The maximum points for this tender are allocated as follows:

	POINTS
PRICE	80
SPECIFIC GOALS	20
Total points for Price and SPECIFIC GOALS	100

I.5 Failure on the part of a tenderer to submit proof or documentation required in terms of this tender to claim points for specific goals with the tender, will be interpreted to mean that preference points for specific goals are not claimed.

I.6 The organ of state reserves the right to require of a tenderer, either before a tender is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the organ of state.

2. DEFINITIONS

- (a) **“tender”** means a written offer in the form determined by an organ of state in response to an invitation to provide goods or services through price quotations, competitive tendering process or any other method envisaged in legislation;
- (b) **“price”** means an amount of money tendered for goods or services, and includes all applicable taxes less all unconditional discounts;
- (c) **“rand value”** means the total estimated value of a contract in Rand, calculated at the time of bid invitation,

and includes all applicable taxes;

- (d) **“tender for income-generating contracts”** means a written offer in the form determined by an organ of state in response to an invitation for the origination of income-generating contracts through any method envisaged in legislation that will result in a legal agreement between the organ of state and a third party that produces revenue for the organ of state, and includes, but is not limited to, leasing and disposal of assets and concession contracts, excluding direct sales and disposal of assets through public auctions; and
- (e) **“the Act”** means the Preferential Procurement Policy Framework Act, 2000 (Act No. 5 of 2000).

3. FORMULAE FOR PROCUREMENT OF GOODS AND SERVICES

3.1. POINTS AWARDED FOR PRICE

3.1.1 THE 80/20 PREFERENCE POINT SYSTEMS

A maximum of 80 or 90 points is allocated for price on the following basis:

80/20

$$Ps = 80 \left(1 - \frac{Pt - P_{min}}{P_{min}} \right)$$

Where

Ps = Points scored for price of tender under consideration

Pt = Price of tender under consideration

Pmin = Price of lowest acceptable tender

3.2. FORMULAE FOR DISPOSAL OR LEASING OF STATE ASSETS AND INCOME GENERATING PROCUREMENT

3.2.1. POINTS AWARDED FOR PRICE

A maximum of 80 or 90 points is allocated for price on the following basis:

80/20

$$Ps = 80 \left(1 + \frac{Pt - P_{max}}{P_{max}} \right)$$

Where

Ps = Points scored for price of tender under consideration

Pt = Price of tender under consideration

Pmax = Price of highest acceptable tender

4. POINTS AWARDED FOR SPECIFIC GOALS

- 4.1. In terms of Regulation 4(2); 5(2); 6(2) and 7(2) of the Preferential Procurement Regulations, preference points must be awarded for specific goals stated in the tender. For the purposes of this tender the tenderer will be allocated points based on the goals stated in table I below as may be supported by proof/ documentation stated in the conditions of this tender:
- 4.2. In cases where organs of state intend to use Regulation 3(2) of the Regulations, which states that, if it is unclear whether the 80/20 preference point system applies, an organ of state must, in the tender documents, stipulate in the case of—
 - (a) an invitation for tender for income-generating contracts, that either the 80/20 preference point system will apply and that the highest acceptable tender will be used to determine the applicable preference point system; or
 - (b) any other invitation for tender, that either the 80/20 preference point system will apply and that the

lowest acceptable tender will be used to determine the applicable preference point system,
then the organ of state must indicate the points allocated for specific goals for both the 80/20 preference point system.

Table 1: Specific goals for the tender and points claimed are indicated per the table below.

(Note to organs of state: Where either the 80/20 preference point system is applicable, corresponding points must also be indicated as such.

Note to tenderers: The tenderer must indicate how they claim points for each preference point system.)

The specific goals allocated points in terms of this tender	Number of points allocated (80/20 system) (To be completed by the organ of state)	Number of points claimed (80/20 system) (To be completed by the tenderer)
Historically Disadvantaged Individuals Ownership	20% (4)	
Women Ownership	20% (4)	
Youth Ownership	20% (4)	
Disability Ownership	20% (4)	
Military Veterans Ownership	10% (2)	
Locality Ownership (Eastern Cape)	10% (2)	
TOTAL	100% (20)	

- a) Service providers must submit proof of its Specific Goals points claimed / status of contributor.
- b) The Specific Goals supporting documents required to verify claimed points may inline with the specified requirements include:
- Historically Disadvantaged Individuals Ownership: Proof of ownership (CIPRO certificate) with id no.
 - Women Ownership: Ownership: Proof of ownership (CIPRO certificate) with id no.
 - Youth Ownership: Ownership: Proof of ownership (CIPRO certificate) with id no.
 - Disability Ownership: Proof of ownership (CIPRO certificate) with valid medical documentary proof.
 - Military Veterans Ownership: Proof of ownership (CIPRO certificate) with valid proof of veteran status.
 - Ownership: Proof of business address (municipal account or valid lease agreement)
 - Updated CSD report

DECLARATION WITH REGARD TO COMPANY/FIRM

4.3. Name of company/firm.....

4.4. Company registration number:

4.5. TYPE OF COMPANY/ FIRM

Partnership/Joint Venture / Consortium
One-person business/sole propriety
Close corporation
Public Company
Personal Liability Company
(Pty) Limited
Non-Profit Company
State Owned Company

[TICK APPLICABLE BOX]

4.6. I, the undersigned, who is duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the specific goals as advised in the tender, qualifies the company/ firm for the preference(s) shown and I acknowledge that:

- i) The information furnished is true and correct;
- ii) The preference points claimed are in accordance with the General Conditions as indicated in paragraph I of this form;
- iii) In the event of a contract being awarded as a result of points claimed as shown in paragraphs 1.4 and 4.2, the contractor may be required to furnish documentary proof to the satisfaction of the organ of state that the claims are correct;
- iv) If the specific goals have been claimed or obtained on a fraudulent basis or any of the conditions of contract have not been fulfilled, the organ of state may, in addition to any other remedy it may have –
 - (a) disqualify the person from the tendering process;
 - (b) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
 - (c) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation;
 - (d) recommend that the tenderer or contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, be restricted from obtaining business from any organ of state for a period not exceeding 10 years, after the *audi alteram partem* (hear the other side) rule has been applied; and
 - (e) forward the matter for criminal prosecution, if deemed necessary.

.....
SIGNATURE(S) OF BIDDER(S)

SURNAME AND NAME:

DATE:

ADDRESS:

.....

.....

.....

T2.2: OTHER DOCUMENTS REQUIRED FOR TENDER EVALUATION PURPOSES



T2.2g: SPECIFIC GOALS CLAIMED (CIPRO CERTIFICATE)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers must attach CIPRO CERTIFICATE

T2.2y: Proof of Registration with Centralized Supplier Database

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers must attach Full CSD report

Annexure A: Method Statement (Generic)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit a method statement.

Annexure A1: Summary Task

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit a summary task.

Annexure A2: Programme with Timelines and Resources

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit Programme with timelines and planned resources.

Annexure B1: Key Personnel Qualification (Construction manager)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit proof of Construction manager's experience.

Annexure B2: Key Personnel Qualification (Construction supervisor)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit proof of Construction supervisor's experience.

Annexure B3: Key Personnel Qualification (OHS Safety officer)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit proof of OHS safety officer's experience.

Annexure B4: Key Personnel Qualification (Skilled installation/maintenance Staff)

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit proof of Skilled installation/maintenance staff

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Suppliers are required to submit proof of business address (municipal account or valid lease agreement not later than 3 months).

Reference No. 2
12.2x: References

Reference No. 1

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Sir/Madam,

We are in the process of evaluating _____ for the above project.

They have listed you as a reference. Please evaluate the Suppliers performance on the criteria listed below by ticking the appropriate boxes. Please return upon completion as soon as possible. If you have any questions please do not hesitate to contact us.

NAME OF EMPLOYER	NAME OF PROJECT	CONTRACT PERIOD (Start and End Date)	VALUE OF WORK

1. QUALITY

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

2. TIME PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

3. FINANCIAL PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

4. COMMENTS:

Project Manager/Principal Agent: _____

Tel. No: _____

E-mail Address: _____

Signature: _____ Date: _____

Place Company Stamp Here

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Sir/Madam,

We are in the process of evaluating _____ for the above project.

They have listed you as a reference. Please evaluate the Suppliers performance on the criteria listed below by ticking the appropriate boxes. Please return upon completion as soon as possible. If you have any questions please do not hesitate to contact us.

NAME OF EMPLOYER	NAME OF PROJECT	CONTRACT PERIOD (Start and End Date)	VALUE OF WORK

1. QUALITY

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

2. TIME PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

3. FINANCIAL PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

4. COMMENTS:

Project Manager/Principal Agent: _____

Tel. No: _____

E-mail Address: _____

Signature: _____ Date: _____

Place Company Stamp Here

Reference No. 3

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Sir/Madam,

We are in the process of evaluating _____ for the above project.

They have listed you as a reference. Please evaluate the Suppliers performance on the criteria listed below by ticking the appropriate boxes. Please return upon completion as soon as possible. If you have any questions please do not hesitate to contact us.

NAME OF EMPLOYER	NAME OF PROJECT	CONTRACT PERIOD (Start and End Date)	VALUE OF WORK

1. QUALITY

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

2. TIME PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

3. FINANCIAL PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

4. COMMENTS:

Project Manager/Principal Agent: _____

Tel. No: _____

E-mail Address: _____

Signature: _____ Date: _____

Place Company Stamp Here

Reference No. 4

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Sir/Madam,

We are in the process of evaluating _____ for the above project.

They have listed you as a reference. Please evaluate the Suppliers performance on the criteria listed below by ticking the appropriate boxes. Please return upon completion as soon as possible. If you have any questions please do not hesitate to contact us.

NAME OF EMPLOYER	NAME OF PROJECT	CONTRACT PERIOD (Start and End Date)	VALUE OF WORK

1. QUALITY

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

2. TIME PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

3. FINANCIAL PERFORMANCE

EXCELLENT	VERY GOOD	GOOD	FAIR	POOR
5	4	3	2	1

4. COMMENTS:

Project Manager/Principal Agent: _____

Tel. No: _____

E-mail Address: _____

Signature: _____ Date: _____

Place Company Stamp Here

VOLUME 3: CONTRACT

PART C1: AGREEMENT AND CONTRACT DATA

C1.1 FORM OF OFFER AND ACCEPTANCE

OFFER

The Employer, identified in the acceptance signature block, has solicited offers to enter into a Contract for the procurement of:

CONTRACT NUMBER: SCMU3-23/24-0491-HO

CONTRACT NAME: SCHEDULED MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

The Tenderer, identified in the offer signature block below, has examined the documents listed in the Tender Data and addenda thereto as listed in the tender schedules, and by submitting this offer has accepted the conditions of tender.

By the representative of the Tenderer, deemed to be duly authorized, signing this part of this form of offer and acceptance, the Tenderer offers to perform all of the obligations and liabilities of the Contractor under the Contract including compliance with all its terms and conditions according to their true intent and meaning for an amount to be determined in accordance with the Conditions of Contract identified in the Contract Data.

The offered total of the prices inclusive of Value-Added Tax is:

.....

 Rand (in words)

R..... (in figures)

This offer may be accepted by the Employer by signing the acceptance part of this form of offer and acceptance and returning one copy of this document to the Tenderer before the end of the period of validity stated in the Tender Data, whereupon the Tenderer becomes the party named as the Contractor in terms of the Conditions of Contract identified in the Contract data.

For and on behalf of the Tenderer:

Name
 Capacity
 Signature Date:

Name and address of tenderer:

.....

Witness Name
 Witness Signature Date:

ACCEPTANCE

By signing this part of this form of offer and acceptance, the Employer identified below accepts the Tenderer's offer. In consideration thereof, the Employer shall pay the Contractor the amount due in accordance with the Conditions of Contract identified in the Contract data. Acceptance of the Tenderer's offer shall form an agreement between the Employer and the Tenderer upon the terms and conditions contained in this agreement and in the Contract that is the subject of this agreement.

The terms of the Contract are contained in:

- Part C1: Agreements and Contract data (which includes this agreement)
- Part C2: Pricing data
- Part C3: Scope of work
- Part C4: Site Information and drawings and documents or parts thereof, which may be incorporated by reference into the above listed Parts.

Deviations from and amendments to the documents listed in the Tender Data and any addenda thereto, as listed in the returnable schedules as well as any changes to the terms of the offer agreed by the Tenderer and the Employer during this process of offer and acceptance, are contained in the schedule of deviations attached to and forming part of this agreement. No amendments to or deviations from said documents are valid unless contained in this schedule, which must be duly signed by the authorised representative(s) of both parties.

The Tenderer shall, within two weeks after receiving a completed copy of this agreement including the schedule of deviation (if any), contact the Employer's Agent (whose details are given in the Contract data) to arrange the delivery of any securities, bonds, guarantees, proof insurance and any other documentation to be provided in terms of the Conditions of Contract identified in the Contract data at or just after, the date this Agreement comes into effect. Failure to fulfil any of these obligations in accordance with those terms shall constitute a repudiation of this agreement.

Notwithstanding anything contained herein, this agreement comes into effect on the date when the Tenderer receives one fully completed original copy of this document, including the schedule of deviations (if any). Unless the Tenderer (now Contractor), within five (5) working days of the date of such receipt, notifies the Employer in writing of any reason why he cannot accept the contents of this agreement, this agreement shall constitute a binding Contract between the parties.

For and on behalf of the Employer:

Name
 Capacity
 Signature Date:

Name and address of employer:

.....

Witness Name
 Witness Signature Date:

SCHEDULE OF DEVIATIONS

Notes:

- The extent of deviations from the tender documents issued by the Employer prior to the tender closing date is limited to those permitted in terms of the conditions of tender.
- A Tenderer's covering letter shall not be included in the final Contract document. Should any matter in such letter, which constitutes a deviation as aforesaid become be the subject of agreements reached during the process of offer and acceptance, the outcome of such agreement shall be recorded here.
- Any other matter arising from the process of offer and acceptance either as a confirmation, clarification or change to the tender documents, and which it is agreed by the parties becomes an obligation of the Contract, shall also be recorded here.
- Any change or addition to the tender documents arising from the above agreements and recorded here, shall also be incorporated into the final draft of the Contract.

A Tenderer's covering letter shall not be included in the final Contract document. Should any matter in such letter, which constitutes a deviation as aforesaid, be the subject of agreements reached during the process of offer and acceptance, the outcome of such agreement shall be recorded here.

Subject
Details
.....
Subject
Details
.....
Subject
Details
.....
Subject
Details
.....
Subject
Details
.....

By the duly authorized representatives signing this schedule of deviations, the Employer and the Tenderer agree to and accept the foregoing schedule of deviations as the only deviations from and amendments to the documents listed in the Tender Data and addenda thereto as listed in the returnable schedules, as well as any confirmation, clarification or change to the terms of the offer agreed by the Tenderer and the Employer during this process of offer and acceptance.

It is expressly agreed that no other matter whether in writing, oral communication or implied during the period between the issue of the tender documents and the receipt by the Tenderer of a completed signed copy of this Agreement shall have any meaning or effect in the Contract between the parties arising from this agreement.

Part 1– Data provided by the Employer

Clause	Statement	Data
1. General		
	The conditions of contract are the core clauses and the clauses for main Option:	A Priced contract with price list
	dispute resolution Option and secondary Options	W1 Dispute resolution procedure X1 Price adjustment for inflation X13 Performance Bond X17 Low service damages X18 Limitation of liability X19 Task Order X20 Key Performance Indicators
	of the NEC3 Term Service Contract (April 2013)	
10.1	The Employer is (name):	Eastern Cape Department of Health
	Address	Department of Health Global Life Centre Corner Phalo Avenue and R63 (opposite Engen garage) Bhisho 5605
	Represented By:	Mr Lamkelo Mdingi
	Tel No.	
	Fax No.	
10.1	The Service Manager is (name):	Lukhozi Consortium
	Tel	
	e-mail	
	The Service Manager is (name):	
11.2(2)	The Affected Property is	Various Health Facilities in the Eastern Cape Province as per Service Information

11.2(13)	The service is	Scheduled and Re-Active Maintenance works
11.2(14)	The following matters will be included in Risk register	N/A
11.2(15)	The Service Information is in	The Contract Part 1: Service Information - Scope of Works. Works Information and all documents and drawings to which it makes reference.
12.2	The law of the contract is the law of	the Republic of South Africa
13.1	The language of this contract is	English
13.2	The period for reply is	7 days

2. The Contractor's responsibility (If the optional statement for this section is not used, no data will be required for this section)

21.1 The Contractor submits a first Plan for 2 weeks of the Contract Date acceptance within

3. Time

30.1 The starting date is at the Site Handover Meeting Date.
 30.2 The service period is 36 Months.

4. Testing and defects

Special testing may be requested by the Service Manager.

5. Payment

50.1 The assessment interval is Monthly
 51.1 The currency of this contract is the South African Rand
 51.2 The period with which payments are made is 30 Days after submission of a valid TAX Invoice to the Employer
 51.4 The interest rate is (i) zero percent above the publicly quoted prime rate of interest (calculated on a 365-day year) charged by from time to time by the South African Reserve Bank (as certified, in the event of any dispute, by any manager of such bank, whose appointment it shall not be necessary to prove) for amounts due in Rands

6. Compensation Events

(if the optional statement for this section is not used, no data will be required for this section)

These are additional compensation N/A events

7. Use of Equipment Plant and Materials		No data is required for this section of the conditions of contract.
8. Risks and Insurance		
80.1	These are additional Employer's risks	N/A
83.1	The Employer provides these insurances from the Insurance Table	N/A
83.1	The Employer provides these additional insurances	N/A
83.1	The minimum amount of cover for insurance against loss and damage caused by the Contractor to the Employer's property is	R 5 000 000.00
83.1	The insurance against loss of or damage to the works, Plant and Materials is to include cover for Plant and Materials provided by the Employer to an amount of	R 5 000 000.00
83.1	The minimum amount of cover for insurance in respect of loss of or damage to property (except the Employer's property, Plant and Materials and Equipment) and liability for bodily injury to or death of a person (not an employee of the Contractor) arising from or in connection with the Contractor's Providing the Service for any one event is:	R 5 000 000.00
83.1	The Minimum limit of indemnity for insurance in respect of death of or bodily injury to employees of the Contractor arising out of and in course of their employment in connection with this contract for any one event is:	As prescribed by the Compensation for Occupational Injuries and Diseases Act No. 130 of 1993 and the Contractor's common law liability for people falling outside the scope of the Act with a limit of Indemnity of not less than R 5 000 000.00
9. Termination		No data is required for this section of the conditions of contract.
10. Data for main Option Clauses		
A	Priced Contract with Price List	Option A
20.5	The Contractor prepares forecasts of the final total of the Prices for the whole of the service at intervals of no longer than	4 Weeks
11. Data for Option W1		
W1.1	The Adjudicator is (Name)	The person selected from the ICE-SA Division (or its successor body) of the South African Institution of Civil Engineering Panel of Adjudicators by the party intending to refer a dispute to him. (See www.icesa.org.za)
	Address	
	Tel. No,	
	Fax No.	
	Email	

W1.2(3)	The Adjudicator nominating body is:	The Chairman of ICE-SA a joint Division of the South African Institution of Civil Engineering																		
W1.4(2)	The Tribunal is:	Arbitration																		
W1.4(5)	The Arbitration Procedure is	The latest edition of Rules for the Conduct of Arbitrations published by the Association of Arbitrators (South Africa) or its successor body.																		
	The place where arbitration is to be held is	South Africa																		
	The person or organization who will choose an arbitrator	The Chairman for the time being or his nominee of the Association of Arbitrators (South Africa) or its successor body.																		
	- If the Parties cannot agree a choice or																			
	- If the procedure does not state who selects an arbitrator, is																			
12. Data for Secondary Option Clauses																				
X1	Price Adjustment for Inflation																			
X1.1	The base date for indices is	Tender Closing Date																		
	The proportions used to calculate the Price Adjustment Factor are:																			
	Note: Requirements for CPA/Price inflation is that Prices must be Fixed and Firm for the First 12 months of the contract and only subject to escalation thereafter. A minimum of 10% of the contract price / prices is not adjustable throughout the life of the contract	<table> <tr> <th>Proportion</th><th>Linked to Index for</th><th>Index prepared by (Source)</th></tr> <tr> <td></td><td></td><td></td></tr> <tr> <td></td><td></td><td></td></tr> <tr> <td></td><td></td><td></td></tr> <tr> <td></td><td>Non-Adjustable**</td><td></td></tr> <tr> <td>100%</td><td></td><td></td></tr> </table>	Proportion	Linked to Index for	Index prepared by (Source)											Non-Adjustable**		100%		
Proportion	Linked to Index for	Index prepared by (Source)																		
	Non-Adjustable**																			
100%																				
X13	Performance Bond																			
X13.1	The Contractor gives the Employer a performance bond	The Tenderer must provide a Performance Bond in the form of a Fixed Performance Guarantee by means of a Bank Guarantee, or from an Insurer approved by the Service Manager, in the amount of 2.5% of the Awarded Contract Value, once the Contract has been awarded to him. This Bond must be given to the Employer with in four (4) weeks of the Contract Date.																		
X17	Low Service Damages																			
X17.1	The service level table is in	As per Demerit Table in Contact Data – Annexure CD1																		
X18	Limitation of Liability																			
X18.1	The Contractor's liability to the Employer for indirect or consequential loss is limited to	R0.0 (zero Rand)																		
X18.2	For any one event, the Contractor's liability to the Employer for loss of or damage to the Employer's property is limited to	R2 500 000.00																		

X18.3	The Contractor's liability for Defects due to his design of an item of Equipment is limited to	The greater of - the total of the Prices at the Contract Date And - R2 500 000
X18.4	The Contractor's liability to the Employer for all matters arising under or in connection with this contract, other than the excluded matters, is limited to	N/A
X18.5	The end of liability date is	3 Months after the end of the Service Period.
X19	Task Order The Contractor submits a Task Order programme to the Service Manager within	Authorization to commence with any Task will be done by Task Order. This Task Order will be issued to the Contractor by the Service Manager. Maintenance Turn- around times are stated in the Works Instructions under specification clause GM7.
X20	Key Performance Indicators	Key performance Indicators will be used to monitor Contractor performance on a monthly basis

Part Two – Data provided by the *Contractor*

Clause	Statement	Data
10.1	The Contractor is (Name): Address: Tel No. Fax No.	
11.2(8)	The Direct Fee Percentage is _____%	
	The Subcontracted Fee Percentage Is _____%	
11.2(14)	The following matters will be included in the Risk Register	
11.2(15)	The Service Information for the Contractor's plan is in:	
21.1	The plan identified in the Contract Data is contained in:	
24.1	The Key Persons are: Name : Job : Responsibilities : Qualifications : Experience	
	Name : Job : Responsibilities : Qualifications : Experience	
		CV's and further key person's data are in _____
A	Priced Contract with Price List	
11.2(12)	The price list is in	
11.2(19)	The tendered total of the Prices is	
X1	Price adjustment for inflation	

X1.1

Proportion	Linked to Index for	Index prepared by (Source)
	Non-Adjustable**	
100%		

Annexure CD1 – Demerit Table and Penalty Calculation System

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

Attach document here

ANNEXURE CD1: DEMERIT TABLE AND PENALTY CALCULATION SYSTEM

If the Contractor fails to remedy any sub-standard work within the time frame stipulated by the Service Manager, the conditions as per GM 3.1 will apply.

The contractor will incur demerit points for specific measurable poor performance incidents which can lead to the early termination of the Contract as described below.

DESCRIPTION	DEMERIT POINT
Failure to submit the Functional Condition Assessment Report by the due date	1 point/ week that the report is late
Exceeding the maximum allowable response and resolve time for a P1 Breakdown	3 points/ incident
Exceeding the maximum allowable response and resolve time for a P2 Breakdown	2 points/ incident
Exceeding the maximum allowable response and resolve time for a P3 or P4 Breakdown	1 point/ incident
Not meeting the Planned Maintenance Performance KPI	1 point/ incident
Not meeting the Rework Rate KPI	1 point/ incident
Not meeting the Contractor Contactability KPI	1 point/ incident

The demerit points will accumulate and trigger the following actions:

ACCUMULATED DEMERIT POINTS	ACTION
6	Service Manager to discuss Contractor's performance deviation and agree on improvement measures. If improvement measures are successful and the Contractor has been consistently meeting the required KPI targets for the following two months, the demerit points can be cancelled by the Service Manager.

12	Service Manager to issue notice that Contractor is in Breach of Contract and that Contract Can be terminated if the Contractor does not improve his performance in line with the agreed improvement measures.
----	---

15	Service Manager to Terminate Contract as per Clause 9 of the NEC3 Term Service Contract.
----	--

Poor performance by the Contractor due to late payments by the Employer will not incur demerit points.

Financial penalties, as per the requirements of Secondary Options Clause X17, will be applied on the effected payments at 1% penalty per demerit point by the Service Manager, in the month that the demerit points are allocated to the Contractor.

Annexure CD2 – Key Performance Indicator Listing

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

ANNEXURE CD2: KEY PERFORMANCE INDICATOR LISTING

The following Key Performance Indicators (KPI's) will be applicable to this Contract and must be monthly updated and reported on by the Service Manager:

KPI Name	KPI Equation			Frequency	Target
Emergency Job Rate	=	$\frac{\text{Total Number of Emergency Jobs Done}}{\text{Total Number of Jobs Done}}$	X 100%	Monthly	<10%
Planned Maintenance Performance	=	$\frac{\text{Total Number of Scheduled Planned Maintenance Jobs Completed}}{\text{Total Number of Planned Maintenance Jobs Scheduled}}$	X 100%	Monthly	100%
Cost Estimation Accuracy	=	$\frac{\text{Total Actual Cost of Work}}{\text{Total Estimated Cost Of Work}}$	X 100%	Monthly	100%
Response Performance	=	$\frac{\text{Number of Service Calls Completed within Targeted Response Time}}{\text{Total Number of Service Calls}}$	X 100%	Monthly	100%
Rework Rate	=	$\frac{\text{Number of Jobs Requiring Rework}}{\text{Total Number of Jobs Done}}$	X 100%	Monthly	0%
SHEQ	=	Number of SHEQ Incidents Involving the Contractor		Monthly	0
Contractor Contactability	=	Number of Times that Contractor was not Contactable by the Call Centre		Monthly	0

The Service Manager must also ensure that the following items are routinely inspected and reported on by the Site Representative for each Health Facility:

1. Compliance with general maintenance requirements as specified in the Service Information.

2. Manner in which preventative and corrective maintenance is carried out.
3. Manner in which the Maintenance Control Plan is implemented and updated.
4. Manner in which Task Orders received from the Service Manager is dealt with.
5. Manner in which records are kept as required by the Service Information as well as the Occupational Health and Safety Act, Act No 85 of 1993 as amended.
6. Quality of services carried out for the month prior to the inspection.

Note: The aim of the above inspection is to determine that all the requirements of the specification have been complied with. Should the Service Manager believe that one or more maintenance items referred to above, have been neglected or totally ignored by the Contractor he may decide to implement demerit points as penalty as per X17 for each type of non-compliance found during the inspection.

C1.3 CIDB ADJUDICATOR'S AGREEMENT

This agreement is made on the day of between:
 (name of company / organisation) of

 (address) and.
 (name of company / organisation) of

 (address) (the Parties) and.
 (name) of

 (address)
 (the Adjudicator).

Disputes or differences may arise/have arisen* between the Parties under a Contract dated and known as.

and these disputes or differences shall be/have been* referred to adjudication in accordance with the CIDB Adjudication Procedure, (hereinafter called "the Procedure") and the Adjudicator may be or has been requested to act.

* Delete as necessary

IT IS NOW AGREED as follows:

- 1 The rights and obligations of the Adjudicator and the Parties shall be as set out in the Procedure.
- 2 The Adjudicator hereby accepts the appointment and agrees to conduct the adjudication in accordance with the Procedure.
- 3 The Parties bind themselves jointly and severally to pay the Adjudicator's fees and expenses in accordance with the Procedure as set out in the Contract Data.
- 4 The Parties and the Adjudicator shall at all times maintain the confidentiality of the adjudication and shall endeavour to ensure that anyone acting on their behalf or through them will do likewise, save with the consent of the other Parties which consent shall not be unreasonably refused.
- 5 The Adjudicator shall inform the Parties if he intends to destroy the documents which have been sent to him in relation to the adjudication and he shall retain documents for a further period at the request of either Party.

SIGNED

by:

Name: _____

SIGNED by:

Name: _____

SIGNED by:

Name: _____

Witness

Name: _____

Address: _____

Witness:

Name _____

Address: _____

Witness:

Name: _____

Address: _____

Date: _____ Date: _____ Date: _____

Contract Data

1	The Adjudicator shall be paid at the hourly rate of R. in respect of all time spent upon, or in connection with, the adjudication including time spent travelling.
2	The Adjudicator shall be reimbursed in respect of all disbursements properly made including, but not restricted to: (a) Printing, reproduction and purchase of documents, drawings, maps, records and photographs. (b) Telegrams, telex, faxes, and telephone calls. (c) Postage and similar delivery charges. (d) Travelling, hotel expenses and other similar disbursements. (e) Room charges. (f) Charges for legal or technical advice obtained in accordance with the Procedure.
3	The Adjudicator shall be paid an appointment fee of R This fee shall become payable in equal amounts by each Party within days of the appointment of the Adjudicator, subject to an Invoice being provided. This fee will be deducted from the final statement of any sums which shall become payable under item 1 and/or item 2 of the Contract Data. If the final statement is less than the appointment fee the balance shall be refunded to the Parties.
4	The Adjudicator is/is not* currently registered for VAT.
5	Where the Adjudicator is registered for VAT it shall be charged additionally in accordance with the rates current at the date of invoice.
6	All payments, other than the appointment fee (item 3) shall become due 7 days after receipt of invoice, thereafter interest shall be payable at 5% per annum above the Reserve Bank base rate for every day the amount remains outstanding.

* Delete as necessary

C1.4 CONFIRMATION OF RECEIPT OF CONTRACT (PRO FORMA)
--

The Tenderer, (now Contractor), identified in the Offer part of this Agreement, hereby confirms receipt from the Employer, identified in the Acceptance part of this Agreement, of one fully completed original copy of this Agreement, including the Schedule of Deviations (if any) on:

The (day) of (month) (year)

At (place)

It is hereby agreed that the official commencement date of the Contract will be:

The (day) of (month) (year)

For and on behalf of the Contractor:

Name

Capacity

Signature Date:

Witness Name

Witness Signature Date:.....

PART C2-1: PRICING DATA

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

C2.1 Pricing Data

GENERAL NOTES

1 Documents

The Schedule of Quantities form part of the Document and must be read in conjunction with the other parts forming the Document in order to gain the full meanings of the descriptions of the work to be done and materials and equipment to be used.

2 Alterations

No alterations, erasure or addition is to be made in the text of the Schedule of Quantities. Should any alteration, erasure or addition be made, it will not be recognised and the original wording of the Schedule of Quantities will be adhered to.

3 Issue of Schedule of Quantities in Electronic Format

The Engineers will make the Schedule of Quantities available to Tenderers in electronic (Microsoft Excel Workbook) format, upon request.

If utilised for tender submission, the Tenderer will be responsible for ensuring the correctness of all calculations. The Consulting Electrical Engineers cannot be held responsible for any arithmetic inaccuracies in the electronic Schedule of Quantities.

4 Pages

Before submitting his Tender, the Tenderer must check to ensure all pages have been included and are distinct. Should any obvious errors be found the Engineer is to be notified immediately to have them corrected as no liability whatsoever will be admitted by the Engineer in respect of errors in the Tender due to the foregoing.

5 Responsibility

The responsibility for the accuracy of the quantities written into the Schedule of Quantities remains with the person who prepared the Schedule of Quantities. The Tenderer shall be relieved of the responsibility of measuring quantities at the Tender stage, and the Tender Price submitted shall be in respect of the quantities set out in the Schedule of Quantities.

The Tenderer will be required to make his assessment of items such as brackets, fixings, etc., from details stated in the Schedule of Quantities and shall make allowances therefore within the rates tendered.

Tenderers shall make due allowance in their rates for any item of incidental or contingent work, labour and materials not contained in the Schedule of Quantities, but deemed necessary for the successful completion of the Works.

6 Offered rates in the Schedule of Quantities

The rates in the Schedule of Quantities shall be final and no further adjustment will be made.

7 Currency

All the offered rates in the Schedule of Quantities shall be in South African Rands (R). Any items purchased overseas must be converted to local currency with all exchange rates and export charges.

8 Unit Rates

Unless a separate rate for the supply and the installation of any item is specifically called for, the supply and installation costs of any items shall be fully included in the unit price.

The description of each item shall, unless otherwise stated herein, be held to include making, conveying and delivering, unloading, storing, unpacking, hoisting, setting, fitting and fixing in position, cutting and

waste, patterns, models and templates plant, temporary works, return of water establishment charges, profit and all other obligations arising out of the Conditions of Contract.

9 Variations

Variations in the scope and extent of the work included in the Schedule of Quantities shall be allowed in order to meet the Employer's requirements and shall be measured and costed at the rates entered in the Schedule of Quantities, where appropriate, forming an addition to or deduction from the total of the Schedule of Quantities. Any items or variations for which rates have not been added in the Schedule of Quantities shall be agreed and priced as non-scheduled items in accordance with the provisions of the contract.

The rules governing the extent and costing of the variations shall be those provided for in the Conditions of Contract and Variations to Sub-contract.

Variations to the planning before the work has been executed shall be priced as above. Alterations to work already executed cannot necessarily be priced as above and must be reviewed on its merits.

The appropriate portions of the Preliminary & General Costs are to be adjusted proportionately to the nett additions or omissions of the variations to the contract

10 Preliminary and General

Tenderers are to note that no allowances have been made in the Schedules of Quantities for the pricing of "Preliminary & General" items.

Tenderers shall therefore, include the "Preliminary & General" component of their Tender Price in their tendered rates for the respective items of equipment / Work.

11 Provisional Sums

All Provisional Sums shall be expended only as directed by the Client and Engineer and any balance remaining shall be deducted from the amount of the Sub-contract sum. No work for which Provisional Sums are provided shall be commenced without written instructions from the Engineer.

All Provisional Sums may be utilised in full or in part. These Provisional Sums may be deleted in full or in part if not required.

12 Contingency Sums

All Contingency Sums shall be expended only as directed by the Client and Engineer. No work for which Contingency Sums are provided shall be commenced without written instructions from the Engineer.

All Contingency Sums may be utilised in full or in part. These Contingency Sums may be deleted in full or in part if not required.

13 Dayworks

The rates included for daywork shall not form part of the Tender Price, but Tenderers shall note that this item must be regarded as provisional and will only be payable to the Sub-contractor if and when a written order to this effect has been issued.

14 Value Added Tax

This Schedule of Quantities shall be priced nett, excluding VAT.

VAT shall only be added at the Summary at the end of the Schedule of Quantities for the Principal Contract.

15 Adjustment

The Employer reserves the right to adjust arithmetical errors in the extension of rates and totals in the Tender, and the Tenderer will be informed of the effect of any corrections on his Tender Sum prior to the award of the Contract. In no case will tendered rates be adjusted when correcting such errors.

In the event of there being tendered rates or prices which are declared by the Employer to be unacceptable to him, because they are either excessively low or high or not in proper balance with other rates, the Tenderer may be required to produce evidence and advance arguments in support of the tendered rates or prices objected to. If after submission of such evidence and any further evidence requested, the Employer is still not satisfied with the tendered rates or prices objected to, he may request the Tenderer to amend these rates and prices along the lines indicated by him.

The Tenderer may or may not thereupon alter and amend the rates and prices objected to and such other related prices as are agreed to by the Employer. Should the Tenderer fail to amend his Tender in a manner acceptable to the Employer, or at all, it may prejudice his Tender.

In the case of Tenders with Schedule of Quantities, the total corrected Tender Price in the Tender Form shall constitute the Sub-contract Sum. Tenderers are advised to check their extensions and additions. In the case of a Lump Sum Tender, the original uncorrected Tender Price shall be considered. The Engineer shall negotiate adjustments to the rates tendered in order to correct the arithmetical extension or addition, whilst the Tender Price as submitted, remains unaltered.

In either case, the Tenderer shall be notified of any arithmetical error in his Tender, and shall be given the opportunity to withdraw the Tender at this stage.

16 Quantification

The successful Tenderer and the Employer or his Agent may agree that the total of any Schedule, including any variations by way of additions thereto or deductions there from, represents a fair and accurate quantification of the items set out in the Schedule of Quantities and the parties may agree final payment on that basis. In the event of any dispute as to the quantities, the disputed item or items shall be adjusted where necessary.

17 Ordering

The quantities in this Schedule of Quantities shall not be used for ordering materials. The onus is on the successful Tenderer to order the correct quantities of materials as per the drawings.

18 Payment

The measurement and payment of Work done shall be made in accordance with the unit price rates, and rates of pay listed in the Schedule of Quantities. No payment will be made for any item of associated work not specifically detailed in the Schedule of Quantities.

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

C2.2 Schedules of Quantities

CONTENTS

PAGES

Contract
Part C2: Pricing Data

1

C2.2
Schedule of Quantities

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Cluster Three - Buffalo City & Mathole Districts

ASSET TYPE: STANDBY GENERATORS

SCHEDULE NUMBER	DESCRIPTION	TENDER AMOUNT
1A-1	NMM DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK	
1A-2	NMM DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1A-3	NMM DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1A-4	NMM DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1A-5	NMM DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK	
1B-1	SB DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK	
1B-2	SB DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1B-3	SB DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1B-4	SB DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)	
1B-5	SB DISTRICT - FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK	
2A-1	NMM DISTRICT - FUNCTIONAL REPAIR SCHEDULE	
2A-2	NMM DISTRICT - FUNCTIONAL REPAIR SCHEDULE (continued)	
2A-3	NMM DISTRICT - FUNCTIONAL REPAIR SCHEDULE (continued)	
2A-4	NMM DISTRICT - FUNCTIONAL REPAIR SCHEDULE	
2B-1	SB DISTRICT - FUNCTIONAL REPAIR SCHEDULE	
2B-2	SB DISTRICT - FUNCTIONAL REPAIR SCHEDULE (continued)	
2B-3	SB DISTRICT - FUNCTIONAL REPAIR SCHEDULE (continued)	
2B-4	SB DISTRICT - FUNCTIONAL REPAIR SCHEDULE	
3A	NMM DISTRICT - MAINTENANCE SERVICE SCHEDULE	
3B	SB DISTRICT - MAINTENANCE SERVICE SCHEDULE	
4	TERM REPAIRS SUBJECT TO APPROVAL OF QUOTATION OF THE WORKS	
5	ROAMING GENERATORS AND GENERATOR HIRE	
SUBTOTAL AMOUNT OF WORKS (EXCL VAT)		
ALLOWANCE FOR VAT AT 15.0%		
TOTAL AMOUNT OF WORKS (INCL VAT) - ENTER THIS AMOUNT TO FORM OF OFFER		

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1A-1: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 2.5	VERIFICATION OF ASSETS ON SITE : Verify assets on site vs Asset Register (C4.1), and compile plant layout line drawings as per GM 2.5 (1) and (2).				
1.1		Bhisho Forensic Laboratory	Item	1		
1.2		Bhisho Hospital	Item	1		
1.3		Cecilia Makhiwane Hospital	Item	1		
1.4		Dimbaza Hospital	Item	1		
1.5		Duncan Village Chc	Item	1		
1.6		Empilweni Gompo Chc	Item	1		
1.7		Ems Vincent	Item	1		
1.8		Frere Hospital	Item	1		
1.9		Grey Hospital	Item	1		
1.10		Mdantsane Forensic Mortuary	Item	1		
1.11		Mount Coke Chc	Item	1		
1.12		New Haven	Item	1		
1.13		Nontyatyambo Chc	Item	1		
1.14		Nkqubela Tb Hospital	Item	1		
1.15		Wood Brook Mortuary	Item	1		
1.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1A-2: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
2	GM 2.5 & 3.2	VERIFICATION OF SPARE PART INVENTORY ON SITE : Find and verify all spares for the asset type that is currently available on site				
2.1		Bhisho Forensic Laboratory	Item	1		
2.2		Bhisho Hospital	Item	1		
2.3		Cecilia Makhiwane Hospital	Item	1		
2.4		Dimbaza Hospital	Item	1		
2.5		Duncan Village Chc	Item	1		
2.6		Empilweni Gompo Chc	Item	1		
2.7		Ems Vincent	Item	1		
2.8		Frere Hospital	Item	1		
2.9		Grey Hospital	Item	1		
2.10		Mdantsane Forensic Mortuary	Item	1		
2.11		Mount Coke Chc	Item	1		
2.12		New Haven	Item	1		
2.13		Nontyatyambo Chc	Item	1		
2.14		Nkqubela Tb Hospital	Item	1		
2.15		Wood Brook Mortuary	Item	1		
2.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1A-3: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
3	GM 2.7	COMPILING OF OPERATING AND MAINTENANCE MANUALS : Compile three sets of O&M Manuals per site per asset type and asset model as per information from the Asset Register C4.1				
3.1		Bhisho Forensic Laboratory	Item	1		
3.2		Bhisho Hospital	Item	1		
3.3		Cecilia Makhiwane Hospital	Item	1		
3.4		Dimbaza Hospital	Item	1		
3.5		Duncan Village Chc	Item	1		
3.6		Empilweni Gompo Chc	Item	1		
3.7		Ems Vincent	Item	1		
3.8		Frere Hospital	Item	1		
3.9		Grey Hospital	Item	1		
3.10		Mdantsane Forensic Mortuary	Item	1		
3.11		Mount Coke Chc	Item	1		
3.12		New Haven	Item	1		
3.13		Nontyatyambo Chc	Item	1		
3.14		Nkqubela Tb Hospital	Item	1		
3.15		Wood Brook Mortuary	Item	1		
3.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1A-4: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
4	SS 8 & 9	OPERATOR AND MAINTAINER TRAINING : Provide Operator and Maintainer training as per SS8 and SS9				
4.1		Bhisho Forensic Laboratory	Hrs	40		
4.2		Bhisho Hospital	Hrs	40		
4.3		Cecilia Makhiwane Hospital	Hrs	40		
4.4		Dimbaza Hospital	Hrs	40		
4.5		Duncan Village Chc	Hrs	40		
4.6		Empilweni Gompo Chc	Hrs	40		
4.7		Ems Vincent	Hrs	40		
4.8		Frere Hospital	Hrs	40		
4.9		Grey Hospital	Hrs	40		
4.10		Mdantsane Forensic Mortuary	Hrs	40		
4.11		Mount Coke Chc	Hrs	40		
4.12		New Haven	Hrs	40		
4.13		Nontyatyambo Chc	Hrs	40		
4.14		Nkqubela Tb Hospital	Hrs	40		
4.15		Wood Brook Mortuary	Hrs	40		
4.16		Fort Grey Tb Hospital	Hrs	40		
5	GM 2.15	ENVIRONMENTAL MANAGEMENT PLAN : The Contractor must compile a basic Environmental plan specific to the type of work that he will be performing at the Health Facilities as per C3.2	Item	1		
6	GM 2.15	OCCUPATIONAL HEALTH AND SAFETY ACT COMPLIANCE COST : The Contractor must comply to the project Health and Safety Specification specific to the type of work that he will be performing on site as per C3.2	Month	36		
7	GM 2.16	HIV / AIDS AWARENESS PLAN : The Contractor must comply with all the requirements of the national Department of Public Works HIV / AIDS Specification (PW 1544) and provide pricing to cover all the requirements under this specification	Item	1		
8	Clause 83.1	INSURANCE : LIMITATION OF LIABILITY (Amounts applicable for whole Contract)				
8.1		Provision for General Contractor's Insurance (Minimum liability limit must be equal to R2,000 000) to cover requirements of Clause 83.1 in Contract Data	Month	36		
9	X13	PERFORMANCE BOND (Amounts applicable for whole Contract)				
9.1		Provision for a Performance bond of not less than 2,5% of the Tender Value	Month	36		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1A-5: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
5	GM 3	MAINTENANCE CONTROL PLAN : Compiling of a detailed Maintenance Control Plan for each Health Facility included in this Tender (See SS 3 for facility listing)				
5.1		Bhisho Forensic Laboratory	Item	1		
5.2		Bhisho Hospital	Item	1		
5.3		Cecilia Makhiwane Hospital	Item	1		
5.4		Dimbaza Hospital	Item	1		
5.5		Duncan Village Chc	Item	1		
5.6		Empilweni Gompo Chc	Item	1		
5.7		Ems Vincent	Item	1		
5.8		Frere Hospital	Item	1		
5.9		Grey Hospital	Item	1		
5.10		Mdantsane Forensic Mortuary	Item	1		
5.11		Mount Coke Chc	Item	1		
5.12		New Haven	Item	1		
5.13		Nontyatyambo Chc	Item	1		
5.14		Nkqubela Tb Hospital	Item	1		
5.15		Wood Brook Mortuary	Item	1		
5.16		Fort Grey Tb Hospital	Item	1		
6	SS15	IN-SERVICE TRAINING OF GRADUATES AND INTERNS : Provisional Sum to pay the costs associated with employing nominated Interns and Graduates for the duration of the Contract				
6.1		Interns	Months	36		
6.2		Graduates	Months	36		
7	SS16	PROVISION OF ASSET APPLICABLE ACCREDITED TRAINING : Arranging of Accredited Asset Applicable Training for Operating and Maintenance Staff as per SS16	Psum	1	R 345 000,00	R 345 000,00
7.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amount above	%			
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1B-1 : FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 2.5	VERIFICATION OF SPARE PART INVENTORY ON SITE : Find and verify all spares for the asset type that is currently available on site				
1.1		Adelaide Hospital	Item	1		
1.2		Bedford Hospital	Item	1		
1.3		Butterworth Hospital	Item	1		
1.4		Cathcart Hospital	Item	1		
1.5		Idutywa Chc	Item	1		
1.6		Xhora Chc	Item	1		
1.7		Fort Beaufort Hospital	Item	1		
1.8		Komga Hospital	Item	1		
1.9		Madwaleni Hospital	Item	1		
1.10		Middledrift Chc	Item	1		
1.11		Nompumelelo Hospital	Item	1		
1.12		Nqamakwe Chc	Item	1		
1.13		S.S Gida Hospital	Item	1		
1.14		Stutterrheim Hospital	Item	1		
1.15		Tafalofefe Hospital	Item	1		
1.16		Tower Hospital	Item	1		
1.17		Victoria Hospital	Item	1		
1.18		Willowvale Chc	Item	1		
1.19		Winterburg Tb Hospital	Item	1		
1.20		Adelaide Mortuary	Item	1		
1.21		Butterworth Mortuary	Item	1		
1.22		Centani Mortuary	Item	1		
1.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1B-2: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
2	GM 2.5 & 3.2	VERIFICATION OF SPARE PART INVENTORY ON SITE : Find and verify all spares for the asset type that is currently available on site				
2.1		Adelaide Hospital	Item	1		
2.2		Bedford Hospital	Item	1		
2.3		Butterworth Hospital	Item	1		
2.4		Cathcart Hospital	Item	1		
2.5		Idutywa Chc	Item	1		
2.6		Xhora Chc	Item	1		
2.7		Fort Beaufort Hospital	Item	1		
2.8		Komga Hospital	Item	1		
2.9		Madwaleni Hospital	Item	1		
2.1		Middledrift Chc	Item	1		
2.11		Nompumelelo Hospital	Item	1		
2.12		Nqamakwe Chc	Item	1		
2.13		S.S Gida Hospital	Item	1		
2.14		Stutterrheim Hospital	Item	1		
2.15		Tafalofefe Hospital	Item	1		
2.16		Tower Hospital	Item	1		
2.17		Victoria Hospital	Item	1		
2.18		Willowvale Chc	Item	1		
2.19		Winterburg Tb Hospital	Item	1		
2.2		Adelaide Mortuary	Item	1		
2.21		Butterworth Mortuary	Item	1		
2.22		Centani Mortuary	Item	1		
2.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1B-3: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
3	GM 2.7	COMPILING OF OPERATING AND MAINTENANCE MANUALS : Compile three sets of O&M Manuals per site per asset type and asset model as per information from the Asset Register C4.1				
3.1		Adelaide Hospital	Item	1		
3.2		Bedford Hospital	Item	1		
3.3		Butterworth Hospital	Item	1		
3.4		Cathcart Hospital	Item	1		
3.5		Idutywa Chc	Item	1		
3.6		Xhora Chc	Item	1		
3.7		Fort Beaufort Hospital	Item	1		
3.8		Komga Hospital	Item	1		
3.9		Madwaleni Hospital	Item	1		
3.10		Middledrift Chc	Item	1		
3.11		Nompumelelo Hospital	Item	1		
3.12		Nqamakwe Chc	Item	1		
3.13		S.S Gida Hospital	Item	1		
3.14		Stutterrheim Hospital	Item	1		
3.15		Tafalofefe Hospital	Item	1		
3.16		Tower Hospital	Item	1		
3.17		Victoria Hospital	Item	1		
3.18		Willowvale Chc	Item	1		
3.19		Winterburg Tb Hospital	Item	1		
3.20		Adelaide Mortuary	Item	1		
3.21		Butterworth Mortuary	Item	1		
3.22		Centani Mortuary	Item	1		
3.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1B-4: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
4	SS 8 & 9	OPERATOR AND MAINTAINER TRAINING : Provide Operator and Maintainer training as per SS8 and SS9				
4.1		Adelaide Hospital	Hrs	40		
4.2		Bedford Hospital	Hrs	40		
4.3		Butterworth Hospital	Hrs	40		
4.4		Cathcart Hospital	Hrs	40		
4.5		Idutywa Chc	Hrs	40		
4.6		Xhora Chc	Hrs	40		
4.7		Fort Beaufort Hospital	Hrs	40		
4.8		Komga Hospital	Hrs	40		
4.9		Madwaleni Hospital	Hrs	40		
4.10		Middledrift Chc	Hrs	40		
4.11		Nompumelelo Hospital	Hrs	40		
4.12		Nqamakwe Chc	Hrs	40		
4.13		S.S Gida Hospital	Hrs	40		
4.14		Stutterheim Hospital	Hrs	40		
4.15		Tafalofefe Hospital	Hrs	40		
4.16		Tower Hospital	Hrs	40		
4.17		Victoria Hospital	Hrs	40		
4.18		Willowvale Chc	Hrs	40		
4.19		Winterburg Tb Hospital	Hrs	40		
4.20		Adelaide Mortuary	Hrs	40		
4.21		Butterworth Mortuary	Hrs	40		
4.22		Centani Mortuary	Hrs	40		
4.23		Idutywa Mortuary	Hrs	40		
5	GM 2.15	ENVIRONMENTAL MANAGEMENT PLAN : The Contractor must compile a basic Environmental plan specific to the type of work that he will be performing at the Health Facilities as per C3.2	Item	1		
6	GM 2.15	OCCUPATIONAL HEALTH AND SAFETY ACT COMPLIANCE COST : The Contractor must comply to the project Health and Safety Specification specific to the type of work that he will be performing on site as per C3.2	Month	36		
7	Clause 83.1	INSURANCE : LIMITATION OF LIABILITY (Amounts applicable for whole Contract)				
7.1		Provision for General Contractor's Insurance (Minimum liability limit must be equal to R2,000 000) to cover requirements of Clause 83.1 in Contract Data	Month	36		
8	X13	PERFORMANCE BOND (Amounts applicable for whole Contract)				
8.1		Provision for a Performance bond of not less than 2,5% of the Tender Value	Month	36		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 1B-5: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
5	GM 3	MAINTENANCE CONTROL PLAN : Compiling of a detailed Maintenance Control Plan for each Health Facility included in this Tender (See SS 3 for facility listing)				
5.1		Adelaide Hospital	Item	1		
5.2		Bedford Hospital	Item	1		
5.3		Butterworth Hospital	Item	1		
5.4		Cathcart Hospital	Item	1		
5.5		Idutywa Chc	Item	1		
5.6		Xhora Chc	Item	1		
5.7		Fort Beaufort Hospital	Item	1		
5.8		Komga Hospital	Item	1		
5.9		Madwaleni Hospital	Item	1		
5.10		Middledrift Chc	Item	1		
5.11		Nompumelelo Hospital	Item	1		
5.12		Nqamakwe Chc	Item	1		
5.13		S.S Gida Hospital	Item	1		
5.14		Stutterheim Hospital	Item	1		
5.15		Tafalofefe Hospital	Item	1		
5.16		Tower Hospital	Item	1		
5.17		Victoria Hospital	Item	1		
5.18		Willowvale Chc	Item	1		
5.19		Winterburg Tb Hospital	Item	1		
5.20		Adelaide Mortuary	Item	1		
5.21		Butterworth Mortuary	Item	1		
5.22		Centani Mortuary	Item	1		
5.23		Idutywa Mortuary	Item	1		
6	SS15	IN-SERVICE TRAINING OF GRADUATES AND INTERNS : Provisional Sum to pay the costs associated with employing nominated Interns and Graduates for the duration of the Contract				
6.1		Interns	Months	36		
6.2		Graduates	Months	36		
7	SS16	PROVISION OF ASSET APPLICABLE ACCREDITED TRAINING : Arranging of Accredited Asset Applicable Training for Operating and Maintenance Staff as per SS16	Psum	1	R 345 000,00	R 345 000,00
7.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amount above	%			
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2A-1: FUNCTIONAL REPAIR SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 2.5	FUNCTIONAL CONDITION ASSESSMENT : Perform Functional Condition Assessment (Inspection and Testing) on all listed assets at all Health Facilities included in the Tender				
1.1		Bhisho Forensic Laboratory	Item	1		
1.2		Bhisho Hospital	Item	1		
1.3		Cecilia Makhiwane Hospital	Item	1		
1.4		Dimbaza Hospital	Item	1		
1.5		Duncan Village Chc	Item	1		
1.6		Empilweni Gompo Chc	Item	1		
1.7		Ems Vincent	Item	1		
1.8		Frere Hospital	Item	1		
1.9		Grey Hospital	Item	1		
1.10		Mdantsane Forensic Mortuary	Item	1		
1.11		Mount Coke Chc	Item	1		
1.12		New Haven	Item	1		
1.13		Nontyatyambo Chc	Item	1		
1.14		Nkqubela Tb Hospital	Item	1		
1.15		Wood Brook Mortuary	Item	1		
1.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2A-2: FUNCTIONAL REPAIR SCHEDULE (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
2	GM 2.5.(5)	COMPILING OF PRICED SPARE PART LISTS : Compile detailed, comprehensive priced spare parts lists for each site and asset type (based on Contractor's cost price). NOTE: The Employer retains the right to negotiate the offered spare part prices, if they are not in line with national price norms.				
2.1		Bhisho Forensic Laboratory	Item	1		
2.2		Bhisho Hospital	Item	1		
2.3		Cecilia Makhiwane Hospital	Item	1		
2.4		Dimbaza Hospital	Item	1		
2.5		Duncan Village Chc	Item	1		
2.6		Empilweni Gompo Chc	Item	1		
2.7		Ems Vincent	Item	1		
2.8		Frere Hospital	Item	1		
2.9		Grey Hospital	Item	1		
2.10		Mdantsane Forensic Mortuary	Item	1		
2.11		Mount Coke Chc	Item	1		
2.12		New Haven	Item	1		
2.13		Nontyatyambo Chc	Item	1		
2.14		Nkqubela Tb Hospital	Item	1		
2.15		Wood Brook Mortuary	Item	1		
2.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2A-3: FUNCTIONAL REPAIR SCHEDULE (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
3	GM 2.5	COMPILING OF DETAILED REPAIR SCHEDULE : Compile detailed, comprehensive repair schedule including defect description, recommended repair method, detailed quote including priced spare parts, outsourced work, and provisional work program, for each Health Facility and asset type.				
3.1		Bhisho Forensic Laboratory	Item	1		
3.2		Bhisho Hospital	Item	1		
3.3		Cecilia Makhiwane Hospital	Item	1		
3.4		Dimbaza Hospital	Item	1		
3.5		Duncan Village Chc	Item	1		
3.6		Empilweni Gompo Chc	Item	1		
3.7		Ems Vincent	Item	1		
3.8		Frere Hospital	Item	1		
3.9		Grey Hospital	Item	1		
3.10		Mdantsane Forensic Mortuary	Item	1		
3.11		Mount Coke Chc	Item	1		
3.12		New Haven	Item	1		
3.13		Nontyatyambo Chc	Item	1		
3.14		Nkqubela Tb Hospital	Item	1		
3.15		Wood Brook Mortuary	Item	1		
3.16		Fort Grey Tb Hospital	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Buffalo District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2A-4: FUNCTIONAL REPAIR SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
4	GM 2.6	COMPILE FUNCTIONAL CONDITION ASSESSMENT REPORT: Compile Functional Condition Assessment Report for all asset types at all Health Facilities included in the Tender				
4.1		Bhisho Forensic Laboratory	Item	1		
4.2		Bhisho Hospital	Item	1		
4.3		Cecilia Makhiwane Hospital	Item	1		
4.4		Dimbaza Hospital	Item	1		
4.5		Duncan Village Chc	Item	1		
4.6		Empilweni Gompo Chc	Item	1		
4.7		Ems Vincent	Item	1		
4.8		Frere Hospital	Item	1		
4.9		Grey Hospital	Item	1		
4.10		Mdantsane Forensic Mortuary	Item	1		
4.11		Mount Coke Chc	Item	1		
4.12		New Haven	Item	1		
4.13		Nontyatyambo Chc	Item	1		
4.14		Nkqubela Tb Hospital	Item	1		
4.15		Wood Brook Mortuary	Item	1		
4.16		Fort Grey Tb Hospital	Item	1		
5	GM 6	PROVISION FOR SPECIAL TESTING BY SERVICE MANAGER : Lump sum provision for doing special tests at the Health Facilities as per the prerogative of the Service Manager	PSum	1	105 000,00	R 105 000,00
5.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amounts above	%	1		
6	GM 2.6	MAINTENANCE DOCUMENTATION SITE STORAGE CONSOLE: Provisional sum to supply and install O&M Manual, Log Books, and site Maintenance Records at each equipment type location as directed by the Service Manager	PSum	1	17 500,00	R 17 500,00
6.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amounts above	%	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2B-1: FUNCTIONAL REPAIR SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 2.5	FUNCTIONAL CONDITION ASSESSMENT : Perform Functional Condition Assessment (Inspection and Testing) on all listed assets at all Health Facilities included in the Tender				
1.1		Adelaide Hospital	Item	1		
1.2		Bedford Hospital	Item	1		
1.3		Butterworth Hospital	Item	1		
1.4		Cathcart Hospital	Item	1		
1.5		Idutywa Chc	Item	1		
1.6		Xhora Chc	Item	1		
1.7		Fort Beaufort Hospital	Item	1		
1.8		Komga Hospital	Item	1		
1.9		Madwaleni Hospital	Item	1		
1.10		Middledrift Chc	Item	1		
1.11		Nompumelelo Hospital	Item	1		
1.12		Nqamakwe Chc	Item	1		
1.13		S.S Gida Hospital	Item	1		
1.14		Stutterrheim Hospital	Item	1		
1.15		Tafalofefe Hospital	Item	1		
1.16		Tower Hospital	Item	1		
1.17		Victoria Hospital	Item	1		
1.18		Willowvale Chc	Item	1		
1.19		Winterburg Tb Hospital	Item	1		
1.20		Adelaide Mortuary	Item	1		
1.21		Butterworth Mortuary	Item	1		
1.22		Centani Mortuary	Item	1		
1.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2B-2: FUNCTIONAL REPAIR SCHEDULE (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
2	GM 2.5.(5)	COMPILING OF PRICED SPARE PART LISTS : Compile detailed, comprehensive priced spare parts lists for each site and asset type (based on Contractor's cost price). NOTE: The Employer retains the right to negotiate the offered spare part prices, if they are not in line with national price norms.				
2.1		Adelaide Hospital	Item	1		
2.2		Bedford Hospital	Item	1		
2.3		Butterworth Hospital	Item	1		
2.4		Cathcart Hospital	Item	1		
2.5		Idutywa Chc	Item	1		
2.6		Xhora Chc	Item	1		
2.7		Fort Beaufort Hospital	Item	1		
2.8		Komga Hospital	Item	1		
2.9		Madwaleni Hospital	Item	1		
2.10		Middledrift Chc	Item	1		
2.11		Nompumelelo Hospital	Item	1		
2.12		Nqamakwe Chc	Item	1		
2.13		S.S Gida Hospital	Item	1		
2.14		Stutterrheim Hospital	Item	1		
2.15		Tafalofefe Hospital	Item	1		
2.16		Tower Hospital	Item	1		
2.17		Victoria Hospital	Item	1		
2.18		Willowvale Chc	Item	1		
2.19		Winterburg Tb Hospital	Item	1		
2.20		Adelaide Mortuary	Item	1		
2.21		Butterworth Mortuary	Item	1		
2.22		Centani Mortuary	Item	1		
2.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2B-3: FUNCTIONAL REPAIR SCHEDULE (continued)

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
3	GM 2.5	COMPILING OF DETAILED REPAIR SCHEDULE : Compile detailed, comprehensive repair schedule including defect description, recommended repair method, detailed quote including priced spare parts, outsourced work, and provisional work program, for each Health Facility and asset type.				
3.1		Adelaide Hospital	Item	1		
3.2		Bedford Hospital	Item	1		
3.3		Butterworth Hospital	Item	1		
3.4		Cathcart Hospital	Item	1		
3.5		Idutywa Chc	Item	1		
3.6		Xhora Chc	Item	1		
3.7		Fort Beaufort Hospital	Item	1		
3.8		Komga Hospital	Item	1		
3.9		Madwaleni Hospital	Item	1		
3.10		Middledrift Chc	Item	1		
3.11		Nompumelelo Hospital	Item	1		
3.12		Nqamakwe Chc	Item	1		
3.13		S.S Gida Hospital	Item	1		
3.14		Stutterrheim Hospital	Item	1		
3.15		Tafalofefe Hospital	Item	1		
3.16		Tower Hospital	Item	1		
3.17		Victoria Hospital	Item	1		
3.18		Willowvale Chc	Item	1		
3.19		Winterburg Tb Hospital	Item	1		
3.20		Adelaide Mortuary	Item	1		
3.21		Butterworth Mortuary	Item	1		
3.22		Centani Mortuary	Item	1		
3.23		Idutywa Mortuary	Item	1		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Amathole District

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 2B-4: FUNCTIONAL REPAIR SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
4	GM 2.6	COMPILE FUNCTIONAL CONDITION ASSESSMENT REPORT: Compile Functional Condition Assessment Report for all asset types at all Health Facilities included in the Tender				
4.1		Adelaide Hospital	Item	1		
4.2		Bedford Hospital	Item	1		
4.3		Butterworth Hospital	Item	1		
4.4		Cathcart Hospital	Item	1		
4.5		Idutywa Chc	Item	1		
4.6		Xhora Chc	Item	1		
4.7		Fort Beaufort Hospital	Item	1		
4.8		Komga Hospital	Item	1		
4.9		Madwaleni Hospital	Item	1		
4.10		Middledrift Chc	Item	1		
4.11		Nompumelelo Hospital	Item	1		
4.12		Nqamakwe Chc	Item	1		
4.13		S.S Gida Hospital	Item	1		
4.14		Stutterrheim Hospital	Item	1		
4.15		Tafalofefe Hospital	Item	1		
4.16		Tower Hospital	Item	1		
4.17		Victoria Hospital	Item	1		
4.18		Willowvale Chc	Item	1		
4.19		Winterburg Tb Hospital	Item	1		
4.20		Adelaide Mortuary	Item	1		
4.21		Butterworth Mortuary	Item	1		
4.22		Centani Mortuary	Item	1		
4.23		Idutywa Mortuary	Item	1		
5	GM 6	PROVISION FOR SPECIAL TESTING BY SERVICE MANAGER : Lump sum provision for doing special tests at the Health Facilities as per the prerogative of the Service Manager	PSum	1	105 000,00	R 105 000,00
5.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amounts above	%	1		
6	GM 2.6	MAINTENANCE DOCUMENTATION SITE STORAGE CONSOLE: Provisional sum to supply and install O&M Manual, Log Books, and site Maintenance Records at each equipment type location as directed by the Service Manager	PSum	1	17 500,00	R 17 500,00
6.1	Clause 11.2(8)	Direct Fee Percentage (Mark-up) to be charged by Contractor on amounts above	%	1		
TOTAL CARRIED FORWARD TO SUMMARY						

SCHEDULE 3A : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.1		Bhisho Forensic Laboratory: Standby Generator System				
1.1.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.1.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.1.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.2		Bhisho Hospital: Standby Generator System				
1.2.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	48		
1.2.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	8		
1.2.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	12		
1.3		Cecilia Makhiwane Hospital: Standby Generator System				
1.3.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	120		
1.3.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	20		
1.3.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	30		
1.4		Dimbaza Hospital: Standby Generator System				
1.4.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.4.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.4.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.5		Duncan Village Chc: Standby Generator System				
1.5.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.5.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.5.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						

SCHEDULE 3A : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.6		Empilweni Gompo Chc: Standby Generator System				
1.6.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.6.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.6.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.7		Ems Vincent: Standby Generator System				
1.7.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.7.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.7.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,8		Frere Hospital : Standby Generator System				
1.8.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	192		
1.8.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	32		
1.8.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	48		
1,9		Grey Hospital : Standby Generator System				
1.9.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.9.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.9.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,10		Mdantsane Forensic Mortuary: Standby Generator System				
1.10.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.10.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.10.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						
1,11		Mount Coke Chc: Standby Generator System				

SCHEDULE 3A : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.11.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.11.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.11.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,12		New Haven : Standby Generator System				
1.12.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.12.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.12.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,13		Nontatyambo Chc: Standby Generator System				
1.13.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.13.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.13.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,14		Nkqubela Tb Hospital: Standby Generator System				
1.14.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.14.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.14.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,15		Wood Brook Mortuary: Standby Generator System				
1.15.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.15.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.15.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,16		Fort Grey Tb Hospital: Standby Generator System				
1.16.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						
1.16.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		

SCHEDULE 3A : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.16.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO SUMMARY PAGE						

SCHEDULE 3B : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.1		Adelaide Hospital: Standby Generator System				
1.1.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.1.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.1.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.2		Bedford Hospital: Standby Generator System				
1.2.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.2.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.2.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.3		Butterworth Hospital: Standby Generator System				
1.3.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	96		
1.3.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	16		
1.3.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	24		
1.4		Cathcart Hospital: Standby Generator System				
1.4.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.4.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.4.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.5		Idutywa Chc: Standby Generator System				
1.5.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.5.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.5.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						

SCHEDULE 3B : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.6		Xhora Chc: Standby Generator System				
1.6.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.6.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.6.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1.7		Fort Beaufort Hospital: Standby Generator System				
1.7.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.7.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.7.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,8		Komga Hospital: Standby Generator System				
1.8.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.8.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.8.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,9		Madwaleni Hospital: Standby Generator System				
1.9.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	72		
1.9.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	12		
1.9.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	18		
1,10		Middledrift Chc: Standby Generator System				
1.10.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.10.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.10.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						
1,11		Nompumelelo Hospital: Standby Generator System				

SCHEDULE 3B : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.11.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	48		
1.11.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	8		
1.11.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	12		
1,12		Nqamakwe Chc: Standby Generator System				
1.12.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.12.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.12.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,13		S.S Gida Hospital: Standby Generator System				
1.13.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	48		
1.13.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	8		
1.13.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	12		
1,14		Stutterheim Hospital: Standby Generator System				
1.14.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	48		
1.14.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	8		
1.14.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	12		
1,15		Tafalofefe Hospital: Standby Generator System				
1.15.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.15.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.15.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						
1,16		Tower Hospital: Standby Generator System				
1.16.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	72		
1.16.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	12		

SCHEDULE 3B : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.16.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	18		
1,17		Victoria Hospital: Standby Generator System				
1.17.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	72		
1.17.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	12		
1.17.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	18		
1,18		Willowvale Chc: Standby Generator System				
1.18.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	48		
1.18.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	8		
1.18.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	12		
1,19		Winterburg Tb Hospital: Standby Generator System				
1.19.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.19.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.19.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,20		Adelaide Mortuary: Standby Generator System				
1.20.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.20.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.20.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED TO NEXT PAGE						
TOTAL FROM PREVIOUS PAGE						
1,21		Butterworth Mortuary: Standby Generator System				
1.21.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		

SCHEDULE 3B : MAINTENANCE SERVICE SCHEDULE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 3.2	MAINTENANCE WORKS : Standard servicing and planned Maintenance Costs including all parts, consumables and lubricants, labour, travelling, accommodation and subsistence allowances (Price per machine)				
1.21.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.21.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,22		Centani Mortuary: Standby Generator System				
1.22.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.22.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.22.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
1,23		Idutywa Mortuary: Standby Generator System				
1.23.1		Minor Service Cost : Price per Monthly Service / Inspection per machine, as per tasks from the Monthly Service Inspection Guideline in C6.	No	24		
1.23.2		Minor Service Cost : Price per Three Monthly Service / Inspection per machine, as per tasks from the Three Monthly Service Inspection Guideline in C6.	No	4		
1.23.3		Major Service Cost : Price per Six Monthly Service / Inspection per machine, as per tasks from the Six Monthly Service Inspection Guideline in C6.	No	6		
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Cluster Three - Buffalo City & Mathole Districts

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 4 : TERM REPAIRS SUBJECT TO APPROVAL OF QUOTATION OF THE WORKS

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1	GM 2.8	LABOUR RATES APPLICABLE TO UNSCHEDULED WORK: Labour rates that Contractor will charge for additional adhoc work that is not contained in Schedules 1 to 3.				
1.1		Technician	Hr	300		
1.2		Senior Artisan (Trade Tested & Additional Certification)	Hr	580		
1.3		Artisan (Trade Tested)	Hr	430		
1.4		Utility Man (Non-Trade Tested)	Hr	890		
1.5		Artisan Aid	Hr	500		
1.6		General Worker	Hr	990		
2	GM 2.8.3	TRAVELLING : Travelling cost will be as per the rates for reimbursable expenses published monthly by the National Department of Public Works at the time of rendering the service/repair.				
2.1		Vehicle Travelling Estimate	Km	110 000		
3	GM 2.8.3	ACCOMMODATION AND SUBSISTENCE : Daily Rates per person that the Contractor will claim for approved trips lasting more than one day at a time.				
3.1		Accommodation	Per/night	60		
3.2		Subsistence	Per/day	60		
4	GM 2.5, GM 2.8.1 & GM 2.10.3	PROVISION TO COVER REPAIRS DURING THE TERM OF THE CONTRACT : Lump Sum Provision to cover repairs and breakdowns during the course of the Contract in addition to the agreed routine servicing of the Assets.	PSum	1	R 4 000 000,00	R 4 000 000,00
5	GM 2.8.1 & Clause 11.2(8)	DIRECT FEE PERCENTAGE (MARK-UP) ON MATERIALS AND SERVICES THAT IS NOT INCLUDED IN PRICE LISTS : Mark-up on proven cost for materials and/or Outsourced Services based on the Provisional sum listed in Item 4. above. (Apply % to provisional sum in Item 4 above when pricing the tender)	%			
TOTAL CARRIED FORWARD TO SUMMARY						

ECDOH GENERAL MECHANICAL AND ELECTRICAL REPAIR CONTRACT

CONTRACT REF. NO: SCMU3-23/24-0491-HO

Cluster/District: Cluster Three - Buffalo City & Mathole Districts

ASSET TYPE: STANDBY GENERATORS

SCHEDULE 5 : ROAMING GENERATORS AND GENERATOR HIRE

ITEM Nr.	PAYMENT REFERS	DESCRIPTION	UNIT	QTY	RATE	AMOUNT
1		ROAMING GENERATORS: Rates that the Contractor will charge for handling of ECDoH Roaming generators as additional adhoc work that is not contained in Schedules 1 to 3.				
		100kVA Generator				
1.1.1		Collection of generator unit from ECDoH Stores/Facilities	No	36		
1.1.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
1.1.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
1.1.4		100litre fuel per delivery	No	36		
1.1.5		Crane Truck for collection and delivery of generator unit	km	5000		
		200kVA Generator				
1.2.1		Collection of generator unit from ECDoH Stores/Facilities	No	36		
1.2.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
1.2.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
1.2.4		100litre fuel per delivery	No	36		
1.2.5		Crane Truck for collection and delivery of generator unit	km	5000		
		300kVA Generator				
1.3.1		Collection of generator unit from ECDoH Stores/Facilities	No	36		
1.3.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
1.3.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
1.3.4		100litre fuel per delivery	No	36		
1.3.5		Crane Truck for collection and delivery of generator unit	km	5000		
2		HIRED GENERATORS: Rates that the Contractor will charge for Hired generators as additional adhoc work that is not contained in Schedules 1 to 3.				
		100kVA Generator				
2.1.1		Daily rate for generator hire	Days	365		
2.1.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
2.1.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
2.1.4		100litre fuel per delivery	No	36		
2.1.5		Crane Truck for collection and delivery of generator unit	km	5000		
		200kVA Generator				
2.2.1		Daily rate for generator hire	Days	365		
2.2.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
2.2.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
2.2.4		100litre fuel per delivery	No	36		
2.2.5		Crane Truck for collection and delivery of generator unit	km	5000		
		300kVA Generator				
2.3.1		Daily rate for generator hire	Days	365		
2.3.2		Delivery and Off-loading of generator unit to ECDoH facility including rigging into position	No	36		
2.3.3		Electrical connection & disconnection of generator unit at allocated facility	No	36		
2.3.4		100litre fuel per delivery	No	36		
2.3.5		Crane Truck for collection and delivery of generator unit	km	5000		
TOTAL CARRIED FORWARD TO SUMMARY						

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

DECLARATION (In respect of completeness of Tender)

Department of Health
 Eastern Cape Department of Health
 Global Life Centre
 c/o R63 and Phalo Avenue
 Bhisho

I/We, the undersigned, do hereby declare that these are the properly priced Schedules of Quantities forming Part C2.2 of this Contract Document which contains 28 pages numbered 1 to 28 and in consecutive order in Volume 2 and the number of pages in consecutive order in Volume 2A as stated on page 1 thereof, upon which my/our tender for **TENDER NO. SCMU3-23/24-0491-HO: SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES**

has been based.

SIGNED ON BEHALF OF TENDERER:

DATE:

PART C3: SCOPE OF WORKS

C3.1: SCOPE OF WORKS

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

This specification is for the repair, maintenance and proper functioning of Standby Generator installations, for the duration of the Contract period, in the following Health facilities:

BUFFALO CITY DISTRICT

Item no.	FACILITY	No.of Units
1	BHISHO FORENSIC LABORATORY	1
2	BHISHO HOSPITAL	2
3	CECILIA MAKHIWANE HOSPITAL	5
4	DIMBAZA HOSPITAL	1
5	DUNCAN VILLAGE CHC	1
6	EMPILWENI GOMPO CHC	1
8	EMS VINCENT	1
11	FRERE HOSPITAL	8
12	GREY HOSPITAL	1
13	MDANTSANE FORENSIC MORTUARY	1
15	MOUNT COKE CHC	1
16	NEW HAVEN	1

AMATHOLE DISTRICT

Item no.	FACILITY	No.of Units
1	ADELAIDE HOSPITAL	1
2	BEDFORD HOSPITAL	1
3	BUTTERWORTH HOSPITAL	4
4	CATHCART HOSPITAL	1
5	IDUTYWA CHC	1
7	XHORA CHC	1
8	FORT BEAUFORT HOSPITAL	1
9	KOMGA HOSPITAL	1
10	MADWALENI HOSPITAL	3
11	MIDDLEDRIFT CHC	1
12	NOMPUMELELO HOSPITAL	2
Item no.	FACILITY	No.of Units
13	NQAMAKWE CHC	1
14	S.S GIDA HOSPITAL	2

15	STUTTERRHEIM HOSPITAL	2
16	TAFALOFFE HOSPITAL	1
17	TOWER HOSPITAL	3
18	VICTORIA HOSPITAL	3
19	WILLOWVALE CHC	2
20	WINTERBURG TB HOSPITAL	1
21	ADELAIDE MORTUARY	0
22	BUTTERWORTH MORTUARY	1
23	CENTANI MORTUARY	0

Details of the work required shall be as listed in the Price Lists which have been sub-divided into the following categories:

SCHEDULE 1: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

SCHEDULE 2: FUNCTIONAL REPAIR SCHEDULE

SCHEDULE 3: MAINTENANCE SERVICE SCHEDULE

SCHEDULE 4: TERM REPAIRS SUBJECT TO APPROVAL OF QUOTATION FOR THE WORKS

SCHEDULE 5: ROAMING GENERATOR AND HIRE GENERATOR

**ASSET REGISTER
BUFFALO CITY DISTRICT**

ITEM Nr.	FACILITY	LOCATION	ENGINE MAKE	ENGINE MODEL	ALTERNATOR MAKE	ALTERNATOR TYPE	ALTERNATOR SIZE	CONTROLLER TYPE
1	BHISHO FORENSIC LABORATORY	MORTUARY	DEUTZ	F3M 2011	WEG	N/A	12 KVA	LOVATO RGAM 20
2	BHISHO HOSPITAL	STORES	PERKINS	2006 TT AG	STAMPFORD	HC 444F2	375 KVA	LOVATO RGK 66
		THEATRE	VOLVO PENTA	VP 145 688	STAMPFORD	HC 444F2	375 KVA	DEEP SEA 7320
3	CECILIA MAKHIWANE HOSPITAL	2B GENERATOR 1	MTU	12V 2000	MARELLI	MJB 355 MB4	800 KVA	DEEP SEA 5510
		2B GENERATOR 2	MTU	12V 2000	MARELLI	MJB 355 MB4	800 KVA	DEEP SEA 5510
		MAIN SUB GENERATOR 1	PERKINS	4012-46 TWG 2A	LEROY SOME	LSC 74M	1250KVA	DEEP SEA 8610
		MAIN SUB GENERATOR 2	PERKINS	DGKM 600S U21008V	LEROY SOME	LSC 74M	1250KVA	DEEP SEA 8610
		THEATRE	VOLVO PENTA	VP 145 688	N/A	N/A	N/A	DEEP SEA 7320
4	DIMBAZA HOSPITAL	GENERATOR	PERKINS	2320/1500	FG WILSON	FG Wilson	88 KVA	LOVATO RGK 700
5	DUNCAN VILLAGE CHC	GENERATOR	VOLVO PENTA	TDA531 GE	MARELLI	MARELLI	105KVA	DEEP SEA 7320
6	EMPILWENI GOMPO CHC	GENERATOR	PERKINS	1506/1500	N/A	N/A	N/A	LOVATO RGK 60
7	EMS VINCENT	GENERATOR	JOHN DEERE	4045STF 158	MAGNA PLUS	361 CSL 1601	57 KVA	DEEP SEA 7320
8	FRERE HOSPITAL	B.BLOCK GENERATOR	DEUTZ	BF6M1013 FC	ENGGA ALTERNATORS	EG280M-160N	200 KVA	DEEP SEA 7320 MK11
		D. BLOCK GENERATOR	PERKINS	2614/1500	LEROY SOMER	LSC 39L2	160KVA	DEEP SEA 7320
		MARTENITY	DEUTZ	BF6M 1015C	N/A	N/A	300KVA	DEEP SEA 7320
		ONCOLOGY	DEUTZ AG	BF6M1015 FP	MARELLI GENERATORS	MJB 315 MA4	410 KVA	DEEP SEA 7320
		NTB B SIDE	VOLVO PENTA	VP145 689	MARELLI GENERATORS	MJB 315 SA4-B	300KVA	DEEP SEA 8610
		J. BLOCK	DEUTZ AG	BF6M1013 FC	ENGGA GENERATORS	EG 280M-160B	200KVA	DEEP SEA 7320
		BLOCK C SIDE	PERKINS	2506A-E15 TAG2	MARELLI GENERATORS	MJB 3555A4-B	510KVA	DEEP SEA 7320
		LAUNDRY GENERATOR	DEUTZ	BF6M1015 C	N/A	N/A	N/A	DEEP SEA 7320
9	GREY HOSPITAL	GENERATOR VOLVO	VOLVO PENTA	VP 189 678	MARELLI GENERATORS	MJB 3155B4-B	300KVA	DEEP SEA 7320
10	MDANTSANE FORENSIC MORTUARY	GENERATOR	JOHN DEERE	4045 TF 158	MAGNA PLUS	361C5L1601	57KVA	DEEP SEA 7320
11	MOUNT COKE CHC	GENERATOR	PERKINS	2320/1500	FG WILSON	FG Wilson	88 KVA	DEEPSEA 7320
12	NEW HAVEN	GENERATOR	DEUTZ	F5L413FR	BOYD BROWN-LEROY SOMER	MAZC10L9A CT	50KVA	LOVATO RGK 60
13	NONTYATYAMBO CHC	GENERATOR	HUA FA	4105ZD	AC SYNCHRONOUS GENERATOR	TFS-40	50KVA	LOVATO RGK 60

ITEM Nr.	FACILITY	LOCATION	ENGINE MAKE	ENGINE MODEL	ALTERNATOR MAKE	ALTERNATOR TYPE	ALTERNATOR SIZE	CONTROLLER TYPE
14	NKQUBELA TB HOSPITAL	GENERATOR	CUMMINGS	6BTAA59-G2	STAMPFORD	N28341	140KVA	LOVATO RGK 60
15	WOOD BROOK MORTUARY	GENERATOR	JOHN DEERE	4045 TF 158	MAGNA PLUS	36 CSL 1601	57KVA	DEEP SEA 7320
16	FORT GREY TB HOSPITAL	FACILITY DOESN'T EXIST						

AMATHOLE DISTRICT

Item no.	FACILITY	LOCATION	ENGINE MAKE	ENGINE MODEL	ALTERNATOR MAKE	ALTERNATOR TYPE	ALTERNATOR SIZE	CONTROLLER TYPE
1	ADELAIDE HOSPITAL	GENERATOR ROOM	VOLVO PENTA	TAD 733GE	ENGGA	EG280L 250N	313KVA	DEEP SEA 7320
2	BEDFORD HOSPITAL	GENERATOR ROOM	VOLVO PENTA	TAD 733GE	MARELLI	MJB250LA4-B	220KVA	DEEP SEA 7320
3	BUTTERWORTH HOSPITAL	MEDICAL WARD	PERKINS	2696/1500	MARELLI	MJB 250 LA4	220KVA	DEEP SEA 7320
		OPD	PERKINS	2696/1500	MARELLI	MJB250LA4	220KVA	DEEP SEA 7320
		BIG CATAPILLAR	CATAPILLAR	3208	CATAPILLAR	3208	105KVA	LOVATO RGK 60
		SMALL CATAPILLAR	CATAPILLAR	N/A	STAMFORD	C30B	80KVA	DEEP SEA 7320
4	CATHCART HOSPITAL	GENERATOR ROOM	VOLVO PENTA	TAD 734 GE	MARELLI	MJB 250LB4	250KVA	DEEP SEA 7220
5	IDUTYWA CHC	GENERATOR ROOM	DEUTZ	BF6M1013 EC	STAMFORD	UC 1274F1	160KVA	LOVATO RGK 40
6	XHORA CHC	GENERATOR ROOM	JOHN DEERE	CD4045C0 61134	MAGNA PLUS	36IC5L1601	57KVA	DEEP SEA 7320
7	FORT BEAUFORT HOSPITAL	GENERATOR ROOM	DEUTZ	BF6M1013 EC	STAMFORD	UC1274F1	160KVA	LOVATO RGK 60
8	KOMGA HOSPITAL	GENERATOR ROOM	AVE	ADE 236T	N/A	N/A	N/A	LOVATO RGK 60
9	MADWALENI HOSPITAL	GENERATOR VOLVO	VOLVO PENTA	VP 144635	MARELLI	MJB 3155A4-13	300KVA	DEEP SEA 7320
		WATERWORKS	IVECO	548739/F4 HE45FEOA	MECC ALTESPA	ECO 38-25N/4	200KVA	LOVATO RGK 60
		WORKSHOP	CATAPILLAR	3406	N/A	N/A	N/A	LOVATO RGK 60
10	MIDDLEDRIFT CHC	GENERATOR ROOM	VOLVO PENTA	TAD532GE	MARELLI	MJB225L44-B	190KVA	DEEP SEA P704
11	NOMPUMELELO HOSPITAL	CASUALTY (PERKINS)	PERKINS	T338611800	MARELLI	MJB 250LA4	317KVA	DEEP SEA 7326
		VOLVO KITCHEN	VOLVO PENTA	TAD 531GE	MARELLI	MJB 225 MA4	105KVA	DEEP SEA 7320
12	NQAMAKWE CHC	GENERATOR ROOM	FORD	2722E	POWER SEN	CA10800L2	53KVA	LOVATO RGK 60
13	S.S GIDA HOSPITAL	CATAPILLAR	CATAPILLAR	320	CATAPILLAR	SR4	1125KVA	LOVATO RGK 60

Item no.	FACILITY	LOCATION	ENGINE MAKE	ENGINE MODEL	ALTERNATOR MAKE	ALTERNATOR TYPE	ALTERNATOR SIZE	CONTROLLER TYPE
		NEW PERKINS	PERKINS	26911500	MARELLI	MJB 250 LA4	220KVA	DEEP SEA 7320
14	STUTTERHEIM HOSPITAL	NEW VOLVO	VOLVO PENTA	TAD 532 GE	MARELLI	MJB 225 LA4	132KVA	DEEP SEA P704
		PERKINS GENERATOR	PERKINS	179711500	PARTNER ALTERNATORS	442 154	100KVA	LOVATO RGAM
15	TAFALOFFE HOSPITAL	VOLVO	VOLVO PENTA	TAD 734 GE	VOX GEN	VOXGEN 250 / SK 250 LL-4	300KVA	LOVATO RGK 60
16	TOWER HOSPITAL	GENERATOR 2	PERKINS	209611500	MARELLI	MJB 286 MB4	185KVA	DEEP SEA 7320
		BOILER ROOM	DETROIT	1113824	SIEMENS	AT315LB3D	200KVA	LOVATO RGK60
		GENERATOR 1	PERKINS	209611500	MARELLI	MJB 286 MB4	N/A	LOVATO RGK60
17	VICTORIA HOSPITAL	SMALL VOLVO	VOLVO PENTA	TDA531 GE	MARELLI	MARELLI	105KVA	DEEP SEA 7320
		CATAPILLAR	CATAPILLAR	3306	GENERATOR	SR4	N/A	LOVATO RGK 60
		BIG VOLVO	VOLVO PENTA	TAD 531GE	MARELLI	MJB 25MA4 B	410KVA	DEEP SEA 7320
18	WILLOWVALE CHC	NEW VOLVO	VOLVO PENTA	TAD 531GE	MARELLI	MJB 225 LA4	132KVA	DEEP SEA P704
		OLD PERKINS	PERKINS	1506/1500	N/A	N/A	N/A	LOVATO RGK 60
19	WINTERBURG TB HOSPITAL	GENERATOR ROOM	PERKINS	2996/1500	MARELLI	MJB 250 MB4	185KVA	DEEP SEA 7320
20	ADELAIDE MORTUARY	FACILITY DOESN'T EXIST						
21	BUTTERWORTH MORTUARY	FORENSIC	JOHN DEERE	3029DF-128	MAGNAPLUS	283 CSL 1507	30KVA	LOVATO RGK 60
22	CENTANI MORTUARY						Recently discovered	
23	IDUTYWA MORTUARY	GENERATOR	DUETZ	F3M2011	CROMTON GREAVES	AX160095	15KVA	LOVATO RGK 20



PART C3.1a

EASTERN CAPE DEPARTMENT OF HEALTH

STANDARD SPECIFICATION

FOR THE

GENERAL MAINTENANCE AND REPAIRS

OF

STANDBY GENERATORS

AT

VARIOUS HOSPITALS AND HEALTH FACILITIES IN

THE

CLUSTER THREE (3) - CHRIS HANI & JOE GQABI
DISTRICTS

OF THE EASTERN CAPE PROVINCE

CONTENTS

GM 1 GENERAL

GM 2 MAINTENANCE REQUIREMENTS

GM 2.1 CALL CENTRE

GM 2.2 ASSET TYPE LEAD CONSULTING ENGINEER

GM 2.3 CONTRACTOR'S RESPONSIBILITIES

GM 2.4 TASK ORDERS

GM 2.5 FUNCTIONAL CONDITION ASSESSMENT

GM 2.6 FUNCTIONAL CONDITION ASSESSMENT REPORT

GM 2.7 OPERATING AND MAINTENANCE MANUALS

GM 2.8 RATES

GM 2.9 REPAIR WORK

GM 2.10 MAINTENANCE WORK

GM 2.11 SUPPLY OF LABOUR, EQUIPMENT AND MATERIAL

GM 2.12 SITE MAINTENANCE RECORD KEEPING

GM 2.13 SERVICE SHEETS

GM 2.14 VOLTAGE SURGES DUE TO LIGHTING AND OTHER CAUSES

GM 2.15 SHEQ: SAFETY, HEALTH, ENVIRONMENTAL AND QUALITY

GM 2.16 HIV / AIDS AWARENESS

GM 3 MAINTENANCE CONTROL PLAN

GM 3.1 WORK QUALITY

GM 3.2 PRELIMINARY MAINTENANCE CONTROL PLAN

GM 3.3 MAINTENANCE CONTROL PLAN

GM 4 COMMUNICATION

GM 5 PERFORMANCE MEASUREMENT

GM 6 SPECIAL TESTING OF AN INSTALLATION

GM 7 MAXIMUM MAINTENANCE DOWN-TIME

GM 8 MEASUREMENT AND PAYMENT

STANDARD SPECIFICATION FOR THE GENERAL MAINTENANCE AND REPAIRS OF ELECTRICAL AND MECHANICAL INSTALLATIONS**GM 1 GENERAL**

The successful Contractor will be responsible for, and is expected to, maintain all the plant and installations detailed in the Price List and the Inventory of Equipment attached to this Contract.

The intention of this comprehensive maintenance Contract is to assess the current mechanical and/or electrical condition of each asset, repair what is needed, and maintain all equipment included as part of the Contract, in such a manner that, except for normal wear and tear, their condition don't deteriorate during the initial Service Period of 24 (twenty-four) months. This initial Service Period is extendable by up to another 12 (twelve) months to give a total Contractual period of up to 36 (thirty-six) months. Any potential extension will however be subject to the Contractor meeting the applicable quality and performance requirements of this Contract during the first 24 (twenty-four) month period. Instruction to proceed with any work related to this Contract shall be authorized by means of a Task Order from the Service Manager.

As skills transfer are an integral part of this Contract the Employer's Operating and Maintenance staff will be responsible for all operating and daily inspections on the equipment, unless otherwise specified in the relevant asset specific Supplementary Specification and/or Relevant Price List.

The Contractor is required to provide pricing for the following items in the Contract as expanded on in this specification for each asset type and equipment quantity as covered by this Tender:

- Verify the Assets and update the Asset Inventory List that is provided with this Contract;
- Compile a Preliminary Maintenance Control Plan (Annexure I) to determine what routine servicing should take place on each type of equipment covered by the Contract, and at what frequency the services should take place during the Contract Period if this does not correlate to the Price List service frequency proposed by the Service Manager. With reference to the Price List and C3.1b Supplementary Specification requirements, the Contractor must submit an all-inclusive price and quantity of, for each Service Activity required. Service Activities may include Operations, Minor Services, Major Services or Statutory Inspections as detailed in the Supplementary Specification related to this bid as well as the Price List.
- Cost to do a full functionality test and condition assessment of all equipment and installations included in the Contract (after Contract award), and provide a priced key spare part pricelist for this equipment;
- Cost to provide a detailed Functional Condition Assessment Report based on the findings from the functionality test and condition assessment process.

It is to be noted that the aim of the maintenance Contract is NOT to replace random components at the beginning of the Contract in anticipation of a possible breakdown during the Service Period. Only known defects shall be repaired once approved by the Service Manager. It is the Contractor's responsibility to decide if he/she wants to visit each site and familiarize themselves with the actual condition of each installation before submitting a Tender, or to rely on the

information as contained in the Inventory of Equipment that is attached to this Contract.

Maintenance of an installation shall be performed in accordance with the Standby Generators **Service Information** which will include:

1. This Standard Specification for the General Maintenance and Repairs of Electrical and Mechanical Installations,
2. The Technical Specifications that may be applicable,
3. The Supplementary Specification for this Asset Type,
4. The Operating and Maintenance Manuals (where applicable) for this Asset Type,
5. Relevant Inspection Check sheets for this Asset Type,
6. The Maintenance Control Plan per Health Facility,
7. All relevant SANS Standards and Legislation that is referred to in the above listed documents, and
8. All relevant drawings forming part of this Contract.

The main mechanical and electrical sections of a facility with their subsections as set out in the Service Information and in the Price List will each be deemed "an installation". Maintenance, as specified, will be applicable to all these installations.

All Contractors are to undergo an approximately three-hour long Contractor's induction process before being allowed to work at any of the sites. This induction shall cover the General Rules for Contractors on Site, the penalty system applicable to this Contract, as well as the minimum work quality standards for the work to be done on site.

Major equipment replacement, major upgrades and/or redesigned functionality will be handled outside of this Contract via a separate projects program, and are therefore not part of this Contract. The maintenance and repair work phase will run parallel to each other at the same time.

GM 2 MAINTENANCE REQUIREMENTS

- i The Contractor will adhere to the Task Order and when completed, contact the Service Manager for formal approval and signing off, of the Task Order. The Engineering Representative will assist the Service Manager in verifying completed work.
- ii The Contractor is expected to be fully aware of his obligations in so far as this Contract is concerned and he shall attend to the maintenance procedure within the time limits specified for each class of maintenance procedure.
- iii The completed Task Order will be returned to the Service Manager, who will forward it to the Call Centre to log the completed Task Order into the system. When the completed Task Order is logged into the system the job will be closed.
- iv When a maintenance procedure cannot be completed within the specified downtime the Contractor should apply in writing to the Service Manager for an extension of time with reasons for the delay. This application should be submitted as soon as the details of the maintenance procedure and availability of spare parts are known.

- v The Call Centre Manager will submit a weekly response performance report to the Service Manager, who will make a decision on the implementation of penalties which will depend on the nature of each breakdown, as well as valid claims on delays received from the Contractor. The recorded report date and time as well as the recorded completion date and time will be regarded as sufficient and final proof for the proper administration of this aspect of the Contract.

GM 2.2 SERVICE MANAGER

Eastern Cape Department of Health's agent will be appointed as **Service Manager** (Project Manager) to manage and administrate all work and financial aspects related to this particular bid. He/she will be supported on the ground by an Engineering Representative to verify workmanship and compliance of completed activities to Contract requirements. The Service Manager will be responsible for the following:

- i Perform duties as per the NEC3 Term Services Contract Standard Clauses;
- i Ensure that either he/she, or the Facility Specific Site Representative, visit the Facility and compile reports on the status of the Facility infrastructure that forms part of this bid;
- ii Liaise with the Call Centre and check on call outs;
- iii Determine routine maintenance work to be done, and issue Task Orders for routine maintenance and repairs/refurbishment/upgrades (that was accepted by the Employer), to the relevant Contractor;
- iv Consult and co-ordinate with the Program Lead Consulting Engineer as needed on specific maintenance aspects, designs and specifications to be done;
- v Assess the completed work for the assessment period, consider the payment applications lodged by the Contractor during this period, Certify the payment due, and issue a Payment Certificate for the accepted work as per the Standard Contract clauses;
- vi Monitor the logging of regular maintenance work done;
- vii Prepare reports on maintenance and repair work done;
- viii Liaise with the hospital Site Representative regarding all work to be done on this asset type at the facility;
- ix Liaise with management of the facility;
- x Obtain approvals from the Employer where required for

GM 2.3 CONTRACTOR'S RESPONSIBILITIES

The Contractor shall maintain the complete installation as specified in the **Service Information** for the full Contract period subject to the agreed repairs and performance criteria.

Maintenance implies and shall include routine preventative maintenance on a schedule as approved by the Service Manager, corrective maintenance, as well as breakdown maintenance of all components of the specified installation.

The Contractor shall be responsible to perform all tasks as specified in this specification, subject to the requirements of the NEC3 Term Service Contract Standard Clauses. In addition, the Contractor must:

1. Record work done, performance indicators, defects identified and/or corrected, and spares used;
2. Obtain work done sign-off on site as well as from the Engineering Representative;
3. Submit completed Task Orders and invoices to the Service Manager;
4. Attend scheduled project meetings with the Service Manager.

The Contractor shall, as part of his maintenance responsibilities repair or replace faulty equipment upon logging of a breakdown, within the down-time as defined in Paragraph GM 7, and against the Tendered rates as provided for in the Price List, and within the down-time as specified in the applicable Task Order. In the event of any repair item for which a rate is not available in the Price List, the rate as specified in the Task Order will apply.

GM 2.4 TASK ORDERS

All works required to be done by the Contractor will be instructed by issuing of a **Task Order** by the **Service Manager**. No Works shall be conducted without a Task Order.

The Call Centre may issue breakdown and defects correction/repair Task Orders to the Contractor at any time during the Service Period, but they must all be copied to the Service Manager. The time for the completion of the Breakdown Task Order will be as per the allowable response times in Table 1 in Section GM 7.

If the exact nature and possible cost of rectifying a breakdown is not known when the Breakdown Task Order is issued to the Contractor, the task order will be issued with provisional information and costs estimates. The Contractor shall respond to such a Breakdown Task Order by traveling to the site to evaluate the breakdown (scope of repair work), estimate the realistic cost as well as downtime and provide feedback to the Service Manager to form the basis of the revised Task Order.

Should the Contractor not be able to complete the Breakdown Task Order within the agreed and approved time for completion, it shall be the Contractor's responsibility to obtain an extension of time from the Call Centre Manager. The written report shall clearly state the reasons for requiring the extension, as well as the actual extension period required.

Should the actual time for completion of the Breakdown Task Order exceed the agreed time allowed, including any extension of time, the Contractor shall be liable for damages at the rate stated in the Task Order.

The Service Manager will issue Task Orders for the routine maintenance services, and approved repair/upgrade work once the Maintenance Control Plan has been approved and updated with the relevant information from the Repair Schedule as per GM 3.


Routine maintenance, approved repairs and breakdown repairs will all be done parallel to each other on the equipment as per the Maintenance Control Plan and Call Centre priorities.

GM 2.5 FUNCTIONAL CONDITION ASSESSMENT

Immediately after handing over of the site, and having attended the Contractor's Induction Training Session, the Contractor shall start with a **detailed functional test and condition assessment process** of the specified installation/equipment at each Health Facility and **submit a detailed report** to the Service Manager regarding the functionality, performance and condition of the equipment. It is this Contract's intention that this task be completed within **two weeks** of each site handover to the Contractor, but the Service Manager will arrange and agree specific deliverable dates for each Health Facility with the Contractor in this regard as part of the Contractor's Maintenance Control Plan.

The following work shall be carried out during the time allowed for the execution of the Functional Condition Assessment:

- i **Verify the Asset Data** from the Asset Inventory List in C4.1, obtain the additional asset information that might be required for a specific piece of equipment, and update the Inventory of Mechanical and Electrical Equipment for each Health Facility with make and model numbers, capacities and general condition, year of manufacture (age), additional equipment to be added to the list, and equipment to be deleted from the list (i.e. equipment not on site anymore), etc., as per the fields provided in the format provided by the Service Manager after Contract award.
- ii **Prepare a clear A4 size line drawing** of the building/ward/room in which the plant is installed, typically as per one of the two examples below, and show positions of the equipment schematically on this drawing. Please provide basic information regarding the general condition of the room/facility/building where the asset is located (this will assist to provide information to the facility repair teams), next to, or below the line drawing;

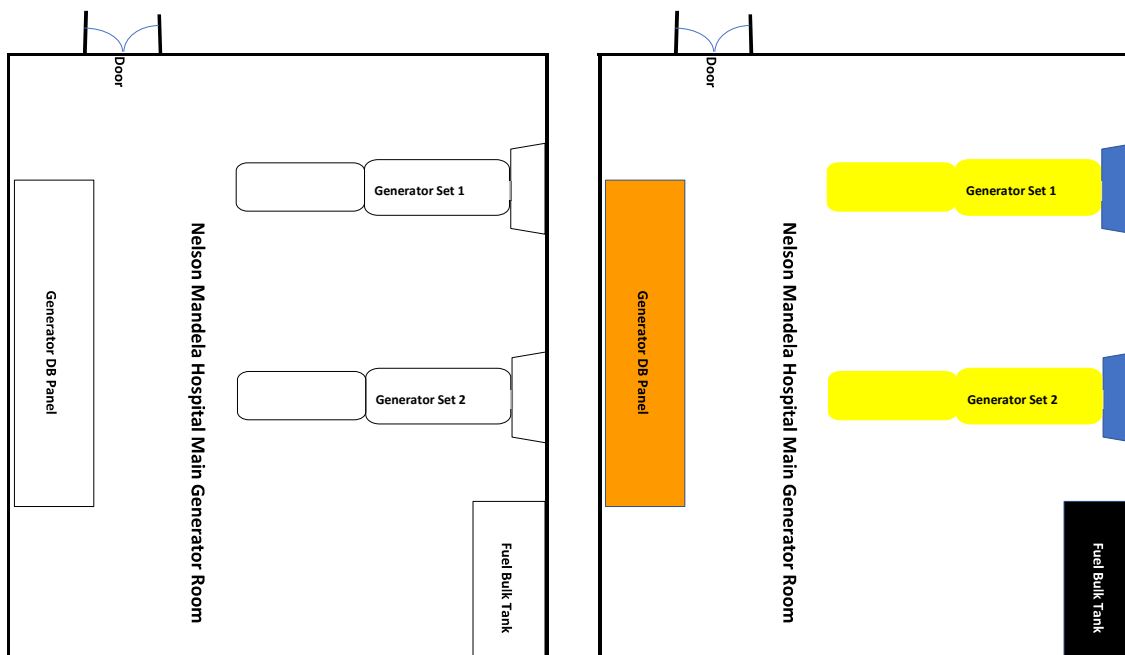

One line drawing per location per Health Facility must be provided and can be hand drawn, provided that the drawing is clear, neat and all info is readable. Where applicable the position of the equipment on the walls must be shown (i.e. Split Air Conditioner Units).

- i Record the number/name of each piece of equipment on the line drawing. If no name/number exists on the equipment itself, allocate a descriptive number (i.e. Fire Pump 1) and mark this on the equipment with a black permanent marker pen. Reference shall be made to this ID number in the defects listed in the Repair Schedules for each item of equipment to identify the equipment accurately.
- ii **Verify what spare parts (if any) are available** on site for the equipment covered by the Contract, as well as the condition there-off;
- iii **Compile a Priced Spare Part List**, (based on the Contractor's cost price for the spares) for the relevant spare parts required for a repair of all the types of equipment listed in the Asset Inventory, and indicate on this list what spares should be kept in stock on site for use by the site maintenance staff. The Employer however retains the right to negotiate the offered spare part prices with like type spares prices solicited through the Tender process, if they are not in line with national price norms.
- iv **Inspect the condition and test the functionality** of all components of the installation to confirm the extent of the repair work required (if any). If the equipment is not in an operable state record this and proceed with item 7 below;
- v **Verify if the equipment meets current standard technical specifications** for the specific application (**for example: a split system air conditioner may be functionally good and serviceable, but does not meet the criteria to operate inside an operating theatre or infection control area**). Advise on an alternative if applicable. Please consult the Facility Manager when doing the

assessment to get information regarding any issues that they are experiencing with the equipment.

- vi **Verify the estimated remaining service life** for the equipment based on the equipment's age and current condition. If the equipment is old and in a bad state it might be more cost effective to replace the unit rather than rebuilding it. Please advise in this regard;
- vii Should it be impossible to determine the details of the defect without dismantling the machine/equipment item, the Contractor shall nevertheless prepare an estimate with a cost breakdown for repairs he/she anticipates will be needed. After a written instruction has been received to repair the machine/equipment item, the final cost will be determined after the machine/equipment item has been dismantled for repairs. **Equipment shall not be dismantled for inspections during the equipment functional condition assessment period.**
- viii **Compile a detailed Repair Schedule for each separate equipment unit (machine).** This Repair Schedule will consist out of a clear identification of the equipment unit, a detailed description of what is wrong with the equipment unit, a detailed repair or replacement method statement (and explanation on why it is recommended that the unit be replaced if applicable), and an accurate detailed quote, with estimated lead times and a high-level project plan to enable the work to proceed if the approval to do so is granted by the Service Manager via a Task Order. (See GM 2.8 for the rates requirements)
- ix The Employer does not guarantee that any, or all, of the repairs/replacements recommended via the repair schedules, will be accepted for implementation by the Contractor. Accepted Repair Schedules will however become part of the Final Maintenance Control Plan once approved by the Employer, and will then be included in the work scheduled for this Contract. Depending on the cost and complexity, equipment replacement recommendations might be transferred to the Repair Project Work Stream of the Employer's Mechanical and Electrical Equipment Repair Programme.
- x **Compare the identified defects of each item of equipment with the components already included under the standard minor and major services scopes** in the Contract Price List, and remove costing for these from the repair requirements. Include all identified defects into the Functional Condition Assessment Report, but only price the defects not covered by the standard servicing scope of works. (See GM 3.2 (3) for costing of the standard services)
- xi Where applicable, **obtain copies of Statutory Inspection and Test Reports** from the Health Facility (if available) and attach these to the Defects Inspection Report.
- xii **Submit the detailed Functional Condition Assessment Report** to the Services Manager who shall thereafter demarcate any areas to be repaired and forward this information to the Contractor. Once approval is granted, the Service Manager will instruct the Contractor about the repair work to be done.

GM 2.6 FUNCTIONAL CONDITION ASSESSMENT REPORT

A Functional Condition Assessment Report must be compiled for each Health Facility, and shall contain the following:

1. The updated Asset Inventory List (both hard and electronic copies) completed in the Excel Format provided by the Service Manager after Contract Award;
2. Clear location identifiable layout line drawings of the equipment, with ID numbers and brief room/facility/building condition description as per GM 2.5 (2)
3. A list of spare parts, and their condition, that is currently available on site;
4. A priced spare part list of the typical spare parts that might be needed to do repairs on the equipment if it should breakdown or fail. The Contractor must also indicate on this spare part price list which consumable spare parts (i.e. fan belts, filters, oil, fuses, light globes, etc.) that can be replaced by the site maintenance staff, should be kept in stock at the Health Facility;
5. A summary of the equipment per Health Facility indicating:
 - i Condition;
 - ii If the equipment meets current technical specifications;
 - iii Estimated remaining Service life before replacement will be due; and
 - iv Recommended work to be done (i.e. service only, minor repairs required, major repairs required, replacement or upgrade recommended).
6. A Repair Schedule for each repair that is required. This information will be used to populate the Task Orders for accepted repairs, or feed the Tender document information in case it is moved to the Project Work Stream;
7. A description of the defect for which repair work is not easily identifiable with an estimate of the final cost for repairs. This item will typically apply to breakdowns or defects where the machine or equipment must be de-commissioned and at least partially dismantled before the extent of the work can be fully established;
8. Compile a list of equipment for which a Statutory Inspection and Test is, or will become due during the Contract period. Copies of previous Inspection and Test Certificates to be attached to the report (if available).

Should the Contractor not be able to complete the Functional Condition Assessment Report within the period as specified GM 2.5, it shall be his responsibility to obtain extension of the Functional Condition Assessment period from the Service Manager. The written report shall clearly state the reasons for the extension, as well as the actual extension required. An extension of time shall only be considered by the Service Manager if the Engineering Representative believes the Contractor has carried out the already completed portion of the report with the due diligence and attention to detail.

Should the actual time for the completion of the report exceed the specified time for completion, including any extension granted, the Contractor shall be liable to a payment reduction for the difference between actual and approved completion periods. The value of the payment reduction

for each health facility shall be as specified in Section X18 of the Secondary Options Clauses of the Contract.

After the repair phase work and costs have been accepted, the Contractor shall commence with the known and approved repair work only after site access for repair work has been approved and the Task Order issued. The Contractor shall complete the work within the period allowed for the repair work as specified in the applicable Task Order.

GM 2.7. OPERATING AND MAINTENANCE MANUALS

The Contractor shall, where specified, and as part of the repairs to each installation, compile and submit a comprehensive Operating and Maintenance Manual based on the Original Equipment Manufacturer's requirements. The Contractor shall ensure through training that the operating and maintenance personnel of the Health Facility are conversant with the instructions as presented in the Operating and Maintenance Manual, as per SS 8 and SS 9.

The Operating and Maintenance Manual, as accepted by the Service Manager, shall be used as a basis for preventative maintenance. The Contractor shall perform all preventative and corrective maintenance as described in the Operating and Maintenance Manual. This shall be in accordance with the Standard and Supplementary Specifications.

The Operating and Maintenance manuals must be based on the updated Inventory of Equipment (C4.1) data after completion of the Functional Condition Assessment, and shall be updated with respect to Make, Model Number, Capacity and any other relevant data.

The Contractor must provide three (3) sets of each required Operating and Maintenance Manual as follows:

- i One set to be installed at a suitable position on a short chain, against a wall in the room/area where the equipment is located, or as otherwise instructed by the Service Manager for outside and spread out equipment;
- ii Two sets to the Services Manager.

The Operating and Maintenance Manuals must be delivered as soon as possible after the Functional Condition Assessment Report has been completed. Also see Section GM 3.3 (15).

Where several of the same equipment is in the same room/area, only one set of three Operating and Maintenance Manuals is required. If the same equipment is spread out throughout the health facility the Contractor must install one Operating and Maintenance Manual near each one, or group of the equipment unless otherwise instructed by the Service Manager. This does not apply to equipment like split air conditioners, etc. for which only one set of three Operating and Maintenance Manuals per make and model will be required. The Service manager will instruct the Contractor where to install the chained Operating and Maintenance Manual for equipment like air conditioners.

The Contractor will be required to install several Document Consoles (storage and writing platform units) with sleeve anchors or bolts, into the walls at different locations of each Health Facility, to secure and store the chained manuals and maintenance logs. A Provisional sum will be included for this in the Price List.

GM 2.8. RATES

Scheduled work is all planned routine servicing of the equipment at the all-inclusive Contracted Rates contained in Schedule 3 of the Contract. Unscheduled work is all repairs, breakdowns, special maintenance activities, special tests and/or replacement tasks, that is ordered via a Task Order by the Service Manager, in addition to the scheduled work. Payment for this work will be based on the Contracted Rates from Schedule 4.

Where no rates exist in the Contract, the itemized breakdown shall be accompanied by documentary proof from the Supplier, Manufacturer, Engineering Works, etc., where materials were bought or services out-sourced from. The Employer however retains the right to verify and test these rates against the market.

The Contractor shall submit quotes for all Unscheduled work with an itemized breakdown of the total cost involved for acceptance by the Service Manager, in a quotation as detailed below:

GM 2.8.1 MATERIALS AND OUTSOURCED SERVICES

Unscheduled:	List all items with quantities and rates as per quotations or price lists obtained from suppliers or service providers (proven reasonable cost), and attach a copy of the quotation/price list to the quotation. Apply the Direct Fee Percentage (Mark-up %) to all proven reasonable material costs and outsourced services.
Direct Fee % (Mark-up %):	Mark up percentage on proven cost to cover P's & G's, overheads, profit, etc. as per Schedule 4 based on NEC3 TSC Contract Data.
Scheduled:	All materials required for Scheduled Servicing are included into the pricing for the Service as per Schedule 3.

GM 2.8.2 LABOUR

Unscheduled:	List time required for travelling to and back from site (subject to conditions contained in GM 2.8.3 below), actual repair and/or replacement, testing and commissioning time of all unscheduled items at the applicable labour rates as stated in Schedule 4. No Direct Fee % will be applicable to Contracted labour rates.
Scheduled:	Cost is included in Service costs as per Schedule 3.

GM 2.8.3 TRANSPORT AND ACCOMMODATION

Unscheduled:

Traveling and Accommodation claims will be subject to the condition contained in GM 2.8.4 below. Travelling cost will be as per the rates for reimbursable expenses published monthly by the National Department of Public Works applicable at the time of rendering the service/repair. Allow for the actual distance travelled (and specify the reason for the traveling). All travel time and disbursements need to be supported by a Google Maps route planner printout for proof of travelling distance and time. Kilometre claims can be claimed from point of departure to destination and back, but must be linked to the indicated kilometres as per the Google Map attached and referenced to. The Contractor must submit proof of registration to verify the engine cubic capacity of the vehicle, in respect of any vehicle to be claimed for. Allow for the actual accommodation and disbursements (and specify the reason for the accommodation requirement) at the rates as per Schedule 4. **Trips must be combined with Scheduled Servicing trips where possible, to minimize additional expenditure. Trips will be in accordance with the approved Maintenance Control Plan.**

GM 2.8.4 The Employer requires that the Contractor be based in a location inside the Cluster or District Area that the Contract is awarded for. The home base (departure point) must therefore be located inside the Cluster Area. If the Contractor does not have a home base in the Cluster Area, the traveling rates (for both distance and labour) will be calculated based on a location inside the Cluster which will typically be the largest Town or City located inside the Cluster or District, as may be applicable as instructed by the Service Manager.

GM 2.8.5 PROVISIONAL SUMS

It is the Employer's sole discretion to decide on spending any, all or none of the Provisional Amounts listed in the different Price List Schedules of this Contract.

GM 2.9 REPAIR WORK

GM 2.9.1 Definitions

1. Defect

For this maintenance Contract, a defect shall mean a deficiency in any component of an installation which impairs the functionality of that component or equipment. Worn parts of a component which do not impair the functionality and/or performance of the component will not be regarded as a defect.

Defects may be classified in the following three groups:

(i) Type A defect

Those deficiencies which can be rectified by proper maintenance only, i.e. set parameters of a control system, proper lubrication, balancing, alignment, set pressures on safety valves, cleaning and de-staining, etc.

(ii) Type B defect

Those deficiencies which can only be rectified by replacing parts of, or the complete component as in the case of a breakdown or where a certain amount of upgrading is necessary such as the provision of anti-vibration mountings, removal of rust and re-painting, etc.

(iii) Type C defect

Those deficiencies which are visible but which do not impair on the functionality of the installation or system yet, such as structural cracks in parts of a component, rust, bad workmanship during a previous Contract, etc.

Components in which abnormal noise and/or vibration is present shall be serviced in accordance with the Manufacturer's recommendations and if the noise and/or vibration persists, the deficiency will be classified as a defect.

2. Repairs

Repairs of an installation shall mean the elimination of the deficiencies classified as types B and C defects in Paragraph (1.) above.

The specific repair phase commences as indicated on the Task Order issued by the Service Manager for each approved repair. The repairs must be completed within the period as determined by the Task Completion Date as stated in the Task Order. Delay damages for late completion will be applicable as indicated on the Task Order.

Depending on the nature of the work and availability of funds access may be given at any time during the Service Period and not necessarily directly after site hand-over.

A representative of the user department or person in charge of the plant, system or building shall endorse the schedule after completion of the maintenance or servicing procedure to the effect that the maintenance or service is, to his opinion, completed satisfactorily and shall countersign the service schedule. Where necessary the Site Representative will inspect the work done and report his findings to the Service Manager.

GM 2.9.2 Scope of Repair Work

The repair work shall be completed within the time allowed for repairs for each installation as defined in the applicable Task Order. If the work is to be carried over two or more financial year's the work will be segmented and prioritized according to the Final Maintenance Plan. The Contractor will be informed of the work to be completed within each financial year. **The starting date for repair work for the current financial year will be the date of acceptance of the measured Price List from the Functional Condition Assessment Report.** The starting dates for subsequent years will be on 1 April of that particular year.

All repair work shall be executed using resources (labour, equipment materials and spare parts) that comply with the requirements of GM 2.11.

The said repair work shall be executed in accordance with the relevant codes of practice, standards, regulations, municipal laws and by-laws, manufacturers' specifications and codes of practice included in this specification.

GM 2.10 MAINTENANCE WORK

Maintenance work commences with the acceptance of the Tender bid and expires at the end of the Service Period. As compensation, the Contractor is paid the **remeasured** Contracted quantities, distributed in agreed intervals and amounts over the Service Period as per the Final Maintenance Control Plan, at the rate Contracted for the applicable maintenance work, subject to the requirements of GM 8.

GM 2.10.1 ROUTINE PREVENTATIVE MAINTENANCE

This entails the rendering of services and servicing of equipment according to a predetermined Maintenance Control Plan to:

- i Repair, lubricate, clean and service components of equipment, units or parts thereof for each installation at pre-scheduled intervals regardless of condition;
- ii Re-adjust, reset, clean, balance, corrosion protect all components of equipment, units or parts thereof for each installation, and
- iii Carry out all necessary and implied actions to maintain installations in a functional condition (i.e. replace or clean filters, replace or top up fluids, etc.)

Preventative maintenance shall be aimed at prevention or at least minimization of breakdowns.

GM 2.10.2 CORRECTIVE MAINTENANCE

This entails regular observation of the equipment, identifying impending breakdowns, maladjustment or anomalies of equipment, units or parts of installations and subsequent action to restore installations to a fully functional condition before a breakdown occurs.

The Maintenance Procedures for Corrective Maintenance shall be compiled by the Contractor and is included in the Maintenance Control Plan for each system or plant. Inspection items shall include, inter alia, the following:

Checking for:

- i Unusual noise and vibration;
- ii Abnormal surface temperature of machines such as electric motors;
- iii High temperatures of equipment and wiring inside switchboards;
- iv Incorrect settings or operation of safety devices;
- v Alarm conditions of any instrument or control panel;
- vi Gas or fluid leaks from the equipment or associated piping systems.

The frequency of corrective maintenance shall be determined by the Contractor himself in line with the recommendations from the Operating and Maintenance Manuals, and actual operational environment where the equipment is operating. This may vary from once every day for high-risk, sensitive installations to once a month for low-risk installations such as exhaust fans and office air conditioners. The frequency of corrective maintenance must be accepted by the Service Manager in the Maintenance Control Plan.

GM 2.10.3 BREAKDOWN MAINTENANCE

This entails repair and/or replacement of defective equipment, units or parts of installations following a breakdown that leaves the installation inoperable or unsafe, and subsequent action to restore the installation to their normal functional condition, within the maximum down-time allowed.

Breakdown repairs will be controlled via the Call Centre and approved Breakdown Repair Task Order process as per GM 2.1. A provisional amount will be included in the Contract Price List Schedules to cover Break Down Task Order expenditure.

GM 2.10.4 COMMENCEMENT OF SERVICE PERIOD

The Contractor shall accept full maintenance responsibilities for each installation from the date on which the site has been handed over to the Contractor. **An annual maintenance service shall be carried out on all installations during the period in which the Defects Inspection Report is compiled, or as soon as possible thereafter.** If the current statutory compliance of a qualifying asset cannot be verified with the correct documentation of proof, a statutory inspection must be performed immediately after the first annual service has been completed.

For equipment or installations where the complete installation is shut down for the repair phase, no maintenance services will be required during the repair period.

GM 2.11 SUPPLY OF LABOUR, EQUIPMENT AND MATERIAL

1. Labour

Only competent, qualified personnel shall be allowed to execute all maintenance work.

2. Equipment

All tools, equipment and consumables required for performing maintenance work shall be supplied by the Contractor at his own cost (except where otherwise agreed to in writing and provided by the Employer). The Contractor may use already installed Employer equipment such as crawl beams and crawls, etc. provided that they obtain written approval from the site Maintenance/Technical Manager to do so. Such site approval will be based on the serviceability of the equipment, and upon confirmation of the Contractor's competency compliance in being able to use and operate this equipment during maintenance.

3. Materials and Parts

All materials, spare parts, components, equipment and appurtenances necessary for the complete maintenance of each installation shall be supplied and installed by the Contractor **at the rates and quantities as instructed by the Service Manager**, after the Functional Condition Assessment Report as specified in GM 2.5 has been accepted.

Only original parts as specified by the Original Equipment Manufacturer may be used for replacement purposes. Generic or alternative parts will only be allowed if they comply fully with all the specifications of the original parts, but may only be used upon written acceptance by the Service Manager.

Substitute electronic components will be acceptable, **PROVIDED** that they are equal to, and

of the same quality as, or superior to, the original components and are accepted, in writing, by the Service Manager.

All parts, spares and materials which are used, shall conform to the applicable SANS Specifications and shall, where possible, carry the SANS mark of approval.

Substitute parts, as well as the serial numbers (where available) of the original and new components, shall be entered on the service sheets and in the maintenance/repair log-book.

The Contractor shall obtain, and cede any supplier's or factory guarantee of repaired or replaced components to the Employer. All workmanship, new equipment, materials, components, systems, etc. used for servicing and repairs shall be guaranteed for 12 months unless otherwise agreed to in writing with the Service Manager. The guarantee cards for repaired or replaced components or equipment shall also be attached to service sheets and the maintenance/repair log-book. New equipment and system installations will in addition to the above requirements also have a twelve (12) month defects liability period, valid from the date of successful commissioning and hand over to the Employer as acceptance by the Service Manager.

All scrapped and/or removed parts and equipment that might be installed elsewhere, or that will not be returned to service again, must remain on site after removal or disassembly of the equipment as they remain the property of the Employer. The Maintenance/Technical Manager of the facility will indicate to the Contractor where to place these items after removal. Removal of any parts and/or equipment for whatever reason from site, may only occur with the written approval to do so by the Maintenance/Technical Manager subject to the rules and regulations that the Employer has in this regard.

GM 2.12 SITE MAINTENANCE RECORD KEEPING

The Contractor shall provide and maintain hard-cover A4 size maintenance files for each installation for the duration of the Service Period. Copies of all schedules, checklists, breakdown reports, preventative maintenance records, component replacement records, service sheets, etc. shall be filed in these.

An A4 size register book shall be kept for all work performed on the equipment, to state the service technician's name, surname, date of work performed, and a short description of the work performed. This book must be installed on a short chain next to the relevant Operating and Maintenance Manual as per GM 2.7.

Copies of the site maintenance records and all service sheets, shall be submitted to the Service Manager at each monthly meeting, while copies of the service sheets must also accompany all claims and invoices.

Statutory Logbooks must be supplied and maintained on site for all statutory equipment such as pressure vessels, boilers and lifts.

GM 2.13 SERVICE SHEETS

Every service, repair, test, inspection, etc. related to the maintenance portion of the Contract, shall be fully described on a service sheet which must be completed and signed by the Contractor and attached to the Task Order when it is returned to the Service Manager. The following minimum information shall appear on service sheets:

- i The company name and address;

- ii A unique work sheet serial number;
- iii The corresponding Task Order unique number;
- iv The district and health facility names;
- v The building/area name or alternatively the building/area code;
- vi The plant identity code and description;
- vii The nature of the call, i.e. P1, P2, P3 or P4 (see GM 7);
- viii A general description of the problem or purpose of the work to be done, alternatively the complaint as received by the Call Centre;
- ix A statement as to whether the individual system is operational or not in terms of the specification;
- x Should the system not be operational (in case of a breakdown) the response time and repair time shall be recorded individually and details of a preliminary service sheet shall be forwarded to the Call Centre Manager;
- xi The description of the repairs/replacements carried out on each machine/equipment item on that specific system;
- xii A list of materials used for each machine/component. Where scheduled items are used, only the description can be listed. For non-scheduled items, a copy of the quotation must be attached to the service sheet;
- xiii A detailed report on the extent of the work done together with the total cost involved;
- xiv Suggestions to avoid similar future problems;
- xv A list of the Contractor's personnel responsible for the work with the date, starting time, completion time, distance travelled, and any accommodation and S&T costs;
- xvi Signature and name of the responsible Employer site technician/artisan/engineer and the Site Representative, confirming the work was completed to the required quality and performance standards, and that the equipment is operational again;
- xvii Signature and telephone number of the User of the equipment or the person who initiated a call or Task Order (if it was a defect, or breakdown).

Service sheets shall also be used for normal routine maintenance services and other non-maintenance activities such as training of the health facility's operating and maintenance personnel and administration duties of heads of firms when managing the Contract.

The Service sheets shall be completed in three categories as follows:

1. **For repairs on machines:** The same data as above must be captured with one service sheet to be completed for each repair (See below for grouping of like type equipment for servicing).
2. **For normal maintenance on an installation:** The same data as above must be captured with one service sheet to be completed for each service (See below for grouping of like type equipment for servicing).
3. **For Administration and Training:** In this case only the name of the Head of the Company is required on the service sheet with no other reference to Building- or Plant codes or machine ID numbers. A full description of the service provided must be included.

Copies of the completed Service Sheet and Task Orders must be attached to all invoices and shall be submitted to the Service Manager for discussions and acceptance.

An example of the Service Sheet is attached to the Contract Documentation as C7.

The standard requirement for normal services carried out on a specific plant is to complete one service sheet for all the equipment within any one building. This standard requirement applies to installations where all such machines can be serviced within a period of approximately five working days, but all equipment serviced must be listed on the service sheet.

For larger installations where the time required for a maintenance service is more than five working days, the machines may be grouped together to form several groups within the building with the provision that each group can be serviced within a period of approximately five working days. One service sheet shall be completed for each group in a building, but all equipment included in the group must be listed on the service sheet.

For smaller installations where the complete installation inside a building can be serviced in less than one working day, the installations in more than one building may be grouped together, but all the equipment covered by the service sheet must be listed.

The definition of the groups must be determined by the Contractor and clearly specified in the Maintenance Control Plan for acceptance by the Service Manager.

GM 2.14 VOLTAGE SURGES DUE TO LIGHTING AND OTHER CAUSES

The area in which most of the sites are situated is known for heavy lightning storms. Damage caused by voltage surges due to lightning, phase imbalance, low and high voltages, power failures, etc. will be dealt with in the same manner as any other breakdown. Contractors are advised to investigate available surge protection systems, if any, on each plant during the Functional Condition Assessment stage, and to decide for themselves whether additional protection will be required or not.

The provision of additional surge protection systems shall form part of the repair activities, if accepted by the Service Manager, and the cost thereof must be allowed for in the Functional Condition Assessment Report.

Contractors may as an alternative provide and install one or more Universal Disturbance

Analysers to record any voltage surges at their own cost. Breakdowns caused by voltage surges which can be proved beyond any doubt will be dealt with in the same manner as operational damage and other normal breakdowns.

GM 2.15 SHEQ: SAFETY, HEALTH, ENVIRONMENTAL AND QUALITY

The Contractor must comply with all the Safety, Health, Environmental and Quality requirements as per C3.2 and GM 3.1, and must provide pricing to cover all the applicable requirements under this specification. The Contractor must take note of any specific Safety, Health and/or Environmental risks that might be highlighted in section SS 13.

GM 2.16 HIV / AIDS AWARENESS

The Contractor must comply with all the requirements as per C3.3, and must provide pricing to cover all the applicable requirements under this specification.

GM 3 MAINTENANCE CONTROL PLAN

The Contractor is responsible to compile a detailed Preliminary Maintenance Control Plan (Annexure I) as per GM 3.2 which he need to submit with his Tender Bid. This plan must contain the details of what maintenance will be done (itemized), how often, what resources will be involved, what spares and consumables will be used, how long it will take to perform the work, and the cost breakdown per service for a specific Asset Type. The Service Manager gave service interval recommendations in Schedule 3, but the Contractor can recommend alternative intervals for consideration and approval by the Service Manager.

After Contract Award the Contractor will be required to expand the Preliminary Maintenance Control Plan to a Health Facility specific plan for each asset type with the assistance of the Service Manager.

GM 3.1 WORK QUALITY

Maintenance quality control shall be the responsibility of the Contractor who shall introduce a Maintenance Control Plan to assist him in ensuring that all preventative, corrective and breakdown maintenance is performed as described in the Service Information. The Contractor will be responsible to correct any sub-standard work that is discovered after the Contractor has done his work. The rework will be for the Contractor's own account and must be signed off by the Site Representative after completion.

If the Contractor fails to remedy any sub-standard work within the time frame stipulated by the Service Manager, the Service Manager may at his/her discretion appoint another Contractor to execute the repair work. In this case, the replacement Contractor will be paid with the funds that were earmarked for the first Contractor to do the work, and the first Contractor will not be paid for that specific work.

GM 3.2 PRELIMINARY MAINTENANCE CONTROL PLAN

A preliminary version of the Maintenance Control Plan, based on the Asset Inventory Data, must be submitted with the Contractor's Tender bid. This plan is a high-level plan on what maintenance tasks the Contractor will be performing on all the equipment across all Health Facilities covered by the Contract and must be completed on the forms of Annexure I. The information from the Preliminary Maintenance Control Plan will be expanded into that of the final Maintenance Control Plan as specified in Section GM 3.3 below. Details contained in this preliminary Maintenance Control Plan shall include:

1. A Maintenance Schedule containing all the different tasks that will be performed on all the equipment covered by this Contract, and captured on the **Preliminary Annual Equipment Maintenance Schedule** Form contained in Annexure I.
2. A brief Capacity Statement where the Contractor describes his company's capacity and experience that will be applicable to this Contract. This must include a description and location of his home base (workshop/home/bakkie based, number of staff with qualifications and experience, what staff and/or Sub-Contractors will be used to support on the Contract, available tools and/or specialized equipment, transport capacity and where staff will be based, as well as capacity/ability to repair defective equipment (i.e. overhauling a pump or compressor);
3. A detailed **Maintenance Task Planning Sheet** (See Annexure I) for each of the Minor, Major, and other, service activities priced in the Price List. This Maintenance Task Planning Sheet will describe the pricing and details of scheduled maintenance activities to be performed during services conducted as per the recommendations of the **Preliminary Annual Equipment Maintenance Schedule**, and will also be used to populate the respective Task Order. These prices must be all inclusive and must include all labour, service parts, lubricants and consumables, special equipment (if required), accommodation (if applicable) and any travelling and subsistence costs, etc. that might be applicable to do the service. The service price must indicate clearly if more than one piece of equipment will be combined for servicing during a single trip to avoid double payment for Travel and Subsistence related payments by the Employer.
4. The service methodology;
5. Preliminary grouping of equipment for maintenance purposes as per GM 2.13 (if applicable);
6. A breakdown of which sub-Contractors will be used (as per T2.2c), and for what activities, by the Contractor in rendering the services required by this Contract **Sub-Contractors must also be registered on the Treasury Central Supplier Database;**

GM 3.3 MAINTENANCE CONTROL PLAN

One Maintenance Control Plan must be compiled for each Health Facility covered by the Contract. The Maintenance Control Plan shall be based on the Contractor's Preliminary Maintenance Control Plan information, and updated with the findings and data from the Functional Condition Assessment process. The Maintenance Control Plan shall be bound in a neat, A4 sized, ring bound document with a cover page and back cover and an original copy

presented to the Service Manager. The contents of the document shall be indexed.

The Maintenance Control Plan will become the main plan for all work to be done under this Contract, as per the Main Contract Clauses, after the Contract has been awarded.

When the documents are compiled, the Contractor may reproduce relevant paragraphs from any of the specifications forming part of the Contract documents, or Operating and Maintenance Manuals, but should there be any discrepancies between such paragraphs and paragraphs in the Maintenance Control Plan and those in the Contract documents, those in the Contract documents shall be regarded as being correct and shall apply.

The Maintenance Control Plan shall also contain the following in addition to the items listed in Section GM 3.2:

1. Detailed Maintenance Schedule per equipment type, per Health Facility on the **Annual Equipment Maintenance Schedule Asset Specific** Form;
2. Remeasured service quantities for the routine services of Schedule 3 in the Price List, based on actual equipment condition and the ability to perform a service on them or not in their current condition. **The Contractual payments will be based on these remeasured quantities, accepted by the Service Manager, and not on the original Tendered quantities which might have been based on incorrect information at the time;**
3. A risk register containing all the foreseen risks that can have an impact on the cost and/or deliverables of this Contract as per the NEC3 Term Service Contract Standard Contract Clauses numbers 11.2(14), 16.1, and 16.4;
4. A summary of the repair and maintenance work to be carried out in terms of the Contract giving details of the conditions of the various installations at the facility affected by the activities under the Contract.
5. Details of how the Contractor intends to carry out the various types of maintenance work especially breakdown maintenance should breakdowns occur.
6. Details of the procedures agreed upon between the Service Manager and the Contractor on how breakdown calls will be handled (Call Centre process).
7. A list of organisations and persons directly involved with the Contract or whose requirements must be considered during the entire Service Period. Each person's position within his organisation as well as the applicable phone numbers shall be given. (See T2.2c)
8. Details of monthly meetings (dates, times and venues) to be held between the Contractor, Employer Representative and Site Representative.

9. Service Sheets and Reports to be submitted after every routine inspection (a copy of all reports, checklists, breakdown records, etc. for each system of an installation shall be kept on the site in a hardcover file);
10. A priced spare parts list for relevant spares that might be required for repairs and/or breakdowns for each equipment type. The Employer retains the right to negotiate the listed prices based on price comparisons with like type spares prices solicited through the Tender process;
11. A recommended spares list for items that should be held in stock at the facility;
12. Copies of the Repair Schedules from the Functional Condition Assessment process that has been approved to proceed;
13. An updated Cost Forecast of the estimated final total of the Prices for the whole of the services in consultation with the Service Manager at intervals as stated in the Contract Data Clause 20.5;
14. Procedures to address complaints and logged breakdowns.
15. Details of reports in electronic format, summarizing all inspections, together with inspection data such as nature of test, names of persons carrying out tests and inspection results. Detail of repairs and replacements, together with testing of repaired equipment shall also be reflected in this report, and shall be obtained from the service sheets.
16. Assistance to be given to the Service Manager and Engineering Representative with decisions regarding material, equipment and other recommendations.
17. An updated list of the inventory of equipment complete with the ID number (if available), make and model number, serial number, year of manufacture/age and capacity.
18. The Maintenance Control Plan shall be upgraded when its contents are no longer representative of actual conditions.
19. The Contractor shall check the contents of existing Operating and Maintenance Manuals (if available) and shall update or modify them and then incorporate applicable data into his own manuals. Where no manuals exist, the Contractor shall draw up his own Operating and Maintenance Manuals based on the OEM Operating and Maintenance manuals as per the requirements of GM 2.7.
20. The way maintenance data as recorded on service sheets will be captured and processed for submission to the Services Manager, for invoicing, and as part of the maintenance report.

Pertinent data contained in the Operating and Maintenance Manuals may be transferred to the Maintenance Control Plan to make it a document which can be used as an independent

handbook for maintenance work in future.

GM4 COMMUNICATION

The Maintenance Control Plan (Paragraph GM 3.3) will provide, after agreement between the Contractor and the Service Manager, with the assistance of the Site Representative, for the following communication procedure to be implemented:

1. The Contractor shall establish a telephone and fax line and a cellular telephone connection to ensure that he can be reached at any time.
2. Should the Service Manager determine or suspect that preventative, corrective or breakdown maintenance is required, a call shall be logged through any communication channel available to reach the Contractor as soon as possible. This will be followed up with a Task Order.
3. Maximum down times will be as described in Paragraph GM 7.
4. All breakdown calls from the Health Facility will be reported to the Call Centre who will follow the procedure as detailed in Section GM 2.1.

GM 5 PERFORMANCE MEASUREMENT

The Contractor's performance shall be measured against the criteria specified in Section X20 of the Secondary Options Clauses of the Contract and C1.2b Annexure CD.

Poor performance by the Contractor will lead to penalties being imposed by the Service Manager as per X17 and C1.2b Annexure CD, and can lead to early termination of the Contract.

GM 6 SPECIAL TESTING OF AN INSTALLATION

An amount has been allowed in the Price List to cover the cost of additional tests that the Service Manager may request at his own discretion from time to time on the equipment and installations covered by this Contract. The Service Manager will have the sole authority to spend the amount or part thereof under sub-paragraph.

The Service Manager reserves the right to select, at random, component equipment and trade practices to be tested by the Contractor or independent authorities for compliance with specifications as specified in this Contract document.

The Contractor shall provide all equipment, tools and instruments required for such testing.

The Service Manager shall upon completion of the tests or inspections issue an inspection report including any corrective actions (if any) to be taken by the Contractor.

The Contracted markup percentage will be paid to the Contractor on the value of each payment made to the approved testing authority if any special testing is ordered by the Service Manager.

GM 7 MAXIMUM MAINTENANCE DOWN-TIME

After a breakdown, defect or complaint has been logged the Contractor will be expected to remedy the defect in the system/component with as little delay as possible, notwithstanding the maximum down-time allowed and listed in the following paragraphs or as stipulated in the Task Order. **Should the Contractor not respond within the maximum down-time, the Service Manager may arrange, at the cost of the Contractor, for the necessary repair work to be done by others.**

The Contractor shall respond to a breakdown registration by traveling to the site to evaluate the breakdown (scope of repair work), estimate the realistic cost as well as downtime and provide feedback to the Service Manager and Site Representative to form the basis of a Task Order.

Should the Contractor not be able to complete the required repair work within the maximum down-time period allowed, it shall be his responsibility to obtain extension of down-time from the Service Manager. The written report shall clearly state the reasons for the extension, as well as the actual extension required.

Extension of down-time will only be granted by the Service Manager if:

1. The maximum down-time is unreasonable in relation to the scope of the repair work required.
2. The delivery time of a new component/subassembly/machine or spares required for the repair of the defective component/subassembly does not enable the Contractor to successfully complete the repair work within the maximum breakdown down-time allowed.

Should the actual down-time exceed the maximum down-time, the Contractor shall be penalized as per X17 and C1.2b Annexure CD.

PRIORITY	DESCRIPTION	RESPONSE
P1	Emergency (Life Threatening)	Immediate response from the time of logging a call and the emergency to be resolved (at least temporarily) within 8 hours
P2	Urgent	Immediate response from the time of logging a call and to be resolved within 12 hours
P3	Planned Maintenance Repairs	Scheduled Maintenance is to be scheduled and performed within 3 business days of the scheduled date
P4	Emergency Facility Repairs	7 Days planning and execution subject to supply chain regulations

Table 1: Maximum allowable response times

"Maximum down-time" shall mean the period of time allowed to repair a breakdown, and "actual down-time" shall mean the measured period from the instant when the breakdown was reported or located until the installation has been repaired to its functional specification.

A guideline classification for typical P1, P2, P3 and P4 breakdowns for each installation are specified in the Supplementary Specification for each asset type.

The job card (Task Order) issued for the repair will state whether the repair is regarded as P1, P2, P3 or P4 and it will be required of the Contractor to react accordingly.

GM 8 MEASUREMENT AND PAYMENT

Measurement and payment will be done as per the Secondary Options Clauses of the Contract. See X1, X13, X17, X18, X19 and X20, supplemented by C1.2b Annexure CD.

C3.6: HEALTH AND SAFETY SPECIFICATION

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

SEPTEMBER 2023
Version 3

TABLE OF CONTENT

- 1. INTRODUCTION**
- 2. KEY ROLE PLAYERS**
- 3. LIST OF ABBREVIATIONS**
- 4. DEFINITIONS**
- 5. KEY REFERENCES**
- 6. PURPOSE OF THE PROJECT SPECIFIC HEALTH & SAFETY**

SPECIFICATION (PSHSS)

- 7. IMPLEMENTATION OF THE PROJECT SPECIFIC HEALTH & SAFETY SPECIFICATION (PSHSS)**

8. APPLICATION

9. REQUIREMENTS AT TENDER STAGE

10. GENERAL REQUIREMENTS

- 10.1 Summary of Risks identified during Design.
- 10.2 Hazard Identification and Risk Assessment (HIRA)

11. OCCUPATIONAL HEALTH & SAFETY MANAGEMENT

- 11.1 Scope
- 11.2 Scope of Works
- 11.3 Structure and Organization of H&S Responsibilities
- 11.4 Health & Safety Plan Framework
- 11.5 Appointment of Competent Site Personnel
- 11.6 Construction Supervision
- 11.7 Construction Health & Safety Manager
- 11.8 Construction Health & Safety Officer
- 11.9 Construction Vehicles
- 11.10 Health and Safety Representatives and H&S Meetings
- 11.11 Appointment of Competent Contractors

12. GENERAL RISK MANAGEMENT

- 12.1 Health Risks and Medical Surveillance
- 12.2 General Environmental Conditions
- 12.3 Noise Risks
- 12.4 Emergency Procedures
- 12.5 First Aiders and First Aid Equipment
- 12.6 Fire and Emergency Management
- 12.7 Incident Management and Compensation Claims
- 12.8 Personal Protective Equipment (PPE) and Clothing
- 12.9 Occupational Health & Safety Signage
- 12.10 Induction of Employees and Visitors, General H&S Training

12.11 Public and Site Visitor Health & Safety

12.12 Awareness

13. MANAGEMENT OF PLANT AND EQUIPMENT

13.1 Construction Plant

13.2 Plant and Equipment

13.3 Operators

13.4 Machinery and Power Tools

13.5 Portable Electrical Tools / Equipment and Explosive Powered Tools

13.6 Hired Plant and Machinery

13.7 Vessels under Pressure and Gas Bottles

13.8 Hand Tools

13.9 Inspection of equipment and tools

13.10 Ladders and ladder work

13.11 Cranes and lifting equipment

13.12 Overhead work and suspended loads

13.13 Temporary Works (Scaffolding, support work, formwork)

13.14 Batch plants

14. WORKING PROCEDURES

14.1 Demolition work

14.2 Site Works and Excavations

14.3 Excavations

14.4 Working at Heights

14.5 Edge protection

14.6 Roof Work

14.7 Piling

14.8 Asbestos removal / replacement of roof / sheeting

14.9 Mechanical Installations

14.10 Electrical Work

15. AUDITING

16. OCCUPATIONAL HEALTH

16.1 Communication on Site

16.2 Care of Workers on Site (Welfare)

16.3 Discipline, Alcohol and Substance Abuse

16.4 Rules of Conduct

16.5 Compliance with Rules of Conduct

16.6 Electrical Equipment

17. SAFETY RULES WITH RESPECT TO WORK TO HEALTHCARE FACILITIES

18. PROJECT SPECIFIC RISKS

19. PROCEDURES TO MANAGE PROJECT RISKS

20. HEALTH & SAFETY FILE

21. NON-CONFORMANCES

22. MEASUREMENT AND PAYMENT

ANNEXURE A - Close Out Report

ANNEXURE B - Non-Conformance Report

ANNEXURE C - Monthly OHS Report

ANNEXURE D - Risk Assessment

ANNEXURE E - Guidelines to Health and Safety Bill of Quantities

ANNEXURE F - Safety Specification and Baseline Risk Assessment Issue Register

1. INTRODUCTION AND BACKGROUND

- 1.1 The Construction Regulations No. 3705 of 7th February 2014 requires the Client to prepare a pre-construction Health and Safety Specification, with all existing risks identified.
- 1.2 The Eastern Cape Department of Health (ECDoH) is tasked to provide Healthcare operational facilities across the Eastern Cape.
- 1.3 The ECDoH has a responsibility to limit its risk by ensuring a zero tolerance and best practice approach to Contractors and those affiliated to a construction project. Thus, a high premium is placed on the health and safety (H&S) of ECDoH stakeholders, which include its employees, professional service providers, public and its physical assets.
- 1.4 The responsibilities that the Department and relevant stakeholders have toward its employees are captured in, but not limited to this document. The responsibilities stem from both moral, civil and a variety of legal obligations.
- 1.5 The Principal Contractor is to take due cognizance of the above statement.
- 1.6 The ECDoH, as the Client and where there is an appointed H&S Agent on its behalf, shall provide a project specific Health & Safety Specification (PSHSS) for the project and provide the Principal Contractor/s making a bid or appointed to perform construction work for the project, or parts thereof such documentation.
- 1.7 This Health and Safety Specification complies with the Occupational Health and Safety Act No. 85 of 1993 and the Construction Regulations of February 2014.
- 1.8 This Health and Safety Specification is to be used as a management tool to comply with the Occupational Health and Safety Act.

2. KEY ROLE PLAYERS

2.1 CLIENT

- 1.1.1. Electrical Engineer
- 1.1.2. Mechanical Engineer
- 1.1.3. Health & Safety Agent

2.2 PRINCIPAL CONTRACTOR

- 2.2.1 Contracts Manager
- 2.2.2 Construction Manager
- 2.2.3 Health & Safety Officer
- 2.2.4 Other

3. LIST OF ABBREVIATIONS

AAIA	Approved Asbestos Inspection Authority
AIA	Approved Inspection Authority
BoQ	Bill of Quantities
CC	Compensation Commissioner
CR	Construction Regulations
DMR	Driven Machinery Regulations
DoL	Department of Labour
FEMA	Federated Employers Mutual Association
GAR	General Administration Regulations
GSR	General Safety Regulations
HCSR	Hazardous Chemical Substances Regulations
HIRA	Hazard Identification Risk Assessment
H&S	Health and Safety
ER	Engineer's Representative
LI	Labour Intensive
OH	Occupational Health
OHSA	Occupational Health and Safety Act No. 85 of 1993 (as amended)

OHSS	Occupational Health and Safety Specification
PSHSS	Project Specific Health and Safety Specification
PC	Principal Contractor
PPE	Personal Protective Equipment
SANS	South African National Standards (Authority)
SDS	Safety Data Sheet
SMME	Small, Micro, Medium Enterprise
SWP	Safe Work Procedure

4. DEFINITIONS

The definitions used will be those set out in the Regulation Gazette N0 3705 of 7th February 2014 with the following additions:

4.1 Client:

The Superintendent General, Department of Health of the Province of the Eastern Cape.

4.2 Hazard:

Source of exposure to danger.

4.3 Hazard Identification and Risk Assessment (HIRA) and Risk Control:

Means a documented plan, which identifies hazards, assesses the risks and details the control measures and safe working procedures which are to be used to mitigate and control the occurrence of hazards and risks during construction or operation phases.

4.4 Health and Safety Agent:

Means any person who acts as a representative for the Client in managing the overall health and safety work as their responsible person.

4.5 Health and Safety Plan:

Means a documented plan which answers to the Project Specific Health and Safety Specification; including all the supporting documentation that indicate how the Principal Contractor or Contractor plans to manage H&S for the duration of the Contract.

4.6 Induction Training:

Means once off introductory training on general health and safety issues given to all employees and visitors to the site before commencement of work on site.

4.7 Risk:

Means the probability or likelihood that a hazard can result in injury or damage.

4.8 Regulation/s:

Shall mean the relevant regulation/s promulgated in terms of the Occupational Health and Safety Act, No. 85 of 1993 and the Construction Regulations No. 3705 of 7th February 2014.

4.9 Site:

Means the area in the possession of the Principal Contractor for the construction of the works. Where there is no demarcated boundary it will include all adjacent areas, which are reasonably required for the activities for the Principal Contractor and approved for such use by the Designer.

4.10 **The Act:**

Means, unless the context indicates otherwise, the Occupational Health and Safety Act, No. 85 of 1993 and Regulations promulgated thereunder, as amended.

5. KEY REFERENCES

5.1 Occupational Health and Safety Act No. 85 of 1993 and Regulations (as amended).

5.2 Compensation for Injury and Occupational Diseases Act No. 100 of 1993 (as amended)

5.3 The Preferential Procurement Policy Framework Act 2000 and the Preferential Procurement Regulations 2017, the General Conditions of Contract (GCC)

5.4 Construction Regulations No. 3705 of 7th February 2014

5.5 SANS Code 10400 and others that are applicable.

6. PURPOSE OF THE PROJECT SPECIFIC HEALTH AND SAFETY SPECIFICATION (PSHSS)

6.1 The PSHSS is a performance specification to ensure that the Client and any bodies that enter into formal agreements with the Client Viz. Agents, Professional Service Consultants (Engineers, Quantity Surveyors and Architects), Principal Contractors and Contractors achieve an acceptable level of OHS performance.

6.2 To assist in achieving compliances with the Occupational Health and Safety Act No. 85 of 1993 and the Construction Regulations of February 2014, to, as far as is practical, reduce or eliminate incidents or injuries.

6.3 No advice, approval of any document required by the PSHSS, such as hazard identification and risk assessments, or any other form of communication from the Client shall be construed as acceptance by the Client of any obligation that absolves the Principal Contractor from achieving the required level of performance and compliance with legal requirements.

6.4 Furthermore, there is no acceptance of liability by the Client, which may result from the Principal Contractor failing to comply with the PSHSS, i.e. the Principal Contractor remains responsible for achieving the required performance levels.

6.5 A Mandatory Agreement in terms of Section 37.2 of the OHSA will be signed between parties prior to any works commencing.

6.6 The PSHSS highlights the aspects to be implemented over and above the minimum requirements of current legislation.

6.7 Requirements may be changed should new risks or issues are identified that could not have been foreseen during the design phase of the project, or during the construction phase. Any new legislation or

standards (legislated or determined by the (ECDoH) that are promulgated or accepted during the contract will automatically be applied.

6.8 Environmental management shall receive due attention as per the requirements of the Environmental Control Officer (ECO) but will be managed by the ECO directly.

6.9 The Contractor shall use this Specification as a basis for the drafting of his and any Subcontractors' Construction Health and Safety Plans.

6.10 The Specification sets out the requirements to be followed by all Contractors so that the Health and Safety of all persons who may be affected by the Construction Project will receive proper priority.

6.11 The Project Specific Risks that have been identified have been tabulated in Section 18 of this Specification.

7. IMPLEMENTATION OF THE PROJECT SPECIFIC OCCUPATIONAL HEALTH AND SAFETY SPECIFICATIONS (PSHSS)

7.1. The project specific H&S specification (PSHSS) forms an integral part of the Contract, and PCs are required to make it an integral part of their Contracts with Contractors and Suppliers.

7.2. A PSHSS will be available for each level of Contract and Contractor and must be complied with.

7.3. This specification must be read in conjunction with the OHSA, Regulations thereto (as amended) and any other standards relating to work being done and ensure compliance thereto.

7.4. The information relative to the scope of the project, the works etc. are detailed in the tender, are to be considered when developing the H&S plan and associated documentation.

7.5. The summary of risks is included in Section 18 of the PSHSS.

7.6. The OHSA S.37.2 Mandatory Agreement must be fully completed by the PC, supplied by the Client.

7.7. No work may commence without written approval of the H&S plan by the H&S Agent, or the responsible person in the ECDoH.

7.8. Should there be design changes, or change in the scope of works, an amended PSHSS may be issued.

7.8.1. Where amended PSHSSs are issued, the PC will be required to ensure a resubmission of an amended H&S plan for approval.

7.8.2. Further to this, the PC must ensure that similar information must be provided as it applies to the works to all their Contractors, within 5 working days following notification thereof of such design changes.

7.9. The H&S Agent will visit the project as deemed necessary by the Designer and the H&S Agent to ensure compliance and limit risk.

7.9.1. All activities on the site and all appropriate documentation will be monitored and reported on to the Client and the Designer.

7.10. Non-conformances will be issued and penalties or work stoppage will be issued where appropriate. Communication between the H&S Agent and the PC will be through the Designer (or Client's responsible person) as determined at the commencement of the project.

7.11. The Contractor must forward a copy of the Health and Safety plan to all Subcontractors to enable them to prepare their own Health and Safety plans.

8. APPLICATION

8.1. This Specification is a compliance document drawn up in terms of the Occupational Health and Safety Act No. 85 of 1993, and the Construction Regulations of February 2014, and is therefore binding on the Contractor as well as the Client.

8.2. All Contractors are to comply with the conditions of this Health and safety Specification.

8.3. All Direct Contractors carrying out work on behalf of the Eastern Cape Department of Health, for **SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES** are also required to comply with the conditions of this Health and Safety Specification.

8.4. All staff and representatives of, Eastern Cape Department of Health, **SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES**, who visit the site are required to comply with the conditions of this Health and Safety Specification.

8.5. Facility is also required to comply with the conditions of this Health and Safety Specification.

8.6. Facilities staff and everyone who visit the site is required to comply with the conditions of this Health and Safety Specification.

9. REQUIREMENTS AT TENDER STAGE

9.1. **Adequate pricing for H&S is required, and the appropriate section in the BoQ is to be completed.**

9.1.1. Failure to do so could result in the Tender being regarded as non-responsive.

10. GENERAL REQUIREMENTS

10.1. **Summary of Risks identified during Design.**

- a) At the onset the Principal Agent will identify any Project Specific hazards or risks that may affect the work.
 - b) These hazards or risks are listed under section 18 of this Specification.
 - c) Tenderers are also advised to notify the client of any other risks or hazards that have not previously been identified.
-

- d) These risks are to be recorded and a recommended procedure for addressing each item agreed on and recorded.
- e) The Contractor is to conduct inspections of all tools and equipment before the commencement of the works and at least once a week during the works.
- f) The Contractor shall ensure that all Contractors and workers are informed, instructed and trained by a competent person regarding any hazards, risks and related safe work procedures as part of the Induction process before any work commences and thereafter at regular intervals as the risks change and as new risks develop.
- g) Proof of this training must be kept for inspection by the Client or Client's Representative.
- h) The Contractor shall be responsible for ensuring that all persons who could be negatively affected by the operations are informed and trained according to the hazards and risks and are conversant with the safe working procedures, control measures and other related rules (tool box talk strategy to be implemented).
- i) The format used for the risk assessment must make provision for the following information;
 - Reference Number
 - Project Name
 - Identification of task assessed.
 - Date
 - Risk assessment team & designation
 - Approval of risk assessment team.
 - Risk rating with matrix
 - Review date
 - Task steps
 - What can go wrong (Hazard)
 - The result (Risk)
 - Risk rating
 - Preventative Action (Control Measures)
 - The format The Principal Contractor is to ensure that all Hospital Staff and Management personnel that will be affected by the works are fully informed of the risks and hazards associated with the works.

10.2 Specified Hazardous Chemical Substances

- a) Where the PC is likely to supply the product as the product has not been specified, safety data sheets (SDSs) need to be considered prior to all selections.
- b) Hazardous and potential situations

The Principal Contractor shall immediately notify other Sub Contractors as well as the Client of any hazardous or potentially hazardous situations that may arise during performance of construction activities.

11. OCCUPATIONAL HEALTH & SAFETY MANAGEMENT

11.1.Scope

11.1.1. The Specification covers the requirements for eliminating and mitigating incidents and injuries at **SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES.**

11.1.2. The scope addresses legal compliance, hazard identification, risk assessment, risk control, and promoting a Health and Safety culture on the project.

11.1.3. The Specification also provides for the protection of those persons other than employees.

11.2. Scope of Works

This specification is for the repair, maintenance and proper functioning of Standby Generator installations, for the duration of the Contract period, in the following Health facilities:

BUFFALO CITY DISTRICT

Item no.	FACILITY	No.of Units
1	BHISHO FORENSIC LABORATORY	1
2	BHISHO HOSPITAL	2
3	CECILIA MAKHIWANE HOSPITAL	5
4	DIMBAZA HOSPITAL	1
5	DUNCAN VILLAGE CHC	1
6	EMPILWENI GOMPO CHC	1
8	EMS VINCENT	1
11	FRERE HOSPITAL	8
12	GREY HOSPITAL	1
13	MDANTSANE FORENSIC MORTUARY	1
15	MOUNT COKE CHC	1
16	NEW HAVEN	1

AMATHOLE DISTRICT

Item no.	FACILITY	No.of Units
1	ADELAIDE HOSPITAL	1
2	BEDFORD HOSPITAL	1
3	BUTTERWORTH HOSPITAL	4
4	CATHCART HOSPITAL	1
5	IDUTYWA CHC	1
7	XHORA CHC	1
8	FORT BEAUFORT HOSPITAL	1
9	KOMGA HOSPITAL	1
10	MADWALENI HOSPITAL	3
11	MIDDLEDRIFT CHC	1
12	NOMPUMELELO HOSPITAL	2
Item no.	FACILITY	No.of Units
13	NQAMAKWE CHC	1
14	S.S GIDA HOSPITAL	2
15	STUTERRHEIM HOSPITAL	2
16	TAFALOFEFE HOSPITAL	1
17	TOWER HOSPITAL	3
18	VICTORIA HOSPITAL	3
19	WILLOWVALE CHC	2
20	WINTERBURG TB HOSPITAL	1
21	ADELAIDE MORTUARY	0

22	BUTTERWORTH MORTUARY	1
23	CENTANI MORTUARY	0

Details of the work required shall be as listed in the Price Lists which have been sub-divided into the following categories:

SCHEDULE 1: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

SCHEDULE 2: FUNCTIONAL REPAIR SCHEDULE

SCHEDULE 3: MAINTENANCE SERVICE SCHEDULE

SCHEDULE 4: TERM REPAIRS SUBJECT TO APPROVAL OF QUOTATION FOR THE WORKS

SCHEDULE 5: EQUIPMENT REPLACEMENT COST SCHEDULE

11.3. Structure and Organization of H&S Responsibilities

Principal Contractor to provide a proper OHS organogram.

11.4. Notification of Construction Work

- a. There is no need for notification of construction since this is a maintenance project.

11.5. Health and Safety Plan Framework

- a) The H&S aspects related to the project outlined in the previous sections are to be considered when drawing up the H&S Plan.
- b) The PC is required to demonstrate competence by providing an H&S system that will address the requirements of the project.

11.6. Appointment of Competent Personnel

- a) The CEO (OHSA S16.1) of the PC will take overall responsibility for the appointment of competent staff for the duration of the project. Should the CEO not be personally involved in the project, the H&S responsibilities are to be delegated to the Site Agent (OHSA 16.2). Knowledge and training in H&S is required, and certificates indicating H&S training as well as experience to be included in CVs.
- b) All other legal appointments are to be made with relevance to the type of work required and kept current with the project programme.

11.7. Contracts Supervision

- a) Competent Construction manager will be appointed to manage part or all the works and have training and/or experience in the area of responsibility. All site supervisors must show evidence of appropriate training in H&S, and an understanding or training in areas of responsibility (i.e., risk assessments, method statements etc.).
-

- b) Construction Supervisor is to be full time on site, for this single site.
- c) Curriculum Vitae (CVs) are to be submitted for approval by the Designer, and/or Client.
- d) The Manager will be held responsible for the safety of working teams and subordinates, housekeeping and stacking and storage of materials.

11.8. Construction Health and Safety Management

- a) The PC will employ at least one competent, H&S Officer the duration of the contract.
- b) The H&S Officer CVs are to be submitted for approval to the H&S Agent or the Client.
- c) The CHSO must provide the SACPCMP valid registration certificate, CV and relevant certificates/qualifications. The officer will be required to compile a monthly report, see Annexure A.
- d) In the case of a contract where contractors are employed, the H&S Officer must have a competence to evaluate the Contractors Health and Safety plans.
- e) They may not hold any other position on the site staff.
- f) The site supervisor may not act as the H&S Officer.
- g) The H&S Officer will be held responsible for all H&S issues on the project.
 - 11.8.g.1. Senior site staff and supervision, Contractors are to follow systems, instructions etc, given by the H&S Officer at all times;
 - 11.8.g.2. No new workers or Contractors may commence work without approval or following the H&S plan as submitted, and
 - 11.8.g.3. No inductions of Contractor staff until the H&S documentation is approved by the H&S Officer.
 - 11.8.g.4. The H&S Officer may not be removed or replaced without the approval of the client or client's agent, nor may the construction site be left unattended for more than 1 day without adequate, competent cover.
- h) A monthly report of all H&S activities and incidents is required by the end of the first week of each month, or at a date agreed to by the H&S Agent/Client and the H&S Officer.
 - 11.8.h.1. An example of the monthly report is attached as an Annexure C.
The H&S Officer will be responsible for collating the H&S documentation at the close out of the project in electronic format.
 - 11.8.h.2. A list of the typical aspects that should be provided is available as Annexure B to this document.
 - 11.8.h.3. The PC is to ensure that all Contractors documentation follows the same requirements and closed out H&S documentation must be completed and be available with the close out of the main contract.
 - 11.8.h.4. Failure to do so will be considered a serious offence and penalties applied.

11.9. Health and Safety Representatives and H&S meetings

- a) H&S Representatives representing workers and Contractors are to be appointed following the start-up of the project, irrespective of the number of workers on site.
- b) The appointed H&S Representatives are to be actively involved with H&S and will assist the H&S Officer and site management in meeting legislative duties.
- c) The H&S Officer shall further ensure that H&S is discussed at all internal production or progress meetings.
- d) Issues arising from the H&S Agent audits are to be discussed, as well as all H&S related issues.
- e) Minutes are to be kept for all H&S interventions and meetings. Failure to do so will be deemed to be a moderate offence.
- f) Every team that is allocated to a site should have someone competent to manage safety (Incident investigation/ daily risk assessment/ and feedback on other risk associated found)

11.10. Appointment of Competent Contractors

- a) The Principal Contractor is to ensure compliance with the Client's minimum standards and all legislative requirements.
 - 11.10.a.1. All competent persons shall have the knowledge, experience, training, and qualifications specific to the work they have been appointed to supervise, control, and carry out.
 - b) The Principal Contractor is responsible to ensure that competent Contractors are appointed to carry out construction work.
 - c) The same H&S standards required of the PC are to be applied to all Contractors.
 - d) An index of all Contractors and Suppliers is to be on file and kept updated at all times.
 - e) Where the ECDoH appoints Direct Contractors or uses the Maintenance staff to carry out works in the site area, the ECDoH is to ensure that the appropriate competent persons are responsible for supervising & controlling the work being undertaken.
 - f) The PC is to ensure there is sufficient funding for H&S compliance by each Contractor.
 - g) The following minimum aspects are applicable to any Contractor appointed:
 - 11.10.g.1. Mandatary agreements in place
 - 11.10.g.2. Letter of Good Standing
 - 11.10.g.3. Method statements and risk assessments
 - 11.10.g.4. Available information relative to:
 - 11.10.g.4.1. Load testing and registers for cranes or lifting devices
 - 11.10.g.4.2. Medical certificates of fitness
-

11.10.g.4.3. Safety data sheets (SDSs)

- h) Failure to provide written approval of H&S documentation will be considered a serious offense, and could result in aspects of, or all the activities being stopped, and penalties implemented.

12. GENERAL RISK MANAGEMENT

12.5. Health Risks and Medical Surveillance

12.1 All permanent workers (including those of Contractors) are required to be in possession of a medical certificate of fitness issued by a registered Occupational Medical Practitioner prior to commencing work. Medical surveillance will commence at pre-employment.

12.2 All workers (including Contractors) are required to be in possession of a medical certificate of fitness prior to commencing work.

Lung Function test a must be done in Medical.

- a) *Employees required to perform work at heights or from fall risk position must be medically fit to perform such work, such employee's medicals must specify "Fall Risk" or "Working at heights" in the exposure section of the annexure 3 template.*
- b) Annual medical surveillance is required (unless identified as being required more frequently), as well as an exit medical.
- c) Arrangements for keeping medical records for the required time are to be noted.
- d) It is preferable that the PC has a medical surveillance plan.
 - 1. Where a TB Hospital we need:
 - a. Proper ventilation when working in areas.
 - b. FFP 2 Mask to be worn when working in areas.
 - c. Medicals must be done for all with Lung function test as a must.
 - d. Employees must wear mask when working near patients.
 - 2. Where working near Forensic facilities:
 - a. All persons working near patients to have Hepatitis B inoculations.
- ii. Failure to do so will be considered a serious offence.

12.5. **General Environmental Conditions**

- a) Compliance with the Environmental Regulations (as amended), among others is required.
 - b) Environmental monitoring of ventilation, lighting and dusts may be deemed to be required by the Approved Inspection Authority used to measure the environment.
 - c) Copies of the relevant reports and actions taken in respect of these are to be placed in the H&S file.
 - d) Any spillages of substances which could be toxic to persons must be dealt with adequately. The Contractor must include his spillage removal system in the OHS Plan. (spill kit to be carried with every bakkie)
-

12.6. **Noise Risks**

- a) All plant from plant hire companies (suppliers) or that of the PC is to be compliant with the Noise Induced Hearing Loss Regulations.
- b) Plant identified that has not been tested and marked for noise emissions will result in having to be tested at the Contractors or PCs expense.

12.6.b.1. Failure to do so within a reasonable time will result in such plant being removed from site.

- c) Audiometric testing of all workers is noted as required in the medical surveillance programme for all permanent workers prior to work commencing.

12.6.c.1. Temporary labour working in identified noise areas will require testing if the noise levels are indicated on plant or through processes as greater than 85dB.

12.6.c.2. Audiometry records are to be available in the H&S file.

- d) Suitable SANS approved hearing protective equipment shall be issued and worn where noise levels are identified as equal to or greater than 85 db.

12.6.d.1. Failure to do so will be considered a serious offence.

12.7. **Emergency Procedures**

- a) The Principal Contractor must prepare a detailed emergency procedure manual for approval by the Client prior to commencement of work on the site.
- b) It is advised that the system should be simple and easy for any worker to follow.
- c) The plan may be adapted should new information or risks are identified.
- d) The procedures for dealing with the emergency evacuation of staff must be agreed upon with the Facility Management.
- e) All teams should have knowledge and skills for emergency (Per Bakkie Designation)

12.8. **First Aiders and First Aid Equipment**

- a. Competent, trained First Aider is to be formally appointed for the project.
- b. At least one worker is to be trained to level 3.
- c. First aider is to be available at all times and be able to cover each working team.
- d. Further first aiders from the community or SMMEs, If not already accredited, are to be sent for accredited first aid training.
- e. Appropriately stocked first aid kits are to be available at all times and to assure continual availability and access on site.

12.9 Fires and Emergency Management

- a. Attention to emergency planning and procedures is very important.
-

- b. The full emergency plan must form part of the supporting documentation with the H&S Plan.
- c. It is advised that the system should be simple and easy for any worker to follow.
- d. The plan may be adapted should new information or risks are identified.
- e. First aiders shall be available in each working team and be able to work as a team when responding to any emergency on the project.
- f. The procedure shall detail the response plan in relation to the works, and include at least (but are not limited to) the following key elements:
- g. Appointment of a competent emergency response co-ordinator and wardens;
- h. Fire Fighting equipment to be supplied per vehicle and a competent person per bakkie to be able to have fire training.

12.11 Incident Management and Compensation Claims

- a. The PC will ensure there is a management system to investigate all incidents.
- b. All serious incidents involving any form of disabling injury or fatality are to be reported to the Client immediately.
- c. This shall be confirmed in writing following the incident.
- d. Full details are to be included in each site meeting or when the Client visits site.
- e. A summary of incidents is to be included in the monthly report.
- f. Failure to comply with emergency provisions will be considered a serious offence, and the operation or project may be stopped if deemed inadequate for the work at the time of assessment or site inspection.
- g. Per team all employees to have knowledge of above

12.12. Personal Protective Equipment (PPE) and Clothing

- a) The PC is to provide a procedure as an addendum to indicate how PPE is managed within the Company.
- b) The wearing of the identified SANS approved PPE at all times is non-negotiable.
- c) The PC shall ensure that all workers (Including Contractors) are issued with and shall wear as required; the first 3 items are mandatory for all workers:

- 12.12.c.1. Protective footwear;
- 12.12.c.2. Reflective jackets (no bibs)
- 12.12.c.3. Overalls that ensure worker visibility
- 12.12.c.4. Eye protection;
- 12.12.c.5. Hearing protection;
- 12.12.c.6. Respiratory protection (minimum of FFP2), and
- 12.12.c.7. Any other necessary PPE identified from SDSs and/or risk assessments.

- d) Adequate quantities of PPE shall be available. This shall include necessary PPE for visitors. The procedures for managing PPE are to be in a formal procedure submitted with the H&S plan for approval.
- e) Failure to comply will result in penalties being applied.

12.13. Occupational Health and Safety Signage

- a) On-site H&S signage is required.
-

12.13.a.1. Signage shall be posted up at temporary working areas, or other potential risk areas/operations.

12.13.a.2. These signs shall be in accordance with the requirements of the General Safety Regulations or SANS requirements as amended.

12.13.a.3. Signage is to be noted on the site drawings indicating where fixed/temporary signage is required.

b) Temporary signage is to include (but not be limited to) the following:

12.13.b.1. "Warning: Construction Site – Keep out" or similar.

12.13.b.2. 'First aid box positions (including vehicles); and where one is working

12.13.b.3. Fire extinguishers.

c) Signs shall be posted at areas of work on site indicating that a construction site is being entered and that persons should take note of H&S requirements.

d) The Contractor shall establish a system for controlling and recording entrance to the Site office and camp area.

e) Failure to comply will result in penalties being applied.

12.14. **Induction of Employees and Visitors, General H&S Training (to be done at office/ workshop)**

a) A formal induction programme is to be submitted as an addendum for approval with the H&S plan.

12.14.a.1. Inductions must be carried out for all workers and visitors (including Client, Designers) to the site.

b) Pre-task training is required to ensure workers are familiar with the risks and H&S measures of the work or tasks to be done.

12.14.b.1. Such training is to be done at least weekly.

12.14.b.2. Records of inductions and pre-task training are to be kept in the H&S file.

c) Any person found on site without proof of induction will be removed from site until the proof is supplied and, and a penalty issued per non-compliance.

12.15. **Public and Health and Safety**

12.15.a.1. The Contractor shall ensure that each person working on or visiting a site, and the surrounding community, shall be made aware of the dangers likely to arise from onsite activities and the precautions to be observed to avoid or minimize those dangers. Appropriate health and safety signage shall be posted at all times.

12.15.a.2. Warning notices are to be provided at the main entrance to area of works to each hospital facility, notifying that construction work is taking place within the existing buildings.

12.15.a.3. Hoardings are to be inspected daily and monitored during working hours.

12.16. **Awareness**

- a) The Principal Contractor shall ensure that, on site, periodic toolbox talks take place at least once per week at workshop or office area.
- 12.16.a.1. These talks should deal with risks relevant to the construction work at hand.
 - 12.16.a.2. A record of attendance shall be kept in the Health & Safety File.
 - 12.16.a.3. All Contractors must comply with this minimum requirement.
 - 12.16.a.4. At least one of the Toolbox talks shall include an environmental related issue.
- b) The Principal Contractor is to ensure that the Hospital Management & Staff are kept informed of any change in the situation regarding the risks and hazards relating to the construction work on the site.

13. MANAGEMENT OF PLANT AND EQUIPMENT

13.12. Construction Plant (where necessary)

- a) Construction Plant” includes all types of plant including but not limited to, cranes, piling rigs, excavators, road vehicles, and all lifting equipment.
- b) The Principal Contractor shall ensure that all such plant complies with the requirements of the OHS Act 85/1993 and Construction Regulations 2014
- c) The Principal Contractor and all relevant Sub Contractors shall inspect and keep records of inspections of the construction plant used on site.
- d) Only authorised/competent (certified) persons are to use machinery under proper supervision.
- e) Appropriate PPE and clothing must be provided and maintained in good condition at all times.
- f) Proof of medical evaluations as required by the Construction regulations is available for inspection by the Client.

13.13. Plant & Equipment

- a) Close control of plant and equipment is required, including that of Contractors.
- b) Daily monitoring of all plant and equipment is required prior to commencing work.
- c) Full lists of hired and own plant are to be available at the H&S Agent's/Client audit.
- d) All daily inspection records are to be kept in the H&S file where plant and equipment is brought on to site.
- e) Registers are not to be more than 1 week behind.

13.14. Operators

- a) Only competent, fit plant operators are to be used.
-

- b) Medical certificates of fitness are required for all operators.
- c) Operators are to be adequately trained and certified to operate mobile cranes or crane trucks.
- d) Certificates and registers are to be placed in the H&S file.
- e) Failure to do so will be considered a serious offence.

13.15. **Machinery and Power Tools**

- a) Only authorized competent persons are to operate machinery and power tools.
- b) Appropriate PPE and clothing must be provided, used and maintained.
- c) No unsafe / dangerous equipment or tools may be brought onto, or used, on the site.
- d) The Client / Principal Agent reserve the right to inspect all tools and equipment at any time and to prevent / prohibit their use, if found to be unsafe, without any penalty to the Client and without affecting the terms of the contract in any way.
- e) The Contractor may not use any machinery or power tools belonging to the Hospital.

13.16. **Portable Electrical Tools/Equipment and Explosive Powered Tools**

- a) The Principal Contractor shall ensure that use and storage of all explosive powered tools and portable electrical tools are in compliance with relevant legislation.
 - b) The Principal Contractor shall ensure that all-electrical tools, electrical distribution boards, extension leads, and plugs are kept in safe working order.
 - c) The Principal Contractor is to ensure that extension cables and temporary power supplies do not impede access ways or escape routes.
 - d) Regular inspections and toolbox talks must be conducted to make workers aware of the dangers and control measures to be implemented e.g. personal protection equipment, guards, etc.
 - e) The Principal Contractor shall ensure the following:
 - 13.16.e.1. A competent person undertakes routine inspections and records are kept.
 - 13.16.e.2. Only authorised trained persons use the tools.
 - 13.16.e.3. The safe working procedures apply.
 - 13.16.e.4. Awareness training is carried out and compliance is enforced at all times.
 - 13.16.e.5. PPE and clothing is provided and maintained.
 - 13.16.e.6. Electrical cables must be free from any damage.
 - 13.16.e.7. Electrical tools & equipment may not be exposed to water.
-

13.16.e.8. Signs to be posted up in the areas where explosive powered tools are being used.
(WARNING - EXPLOSIVE POWERED TOOL IN USE - KEEP CLEAR).

13.16.e.9. That prior arrangement is made with the facility Maintenance Supervisor before any explosive powered tools are used.

13.17. **Hired Plant and Machinery**

- a) The Principal Contractor shall ensure that any hired plant and machinery used on site is safe for use.
- b) The necessary requirements as stipulated by the OHS Act 85/1993 and Construction Regulations (February 2014) shall apply.
- c) The Principal Contractor shall ensure that operators hired with machinery are competent and that certificates are kept on site in the health & safety file.

13.17.c.1. This includes medical certificates of fitness to operate construction vehicles and appointment of the operator.

13.17.c.2. All relevant Sub Contractors must ensure the same.

- d) Daily inspections must be recorded by each operator.

13.17.d.1. A copy of the machines service log book & planned maintenance schedule must be supplied with the machine.

- e) Operators must be trained on the relevant risk assessments and safe working procedures.
- f) The hired plant company must provide proof of registration with Workman's Compensation or FEM before delivery of plant to site.
- g) The Hire Company must be required to sign a 37(2) Mandatory Agreement with the hire company before commencing with work. (Applicable if an operator is supplied with the machine.

13.18. **Vessels under Pressure and Gas Bottles**

- a) The Principal Contractor and all relevant Sub Contractors shall comply with the Vessels under Pressure Regulations, including:

13.18.a.1. No smoking or naked flame signs posted as well as sufficient firefighting equipment.

13.18.a.2. Cylinders must be stored in rows with aisles in between for easy removal in event of a fire.

13.18.a.3. Different types of gasses will be stored separately in an upright position, separately secured and the type of gas displayed identified with appropriate signage.

13.18.a.4. Before a cylinder is moved without suitable truck or trolley, the cylinder valve will be closed, and the regulator removed.

- 13.18.a.5. Only approved cylinder crates/cradles will be used.
- 13.18.a.6. Cylinders may not be transported with magnet cranes.
- 13.18.a.7. Cylinders may never be used as rollers, even if they are marked empty.
- 13.18.a.8. Cylinders may never be exposed to electrical circuits, e.g. welding leads. Never strike an arc on a cylinder.
- 13.18.a.9. Cylinders must be protected from direct sunlight or areas that could cause the cylinder to overheat.
- 13.18.a.10. Oxygen cylinders must be stored at least 5m away from other flammable gas cylinders.
- 13.18.a.11. Flashback arrestors must be fitted to the torch and the cylinder.
- 13.18.a.12. Empty cylinders must be marked as such and removed daily to a separate approved storage area.
- 13.18.a.13. Cylinders may only be allowed on site in an approved trolley, properly secured and with a 1.5kg dry powder fire extinguisher within 2m of the cylinder.
- 13.18.a.14. Flammable and oxidizing gasses may not be stored together, and greases/oils may never be allowed to come in contact with Oxygen.
- 13.18.a.15. Visual inspections will be done by the appointed HCS Controller to ensure that substandard vessels are not delivered and stored on site.
- 13.18.a.16. Hot works permit to be used in conjunction with welding.
- 13.18.a.17. Pressure vessels must have a certificate of manufacture as well as a service inspection test certificate issued at intervals not exceeding 36 months. These certificates will need to be submitted to the Safety Department on site.

13.19. **Hand tools**

- a) No handmade or damaged tools may be used on site.
- b) The Principal Contractor needs to exercise control over all contractors on site.
- c) Hand tools may only be used for its intended purpose.
- d) A competent person must be appointed to inspect hand tools monthly.
- e) Inspections need to be recorded on a register and each tool identified with a unique number.

13.20. **Inspection of equipment and tools.**

- a) The following items of equipment must be inspected weekly and maintained, and appropriate records kept.

13.20.a.1. Vehicle to inspected Daily (before leaving office)

- 13.20.a.2. First Aid dressing registers
- 13.20.a.3. Fire equipment
- 13.20.a.4. Lifting equipment
- 13.20.a.5. Lifting Gear
- 13.20.a.6. Portable electrical equipment
- 13.20.a.7. Stacking and storage inspections
- 13.20.a.8. Explosive power tools
- 13.20.a.9. Hazardous Chemical Substances (HCS)
- 13.20.a.10. Materials hoists (where applicable)
- 13.20.a.11. Pressure Vessels
- 13.20.a.12. Ladders
- 13.20.a.13. Excavations
- 13.20.a.14. Safety harnesses
- 13.20.a.15. Scaffolds - static and mobile.
- 13.20.a.16. Pneumatic tools
- 13.20.a.17. Construction vehicles and mobile plant.
- 13.20.a.18. Health and Safety Representatives checklists.

13.21. **Ladders and ladder work**

- a) The Principal Contractor shall appoint a competent person in writing to inspect all ladders monthly and record such findings in a register.
- b) Ladders are to extend one meter above a landing and must be secured at the top and have a secure, non-slip base.
- c) All ladders that do not comply with Health and Safety standards are to be removed from the site immediately.

13.22. **Cranes and lifting equipment. (Where Applicable)**

- a) Should any form of lifting device or crane (fixed or mobile) be used during the project for deliveries, moving of supplies or equipment, the appropriate documentation must be made available.
 - b) The Principal Contractor and all Contractors shall ensure that lifting machinery and tackle is inspected before use and thereafter in accordance with the Driven Machinery Regulations and the Construction Regulations (section 20).
 - c) Method statements, risk assessments, safe work procedures and training are to be available prior to work commencing.
 - d) A procedure for managing loads and lifting must be made available as an addendum to the H&S Plan.
-

- e) There must be competent lifting machinery and tackle inspector who must inspect the equipment daily or before use, considering that:
- f) All lifting machinery has a safe working load clearly indicated.
- g) All lifting equipment is clearly marked with a unique number and safe working load.
- h) Regular inspection and servicing is carried out:
 - 13.22.h.1. Lifting Machinery load test – every 12 months
 - 13.22.h.2. Lifting Machinery Inspection & service – every 6 months
 - 13.22.h.3. Lifting Tackle Load test – every 12 months
 - 13.22.h.4. Lifting Tackle Inspections – every 3 months
- i) Records are kept of inspections and of service certificates.
- j) Any plant or slings used to lift plant or material requires annual load testing by an AIA, and all certificates must have the testers LMI/E number.
- k) There is proper supervision in terms of rigging & guiding the loads that includes a trained banks man to direct lifting operations and check lifting tackle.
- l) The operators are competent as well as physically and psychologically fit to work and in possession of a medical certificate of fitness to be available on site.

13.23. **Overhead Work & Suspended Loads**

- a) All overhead work & suspended loads must be safely executed and controlled under supervision.
- b) The area around suspended loads must be barricaded to prevent unauthorized entry of persons who is not part of the task.
- c) Workers may not be positioned under a suspended load at any given time.
- d) To control overhead work the principal contractor must ensure that Workers secure all materials & equipment to prevent articles falling from above onto workers below.

13.24. **Temporary Works (Scaffolding, support work, formwork) where applicable**

- a) The Principal Contractor shall ensure that the provisions of section 12 of the Construction Regulations are adhered to.
 - 13.24.a.1. These provisions must include but not be limited to the appointment of a competent supervisor; ensuring that all equipment used is examined for suitability before use; that all formwork and support work is inspected by a competent person immediately before,
-

during and after placement of concrete or any other imposed load and thereafter, daily until the formwork and support work has been removed.

- b) Temporary works must be properly designed and signed off by a competent person.

13.24.b.1. In these instances, a competent person is defined as a Professional Engineer or Professional Technologist (registered with ECSA) who has sufficient experience in the design of the type of temporary work in question to be able to assess the design.

- c) The appropriate competent persons are to be appointed to manage and monitor such works to the satisfaction of the Engineer and H&S Agent.
- d) Records and registers are to be properly completed and kept in the H&S file. If temporary works are to be erected by a Contractor, this must be notified to the Designer/H&S Agent.
- e) Failure to do so will be considered a serious offence.

14. WORKING PROCEDURES

14.12. Site Works and Excavations

- a) A competent person is to be appointed in writing to supervise the Site Works and Excavations.
- b) A method statement on the procedures relating to the diversion of existing services and the maintenance of services to the existing facilities is to be agreed between the Contractor and the Principal Agent prior to the commencement of the work.
- c) The Contractor is to ensure Risk Assessments & Safe Working procedures have been communicated to the workers before any work is commenced.

14.13. Excavations

- a) A procedure for managing excavations is to be provided as an addendum to the H&S plan describing how excavations are to be managed.
- b) Excavation method statements are to be approved by the Designer and associated risk assessments are required.
- c) All Excavations are to be properly barricaded and demarcated.
- d) Any excavation shall be adequately shored if people are required to work in the excavation and the depth is more than 1.5 metres or where conditions render this necessary at lesser depths unless battered/sloped at the maximum angle of repose measured relative to the horizontal plane.

14.13.d.1. Undercutting is not allowed.

- e) Excavated material shall be placed at least 2m from the edge of an excavation.
-

14.13.e.1. A close watch shall be maintained at all times for signs of slipping, (e.g. cracks developing at the edges of the excavation).

14.13.e.2. Any Excavations over one metre in depth are to be properly shored up in accordance with the requirements of the Civil / Structural Engineer.

14.13.e.3. The requirements as per section 13 of the Construction Regulations are adhered to.

14.13.e.4. Designs by competent persons are required where ground conditions are deemed to require shoring.

f) A competent person is to be appointed for managing all excavations.

14.13.f.1. A permit system is to be available and used for all excavations.

14.13.f.2. All equipment and ground conditions to be checked daily, and prior to work commencing.

14.13.f.2.1. Cause every excavation, including all bracing and shoring, to be inspected by the competent person contemplated in the sub regulation:

14.13.f.2.1.1.1. Daily, prior to each shift.

14.13.f.2.1.1.2. After an unexpected fall of ground.

14.13.f.2.1.1.3. After substantial damage to supports.

14.13.f.2.1.1.4. After rain.

14.13.f.2.2. Cognisance is required of the surrounding area and increased levels of protection are required where work is in communities, near schools' clinics and / or Hospitals.

g) Work will be stopped, and penalties applied to any work in excavations that are not compliant.

14.14. **Working at Heights**

a) A fall protection plan is to be available and supplied as an addendum to the H&S plan.

14.14.a.1. The fall protection plan must be appropriate for the project.

14.14.a.2. Method statements, appropriate risk assessments, safe work procedures and training are to be available prior to work commencing.

b) Construction drawings shall be required for all temporary structures as they relate to the project.

14.14.b.1. The drawings shall be accompanied by full calculations, design loads and any relevant test results as required by the SANS code and ensure adequate allowance for the development of appropriate documentation and training.

14.14.b.2. All drawings are to be checked and signed by a competent structural engineer (registered with ECSA).

- c) The focus for working at height shall include fall restraint systems where possible except during assembling or dismantling top components or where it is not deemed safe.

14.14.c.1. The relevant SANS codes are to be applied as they apply to the works and the project, such as:

14.14.c.1.1. SANS 10085

14.14.c.1.2. SANS 10333 (parts 1-3)

- d) Should part of the works be contracted out, competent Contractors are to be appointed and submit documentation according to the project requirements.

14.14.d.1. The PC is to note if such work is to be contracted to specialists in the H&S Plan.

14.14.d.2. The plan is to be developed and work managed by a competent person for the duration of the project.

14.14.d.3. The following aspects must be included:

14.14.d.3.1. The public or users of buildings are to be protected at all times by way of hoarding, barricading or fencing.

14.14.d.3.2. Notices to be posted.

14.14.d.3.3. Restrictions or stoppage when weather conditions are deemed hazardous.

14.14.d.3.4. Permit system for working at heights.

14.14.d.3.5. Prevention of falling tools or equipment

14.14.d.3.6. Link to emergency plan regarding rescue

14.14.d.3.7. All workers are to be in possession of valid certificates of fitness that extend for the duration of the works.

14.14.d.4. Note the requirements in the section relating to medical surveillance.

14.14.d.5. Registers and all relevant documentation are to be placed in the H&S file.

14.14.d.6. Work will be stopped, and penalties applied to any work at heights that is not compliant.

14.15. **Edge protection**

- a) The Principal Contractor must ensure that all edges and openings are guarded and demarcated at all times until permanent protection is erected.
- b) The protection must be visibly marked, and sign posted.

14.16. **Mechanical installations**

- a) All mechanical installations are to be carried out in conformity with the manufacturer's instructions.
-

- b) Method statements and risk analyses must be compiled for each type of installation.
- c) A competent person must be designated to supervise the work.

14.17. **Electrical work**

- a) In addition to the requirements of the Electrical Machinery Regulations and the General Machinery Regulations any electrical distribution board used for construction work shall be fitted with suitable earth leakage protection.
- b) Leads must be properly and firmly connected.
- c) Plugs and sockets shall be in good and safe condition.
- d) All electrical apparatus, other than electrical hand tools, shall have a physical “lock out” system which will prevent any operation other than that authorized by a supervisor.

14.17.d.1. A “lock out” sign shall be displayed when the apparatus is not in use.

- e) Method statements and safe work procedures will be required for all work involving electrical apparatus.

15. **AUDITING**

- a) Frequency of external auditing by the Client or client’s agent will be as agreed with the Client and Designer but will at least conform to the requirements of the Construction Regulations.

15.12.a.1. The site will be inspected, and the documentation audited relative to the activities and H&S plan.

15.12.a.2. The H&S Officer of the PC must accompany the Client, or the H&S Agent, on all audits and inspections.

15.12.a.3. Not all audits will be, or need be announced.

- b) The PC will ensure that all their Contractors are audited at a frequency determined by the H&S Agent.

15.12.b.1. Audit frequency may be increased if Contractors are not performing adequately.

15.12.b.2. Audit results will be acted upon and non-conformances and penalties issued where deemed appropriate.

15.12.b.3. The Client, Designer or H&S Agent may act or require further outcomes if non-compliances are noted or unsafe acts are noted on site.

- c) Internal audits are to include site conditions as well as ensuring H&S files are appropriate, and compliant.
-

15.12.c.1. Comprehensive audit reports are to be made available, the format of the audit reports is to be acceptable by the H&S Agent.

d) The PC will be audited using a template as supplied in the tender document.

15.12.d.1. The audit template will be adjusted from time to time relative to the activities on site.

15.12.d.2. A similar process is to be used by the PC when auditing their Contractors on site.

15.12.d.3. Compliance with legislative requirements and the systems provided by the PC to manage the H&S on site will be measured.

15.12.d.4. Full compliance is required. Time limits for corrective actions will be set and must be adhered to.

e) Failure to address findings or non-conformances will be considered a serious offence.

16. OCCUPATIONAL HEALTH

16.12. Communication

a) All H&S communication during the project between the Client and the PC will be done through the Client's agent and be in writing, including the issue and responses to non-conformances and H&S audit results.

b) Failure to address issues timeously will be considered a serious offence.

c) To be done at DEPOT/ OFFICE before getting to premises.

16.13. Care of Workers on Site (Welfare)

a) Clean, safe drinking water.

b) Hand washing facilities to be arrange with facilities.

c) Arrangements made where existing facilities are shared with existing users must be made in writing and placed in the H&S file.

d) Failure to manage specific conditions or address issues timeously will be considered a serious offence.

16.14. Discipline, Alcohol and Substance Abuse

a) All employees (management included) are to follow instructions given in the interest of H&S.

16.14.a.1. Disciplinary action is to be imposed on those who do not follow such instructions or company rules or policies.

b) No person can work or access site if under the influence of alcohol or other substances that could impact on their own or others safety.

16.14.b.1. The PC is to have a drug and alcohol policy available to manage such instances.

c) These requirements are applicable to any employee of any organization providing services on site.

16.14.c.1. Penalties may also be applied by the Client, OHS Agent, Engineer or Principal Agent.

16.15. Compliance with the Rules of Conduct.

- a) The Principal Contractor, Subcontractors and all employees under their control, including any visitor brought onto site must adhere to the Rules of conduct on site, as listed under Section 12.28.
- b) These Rules of Conduct must also be adhered to by any of the following who visit the Site:
 - 16.15.b.1. Electrical & Mechanical Engineering
 - 16.15.b.2. Hospital Management and Staff
 - 16.15.b.3. ECDoH Employees
 - 16.15.b.4. Direct Contractors
 - 16.15.b.5. Trade Representatives
 - 16.15.b.6. Any other visitors to the Site.

16.16. Electrical Equipment

- a) In addition to the requirements of the Electrical Machinery Regulations and the General Machinery Regulations any electrical distribution board used for construction work shall be fitted with suitable earth leakage protection.
- b) Leads must be properly and firmly connected.
- c) Plugs and sockets shall be in good and safe condition.
- d) All electrical apparatus, other than electrical hand tools, shall have a physical "lock out" system which will prevent any operation other than that authorized by a supervisor.
 - 16.16.d.1. A "lock out" sign shall be displayed when the apparatus is not in use.
- e) Method statements and safe work procedures will be required for all work involving electrical apparatus.

17. SAFETY RULES WITH RESPECT TO WORK TO HEALTH CARE FACILITIES

-
- a. All persons on the premises shall obey the ECDoH & facilities' Health and Safety rules, procedures and practices.
 - b. No smoking will be permitted within the buildings or within the buildings under construction.
-

- c. All work shall be carried out within normal working hours except certain essential works which may need to be carried out after hours or over weekends – arrangements for such work to be agreed in advance between the Contractor and Principal Agent.
 - i. Note: That on this contract it is assumed that work will take place 7 days a week including after hours and at night as required.
 - ii. The Contractor is to agree the weekly work schedule in advance with the Client's Agent.
 - d. All workers are to be instructed in and familiarise themselves with the existing emergency and safety procedures and to co-operate in any drills or exercises which might be held by the Hospital.
 - e. Emergency / Firefighting equipment belonging to the premises is not to be interfered with.
 - f. Emergency Exits and Escape Routes, including Temporary Escapes Routes are not to be obstructed.
 - g. No persons shall carry out or initiate an unsafe / unhygienic act or operation whilst on the premises.
 - h. Workers are not to interfere with the duties of the hospital, its staff, patients or visitors.
 - i. The Contractor shall maintain good housekeeping standards in the areas being worked on throughout the duration of the contract.
 - j. All waste / scrap materials are to be removed from the work areas on an on-going basis and should not be allowed to accumulate.
 - k. The Client and facility Management reserves the right to act in any way necessary to ensure the safety and / or security of any persons or equipment on its premises and will not be liable for any costs incurred or loss evoked by such actions.
 - l. The Client and health facility Management reserves the right to search all vehicles entering, leaving or parked on the premises and to inspect any parcel, package, handbag, tog-bag or suitcase.
 - m. The health facility reserves the right to search any person entering or leaving the health facility premises.
 - n. All workers must wear proper identification labels at all times – The Contractor will be asked to remove persons without identification from the premises.
 - o. The Contractor will not be permitted to use any tools or equipment belonging to the health facility.
-

- p. The Contractor is to ensure that noise is kept to a minimum so as not to unduly interfere with the functioning of the adjacent facilities.
- q. The Contractor is to ensure that dust from the works is properly contained so as not to cause problems with the normal functioning of the adjacent facilities.

18. PROJECT SPECIFIC RISKS

18. Risk Associated

- a) Working on the existing facility that will remain in operation throughout the contract period.
- b) The limiting of noise & vibration from maintenance activities.
- c) Keeping the escape routes clear and unobstructed.
- d) Working in confined spaces.
- e) Restricted access for materials and work areas.

18. HEALTH AND SAFETY FILE

18.12. The documentation submitted and approved following the awarding of the contract will be used to form the H&S file.

18.13. The H&S file is required to be laid out in a logical manner, and documentation filed within the file is to be easily accessible.

18.14. The following completed information shall be included (but not be limited to) as part of the index:

- a) The PSHSS;
 - b) The H&S Plan and the approval by Client;
 - c) Appointment by Client;
 - d) Mandatory agreement with Client;
 - e) Notification of construction work;
 - f) A record of all working drawings, calculations and design where applicable;
 - g) Detailed list of Contractors with contact details, appointments, Mandatories etc., H&S specifications issued;
 - h) Record of Competencies (CVs) and appointments;
 - i) Training Records;
 - j) Permits;
 - k) Method statements;
 - l) Risk assessments;
 - m) Safe work procedures;
 - n) Emergency and injury management;
 - o) Safety data sheets
 - p) Medical surveillance records;
 - q) Registers;
-

- r) Records of audits, minutes etc.
- s) Plant lists
- t) Temporary electrical installations
- u) Employee records (who is on site)

19. NON-CONFORMANCES

19.12. Should, at any time, the works, or part of the works, be stopped due to unsafe acts or non-compliance with the Clients or PCs H&S Plan; neither the PC nor any other Contractor shall have a claim for extension of time or any other compensation.

19.13. The following constitute examples of the types of non-conformances that will attract penalties:

Minor: Penalty: R50/count	Medium: Penalty: R500/count and a non-conformance	Severe Penalty: R5000/count, a non-conformance and/or activity stoppage
Non-use of PPE supplied	Toilets not supplied or regularly serviced; lack of drinking water	Contractors working without Health and Safety Plan approval
Non-completion of registers for plant and equipment on site	Contractors not audited	Workers transported in contravention of the OHS plan or legal requirements
Lack of H&S signage at work areas	Working without training or the appropriate, approved H&S method statements	Invalid Letters of Good Standing
Tools and equipment identified in poor condition during inspections	Legal non-conformances identified during the previous audit and not addressed within the agreed time frame	Non-compliance with traffic accommodation requirements: layout or physical conditions
	No monthly OHS report at site meeting to report on	Any serious breach of legal requirements
	No certificates of fitness for workers as required	
	Working without approved method statements	

19.14. Failure to Comply with Provisions

- a) Failure or refusal on the part of the PC or their Contractors to take the necessary steps to ensure the safety of workers and the general public in accordance with these specifications or as required by statutory authorities or ordered by the engineer, shall be sufficient cause for the engineer to apply penalties as follows:

19.14.a.1. A penalty as shown in the Table above shall be deducted for each occurrence of non-compliance with any of the requirements of the PSHSS.

19.14.a.2. In addition, a time-related penalty of R500,00 per hour over and above the fixed penalty may be deducted for non-compliance to rectify any non-conformance within the allowable time after a site instruction to this effect has been given by the Designer.

19.14.a.3. The site instruction shall state the agreed time, which shall be the time in hours for reinstatement of the defects.

19.14.a.4. Should the Contractor fail to adhere to this instruction, the time-related penalty shall be applied from the time the instruction was given.

RESPONSIBILITY	SIGNATURE	DATE
CLIENT'S AGENT SIGNATURE:		
CLIENT SIGNATURE:		

ANNEXURE A

CLOSE OUT REQUIREMENTS

The H&S files for the Principal Contractors and all Contractors require closure and handover to the Client at the completion of the project. The following list is an example of what should be included, but is not exhaustive. The OHS Agent or the Client may require further information at the time of completion and the Principal Contractor is to ensure that all instructions are met. Documentation would include all records from the start of the project. Daily or monthly plant inspection records are not required unless they are related to an accident. All records to be in electronic format and submitted to the OHS agent for approval in adequately formatted lists and folders. Layout should be logical and in the same order as in the site files.

Health and Safety close out file requirements include:

- a) Client H&S Specification
 - b) Principal Contractor's OHS Plan(s)
 - c) Organograms
 - d) Legal Appointments
 - e) List of all employees employed on a permanent or contractual basis over the duration of the contract
 - f) Notification to Department of Labour of commencement of work
 - g) Letters of Good Standing for the Project
 - h) Full files for all Contractors as well as their close out reports
 - List of Contractors
 - All employees employed on a permanent or contractual basis over the duration of the contract
 - Letters of Approval of Contractors
 - Mandatary Agreements
 - Letters of Good Standing
 - Appointments
 - i) Incident Records
 - j) Non- Conformance records
 - k) Agent's Audits
 - l) Method Statements
 - m) Risk assessments
 - n) Safe work procedures
 - o) Medical surveillance certificates of fitness. Medical records are to be kept according to the OH&S Act as amended
 - p) All drawings for temporary structures (suspended beams/scaffolds etc.)
-

- q) All operating manuals for any systems that require on-going maintenance
- r) Copies of test results, policies and procedures for environmental monitoring (silica, noise, dusts etc.)

Defect and Liability Period

The H&S files are to be kept 'live' for the defect and liability period by the Principal Contractor, including those of their Contractors. Any work required during the defect and liability period will require an assessment of the H&S file by the OH&S Agent prior to any work commencing.

A copy of drawing records for the as-built drawings are to be placed on file by the Designers once complete.

ANNEXURE B

NON-CONFORMANCES

HEALTH AND SAFETY SITE INSPECTION NON-CONFORMANCE NO		
AGENT:	PROJECT:	
Consultant:	Date and time:	
Client	Area:	
Contractor:		
ASPECTS NOTED:	COMMENTS:	COMPLETION REQUIRED BY (DATE):
	•	
	•	
	•	
	•	
	•	
PHOTOGRAPHIC EVIDENCE (if available):		
OTHER:		
The following penalties are to be applied:		
Signature of H&S Officer/Site Agent		
Signature: of Client/client's Agent		

(To be submitted by the end of the first week of each month and be available with each audit)

[illegible]

10	GENERAL	

Health and Safety Officer: _____ Signature: _____

Date: _____

Construction Manager: _____ Signature: _____

Date: _____

ANNEXURE D - Risk Assessment (see Excel Sheet)

ANNEXURE E - Guidelines to Health and Safety Bill of Quantities

DESCRIPTION	UNIT	QTY	RATE	AMOUNT	
				R	C
Preparation of principal contractor's site-specific health and safety plan, safety file, risk assessments, fall prevention/protection plan, Annexure 2 notification to Dept of Labour, demolition method statement, other method statements requested to be prepared for safety reasons, permits, amendments to safety plan during course of project, traffic management / accommodation plans, and any other legally required health and safety documentation	Lump sum	Lump sum			
Provision of current workman's compensation cover for employees for the project, and ensuring that contractors appointed have such cover too	Lump sum	Lump sum			
Health and safety management of principal contractor's employees, visitors, and contractors' employees on site.	Lump sum	Lump sum			
Provision of full time Construction Manager for site, provision of Alternate Construction Manager in absence of Construction Manager and provision of sufficient safety supervision on site	Lump sum	Lump sum			
Provision of full time SACPCMP registered Construction Health & Safety Officer for site (refer to safety specification for full time / part time requirement) and preparation of safety reports after each safety inspection	Lump sum	Lump sum			
Competence assessment, appointment and required competence and safety training of all principal contractor's legally required appointments for site	Lump sum	Lump sum			
Maintenance of principal contractor's plant and equipment on site so as to be in safe condition, including inspection registers, inspections by competent persons, thorough examination certificates, hand over certificates and related documentation	Lump sum	monthly			
Provision of general safety signage (e.g., first aid, firefighting, traffic safety, excavations, PPE, Assembly Point, noise zones, etc.)	Lump sum	monthly			
Each Bakkie to have Safety File for Emergency and registers	Lump sum	Lump sum			
DESCRIPTION	UNIT	QTY	RATE	AMOUNT	
				R	C
Provision of medical certificates of fitness for employees on site (Annexure 3)	Lump sum	Lump sum			
Provision of personal protective equipment (PPE) by principal contractor to employees and, as applicable, visitors to site, incl. - reflective vests - hard hats - protective footwear - hearing protection	Lump sum	Lump sum			

• respiratory protection • safety eyewear • gloves • overalls • Safety harnesses and lanyards • Sunblock • UV Protective clothing / hats / eye wear • Protective thermal wear (heat / wind / cold / rain) • Protective firefighting clothing • Arc flash and electrical protective clothing • Spill Kits					
Provision of Fall Prevention and Protection Equipment including. • Rope • Lifelines & Self-Retracting Lifelines (SRL) • Anchor Points • Warning Lines & Area demarcation • Fall Arrest Accessories • Fall Rescue Equipment • Passive Fall Protection Equipment • Confined Space Rescue and Retrieval (In elevated work situations) • Etc.	Lump sum	Lump sum			
Provision of Confined Space work equipment & Training • Training • Air Monitoring Equipment • Ventilation Equipment • Entry Equipment • Personal Protective Equipment • Confined Space Rescue and Retrieval Equipment • Communication Equipment • Etc.	Lump sum	Lump sum			
Holding of safety meetings with safety representatives and safety officers at workshop on at least weekly basis	Lump sum	monthly			

DESCRIPTION	UNIT	QTY	RATE	AMOUNT	
				R	C
Principal contractor construction safety management attendance at health and safety meetings called by client, professional team, or safety agent	Lump sum	monthly			
Provision of site-specific health and safety induction training for all at Workshop / Office	Lump sum	Lump sum			
Conducting of toolbox talks to employees on health and safety issues on a weekly basis at Workshop or office	Lump sum	Lump sum			
Provision of sufficient First Aiders for site as per legal requirements	Lump sum	Lump sum			
Provision of First Aid Boxes per bakkie as per legal requirements	Lump sum	Lump sum			
Provision of sufficient fire extinguishing equipment per bakkie.	Lump sum	Lump sum			
Fire drills on site at least 1-monthly basis for duration of project	Lump sum	Lump sum			
Provision for safe disposal of waste, spill kits, safe housekeeping, and storage practices	Lump sum	Lump sum			
Provision of leading-edge protection, covers to prevent falls	Lump sum	Lump sum			
Compilation of consolidated Safety File at Close Out stage and handover of file to safety agent in hard copy or digital format	Lump sum	Lump sum			
Any other compliance item in site specific safety specification issued by project client/ safety agent with potential cost implication	Lump sum	Lump sum			
• Item 1					
• Item 2					
• Item 3					
• Item 4					
• Item 5					
Principal contractor's general compliance with respect to the Occupational Health and Safety Act, Construction and other health and safety Regulations apart from other provisions in this bill.	Lump sum	Lump sum			
SUMMARY TOTAL OHS COST PROVISION					

Revision Summary	Revised By	Revision Date

Comments:

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

low	med	high
1	4	12
2	6	18
3	8	27

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

					Baseline risk			
Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category

SCOPE AREA OF MAINTENANCE PROGRAMME

	Bakkie / Truck Maintenance Team	Driving on public roads/ Driver not competent or medically and psychologically fit/ under the influence of drugs and/or alcohol/ Pre-start check not completed	Financial loss/ Damage to equipment/ Injuries to employees/ Damage to property/ Possible fatalities	All drivers must be authorised in writing, be in possession of valid Competence and Medical Certificate. All employees shall undergo a mandatory alcohol level test. Driver must perform pre-ignition check and ensure checklist completed before leaving workshop/office. Under no circumstances shall anyone tamper with the safety devices / mechanisms on the machinery. No loading of passenger in Load cab of bakkies. Driver to ensure that bakkie are kept in good state. Maintained as per maintenance schedule. All Occupants in bakkie to ensure seatbelt is engaged at all times.	2	2	2	8
		Storage of Materials and Tools	Injury / Property damage / Theft / Security Issues	Proper separated demarcated storage to be allocated to the contractor. Materials to be stored in demarcated storage bins. At least one fire extinguisher must be made available.	3	3	3	27
		Mechanical failure/ not maintained as per maintenance schedule/ Wear and Tear	Financial loss/ Damage to equipment/ Injuries to employees/ Damage to property/ Possible fatalities	Daily pre-ignition checklist to be completed and any faults found reported to immediate supervisor and/or safety officer. Workshop Manager to ensure that machines are kept in good state. Maintained as per maintenance schedule. Under no circumstances shall anyone tamper, remove or modify any safety devices / mechanisms on the machinery. Maintenance must be performed by Competent Trained Petrol / Diesel Mechanics	2	1	2	4

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
	Pre-inspect generator and PPE before start of work for compliance to own and client specifications. Carry the Equipment, Generator drip tray and fire extinguisher to the required workplace.	Exposed Moving Parts	Contact, been struck with moving parts resulting in injury to employees and bystanders.	Staff to pre-inspect Generator before use and recorded on the inspection register, all deviations to reported and fixed before use. Safety guards are in place and in good working condition.	1	3	2	6
		Heavy Equipment and Material	Employee suffering from muscle strain when picking up the tools or equipment alone or in the wrong manner.	At least 2 employees carry the equipment Employees trained in ergonomics (lifting techniques). Good communication. Equipment has handles (cage) to make handling easy. Employees to use their upper legs to pick up the equipment and not their lower back.	3	2	2	12
		Sharp Object	Injuries to the body when making contact with exposed sharp parts on the generator.	Safety guards are in place and in good working condition. Correct PPE to be used. To make sure that all parts is in place and not loose before picking up.	3	2	2	12
		Spillage (Oil, Fuel, Diesel, Paint)	Soil and water pollution occurs when fuel is spilled when tank is not closed correct or leaks fuel.	Generator in good working order and no leaks present. Generator placed in spill bath to catch any possible spills. Correct fuel cap used and properly closed.	1	2	2	4
		Hot Surface	Employee suffering from burns when making contact with the hot surface of the generator.	Generator only handled when it has cooled enough. Hot surfaces isolated with cage. Correct PPE to be used to make sure that skin wont come into contact with hot surface.	2	2	2	8

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
GMR		Plant and Equipment	Injury / Property damage / Theft / Security Issues	Implement traffic protection measures Trained and competent operators must be used Check plant and vehicles on daily basis before use and record inspections. Maintain vehicles in safe condition. Medical certificates of fitness required for construction plant. Crossing of road by construction vehicles or machines must be limited to the practical minimum Plant and vehicles must be fitted with amber rotating beacons and reverse alarms. Wear appropriate protective clothing/equipment, e.g., goggles, gloves, ear defenders, etc. as appropriate	3	3	3	27
CR22		Mobile Crane Erection and Dismantling and Use	Collapse of structure Overturning of structure Falling materials	Ensure emergency procedures are in place and all operatives are aware of the details Only use trained and competent operators for the erection and dismantling and use of cranes Ensure crane driver is trained and holds certification as proof. Must have valid medical certificate of fitness. Ensure there is safe means of access available at all times Ensure the mobile crane driver has 360° vision if not ensure a fully trained banksman is used Banksman to wear reflector vest to identify himself to the crane driver Ensure all personnel wear suitable and sufficient personal protective equipment Consider creating exclusion areas	2	2	2	8
General		Snakes/Bees/Wasp	Snake bite/ Bee Stings	Qualified first aider required for site who can treat snakebite/ Bee & Wasp Snake bite kit to be on hand Check area before working Find out nearest hospital and get emergency telephone numbers.	1	1	1	1

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
CR14e	DISTRICT – HEALTH FACILITIES	Overhead Services (Working near)	Contact with live services causing injury to personnel Damage caused to services	Maintain safe clearance levels Establish presence of any services via proper walk-through survey of site and/or means of service drawings Wear personal protective clothing Ensure height of plant/vehicles does not compromise or exceed clearance levels for overhead services Obtain information on clearance levels from service provider	1	1	1	1
CR13g		Underground Services	Striking of buried services	Make all necessary enquiries to establish what services are in the area. Consult drawings and advice from service provider (e.g., Municipality or ESKOM) when planning work. Assume all service to be live (Unless confirmation is received to confirm that services are isolated or otherwise made safe). Do not work near live services without authorisation from site management. Comply with the requirements of the safe system of work for underground services. Where available, locate services with a locator Hand dig around services	3	3	3	27

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

low	med	high
1	4	12
2	6	18
3	8	27

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
CR19.3a	MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT	Lifting Operations	Falling material Crushing by materials Hand injuries to the slinger Toppling crane	Check test certificate Check examination certificate Check inspection have been carried out Check certificates for lifting equipment (chains, slings, shackles, etc.) Ensure lifting gear is rated to carry load (SWL) Ensure materials being lifted are properly packaged and slung. Be aware that there should be a minimum clearance of 600mm between any slewing parts of a crane and any fixed installation to prevent being trapped. Access to the work area during lifting operations is to be restricted to those involved with and trained in the work in hand. Do not allow members of the public to gain access to the area. Only trained banksmen to be used. The crane driver and the banksman are to ensure that the signals given are clearly understood.	2	2	2	8
		Painting	Contact with paint	Refer to safety data sheet for usage instructions, hazards and precautions required. When working at height, refer to risk assessment addressing this hazard below.	1	1	2	2
		Plumbing	Falling material Falling from height Fire Burns Exposure to lead fumes	Ensure standard safety procedures are followed at all times Only used trained and competent personnel Ensure there is a safe working area at all times Ensure materials are stored neatly Ensure there is safe access and egress at all times Ensure all personnel wear suitable and sufficient personal protective equipment Consider a hot works permit system prior to commencing any hot works Make sure emergency procedures are in place and ensure all personnel are aware of where to go in case of a fire	1	1	2	2

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

					Baseline risk			
Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
	SCHEDULE MAINTENANCE	Scaffold Erection/ Dismantling	Personnel falling from a height Items of scaffold falling onto personnel Scaffold collapsing onto those below	Ensure scaffold is designed to take the imposed loads scaffolding is constructed properly scaffold is not overloaded scaffolders are fully trained scaffold is regularly checked by competent person and record of inspection retained. Written inspections to be recorded on weekly basis scaffolders must adhere to the safe systems of work. all fall arrest equipment to be checked and certified in good working order that ALL understand the safe system of work	2	2	2	8
		Steel Erection	Falls from height Falling components Contact injuries from falling lifting equipment	Adhere to all general precautions for working at height (See risk assessment below) Barrier off / exclude area below work All lifting appliances to be examined and inspected Inspection register in place and up to date All personnel to be trained and competent and wear clipped on safety harnessed when working at height Ensure that lifting equipment (slings, chains, shackles) test certificates are current and on site. Competent persons only to connect loads and direct plant	2	1	1	2
		Steel Fixing	Back injuries caused by manual handling Eye injuries from tie wire Trips / falls Falling form height	PPE must include safety boots and goggles Manual handling training may be required Care to be taken when working near overhead lines Use only trained personnel Provide safe means of access Maintain and regularly inspect all lifting appliances and equipment Cap starter bars to prevent injuries where feasible Construct scaffold walk ways to cross reinforcing mesh, as required	2	1	1	2

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
CR10		Working and Heights	Fall from heights / tools and equipment falling / struck by	All access equipment is properly constructed (inspections record must be maintained) Only trained personnel construct, dismantle or control the access equipment All access equipment must have full toe boards and guardrails - comply with SANS 10085 on erection, use and dismantling of scaffolding No access equipment may be loaded above the level of the guardrail No access equipment to be loaded above its safe working load Where work involves leaning out on an open leading edge, then all personnel are to be fitted with full body harness. The harness must be connected at all times All fall arrest equipment to be correctly maintained Ensure if ladders are being used for access, they are either footed or tied. Also, the ladder must be set at the correct level of	3	1	1	3
	Starting the generator.	Exposed Live Electrical Wire	Electrical shock when in contact with exposed live wires or generator is not earthed correct.	Generator to be inspected by a qualified electrician. Not used during wet weather. Earth spike in place. Machine used is inspected before use and need to be clean, leak free and serviceable. Fire extinguisher (9kg DCP) available.	3	2	2	12
		Spillage (Oil, Fuel, Diesel, Paint)	Fire / explosion when a heat source from the generator being started makes contact with spilled fuel.	Trained fire fighters. Employees trained in emergency procedures with proof. Fire spotter/watcher present. No combustible material or vegetation placed close to the generator. Snill Kit available to clean spillage	3	1	3	9
		Exposed Moving Parts	Injury to the body when in contact with exposed moving machinery.	Safety guards are in place and in good working condition. Hand placement to be in the correct place.	3	1	3	9

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

too that should be done before tender phase.					Baseline risk			
Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
	Running generator.	Excessive Noise (>85dB)	Excessive noise can cause noise induced hearing loss. Excessive noise in a public place can cause noise pollution.	Employees to use the correct earplugs and to use them in the correct manner.	3	2	1	6
		Hot Surface	Employee suffering from burns when making contact with the hot surface of the generator.	Generator only handled when it has cooled enough. Hot surfaces isolated with cage. Correct PPE to be used to make sure that	3	2	2	12
		Excessive Smoke	Inhalations of excessive smoke resulting in lung damage.	Generator to be serviced as per maintenance plan. Area demarcated using barrier tape. Generator not to be place in a public place.	3	1	3	9
	Refuelling generator.	Excessive Exposure to HCS (>OEL)	Inhalations of HCS can cause lung damage.	MSDS for fuel available and everyone is informed. Correct PPE to be used when refilling the generator.	3	2	1	6
		Spillage (Oil, Fuel, Diesel, Paint)	Soil and water pollution when refilling the generator in the correct manner of overfilling the generator.	Spill bath (bunt wall) inpescted to contain any spillage. Drip tray to be place under each generator(when filling for test)	3	2	1	6
		Spillage (Oil, Fuel, Diesel, Paint)	Fire / explosion when a heat source from the generator being started makes contact with spilled fuel.	Fire extinguisher (9kg DCP) available. Trained fire fighters. Employees trained in emergency procedures with proof. Fire spotter/watcher present. No combustibile material or vegetation placed close to the generator. Only refuel when machine has cooled down. Snill Kit available to clean spillage	3	1	3	9
General Hospital Safety					Baseline risk			
		Access	Injury to person's / employees /personnel/ consultants/patients	Separate general public from early works / construction site. Extra care to be taken to ensure the public and personnel do not gain access to the construction activities as well as early works	2	2	2	8

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
CR 10	General	Exposure noise	Interruptions to existing activities	Control should be taken to ensure to bear in mind exposure to general patient wards. Extra special care and planning and communication between the contractor and Hospital staff where working in close vicinity to consulting rooms A solid hoarding structure to be above 2.5 meters.	2	2	2	8
		Exposure to dust	Interruptions to existing Hospital activities	Control should be taken to ensure to bear in mind exposure to general patient wards. Extra special care and planning and communication between the contractor and Hospital staff where working in close vicinity to consulting rooms. A solid hoarding structure to be above 2.5 meters.	2	2	2	8
		Waste Management	Daily waste from contractor / professionals / specialists cross contaminated with Hospital waste.	Normal waste from all the appointed contractor / professionals / specialists should have separate controlled waste areas. To ensure no cross contamination with the existing Hospital waste management systems	2	2	2	8
GS' 13A		Contact with Biohazardous Waste	contractor / professionals / specialists coming into contact with medical biohazardous waste from the hospital	Controlled medical biohazardous dump area should be completely separated from contractor / professionals / specialists	2	2	2	8
		Barricading / Demarcating / Hoarding	Interaction with existing Hospital activities / personnel and general public	Control should be taken to ensure that construction activities is at all times being separated from day to day Hospital activities / staff / patients / general public as well as Hospital storage facilities. To bear in mind exposure to general patient to sick patients. A solid hoarding structure to be above ceiling height to be considered.	3	3	3	27
GS' 13A		Security	Theft	Contractors and professionals doing construction activities should have own security on site. Contractors to ensure that materials and items of value are stored correctly as this can cause a security risk for the existing Hospital.	1	1	2	2
GS' 13A		Epidemic and Pandemic Control	Contact with Airbourne and infectious diseases.	Control should be taken to ensure that construction activities is at all times being separated from day to day Hospital activities / staff / patients / general public.	1	1	3	3

BASELINE RISK ASSESSMENT SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) - BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES

Risk Rating multiplier: Low = 1; Medium = 2; High = 3

low	med	high
1	4	12
2	6	18
3	8	27

The base line risk assessment is to highlight hazards emanating from project risks identified. During Stage 2 of the project. This is a working document and does not have a mitigate risk rating and controls as this will be finalized in Stage 3 of the project. This document also includes our view of early works which included tests, analysis and surveys but not limited too that should be done before tender phase.

Reference	Area	Hazard	Risks identified as present	Describe the obvious control measures to be part of design	Baseline risk			
					Likely consequences of an incident	Frequency of Exposure	Probability of harm	Risk rating and risk category
GS' 13A		Medicine Access Control	Theft and substance abuse	Control should be taken to ensure that construction activities is at all times being separated from day to day Hospital activities and deliveries and medical storage facilities.	2	3	3	18
GS' 13A		Infection Prevention	Jeopardizing the sterility of the patients environment.	Control should be taken to ensure that construction activities is at all times being separated from day to day Hospital activities / staff / patients.	2	3	3	18
GS' 13A		Fraternization	Harassment of persons on Hospital property.	Extra Control should be taken to ensure that consultants / professionals / specialists / contractors are separated from staff / patients / general public	1	2	3	6



PART C4.3

EASTERN CAPE DEPARTMENT OF HEALTH

SUPPLEMENTARY TECHNICAL SPECIFICATION

FOR THE

GENERAL MAINTENANCE AND REPAIRS

OF

GENERATORS

AT

VARIOUS HOSPITALS AND HEALTH FACILITIES IN

THE

CLUSTER THREE (3) – BUFFALO CITY AND

AMATHOLE DISTRICTS

OF THE EASTERN CAPE PROVINCE

**SUPPLEMENTARY TECHNICAL SPECIFICATION FOR REPAIRS TO
GENERATORS**

Table of Contents

SS1	GENERAL.....	3
SS 2	EQUIPMENT INSTALLATION.....	3
SS 3	SCOPE OF WORK.....	3
SS 4	INSPECTION OF THE SITE.....	4
SS 5.	STATUTORY AND REGULATORY REQUIREMENTS.....	5
SS 6.	GENERAL REQUIREMENTS FOR REPAIR AND MAINTENANCE CONTRACTS	5
SS 7	ROUTINE SERVICING AND MAINTENANCE WORK.....	4
SS 8.	TRAINING OF THE DEPARTMENT'S MAINTENANCE STAFF	4
SS 9.	TRAINING OF DEPARTMENTS OPERATING STAFF	6
SS 10.	COMPETENT PERSON ON SITE.....	8
SS 11.	CLASSIFICATION OF BREAKDOWNS	8
SS 12.	PENALTIES.....	8
SS 13.	SPECIAL SAFETY, HEALTH, ENVIRONMENTAL AND QUALITY REQUIREMENTS.....	Error! Bookmark not defined.
SS 14.	SPECIAL TOOLING REQUIREMENTS.....	9

SUPPLEMENTARY TECHNICAL SPECIFICATION FOR THE GENERAL MAINTENANCE AND REPAIRS OF GENERATORS

SS 1. GENERAL

This specification is for the repair and fixed term maintenance of Generators installations at various hospitals and health facilities listed in paragraph SS 3. of the CLUSTER THREE (3) – BUFFALO CITY AND AMATHOLE DISTRICTS.

This specification shall be read in conjunction with the Service Information which will include the Standard Specifications for the General Maintenance and Repairs to Electrical and Mechanical Installations, Standard Technical Specifications that may be applicable, the Supplementary Specification, the Operating and Maintenance Manuals (where applicable) and the Maintenance Control Plan, as well as the, General Conditions of Tender and all Schedules and Drawings forming part of the Tender.

Where specifications and/or drawings are at variance this Supplementary Specification will have preference over both the Standard Specifications and the Drawings.

Maintenance and servicing shall be carried out strictly as stated in the service schedules and after each service a copy of the service schedule duly completed and signed shall be submitted to the responsible Service Manager.

SS 2. EQUIPMENT INSTALLATIONS

The following equipment installations shall be maintained and repaired as part of this contract:

1. Generator engine and associated equipment;

SS 3. SCOPE OF WORK

This specification is for the repair, maintenance and proper functioning of Generators, for the duration of the Contract period, in the following Health facilities:

BUFFALO CITY DISTRICT

Item no.	FACILITY	No.of Units
1	BHISHO FORENSIC LABORATORY	1
2	BHISHO HOSPITAL	2
3	CECILIA MAKHIWANE HOSPITAL	5
4	DIMBAZA HOSPITAL	1
5	DUNCAN VILLAGE CHC	1
6	EMPILWENI GOMPO CHC	1
8	EMS VINCENT	1
11	FRERE HOSPITAL	8

12	GREY HOSPITAL	1
13	MDANTSANE FORENSIC MORTUARY	1
15	MOUNT COKE CHC	1
16	NEW HAVEN	1

AMATHOLE DISTRICT

Item no.	FACILITY	No.of Units
1	ADELAIDE HOSPITAL	1
2	BEDFORD HOSPITAL	1
3	BUTTERWORTH HOSPITAL	4
4	CATHCART HOSPITAL	1
5	IDUTYWA CHC	1
7	XHORA CHC	1
8	FORT BEAUFORT HOSPITAL	1
9	KOMGA HOSPITAL	1
10	MADWALENI HOSPITAL	3
11	MIDDLEDRIFT CHC	1
12	NOMPUMELELO HOSPITAL	2
13	NQAMAKWE CHC	1
14	S.S GIDA HOSPITAL	2
15	STUTERRHEIM HOSPITAL	2
16	TAFALOFEFE HOSPITAL	1
17	TOWER HOSPITAL	3
18	VICTORIA HOSPITAL	3
19	WILLOWVALE CHC	2
20	WINTERBURG TB HOSPITAL	1
21	ADELAIDE MORTUARY	0
22	BUTTERWORTH MORTUARY	1
23	CENTANI MORTUARY	0

Details of the work required shall be as listed in the Price Lists which have been sub-divided into the following categories:

SCHEDULE 1: FIXED CHARGE AND VALUE RELATED ITEMS APPLICABLE TO ALL WORK

SCHEDULE 2: FUNCTIONAL REPAIR SCHEDULE

SCHEDULE 3: MAINTENANCE SERVICE SCHEDULE

SCHEDULE 4: TERM REPAIRS SUBJECT TO APPROVAL OF QUOTATION FOR THE WORKS

SCHEDULE 5: ROAMING GENERATOR AND HIRE GENERATOR

Note: The repair work included in Schedules 1 to 4 has been subdivided for each health facility where applicable.

The repair and maintenance phases shall run in parallel as specified in GM 2.4. The equipment to be repaired and maintained is listed under the Inventories of Equipment in Annexure A.

The maintenance work (Minor and Major Services) required on the equipment listed in the Inventory of the attached Annexure A, will be as per the pricing of the Schedule 2 Price List, but subject to the scheduling of the final Maintenance Control Plan as per paragraph GM 3.3. All work must comply to the minimum requirements set by the Standard Specifications for the General Maintenance and Repairs to Electrical and Mechanical Installations, and this Supplementary Technical Specification for the Generator installations

The repair work will be as per the Schedule 3 Price List, but subject to work being approved from the Repair Schedule as per GM 2.6. Due to limited funds and as specified in paragraph GM 2.8, some of the repair work may be stretched over two or more financial years. The repair work for the first financial year will commence only after the Repair Schedule has been accepted and the relevant repairs approved by the Service Manager. The Contractor will be issued with a written instruction (Task Order as per GM 2.4) to proceed with the specified work.

SS 4. INSPECTION OF THE SITE

Due to the large number of and area over which the Health Facilities covered by this Contract is spread, it is the Contractor's own choice if he/she wants to inspect the sites prior to tendering to ascertain the condition of the equipment, or rely solely on the information provided as part of the Tender Documentation and single site tender briefing meeting. No further claims due to non-compliance with this requirement shall be entertained.

SS 5. STATUTORY AND REGULATORY REQUIREMENTS

The latest edition, including all amendments up to the date of tender, of the specifications, publications and codes of practice listed in the Standard Specification for Generator Installations shall be read in conjunction with this specification and shall be deemed to form part thereof.

All equipment that is subject to regular statutory inspections shall be prepared for statutory inspections and tests only when the validity of the existing certificates has expired. This work will form part of the maintenance phase of the contract.

SS 6. GENERAL REQUIREMENTS FOR REPAIR AND MAINTENANCE CONTRACTS

Whenever reference is made in the specifications to repairs and/or repair phase it shall mean the repairs required to the installation to bring the installation up to a standard, as described in the Standard Specifications for the General Maintenance and Repairs to Electrical and Mechanical Installations. In general, the repair work shall commence only after the Functional Condition Assessment Report has been approved and the quantities verified.

Maintenance work must be completed according to the approved Maintenance Control Plan. (See GM 3.3). Repair work can only commence once the Service Manager has approved it (See GM 2.8), or a breakdown Task Order has been issued by the Call Centre. Critical repairs may be carried out immediately with the approval of the Service Manager, but will be priced as per the guidelines of GM 2.8

SS 7. ROUTINE SERVICING AND MAINTENANCE WORK

Maintenance of the Generators may include, but is not limited to inspect, service and/or replace the following:

1. Service genset
2. Diesel engine servicing
3. Check and replace starter battery
4. Change-over service
5. Supply diesel fuel
6. Temperature Gauges
7. Check fuel, water and Oil Gauges
8. Check oil and water level including refilling
9. Provide maintenance tools and schedule of consumable spares
10. Trouble shooting diagram for the plantroom and Service Manager
11. Test system earthing resistance using appropriate tools
12. Recommend service intervals
13. Supply water fuel separator
14. Dummy load test
15. Provide Test results
16. Training of Department's staff
17. Housekeeping

SS 8. TRAINING OF THE DEPARTMENT'S MAINTENANCE STAFF

It is required of this contract that the Contractor arrange for the theoretical and practical training of at least three maintenance personnel employed by the Department at each Health Facility specified in the Supplementary Specification. The Contractor shall ensure that the training is carried out by persons well qualified for the various tasks and shall call upon the services of experts from the various component manufacturers for assistance if need be.

The Contractor shall ensure that his own maintenance personnel are sufficiently qualified for the duties required.

Maintenance staff must receive enough instructions to ensure that they are fully conversant with the equipment concerned, and so that they can understand what the impact of their actions (or lack thereof) will be on the equipment. This training of the Health Facility's Employees shall be for a minimum duration of 40 hours, which shall include, but not necessarily be limited to, instruction on the operation and maintenance of the following items:

1. Service genset
2. Diesel engine servicing

3. Check and replace starter battery
4. Change-over service
5. Supply diesel fuel
6. Temperature Gauges
7. Check fuel, water and Oil Gauges
8. Check oil and water level including refilling
9. Provide maintenance tools and schedule of consumable spares
10. Trouble shooting diagram for the plantroom and Service Manager
11. Test system earthing resistance using appropriate tools
12. Recommend service intervals
13. Supply water fuel separator
14. Dummy load test
15. Provide Test results
16. Training of Department's staff
17. Housekeeping

The training should be aligned to the general tasks contained in the Inspection and Servicing Guideline for the Generator Installations and Operation and Maintenance Manuals.

SS 9. TRAINING OF DEPARTMENTS OPERATING STAFF

The Contractor shall be responsible for the training of the Department's operating staff after the maintenance and/or repairs has been completed. Operating staff must receive enough instructions to ensure that they are fully conversant with the equipment concerned, and so that they can understand what the impact of their actions (or lack thereof) will be on the equipment. Operating staff shall be instructed on:

1. The general operating method of the generator;
2. Starting and stopping instructions;
3. Stopping the generator in emergency and warning against restarting after an emergency unless a competent person is present;
4. Positions and normal settings of control equipment;
5. Normal operating temperatures, etc.;
6. Normal fuel, oil and water levels, etc.;
7. Operational checks on running amperages, etc.;
8. Name, address and telephone number of the competent person responsible for the maintenance of the unit/s.
9. Statutory Log Book (Update maintenance and service records into Log Book)

The operating and maintenance manual must be available during the training of operating staff. Operating staff must also be made conversant with the contents of the manual.

SS 10. COMPETENT PERSON ON SITE

It is not a condition of contract that a Competent Person must be full time on site. Payment reductions will however be imposed if repairs are not carried out within the time limitations specified in Paragraph GM 7. Tenderers are therefore advised to evaluate the additional expense required for a competent person on site to ensure quick response against the possibilities of payment reductions, before submitting a tender.

SS 11. CLASSIFICATION OF BREAKDOWNS

The classification of breakdowns specific to Generators shall be as follows in line with the requirements of GM 7:

PRIORITY	DESCRIPTION	RESPONSE
P1	Emergency (Life Threatening)	Immediate response from the time of logging a call and the emergency to be resolved (at least temporarily) within 8 hours
P2	Urgent	Immediate response from the time of logging a call and to be resolved within 12 hours
P3	Planned Maintenance Repairs	Scheduled Maintenance is to be scheduled and performed within 3 business days of the scheduled date
P4	Emergency Facility Repairs	7 Days planning and execution subject to supply chain regulations

SS 12. PENALTIES

Penalties applicable to this specification will be as per the criteria specified in Section X17 of the Secondary Options Clauses of the Contract.

PART C4: SITE INFORMATION

C4.1: SITE INFORMATION

PROJECT NAME	SCHEDULE MAINTENANCE OF GENERATORS AT CLUSTER THREE (3) – BUFFALO CITY AND AMATHOLE DISTRICT – HEALTH FACILITIES
TENDER No.	SCMU3-23/24-0491-HO

C4 Site Information

1. GENERAL

- a) The Standard for Uniformity in Construction Procurement published in terms of the Construction Industry Development Board (CIDB) Act, 2000 (Act no 38 of 2000), the Standardized Construction Procurement Documents for Engineering and Construction Works as issued by the CIDB and any other relevant documentation pertaining thereto must be studied and all principles in this regard must be applied to all procurement documentation, practices and procedures.
- b) The Supplier must acquaint themselves fully with all matters pertaining to this section in order to enable prospective Suppliers to price for all eventualities.
- c) All hospitals are functional, caution must be taken in terms of contractor movement and noise.
- d) The employer will advise will confirm where the stripped materials need to be disposed.

2. LIST OF FACILITIES

BUFFALO CITY DISTRICT

Item no.	FACILITY	No.of Units
1	BHISHO FORENSIC LABORATORY	1
2	BHISHO HOSPITAL	2
3	CECILIA MAKHIWANE HOSPITAL	5
4	DIMBAZA HOSPITAL	1
5	DUNCAN VILLAGE CHC	1
6	EMPILWENI GOMPO CHC	1
8	EMS VINCENT	1
11	FRERE HOSPITAL	8
12	GREY HOSPITAL	1
13	MDANTSANE FORENSIC MORTUARY	1
15	MOUNT COKE CHC	1
16	NEW HAVEN	1

AMATHOLE DISTRICT

Item no.	FACILITY	No.of Units
1	ADELAIDE HOSPITAL	1
2	BEDFORD HOSPITAL	1
3	BUTTERWORTH HOSPITAL	4
4	CATHCART HOSPITAL	1
5	IDUTYWA CHC	1
7	XHORA CHC	1
8	FORT BEAUFORT HOSPITAL	1
9	KOMGA HOSPITAL	1
10	MADWALENI HOSPITAL	3
11	MIDDLEDRIFT CHC	1
12	NOMPUMELELO HOSPITAL	2
13	NQAMAKWE CHC	1
14	S.S GIDA HOSPITAL	2
15	STUTTERRHEIM HOSPITAL	2
16	TAFALOFFE HOSPITAL	1
17	TOWER HOSPITAL	3
18	VICTORIA HOSPITAL	3
19	WILLOWVALE CHC	2
20	WINTERBURG TB HOSPITAL	1
21	ADELAIDE MORTUARY	0
22	BUTTERWORTH MORTUARY	1
23	CENTANI MORTUARY	0



STANDBY GENERATOR MONTHLY/QUARTERLY INSPECTIONS

Note:

Due to current load shedding, service provided will conduct inspections monthly. This may change back to quarterly (every 3 months) with the improved electricity supply. The change shall be communicated to the contractor in time.

One/Three Monthly inspections must be conducted by the service provider.

One/Three Monthly inspections will include weekly inspection tasks.

Results and findings must be entered in the generator log book and signed by the relevant operator/maintainer.

The tasks listed is for a generic service regime. Where this Task List included below does not include manufacturer's servicing specifications, the Original Equipment Manufacturer's servicing specifications must be added, as all services are to be carried out in accordance with the manufacture's specification.

Step	Service/Inspection Step Description	Task Done?	Value / Reading	Comments/Findings
1	Check connection of battery terminals and clean if necessary			
2	Check electrolyte level in battery and top up if required. Do SG test. Replace battery if SG readings are out of specification			
3	Check battery charge voltage and adjust to specification			
4	Check battery charge rate and perform voltage drop test to determine condition of batteries			
5	Check engine oil and top up if necessary			
6	Check jacket water heater and condition of hoses			
7	Check level and add cooling system coolant to radiator if required			
8	Check for cooling system leaks and damage to radiator			
9	Visual inspection for oil, fuel and water leaks			
10	Check for any loose components, fittings or attachments			
11	Check and clean air filter if needed. Ensure seals are sealing correctly after refitting filter			
12	Check fan belt and alternator belt tension and adjust if required			



Step	Service/Inspection Step Description	Task Done?	Value / Reading	Comments/Findings
13	Check primary fuel filter and clean if necessary			
14	Drain water separator if fitted			
15	Draw fuel sample for contamination analysis from both bulk and day tanks			
16	Test automatic fuel make up system (if equipped)			
17	Lubricate all moving parts if required			
18	Check and verify operation of all instrumentation			
19	Check and record running hours on running hour meter for the generator set and see if it needs an oil change service			
20	Do a visual inspection of all contactors and electrical equipment in the changeover panel			
21	Service and check LV circuit breakers on changeover panel			
22	Clean the inside of the changeover panel			
23	Check condition of electrical and control cabling going to and from the generator. Rectify if needed			
24	Inspect and clean generator control panel			
25	Check and inspect the status of the Lovato (or similar) electronic controller			
26	Inspect earthing of the generator unit			
27	Set unit to "test" position and conduct test run for 30 minutes under available load and check and/or adjust the following: Upon start-up in test position: -Start cut out function -Generator output voltage and stability -Generator output frequency and stability			
28	Check load consumption of unit			
29	Fail the mains supply and see if Generator start automatically and run generator for at least 30 minutes if it started automatically. If not started, resolve problem and redo test.			
30	Record operation of the start-up delay timer. (<20 seconds). Record findings			



STANDBY GENERATOR BI-ANNUALLY LUBRICATION SERVICE INSPECTION

Note:

Bi-annual (every 6 months) services must be conducted by the Service Provider, and must include all task specified by the OEM for the equipment.

If the Generator ran low hours since the last service (i.e less than 120 hours) this service can be delayed, but the service interval between lubrication services must not exceed 12 months. Ideally this service should take place about every 250 operating hours. Results and findings must be entered in the generator log book and signed by the relevant operator/maintainer.

The tasks listed is for a generic service regime. Where this Task List included below does not include manufacturer's servicing specifications, the Original Equipment Manufacturer's servicing specifications must be added, as all services are to be carried out in accordance with the manufacture's specification.

Step	Service/Inspection Step Description	Task Done?	Value / Reading	Comments/Findings
1	Check status of control panel and make sure engine is isolated (Blocked). and remove main battery leads from starter batteries			
2	Inspect radiator fins and straighten if required			
3	Check cooling system for signs of leaks. Repair if needed.			
4	Drain cooling system and check for signs of oil in the coolant. Refill radiator with new engine coolant mix			
5	Perform Radiator Pressure test. Inspect for leaks on both the radiator & hoses.			
6	Drain engine oil and check for signs of water contamination in the oil. If in doubt take a sample for analysis.			
7	Inspect magnetic oil sump plug for metal particles before refitting it with a new copper O-ring seal.			
8	Change oil filter			
9	Refill engine oil			
10	Inspect air filter element / replace if needed. Ensure that filter seals properly after fitment.			
11	Change oil in Air filter if it is the wet type air filter			



Step	Service/Inspection Step Description	Task Done?	Value / Reading	Comments/Findings
12	Check V-belt condition and tension. Replace if needed			
13	Check all V-belt pulleys			
14	Check starter motor and fuel solenoid physical condition and operation			
15	Change fuel and water separator filters and drain any water that might be in the system			
16	Check fuel transfer pump			
17	Replace fuel filters			
18	Drain and refill governor oil			
19	Visually inspect all links and moving parts for operation			
20	Check engine / alternator coupling if accessible without separating the generator from the alternator			
21	Check anti vibration mountings on the plant, engine panel and control panel			
22	Inspect turbo if fitted. Service if needed			
23	Inspect exhaust system. Repair if needed			
24	Check complete generator set for any loose bolts, etc.			
25	Check Generator electrical and control cables.			
26	Check generator auxiliary equipment such as enclosure ventilation fans, etc.			
27	Service generator control panel			
28	Check instrumentation			
29	Simulate low oil pressure alarm for continuity			
30	Simulate high temperature alarm			
31	Simulate coolant flow alarm.(cooling towers)			
32	Simulate fan failure alarm.(cooling towers)			
33	Check emergency stop alarm			
34	Check start failure alarm			
35	Check low fuel alarm			



Step	Service/Inspection Step Description	Task Done?	Value / Reading	Comments/Findings
36	Inspect all AC cabling and wiring for bad connections and or physical damage			
37	Visual check all fuses			
38	Take a sample of the diesel in the bulk tank and have analysed			
39	Perform a maintenance test run to verify that everything is Ok after the work were done on the generator set.			
40	Inspect for abnormal audible noise and vibration, etc. correct if needed.			
41	Record all deviations found in the logbook and on the work sheet by the specialist service provider			
42	Perform normal monthly auto start test and record the data as required.			
43	Ensure that all relevant selectors and breakers are in the correct position (i.e AUTO)			
44	Clean generator enclosure or plant room before leaving.			
45				
46				
47				