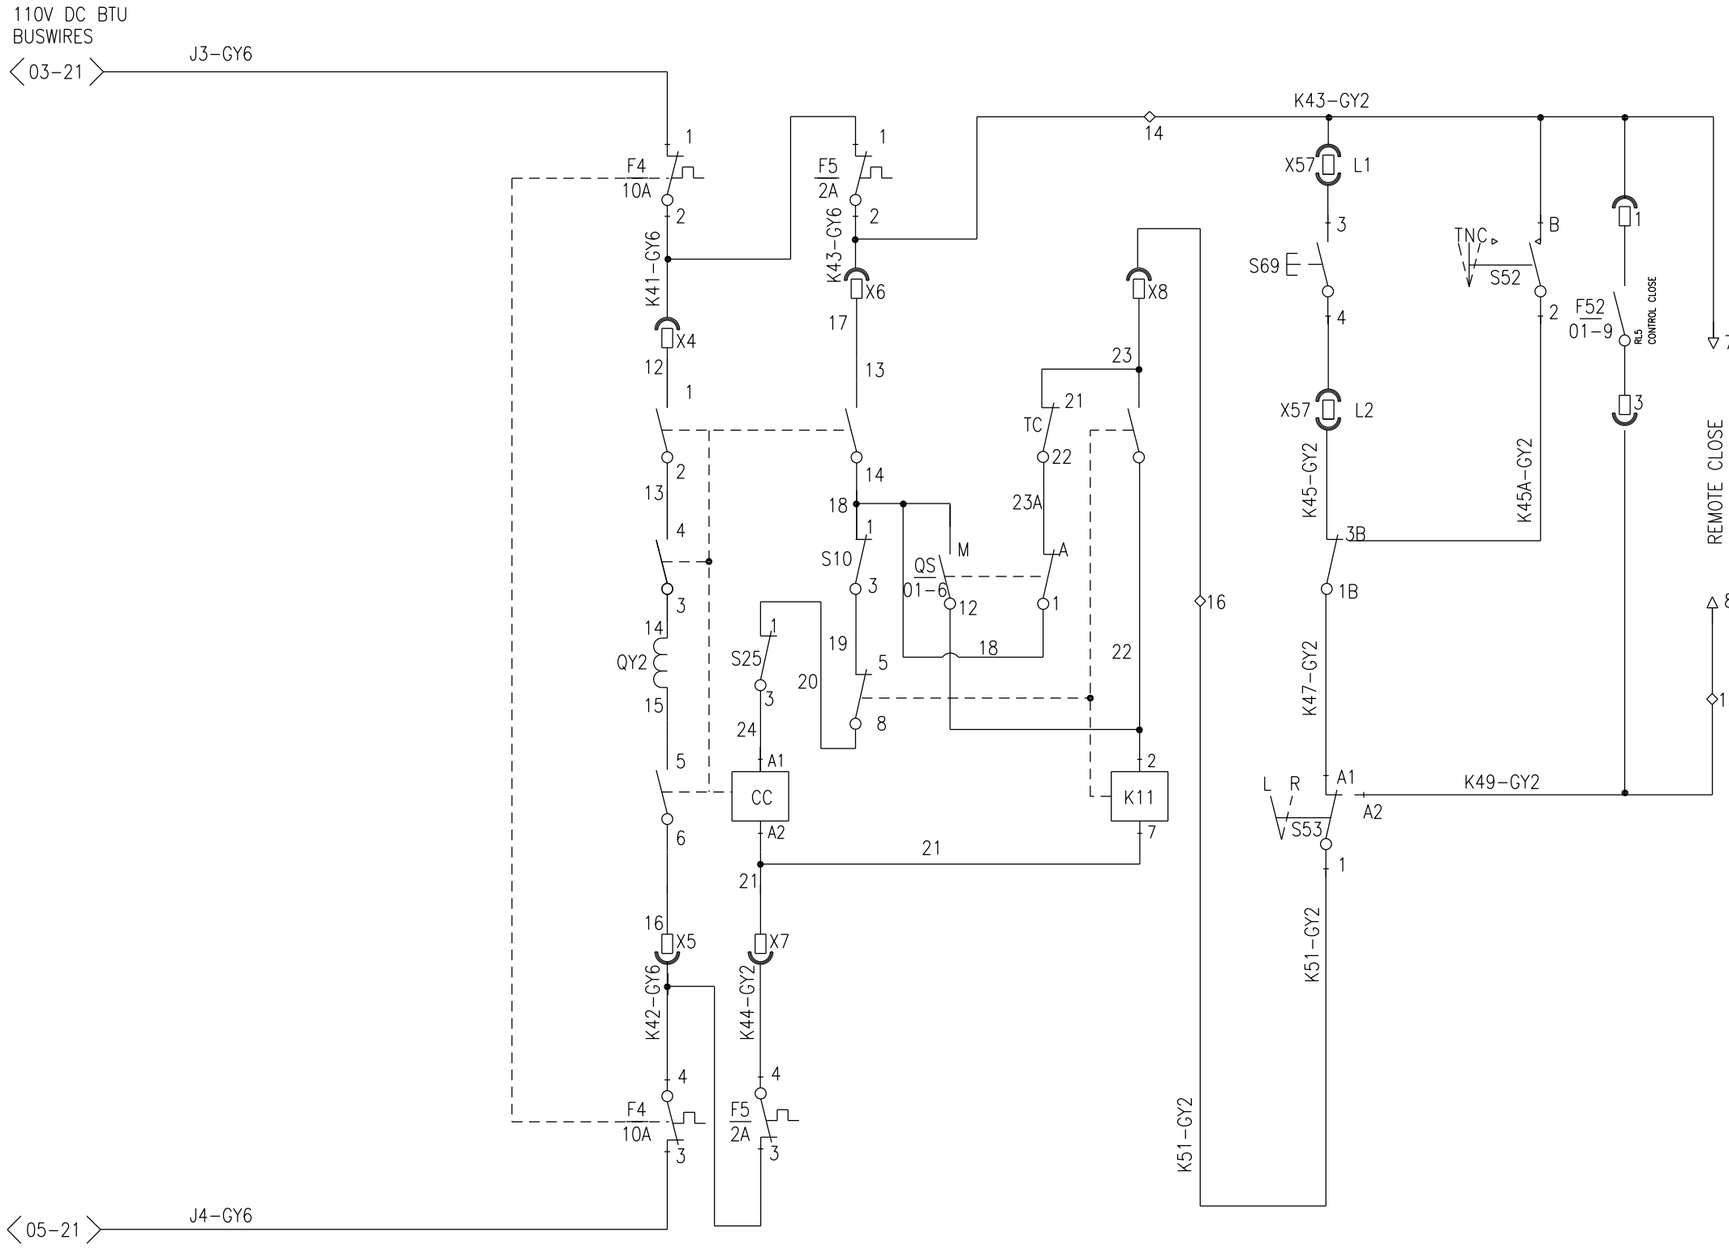


CLOSING CIRCUIT				CLOSING CONTROL CIRCUIT	
QY2-110V DC TRIPPING COIL	CC-110V DC CLOSING COIL CONTACTOR	S69-SAFETY CLOSE P/BUTTON	S2-CARRIAGE RACKING SWITCH	S10-RACKING INTERLOCK MICRO SWITCH	X57-STAND OFF TRIP/CLOSES SOCKET
S52-TRIP /NEUTRAL /CLOSE CONTROL SWITCH	S53-LOCAL/REMOTE SELECTOR SWITCH	S25-MANUAL TRIP CUTOUT MICRO SWITCH	F52- O/C + E/F PROTECTION RELAY		

CLIENT: TRANSNET national ports authority

Client Name:

Designation & Section: ELECTRICAL ENGINEER: PORT ENGINEERING

Client Signature: Project Phase: 0

Date:

Contact No.'s:

No.	DATE	REVISION DETAIL
00	11-12-2020	ORIGINAL
01	27-11-2022	APPROVED FOR CONSTRUCTION (AFC)

Main Contractor:

Stateway Switchboards (Pty) Ltd.

55 Second Road, Linbro Park Sandton | P.O. Box 1055 Linbro Park 2065 | TEL. +27(0) 11 021 7260 FAX. +27(0) 86 503 2258

Main Contractor: STATEWAY SWITCHBOARDS (PTY.) LTD.

ZML Africa Drawing No.: TNPA/2020

Consultant:

Z.M.L Africa Group
Engineering Africa Forward

Site Address:
Sturrock Dry Dock, Cape Town

Building Name:
Combined Pumphouse and Graving Dock Substation

Project Description:
Sturrock Dry Dock Electrical Infrastructure Upgrades: - Sketch Plan

Drawing Description:
Medium Voltage Schematic Diagram-3,3kV Buscoupler

Drawn:	P.MAZIBUKO	Date:	29 / 07 / 2021
Designer/ Checked:	M.SHEZI	Scale:	AS SHOWN
Approved:	M.SHEZI	Drawing Size:	A3
Prof Reg. No.	20110108	Revision No:	01
Signature:		27/11/2022	

Drawing Number: TNPA/2020-000-E-MSCH-0001

Site & Building No.	Floor No.	Discipline & Service Type

Sheet Number	Project Number	Proposal No
004		000