


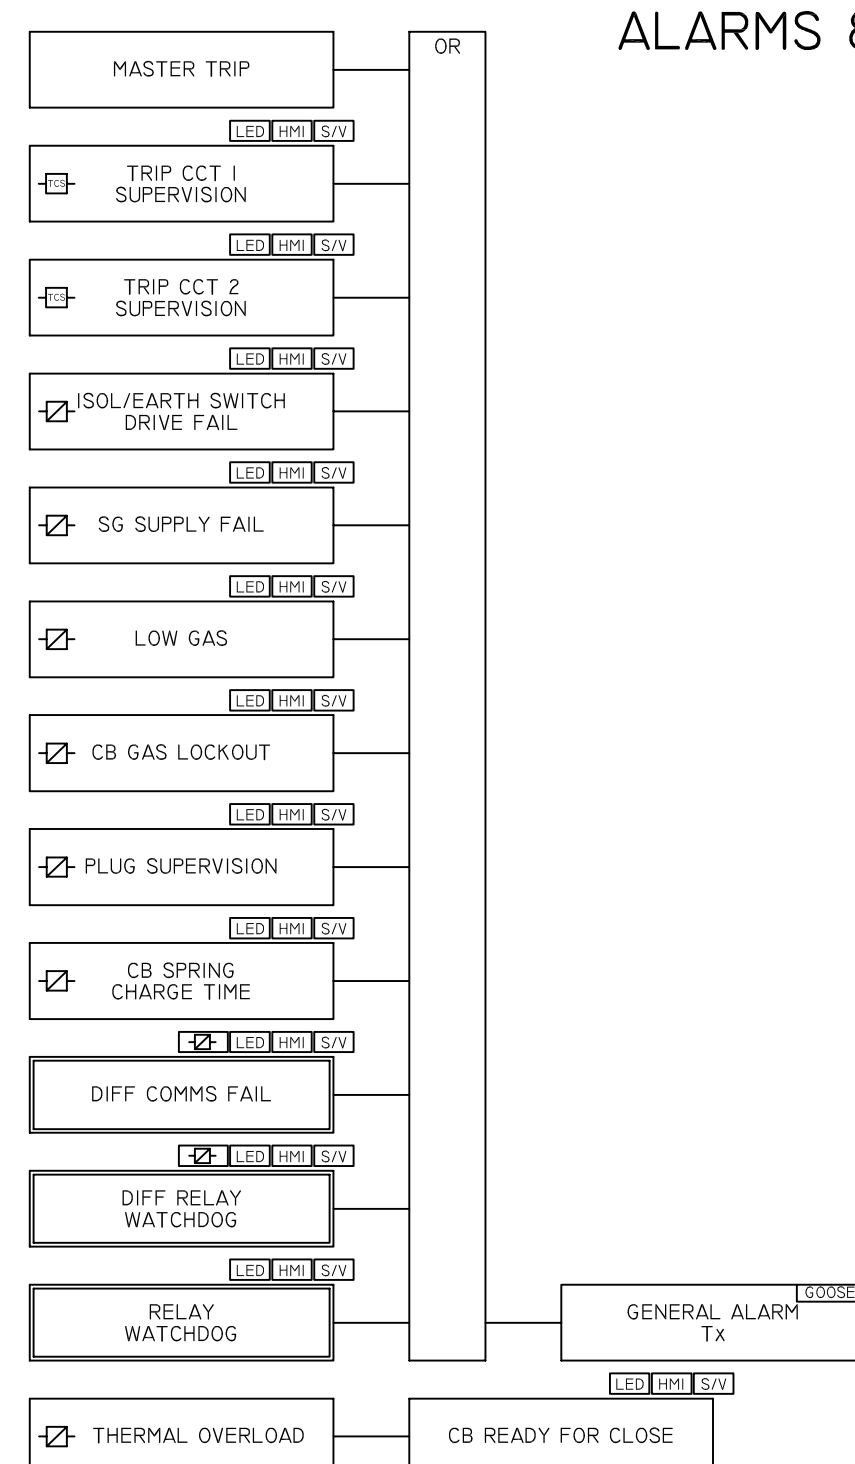






GENERAL ALARM
Tx



INTERLOCKING



DIGITAL VARIABLE

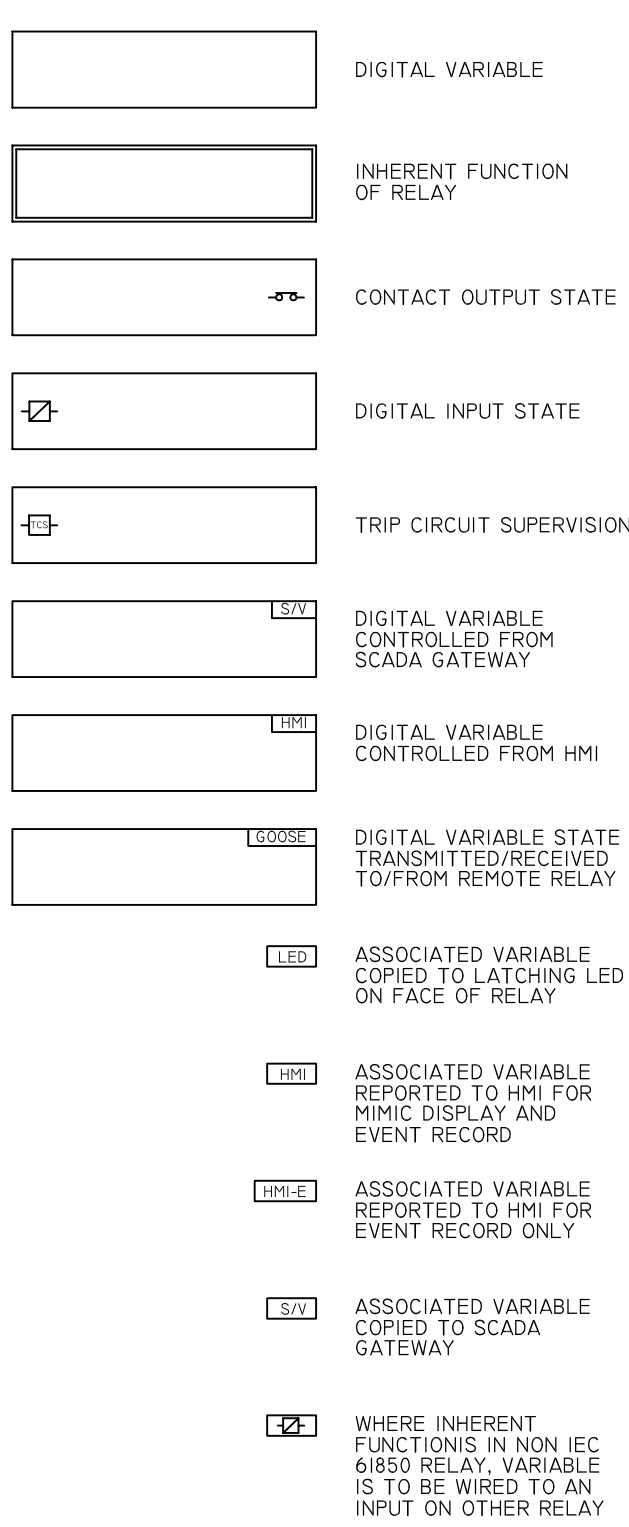

NOTE:
THE PURPOSE OF THIS DRAWING IS TO CLARIFY THE REQUIREMENTS OF THE ASSOCIATED CONTRACT ENQUIRY SPECIFICATION AND THE ISSUE OF THIS WITH THE SPECIFICATION DOES NOT ABSOLVE THE SUCCESSFUL CONTRACTOR FROM HIS NORMAL RESPONSIBILITY TO PROVIDE A SATISFACTORY SCHEME OR SUBMIT DRAWINGS OF SYSTEMS PROPOSED FOR APPROVAL BY THE ENGINEER.

DRAWN	A.J.R.W.						
DATE	25.03.2009			ADDED THERMAL OVERLOAD PROTECTION	HL	02/10/2004	
CHIEF DRAUGHTSPERSON		REFERENCE DRAWINGS:		REVISIONS:	BY:	DATE:	
PLANNING OFFICER		THE EKHWINI ELECTRICITY					
PROTECTION ENGINEER		PROPOSED 132/11kV SUBSTATION WITH 132kV GIS					
PLANNING ENGINEER		PROTECTION & CONTROL LOGIC FOR 132kV FEEDER					
PROJECTS ENGINEER							
PLAN PROJ. MANAGER							
APPROVED R. KHOZAMAND DEPUTY HEAD- H.V. OPERATIONS		SCALE:	DRAWING NUMBER:			REV:	
		NTS	TD 63			1	